



SCDF

The Life Saving Force

... for a safer Singapore



TECHNICAL REQUIREMENTS FOR STOREY SHELTERS 2021

SINGAPORE CIVIL DEFENCE FORCE

Contents

Chapter 1 - Introduction

- Clause 1.1 General
- Clause 1.2 Peacetime Use
- Clause 1.3 Abbreviations
- Clause 1.4 Definitions

Chapter 2 - Architectural Requirements

- Clause 2.1 SS or NS Form
- Clause 2.2 Size of SS
- Clause 2.3 Wall And Slab Thickness of Thickness Of SS And NS
- Clause 2.4 Location of SS
- Clause 2.5 SS Door
- Clause 2.6 Fixtures in SS
- Clause 2.7 NS in SS Tower
- Clause 2.8 Finishes in SS
- Clause 2.9 Exit Staircase
- Clause 2.10 Door Recess
- Clause 2.11 Design Requirements of SS
- Clause 2.12 Design Requirements Of S/C SS and Scissor S/C SS

Chapter 3 - Structural Requirements

- Clause 3.1 General
- Clause 3.2 Materials
- Clause 3.3 Analysis
- Clause 3.4 Member Dimensions and Reinforcement Requirements
- Clause 3.5 Detailing of SS Tower
- Clause 3.6 Penetration Of Services

Chapter 4 - Ventilation Sleeves

- Clause 4.1 General
- Clause 4.2 Position
- Clause 4.3 Accessibility Of Ventilation Sleeves
- Clause 4.4 Fragmentation Plate

Chapter 5 - SS Door

- Clause 5.1 General
- Clause 5.2 Approved SS Door
- Clause 5.3 Removable Door KERB - Applicable for S/C SS and Scissor S/C SS only
- Clause 5.4 SS Door Notice
- Clause 5.5 Specifications of SS Door Notice

Chapter 6 - Construction and Commissioning

- Clause 6.1 General
- Clause 6.2 Structural Works
- Clause 6.3 SS Door
- Clause 6.4 Peacetime Requirement of Ventilation Sleeves
- Clause 6.5 Commissioning Requirements

Chapter 7 - Permitted And Not Permitted Works in SS Tower

- Clause 7.1 General
- Clause 7.2 Permitted and Not Permitted Works

Chapter 8 - Regulated Shelter Products

Clause 8.1 General
Clause 8.2 Definitions
Clause 8.3 Accreditation and Certification
Clause 8.4 Serial Labels
Clause 8.5 Requirements and Responsibilities for Qualified Persons

CLAUSE 1.1 GENERAL

A storey shelter (SS) is designed and constructed for the protection of people against weapon effects during a war emergency. People should not stay inside there for protection during other peacetime emergency situations such as a fire in a building. The SS is located at a common property area of a storey and serves the residents of the dwelling units of that storey.

CLAUSE 1.2 PEACETIME USE

During peacetime, the SS may be used as a common facility for the residents of the storey. Where the staircase or scissor-staircase doubles up as a SS, it is used as a fire exit staircase. The other statutory requirements governing the design and use of the SS space for the specific peacetime use shall also be complied with.

1.3 ABBREVIATIONS

Clause	Description	Abbreviations
1.1	Storey Shelter	SS
2.1	Non-Shelter	NS
2.1	Staircase Storey Shelter	S/C SS
2.2.1	Finished Floor Level	FFL
2.2.1	Grass Floor Area	GFA

CLAUSE 1.4 DEFINITIONS

Clause	Description	Abbreviations
2.1	The space in the SS tower that is not intended for use as a shelter.	Non-Shelter
2.1	Building exit staircase used as SS	S/C SS
2.2.2 (a)	Height of SS measured from its FFL to the soffit of the SS ceiling slab.	SS Clear Height
2.2.2 (a)	Height of NS measured from its FFL to the soffit of the NS ceiling slab.	NS Clear Height
2.3.1	Setback to be protected by slab/trellis at ceiling level and distance to be measured horizontally from external face of SS wall.	Setback Distance
2.3.2 (a)	The SS located below the top-most roof level	Top-most SS

Amendment History - Chapter 1 - Introduction

Clause No.	Amendment Date	Effective Date	Clause Status	Clause Before Amendment	Circular Date
------------	----------------	----------------	---------------	-------------------------	---------------

CLAUSE 2.1 SS OR NS FORM

The configuration of a SS or Non-Shelter (NS) on plan shall be rectangular or square shape. In the case of a staircase storey shelter (S/C SS) and scissor S/C SS, there can be slight deviations from the rectangular or square shape.

CLAUSE 2.2 SIZE OF SS

2.2.1 Area and Volume

a. The minimum internal floor area and minimum internal volume of a SS or S/C SS shall be based on gross floor area (GFA) of dwelling unit and nominal occupancy of dwelling unit in accordance with TABLE 2.2.1.

Figures & Tables

TABLE 2.2.1: MINIMUM INTERNAL SS FLOOR AREA AND VOLUME

TABLE 2.2.1 : MINIMUM INTERNAL SS FLOOR AREA AND VOLUME	
Gross Floor Area (GFA)* Of Dwelling Unit	Nominal Occupancy of Dwelling Unit (No. of persons catered for in SS)
GFA ≤ 45m ²	2
45 ² < GFA ≤ 75m ²	3
75m ² GFA ≤ 140m ²	4
GFA > 140m ²	5

Note:

The GFA of the dwelling unit excludes the area of balconies that are open on at least two sides to make the balconies conducive for sky-rise gardening in accordance with URA guidelines.

Area of Storey Shelter = TNO x 0.6m²

Volume of Storey Shelter = TNO x 1.8m³

TNO = Total Number Occupancy of units served by Storey Shelter

b. The maximum internal floor area of a SS or S/C SS shall be 32m².

c. For the S/C SS, the aggregate planar area of the staircase entrance landing, intermediate landing and the staircase treads (excluding the over-lapping tread at each riser and area taken up by the internal SS door) of each storey is taken as its internal floor area.

d. The product of the internal floor area of the S/C SS and its clear height, measured from the finished floor level (FFL) to the soffit of the ceiling staircase slab, is taken as the internal volume of the S/C SS.

e. The maximum internal length of any floor and roof slab of a SS shall be 10000mm. The minimum internal width of a SS or S/C SS shall be 1200mm. Refer to FIGURE 2.2.1(a) and 2.2.1(b).

Figures & Tables

FIGURE 2.2.1(a): TYPICAL LAYOUT OF SS


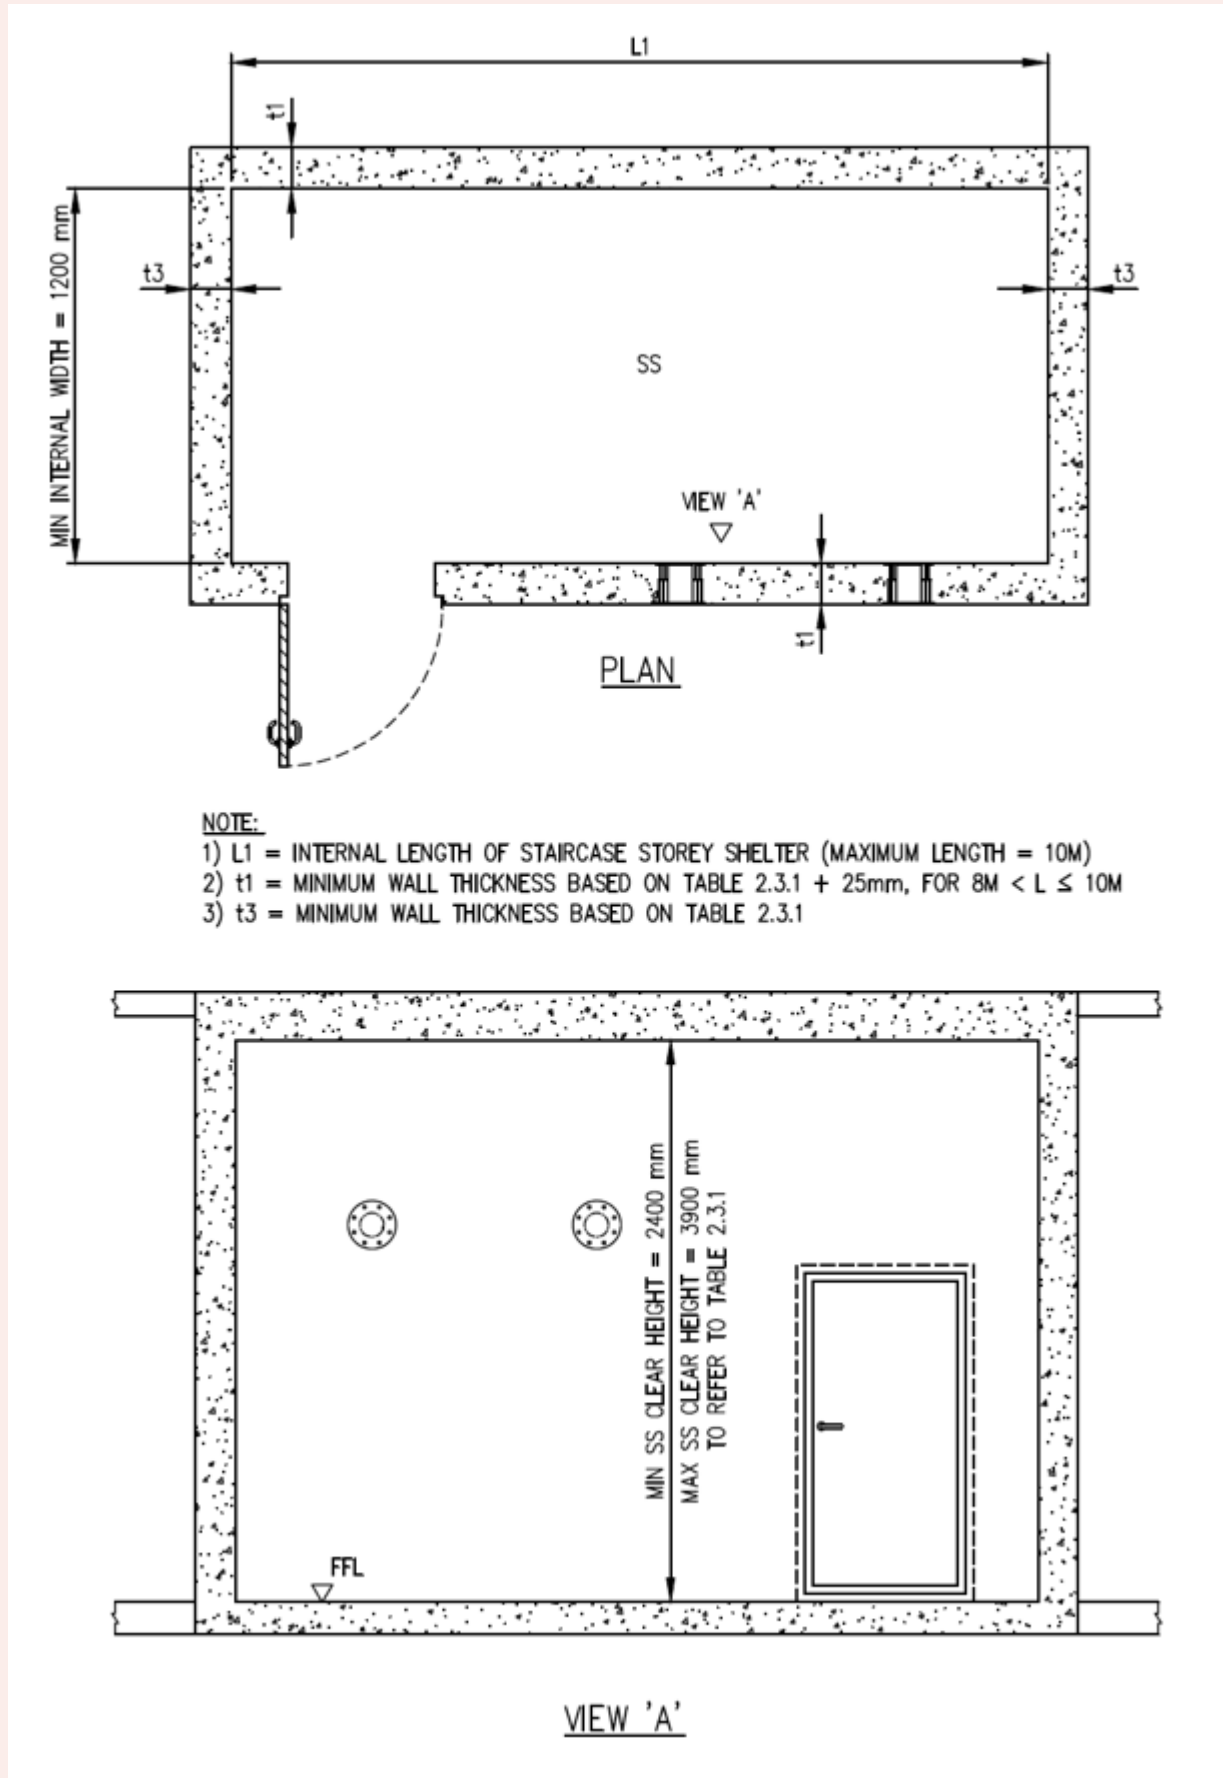



FIGURE 2.2.1(b): TYPICAL LAYOUT OF S/C SS

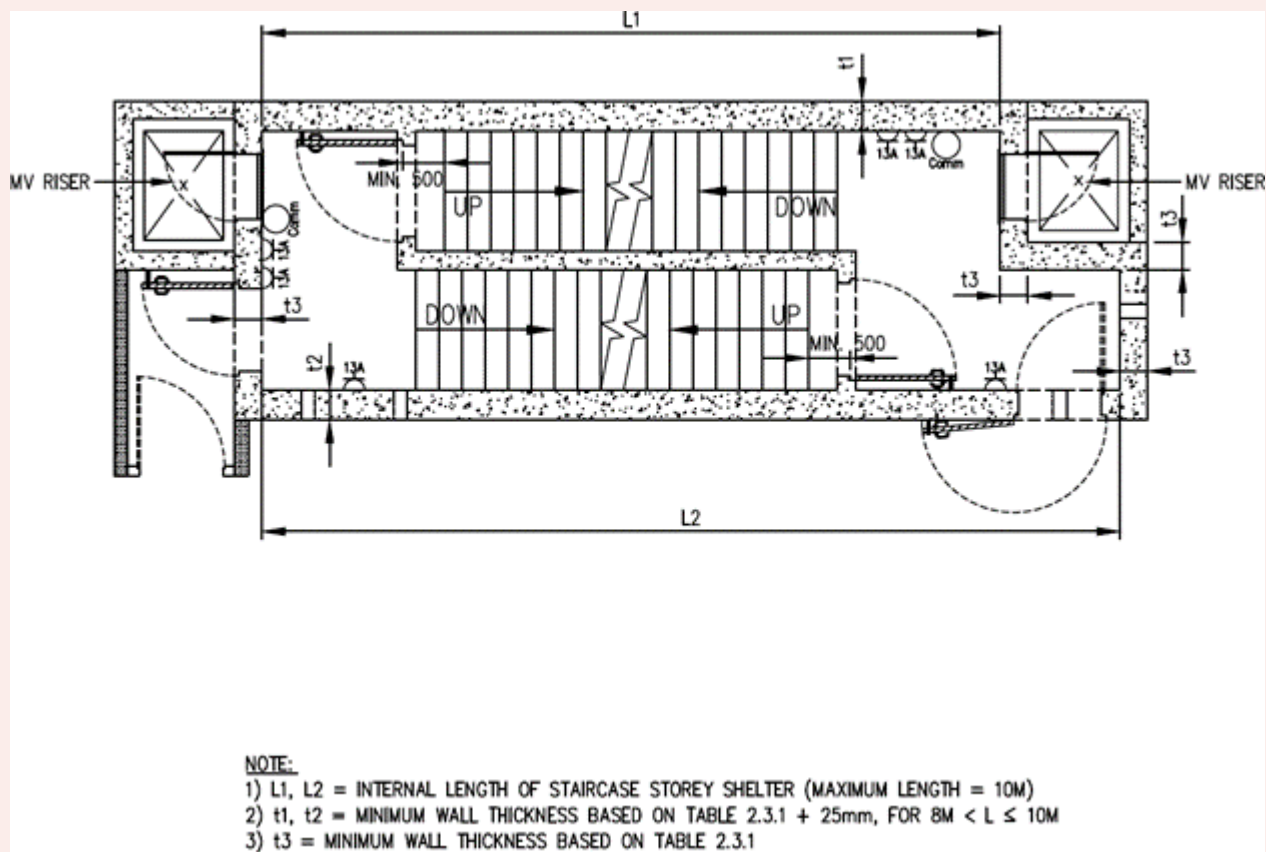

f. For S/C SS, the minimum internal width of staircase flight shall be at least 1150mm. See FIGURE 2.12.1(f).

Figures & Tables

FIGURE 2.12.1(f): TYPICAL PLAN OF S/C SS COMPARTMENT

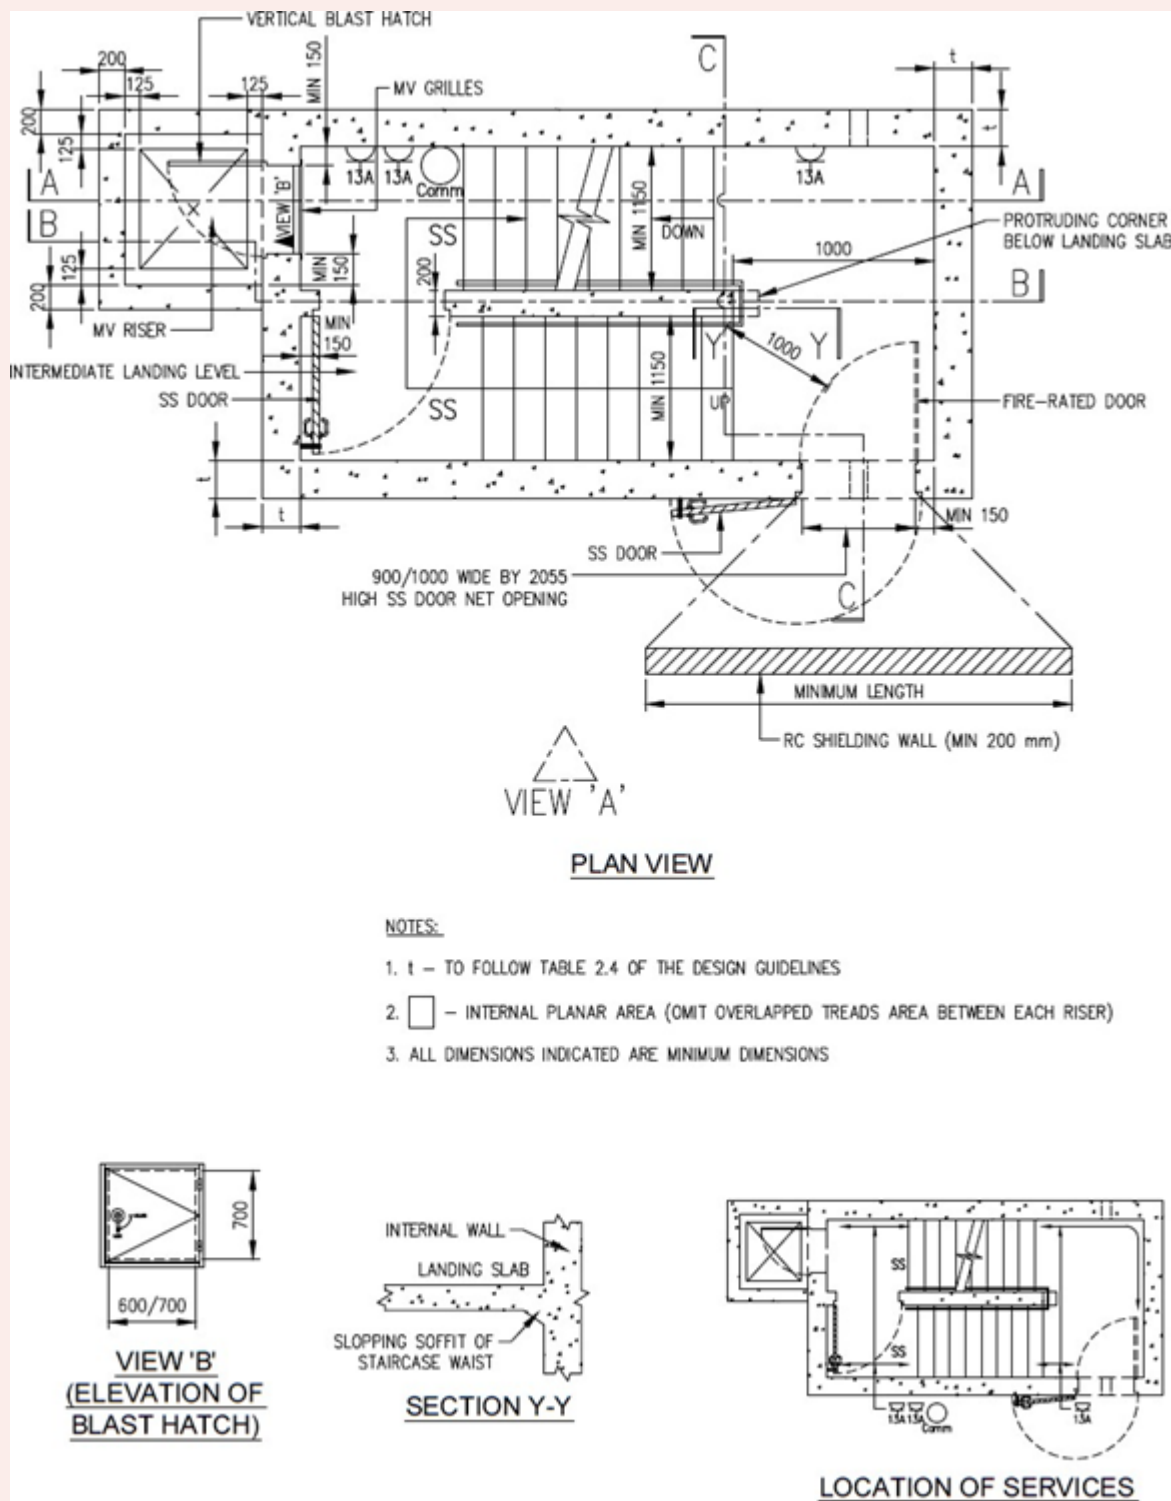


g. The ratio of the internal length to the internal width shall not exceed 3:1.

2.2.2 Heights

- a. The minimum SS clear height shall be 2400mm. Refer to FIGURE 2.2.1(a). The minimum NS clear height shall be 2400mm
- b. The minimum S/C SS or scissor S/C SS clear height shall be 2400mm. Within the S/C SS or scissor S/C SS tower, where the storey height deviated from the typical storey height, the minimum clear height of NS in S/C SS or scissor S/C tower shall be 2000mm. Refer to FIGURE 2.2.2(a).

Figures & Tables


FIGURE 2.2.2(a): SECTION OF S/C SS TOWER SHOWING S/C SS AND NS CLEAR HEIGHT

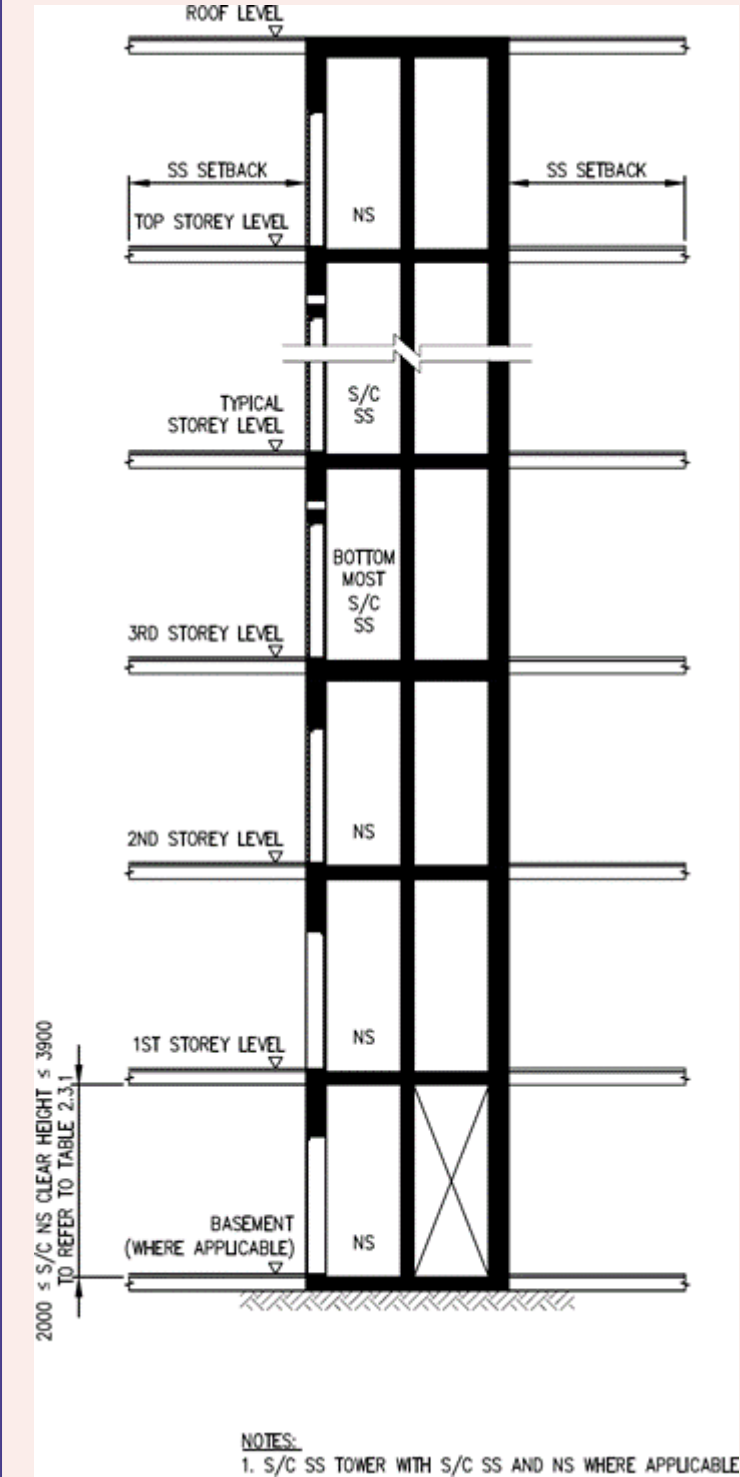

- c. The maximum clear height of a SS, S/C SS, scissor S/C SS and NS shall be 3900mm. Refer to FIGURE 2.2.1(a), 2.2.2(a) and TABLE 2.3.1.

Figures & Tables

FIGURE 2.2.1(a): TYPICAL LAYOUT OF SS

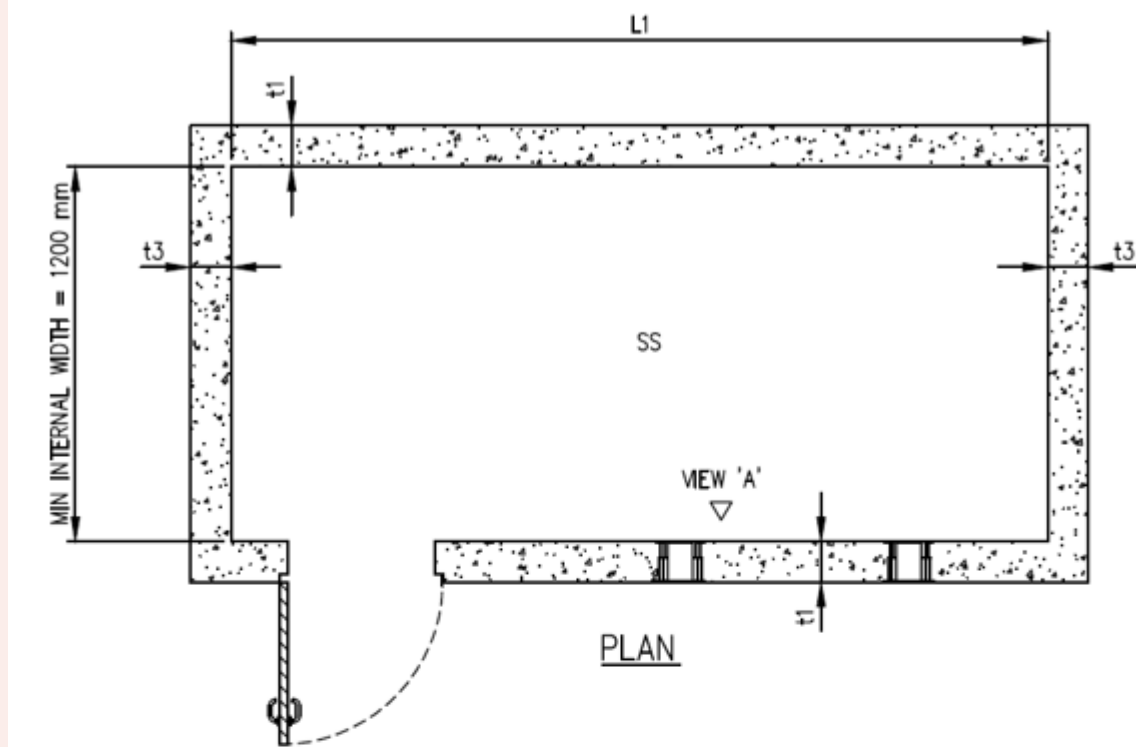

NOTE:

- 1) L1 = INTERNAL LENGTH OF STAIRCASE STOREY SHELTER (MAXIMUM LENGTH = 10M)
- 2) t1 = MINIMUM WALL THICKNESS BASED ON TABLE 2.3.1 + 25mm, FOR $8M < L \leq 10M$
- 3) t3 = MINIMUM WALL THICKNESS BASED ON TABLE 2.3.1

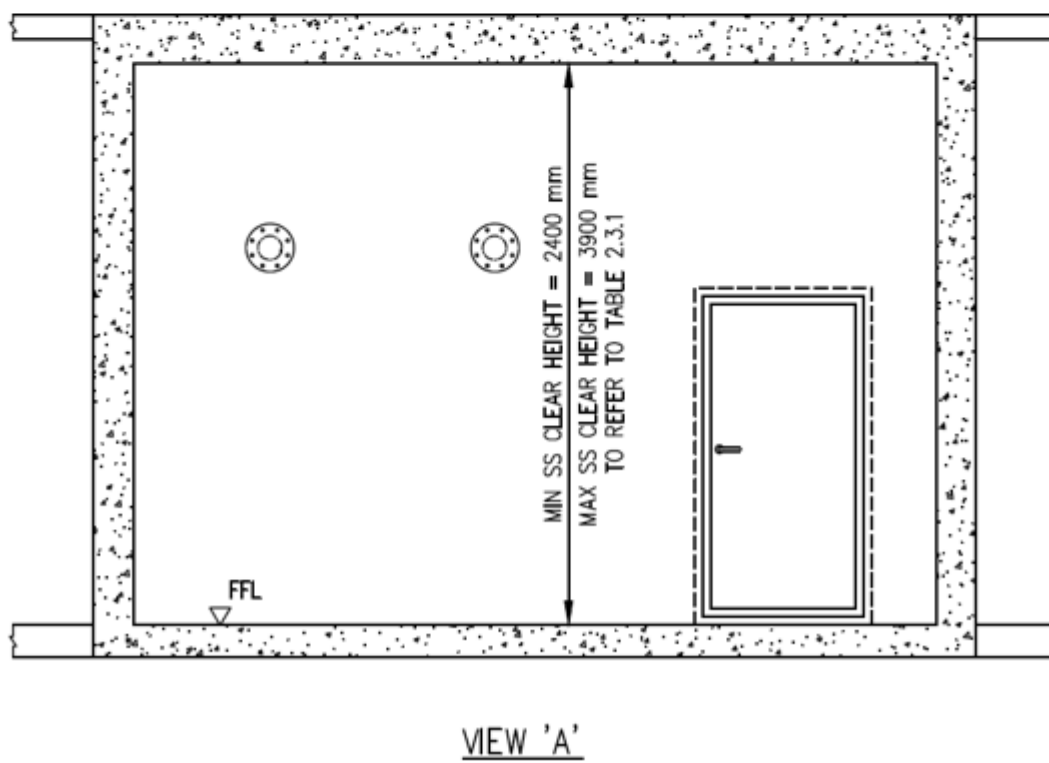


FIGURE 2.2.1(b): TYPICAL LAYOUT OF S/C SS

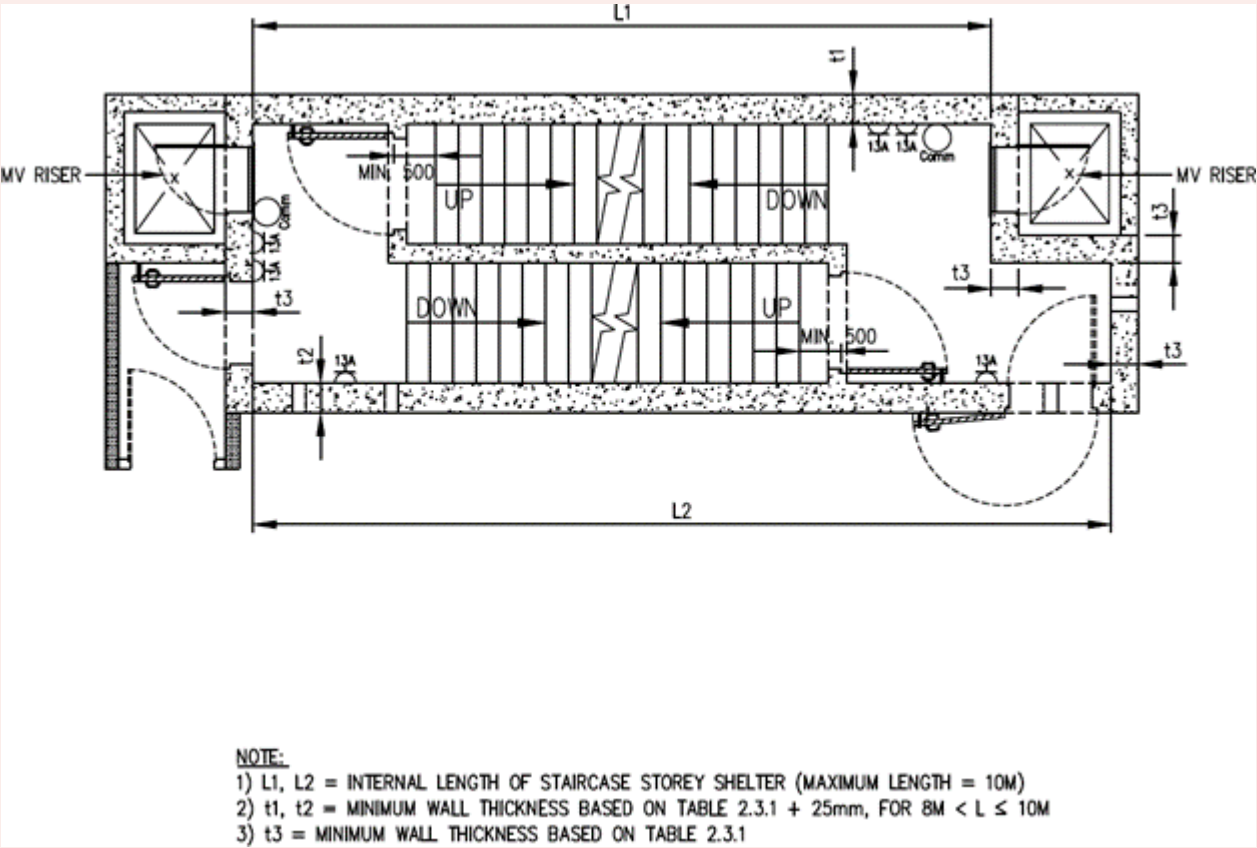


TABLE 2.3.1 : REQUIRED MINIMUM SS AND NS WALL THICKNESS

TABLE 2.3.1 : REQUIRED MINIMUM SS AND NS WALL THICKNESS			
Storey Height (SH) (Mm)	SS/NS Clear Height (Ht) (mm)	Setback Distance of SS Wall (mm)	Wall Thickness (mm)
SH ≤ 4000	2400 ≤ Ht ≤ 3400	≤ 6000	300
		> 6000	250
	3400 < Ht ≤ 3900	≤ 6000	325
		> 6000	275
4000 < SH ≤ 6000	2400 ≤ Ht ≤ 3400	≤ 7000	300
		> 7000	250
	3400 < Ht ≤ 3900	≤ 7000	325
		> 7000	275
6000 < SH ≤ 8000	2400 ≤ Ht ≤ 3400	≤ 8000	300
		> 8000	250
	3400 < Ht ≤ 3900	≤ 8000	325
		> 8000	275
8000 < SH ≤ 10000	2400 ≤ Ht ≤ 3400	≤ 9000	300
		> 9000	250
	3400 < Ht ≤ 3900	≤ 9000	325
		> 9000	275

Note:

The fire growth rate that is applicable through available literature or standard such as the SFPE Handbook shall be adopted. In the instance where the fire growth rate lies in between the range as stated above, the more conservative fire growth rate is to be used.

CLAUSE 2.3 WALL AND SLAB THICKNESS OF SS AND NS

2.3.1 SS Wall Thickness

The thickness of SS wall varies accordingly to SS clear height and the setback distance. The thickness shall comply with the following requirements:


- a. The minimum SS wall thickness shall be in accordance with TABLE 2.3.1.

Figures & Tables			
TABLE 2.3.1 : REQUIRED MINIMUM SS AND NS WALL THICKNESS			
TABLE 2.3.1 : REQUIRED MINIMUM SS AND NS WALL THICKNESS			
Storey Height (SH) (Mm)	SS/NS Clear Height (Ht) (mm)	Setback Distance of SS Wall (mm)	Wall Thickness (mm)
SH ≤ 4000	2400 ≤ Ht ≤ 3400	≤ 6000	300
		> 6000	250
	3400 < Ht ≤ 3900	≤ 6000	325
		> 6000	275
4000 < SH ≤ 6000	2400 ≤ Ht ≤ 3400	≤ 7000	300
		> 7000	250
	3400 < Ht ≤ 3900	≤ 7000	325
		> 7000	275
6000 < SH ≤ 8000	2400 ≤ Ht ≤ 3400	≤ 8000	300
		> 8000	250
	3400 < Ht ≤ 3900	≤ 8000	325
		> 8000	275
8000 < SH ≤ 10000	2400 ≤ Ht ≤ 3400	≤ 9000	300
		> 9000	250
	3400 < Ht ≤ 3900	≤ 9000	325
		> 9000	275


- b. Wall thickness of any SS or NS within the SS tower shall not be less than the wall thickness of the SS or NS above it.

- c. Internal common wall between 2 adjacent SS shall be at least 200mm thick. Refer to FIGURE 2.3.1.

Figures & Tables	
FIGURE 2.3.1: INTERNAL COMMON WALL BETWEEN TWO SS	

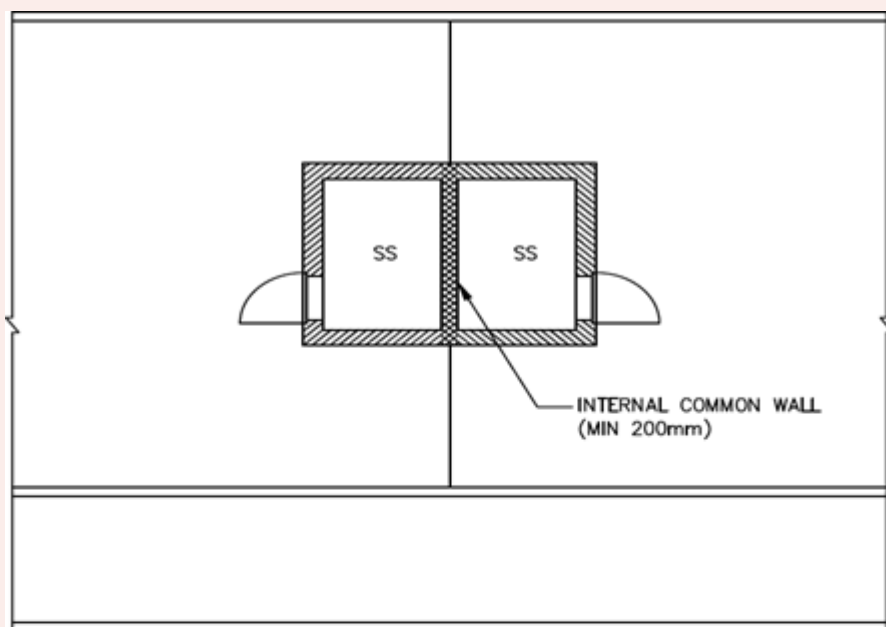

ALTERNATIVE 1

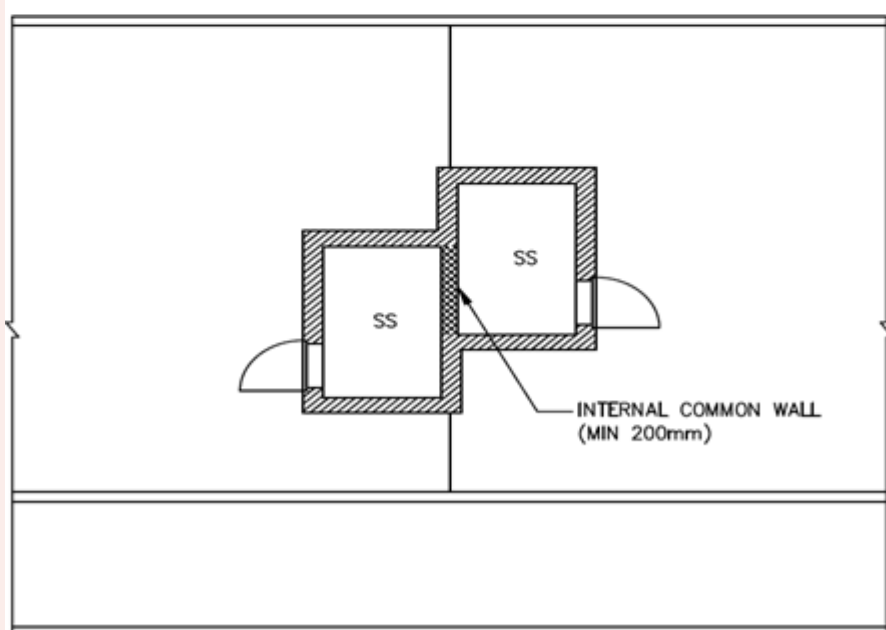


ALTERNATIVE 2

d. The minimum internal common wall thickness between SS and enclosed NS shall be 200mm. The minimum internal common wall thickness between SS and non-enclosed NS shall be 300mm. Refer to FIGURE 2.12.2(i).

Figures & Tables

FIGURE 2.12.2(i): SS WITH NS COMPARTMENT WITH LAST BOTTOM-MOST SS DOOR ON 300MM THICK INTERNAL WALL

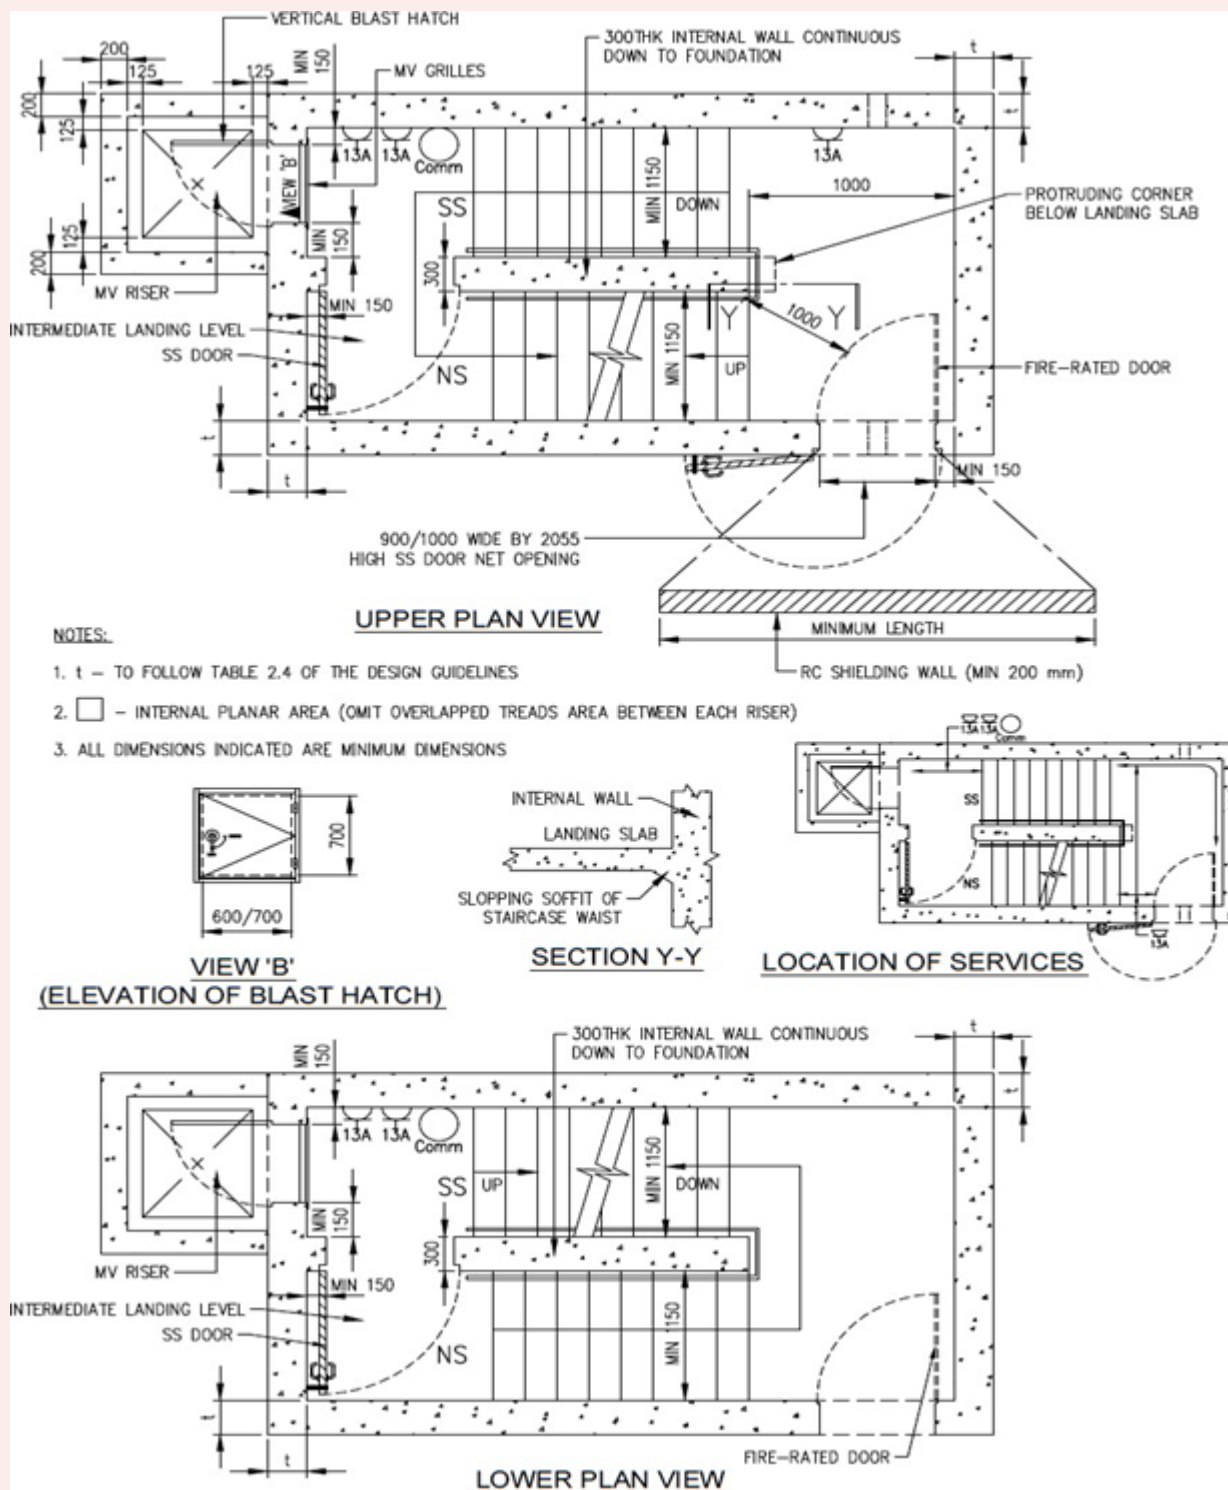

e. For internal SS and S/C SS length more than 8000mm, an additional 25mm thickness shall be provided to the affected SS wall. Refer to FIGURE 2.2.1(a) and 2.2.1(b).

Figures & Tables

FIGURE 2.2.1(a): TYPICAL LAYOUT OF SS


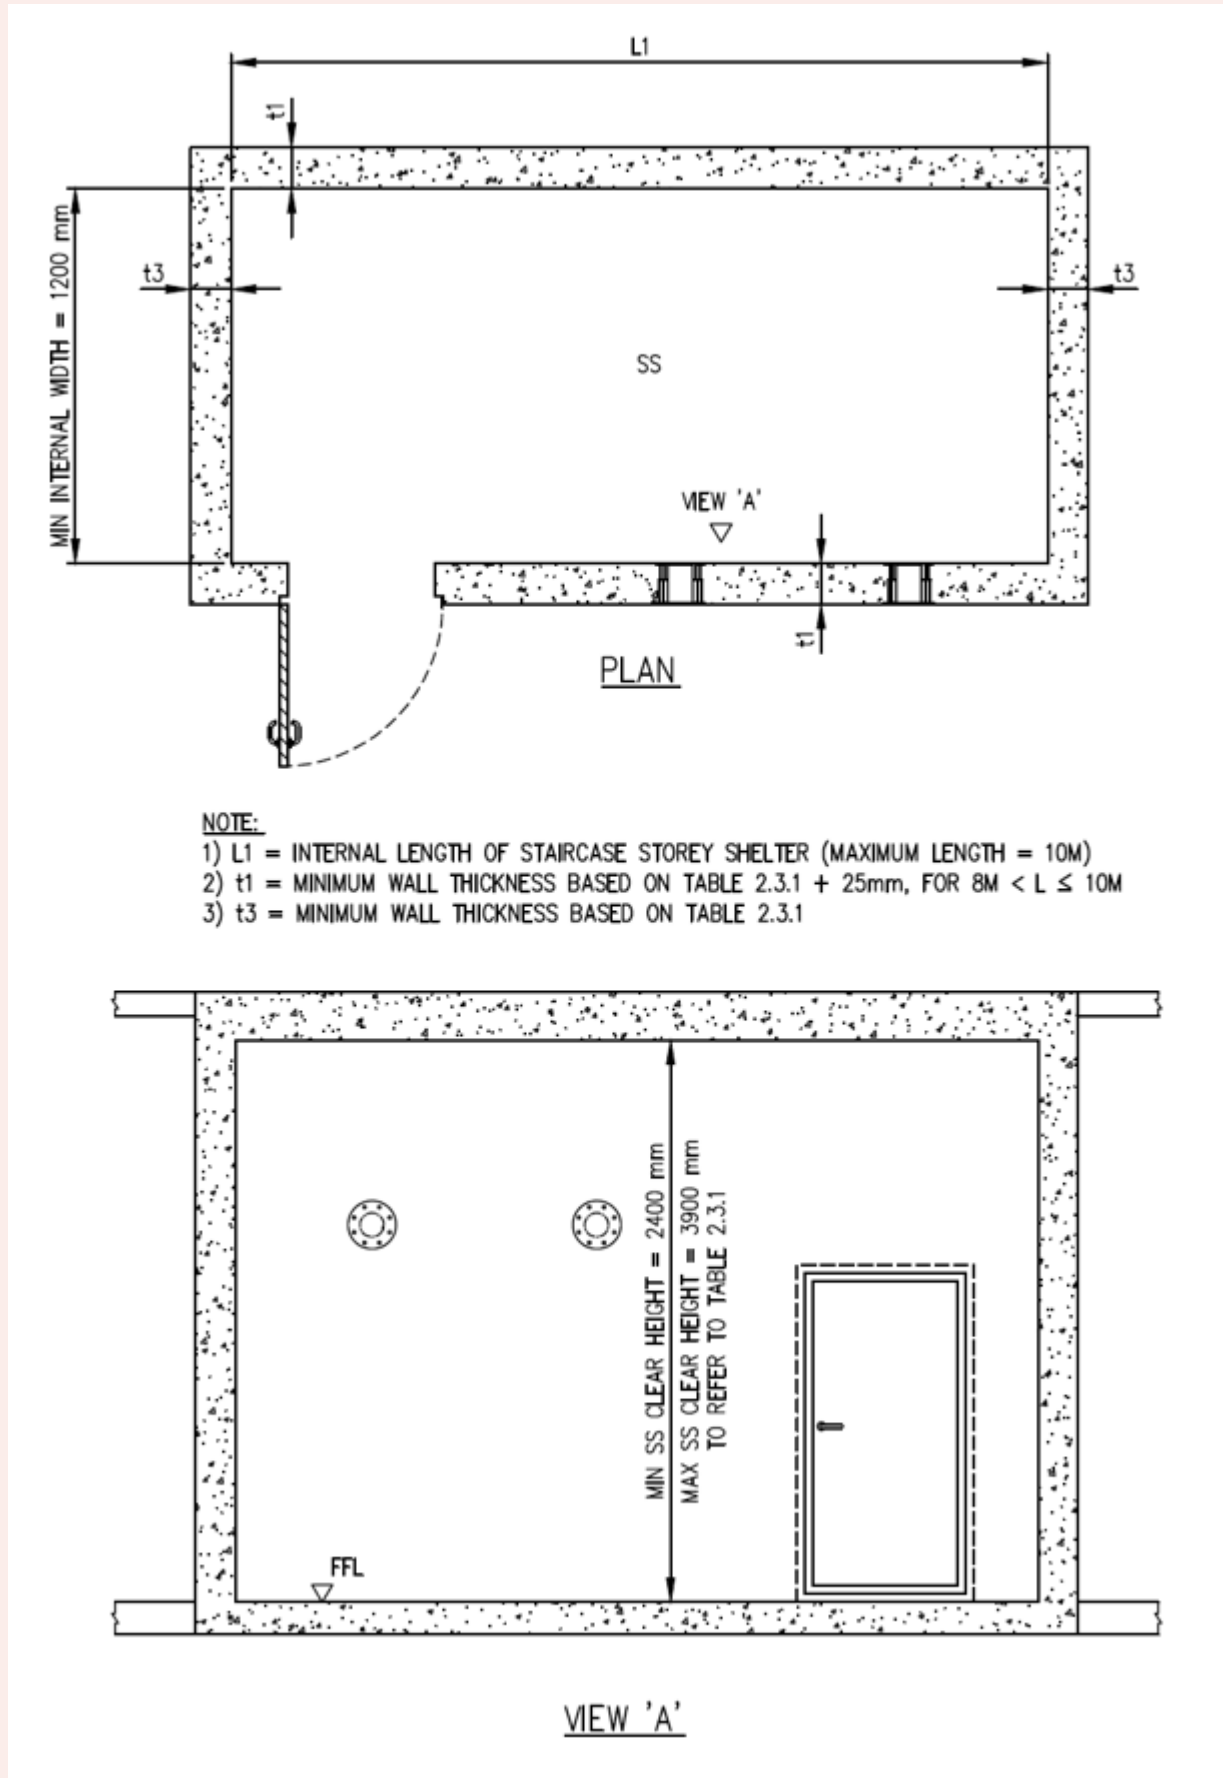


FIGURE 2.2.1(b): TYPICAL LAYOUT OF S/C SS

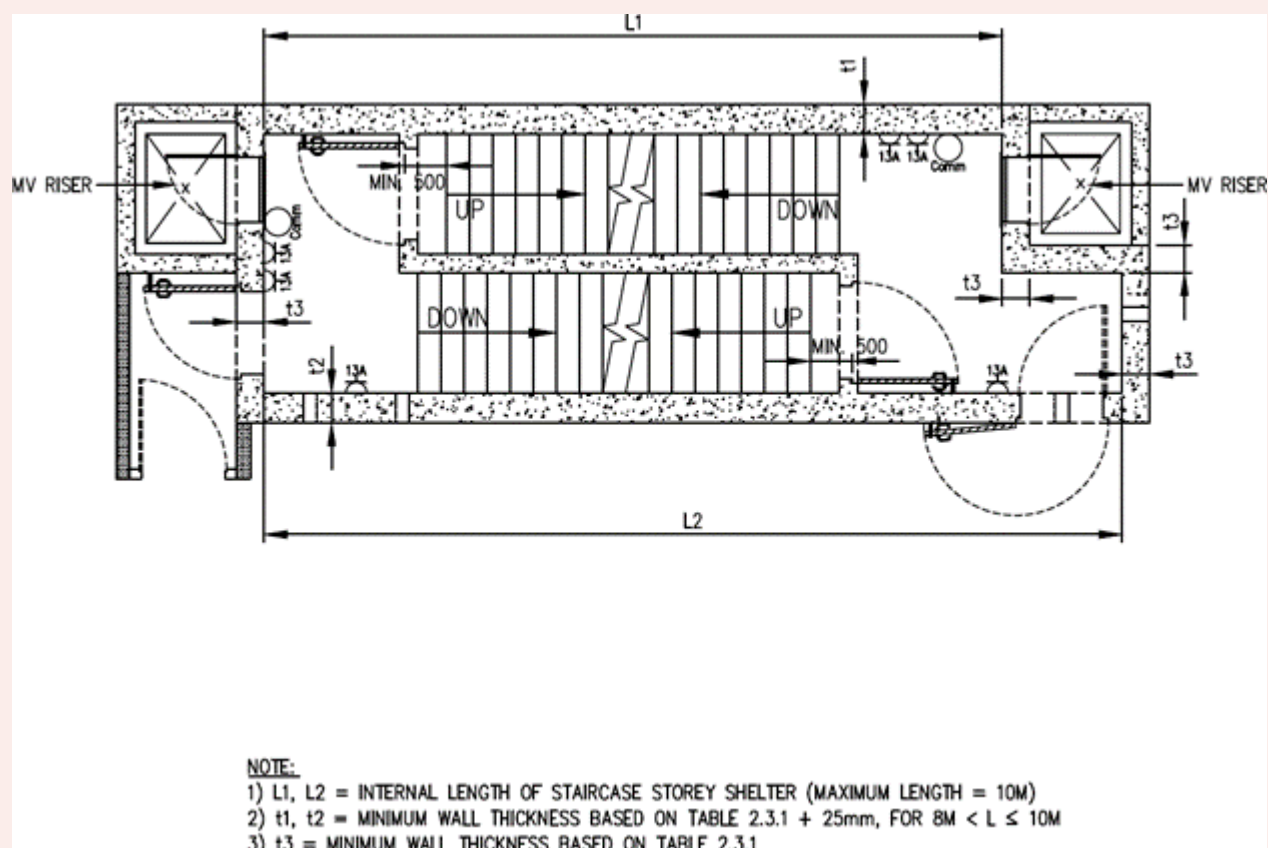


2.3.2 Slab Thickness of SS and Enclosed NS

The minimum dimensions of members forming part of the SS tower shall be as follows:

- a. Ceiling slab of top-most SS or S/C SS or scissor S/C SS – 300mm. Refer to FIGURE 2.3.2.

Figures & Tables


FIGURE 2.3.2: SS TOWER SHOWING SS AND NS (WITH ENCLOSED AND NON-ENCLOSED NS WALL) SLAB THICKNESS

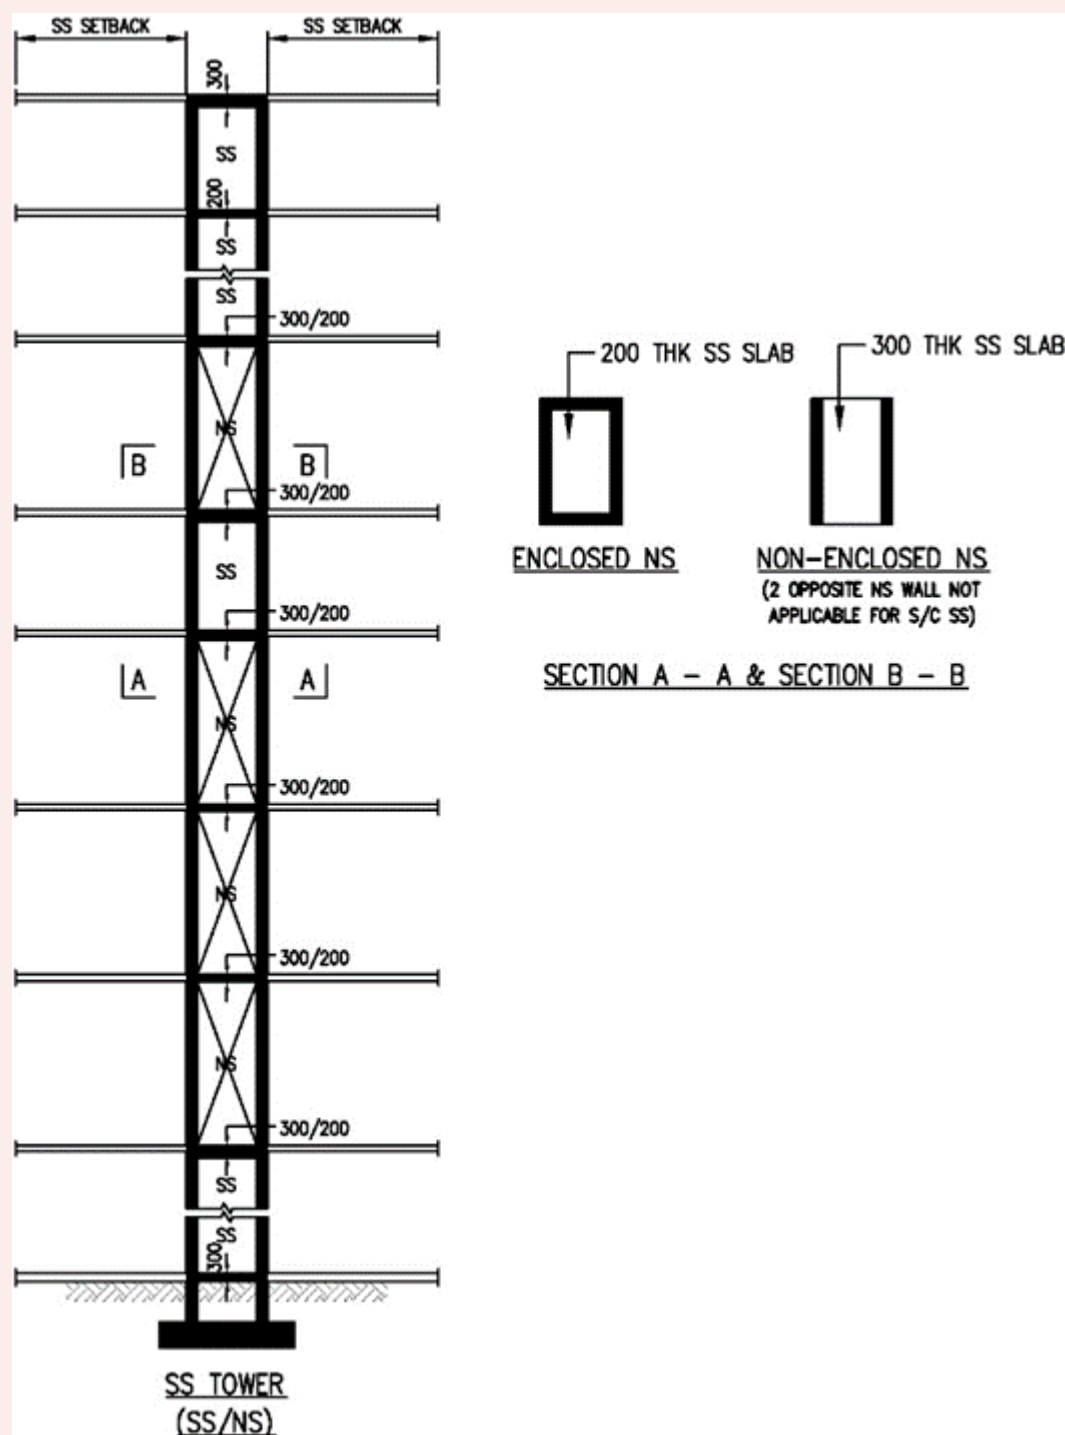

b. Slab between two SS or S/C SS or scissor S/C SS – 200mm. Refer to FIGURE 2.3.2.

Figures & Tables


FIGURE 2.3.2: SS TOWER SHOWING SS AND NS (WITH ENCLOSED AND NON-ENCLOSED NS WALL) SLAB THICKNESS

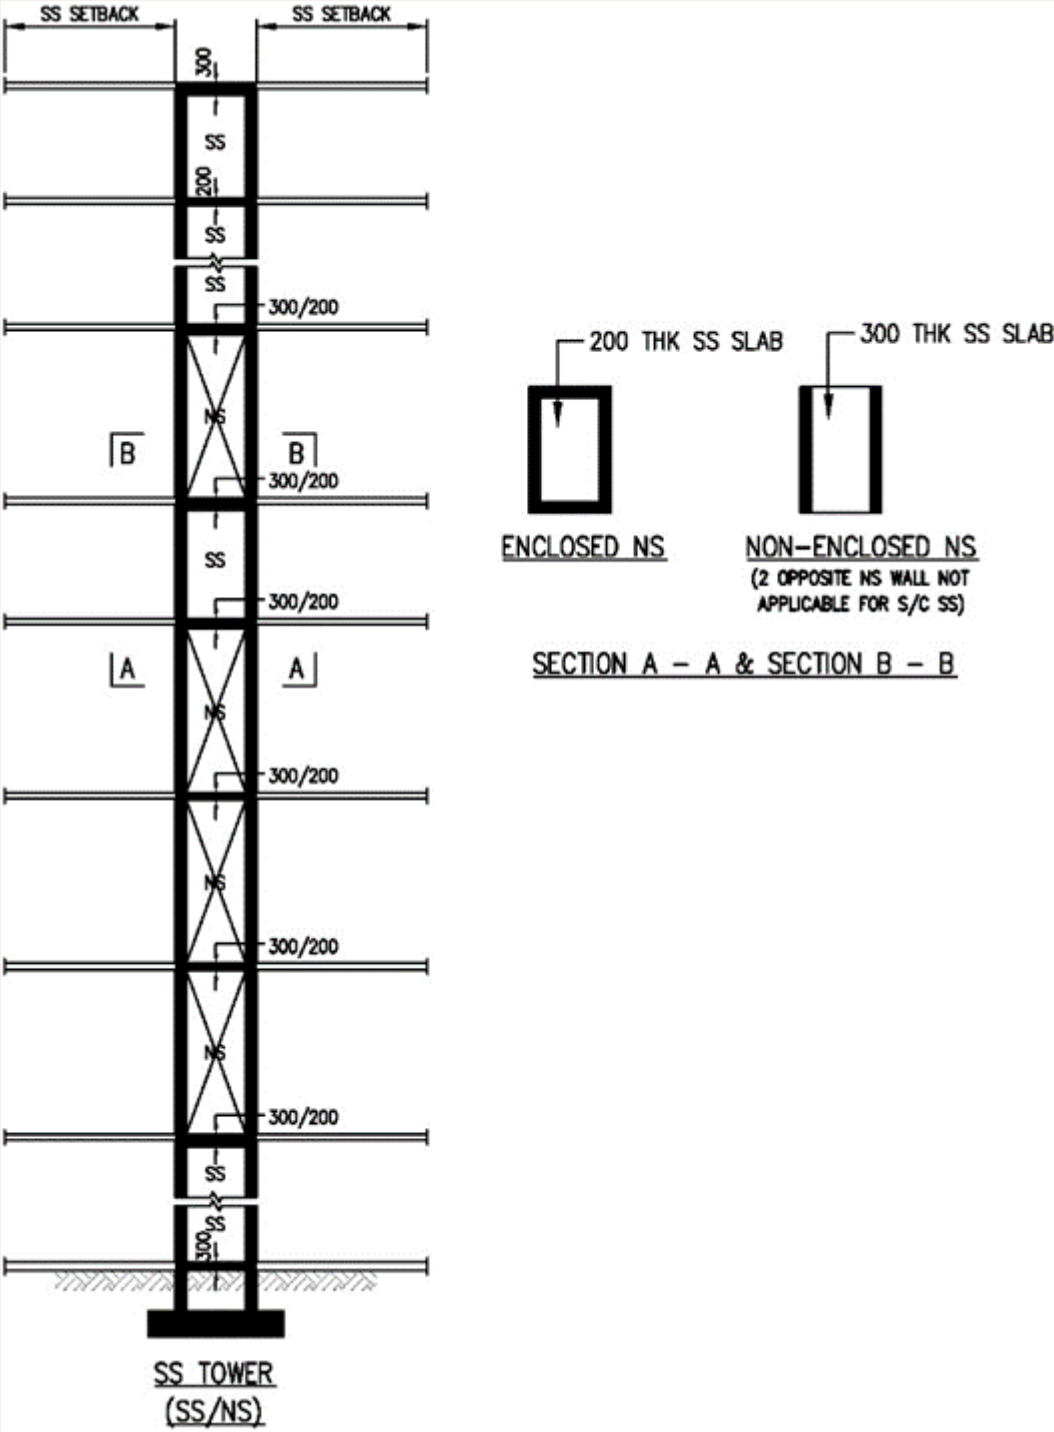

c. Floor slab of bottom-most SS/NS in contact with soil – 300mm. Refer to FIGURE 2.3.2.

Figures & Tables

FIGURE 2.3.2: SS TOWER SHOWING SS AND NS (WITH ENCLOSED AND NON-ENCLOSED NS WALL) SLAB THICKNESS

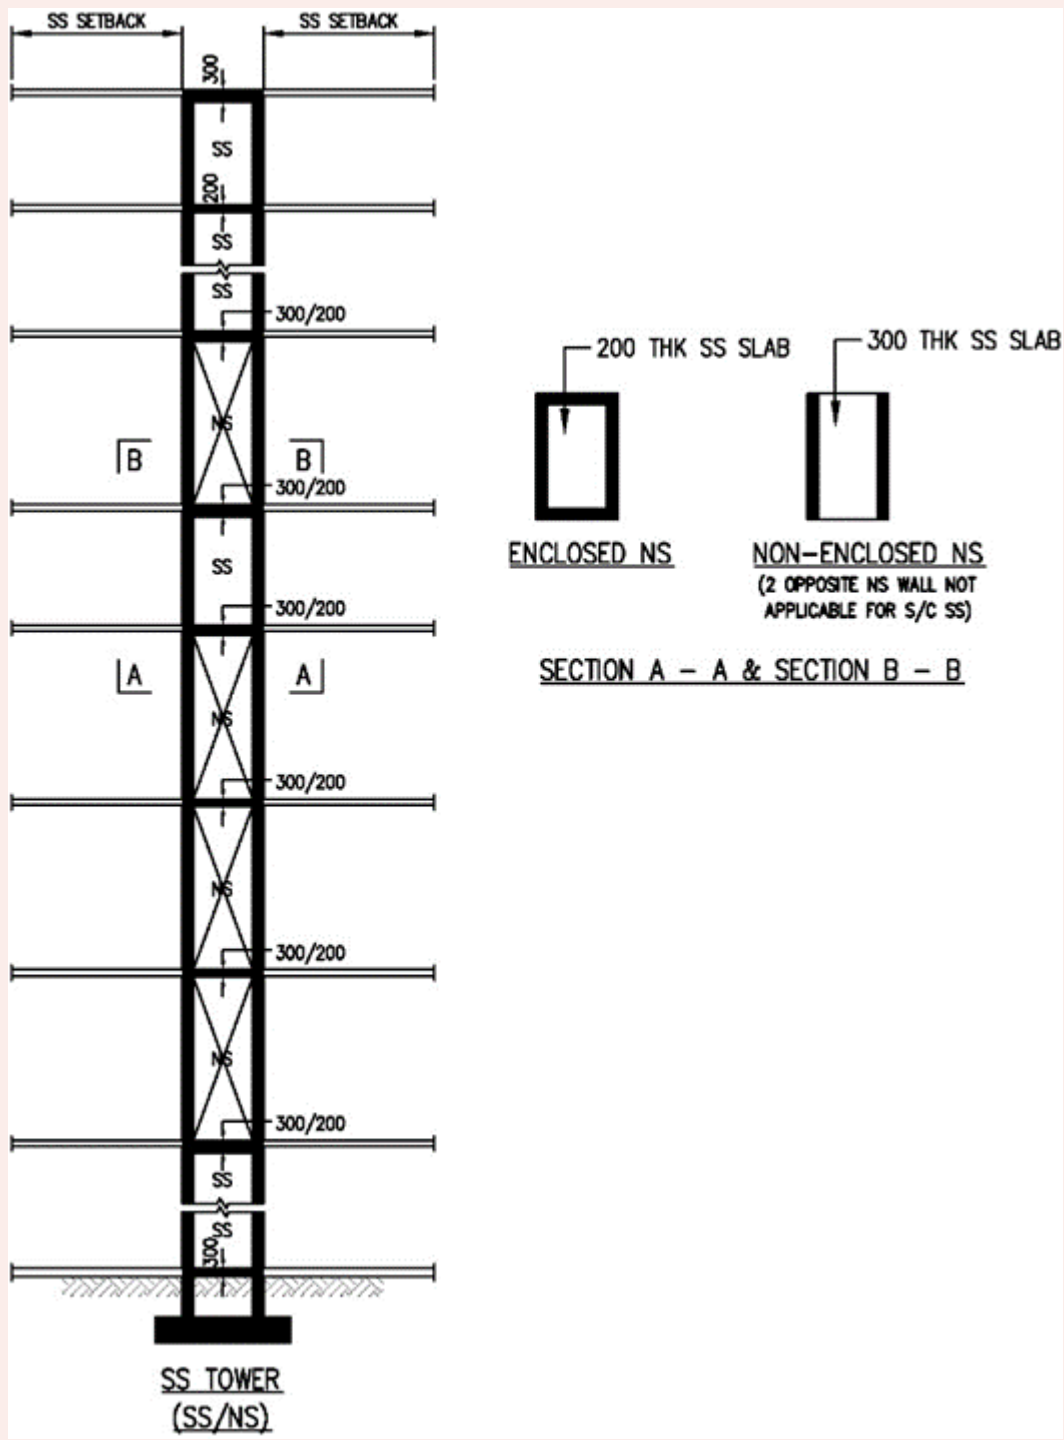


- b. Ceiling slab of SS which is below non-enclosed NS or NS wall - 300mm.
- c. Slab between two non-enclosed NS - 300mm.

CLAUSE 2.4 LOCATION OF SS

2.4.1 SS Position

- a. A SS has to be positioned such that the setback distance of each SS wall shall be as large as practicable and shall not be less than the minimum specified setback distance. Setback distance is provided by horizontal RC slab/ trellis at the SS ceiling level or above.
- b. Each of the dwelling units served by the SS shall have at least one exit door at the same storey as the SS. The travel distance between the SS door and the exit door (at the same storey as the SS) of any dwelling unit served by the SS shall not exceed 40 metres. Refer to FIGURE. 2.4.1

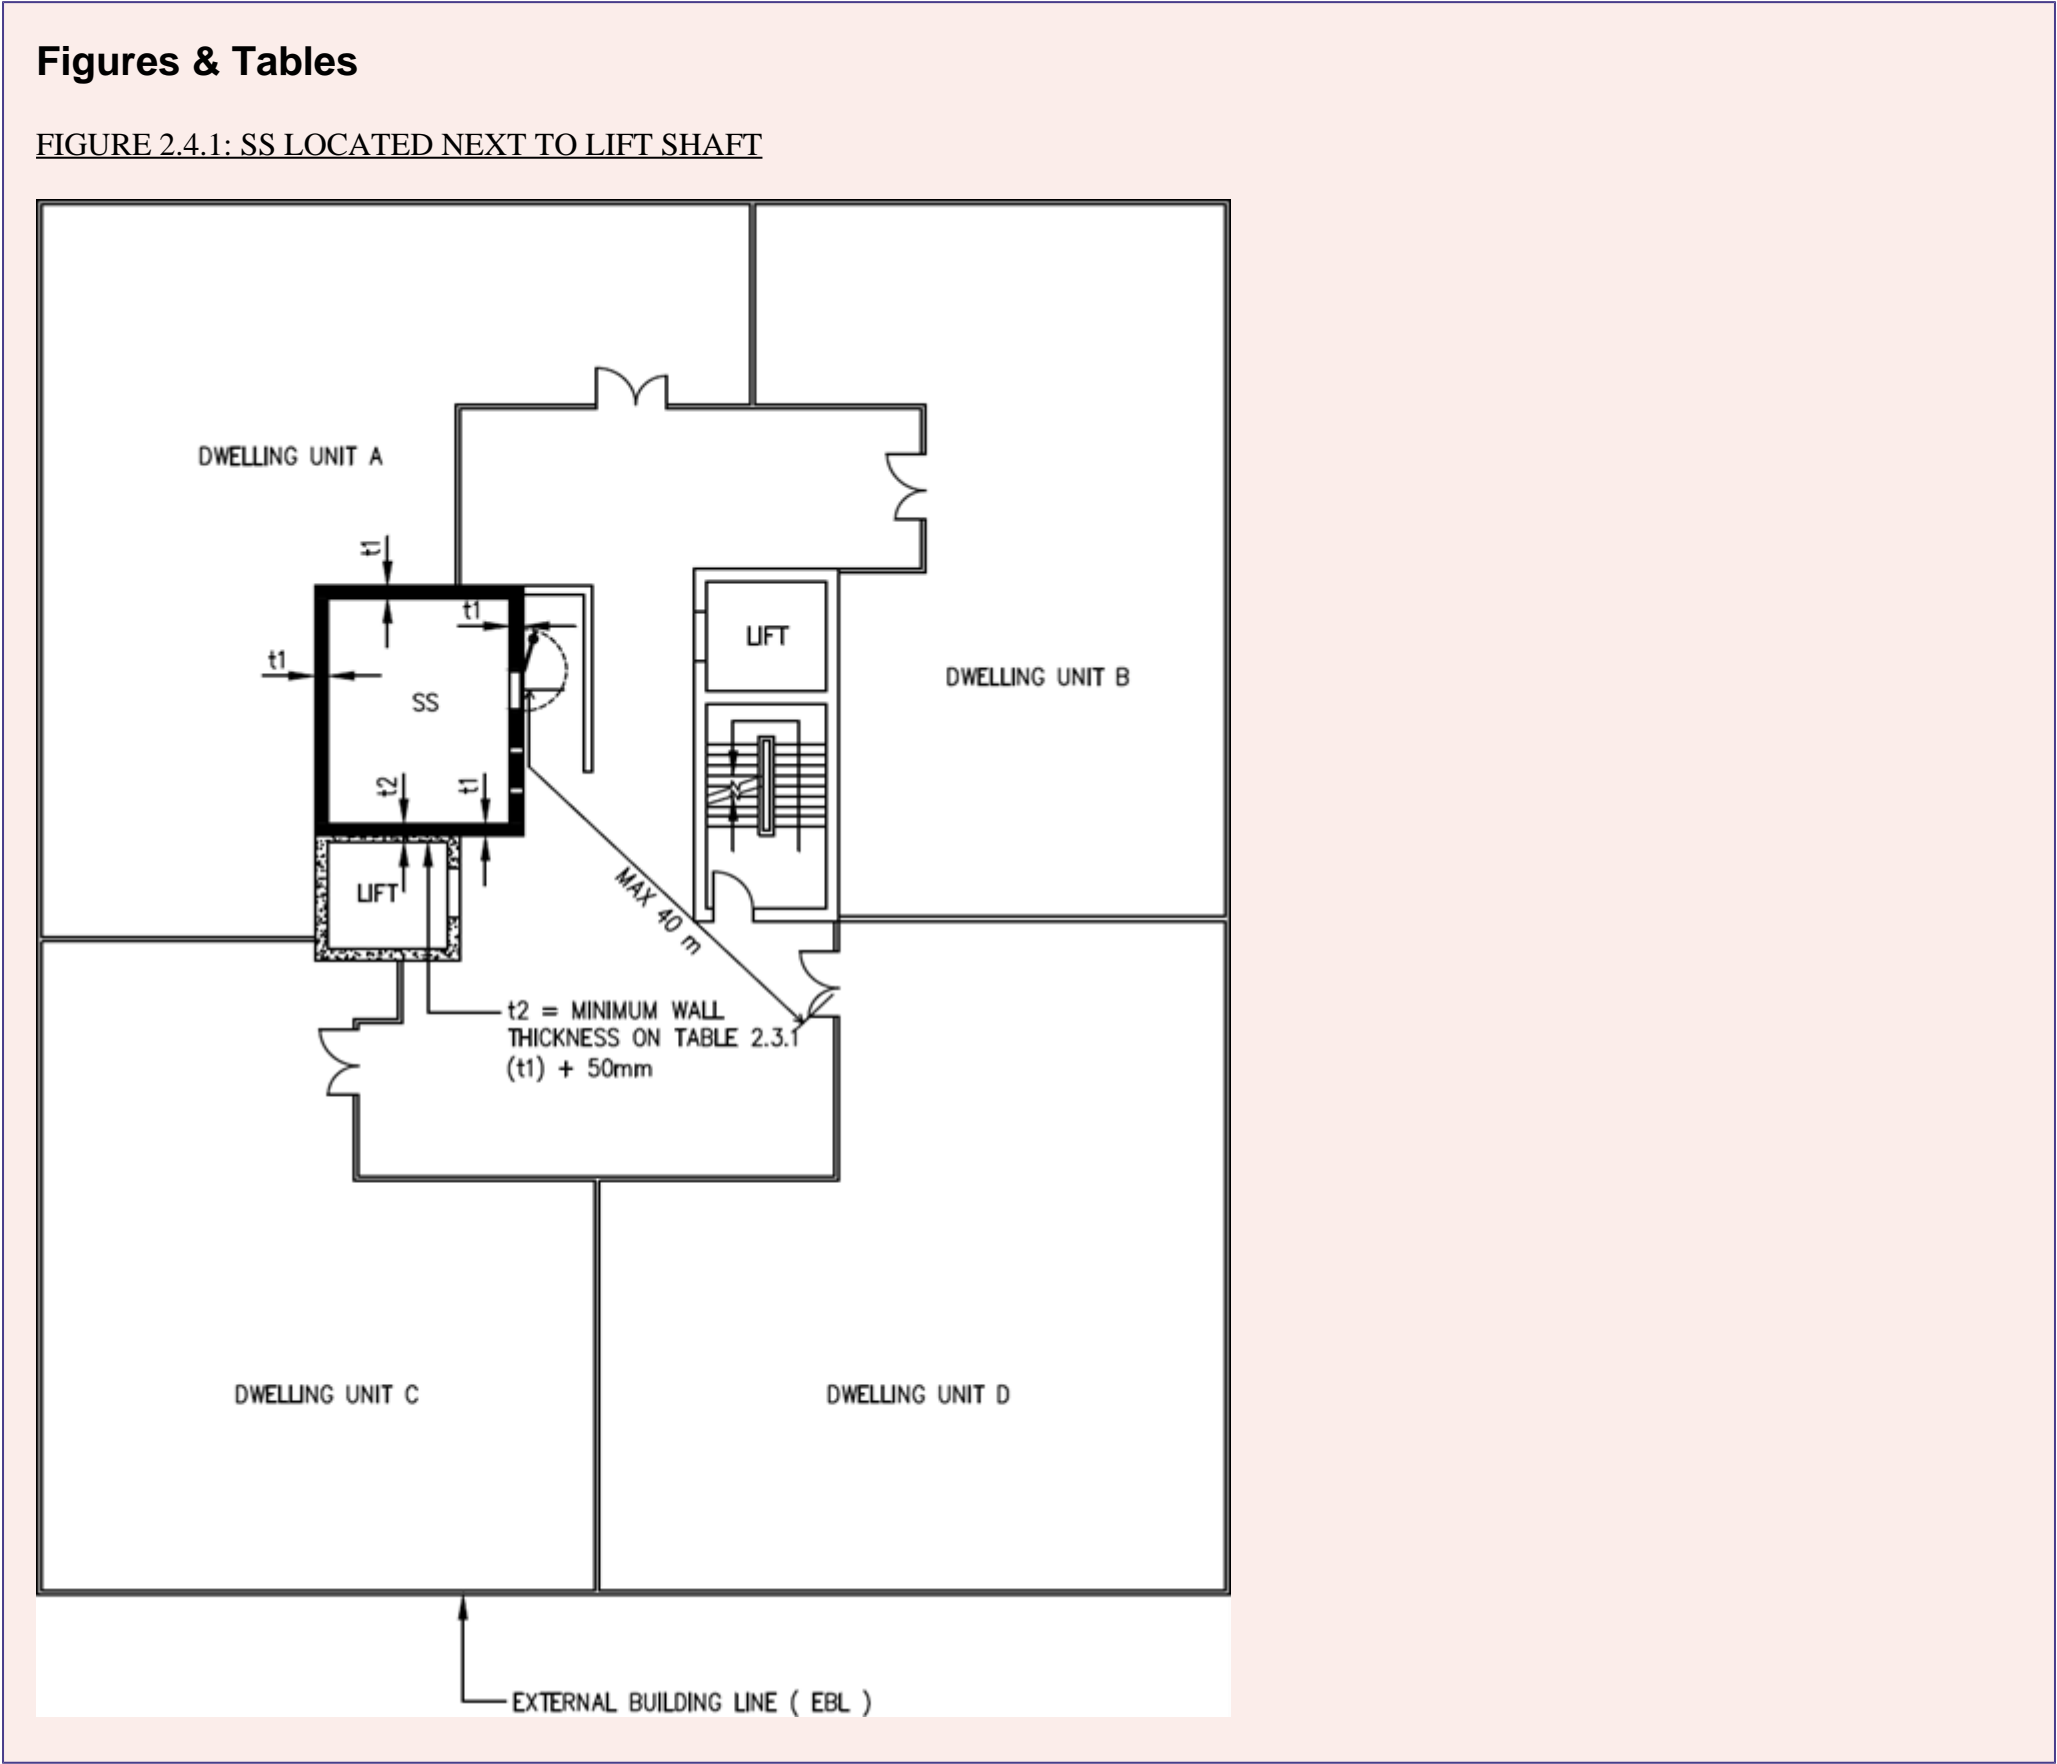

2.4.2 SS Tower

- a. In a building of more than one-storey, the SS (or NS, where applicable) on every storey shall be located one on top of the other to form a vertical tower with its walls founded directly to the foundation. Refer to FIGURE 2.4.2.



- be continuous to foundation, except where there are fire discharge openings at fire
that all corners of the S/C SS walls are continuous to foundation

and Concrete Down-hang Beams)

- own in FIGURE 2.4.3(a) to 2.4.3(c) and shall comply with TABLE 2.4.3.

S WALLS (WITHOUT DOWN-HANG BEAM) (FOR 2500MM < STOREY

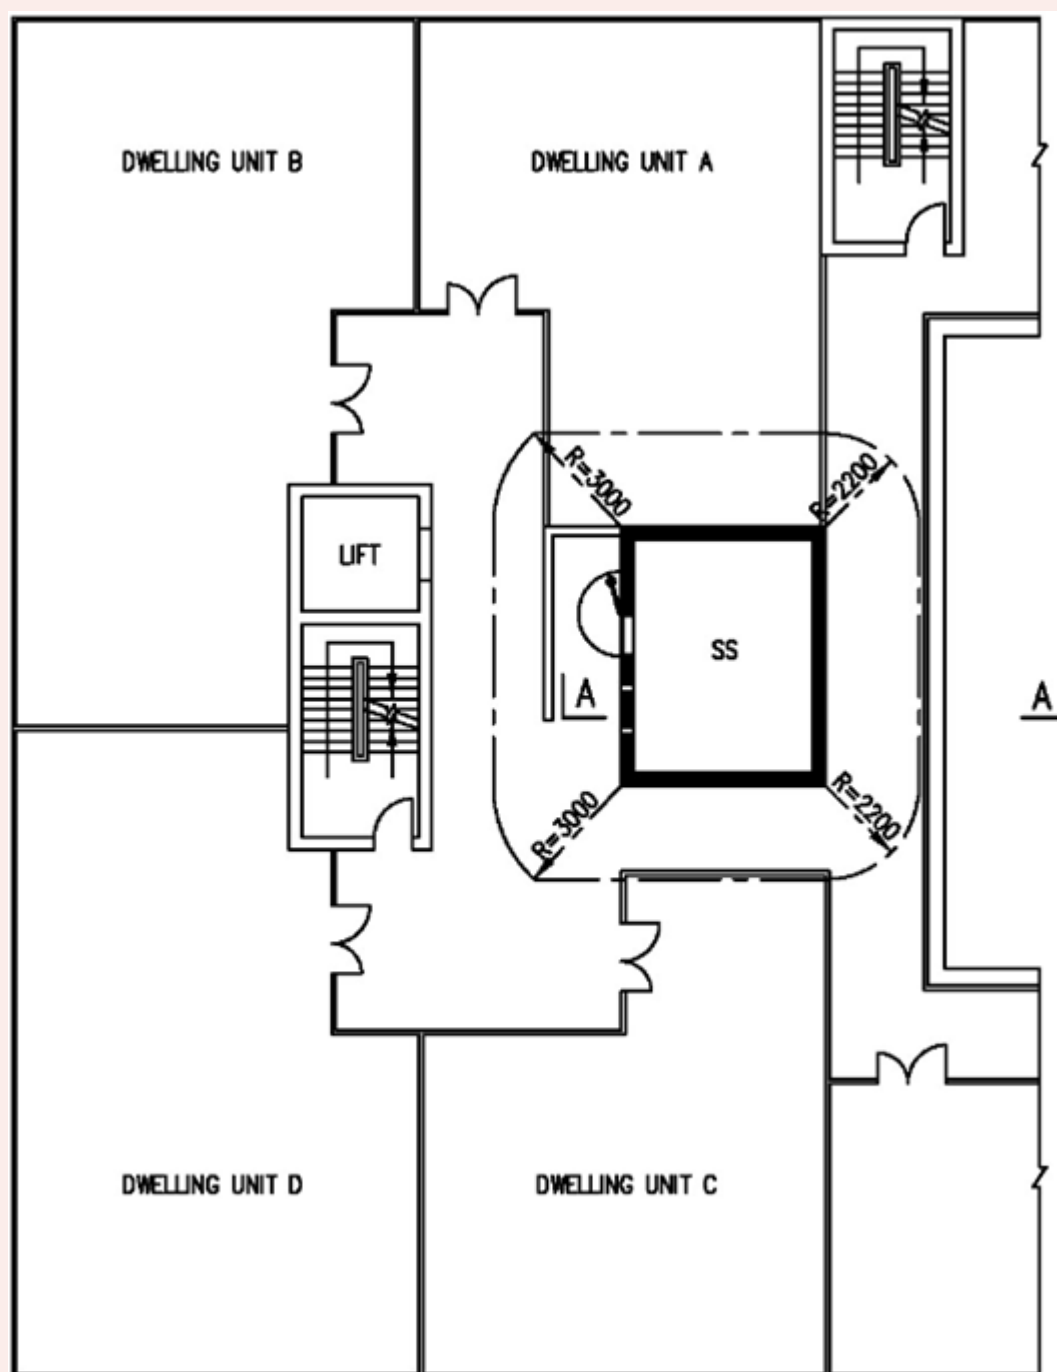


FIGURE 2.4.3(b): REQUIREMENT ON SETBACK DISTANCE OF SS WALLS (WITHOUT DOWN-HANG BEAM) (FOR 3500MM < STOREY HEIGHT 4000MM)

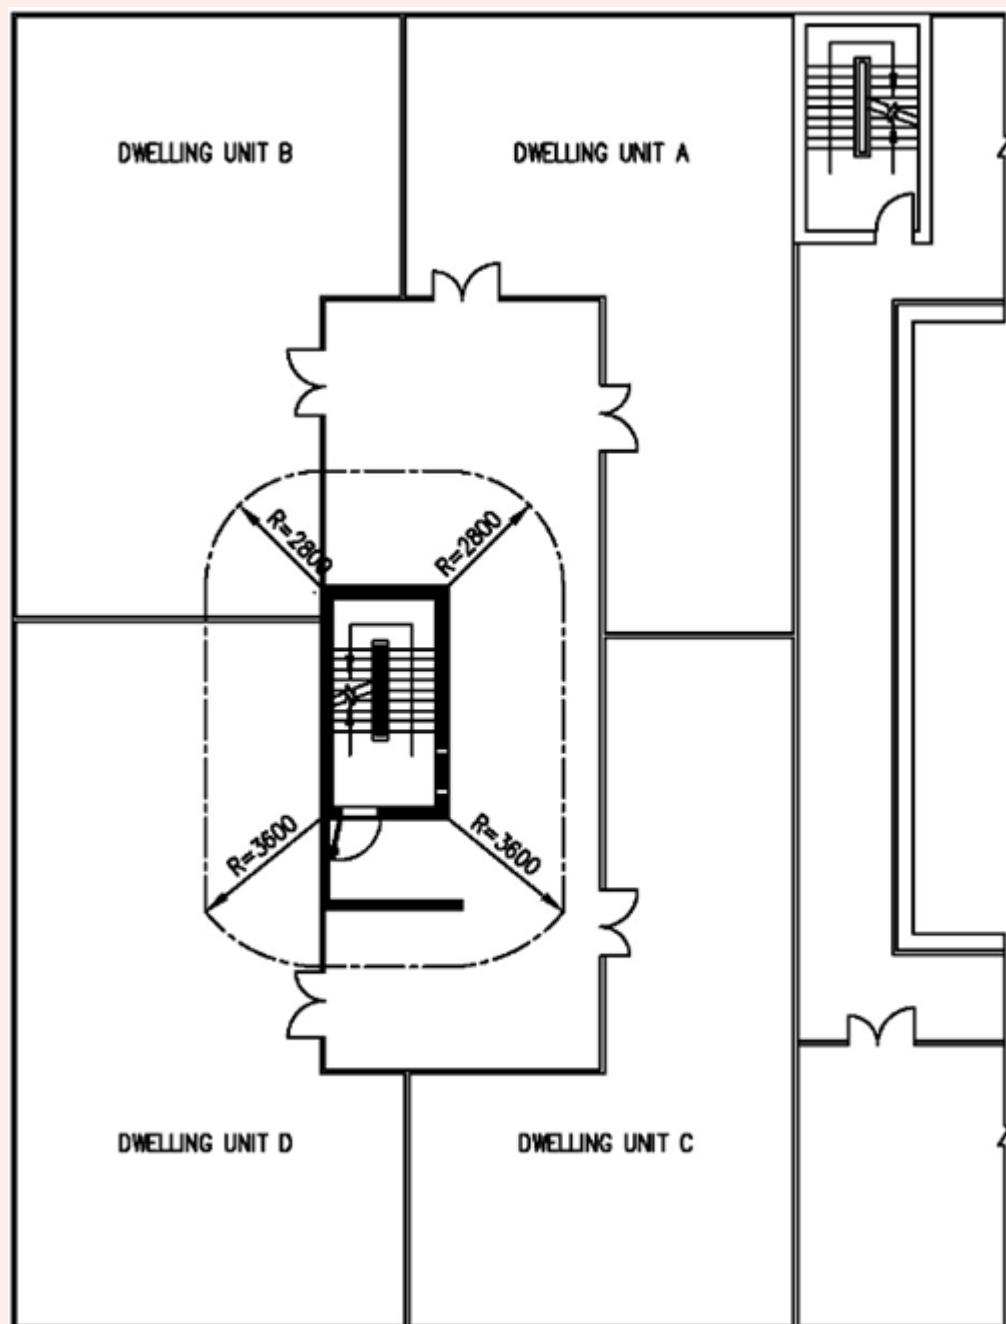


FIGURE 2.4.3(c): SETBACK DISTANCE OF SS WALLS (WITHOUT DOWN-HANG BEAM)

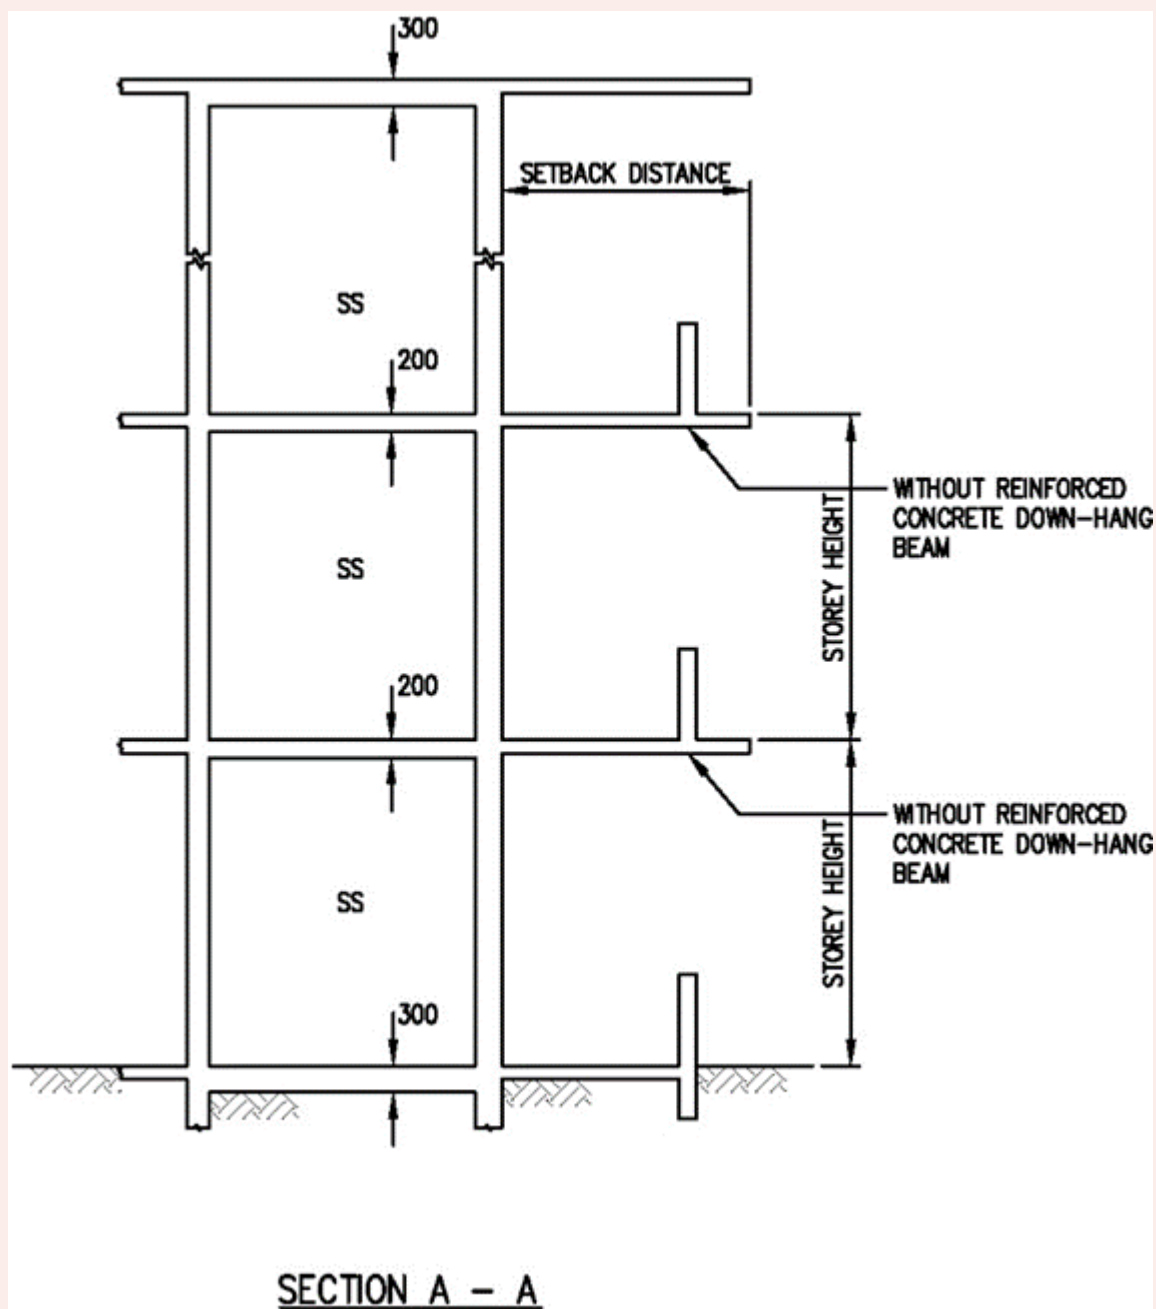


TABLE 2.4.3 : MINIMUM SETBACK DISTANCES OF SS WALLS WITHOUT REINFORCED CONCRETE DOWN-HANG BEAM

TABLE 2.4.3 : MINIMUM SETBACK DISTANCES OF SS WALLS WITHOUT REINFORCED CONCRETE DOWN-HANG BEAM


Storey Height (SH) (Mm) Column(1)	Setback Distance of SS Wall with SS Door (mm) Column(2)	Setback Distance of SS walls without SS Door (mm) Column(3)
2200 < SH ≤ 2500	3000	2100
2500 < SH ≤ 2800	3000	2200
2800 < SH ≤ 3100	3200	2400
3100 < SH ≤ 3200	3250	2450
3200 < SH ≤ 3400	3300	2500
3400 < SH ≤ 3500	3400	2600
3500 < SH ≤ 4000	3600	2800
4000 < SH ≤ 4500	3850	3050
4500 < SH ≤ 5000	4100	3300
5000 < SH ≤ 5500	4300	3500
5500 < SH ≤ 6000	4550	3750
6000 < SH ≤ 6500	4800	4000
6500 < SH ≤ 7000	5000	4200
7000 < SH ≤ 7500	5250	4450
7500 < SH ≤ 8000	5500	4700
8000 < SH ≤ 8500	5750	4950
8500 < SH ≤ 9000	6000	5200
9000 < SH ≤ 9500	6250	5450
9500 < SH ≤ 10000	6500	5700

b. For SS wall (with door), the setback distance requirement shall be read in conjunction with [Clause 2.5.4](#).

- c. Where the storey height of a SS on the first storey is up to 3.6m and is greater than the storey heights of other SS above it, the minimum setback distances of the SS on the first storey may be the same as the setback distances of the SS above it.
- d. For SS walls (where the SS door is not located), trellis constructed of RC or steel hollow section may be used to make up for the shortfall in setback distance. However, a minimum 1200mm RC ceiling slab from the SS wall shall be provided. Refer to FIGURE 2.4.3(d).

Figures & Tables

FIGURE 2.4.3(d): USAGE OF TRELLIS (RC/STEEL HOLLOW SECTION) TO MAKE UP FOR SHORTFALL IN SETBACK DISTANCE (SS)

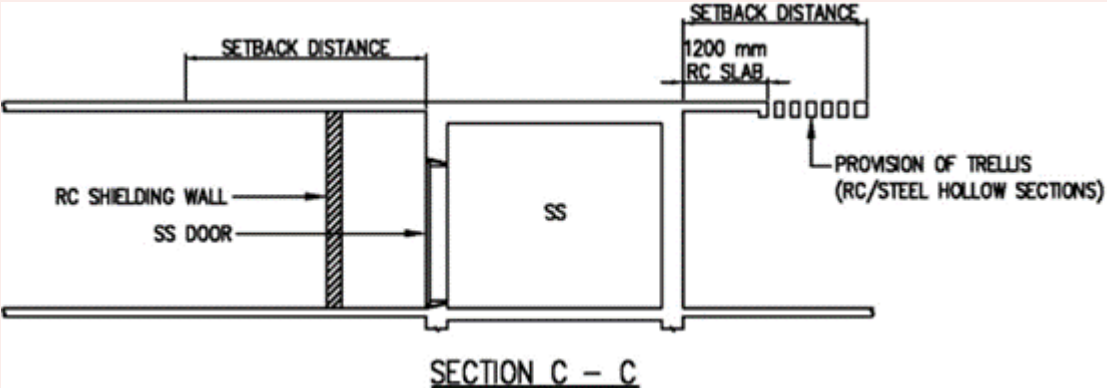

- e. A perpendicular or parallel trellis arrangement, or a combination of both, with respect to the SS wall concerned, shall comply with the geometrical configuration as shown in FIGURE 2.4.3(e) and 2.4.3(f).

Figures & Tables

FIGURE 2.4.3(e): USAGE OF TRELLIS (RC/STEEL HOLLOW SECTION) TO MAKE UP FOR SHORTFALL IN SETBACK DISTANCE (SS)


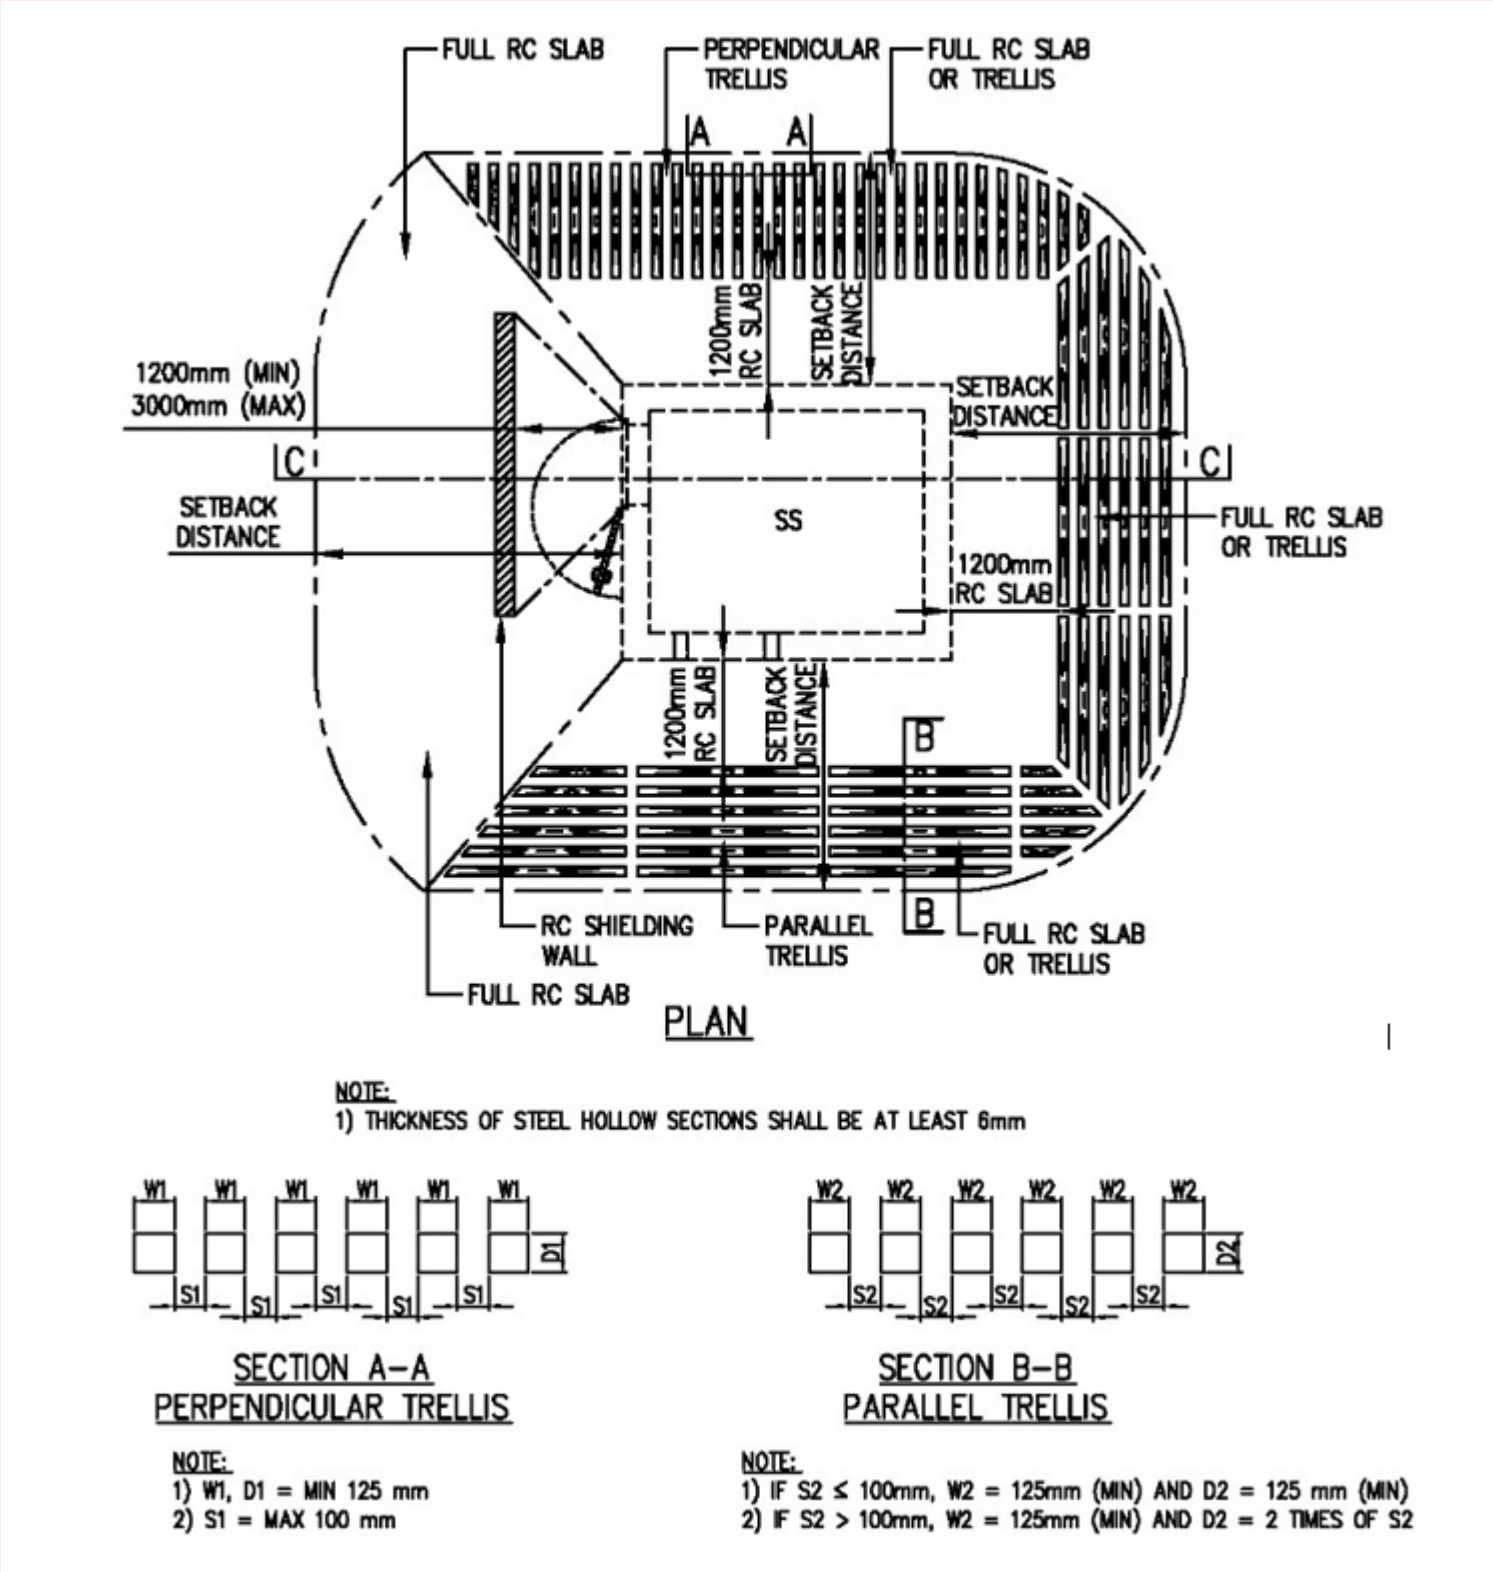


FIGURE 2.4.3(f): USAGE OF TRELLIS (RC/STEEL HOLLOW SECTION) TO MAKE UP FOR SHORTFALL IN SETBACK DISTANCE (S/C SS)

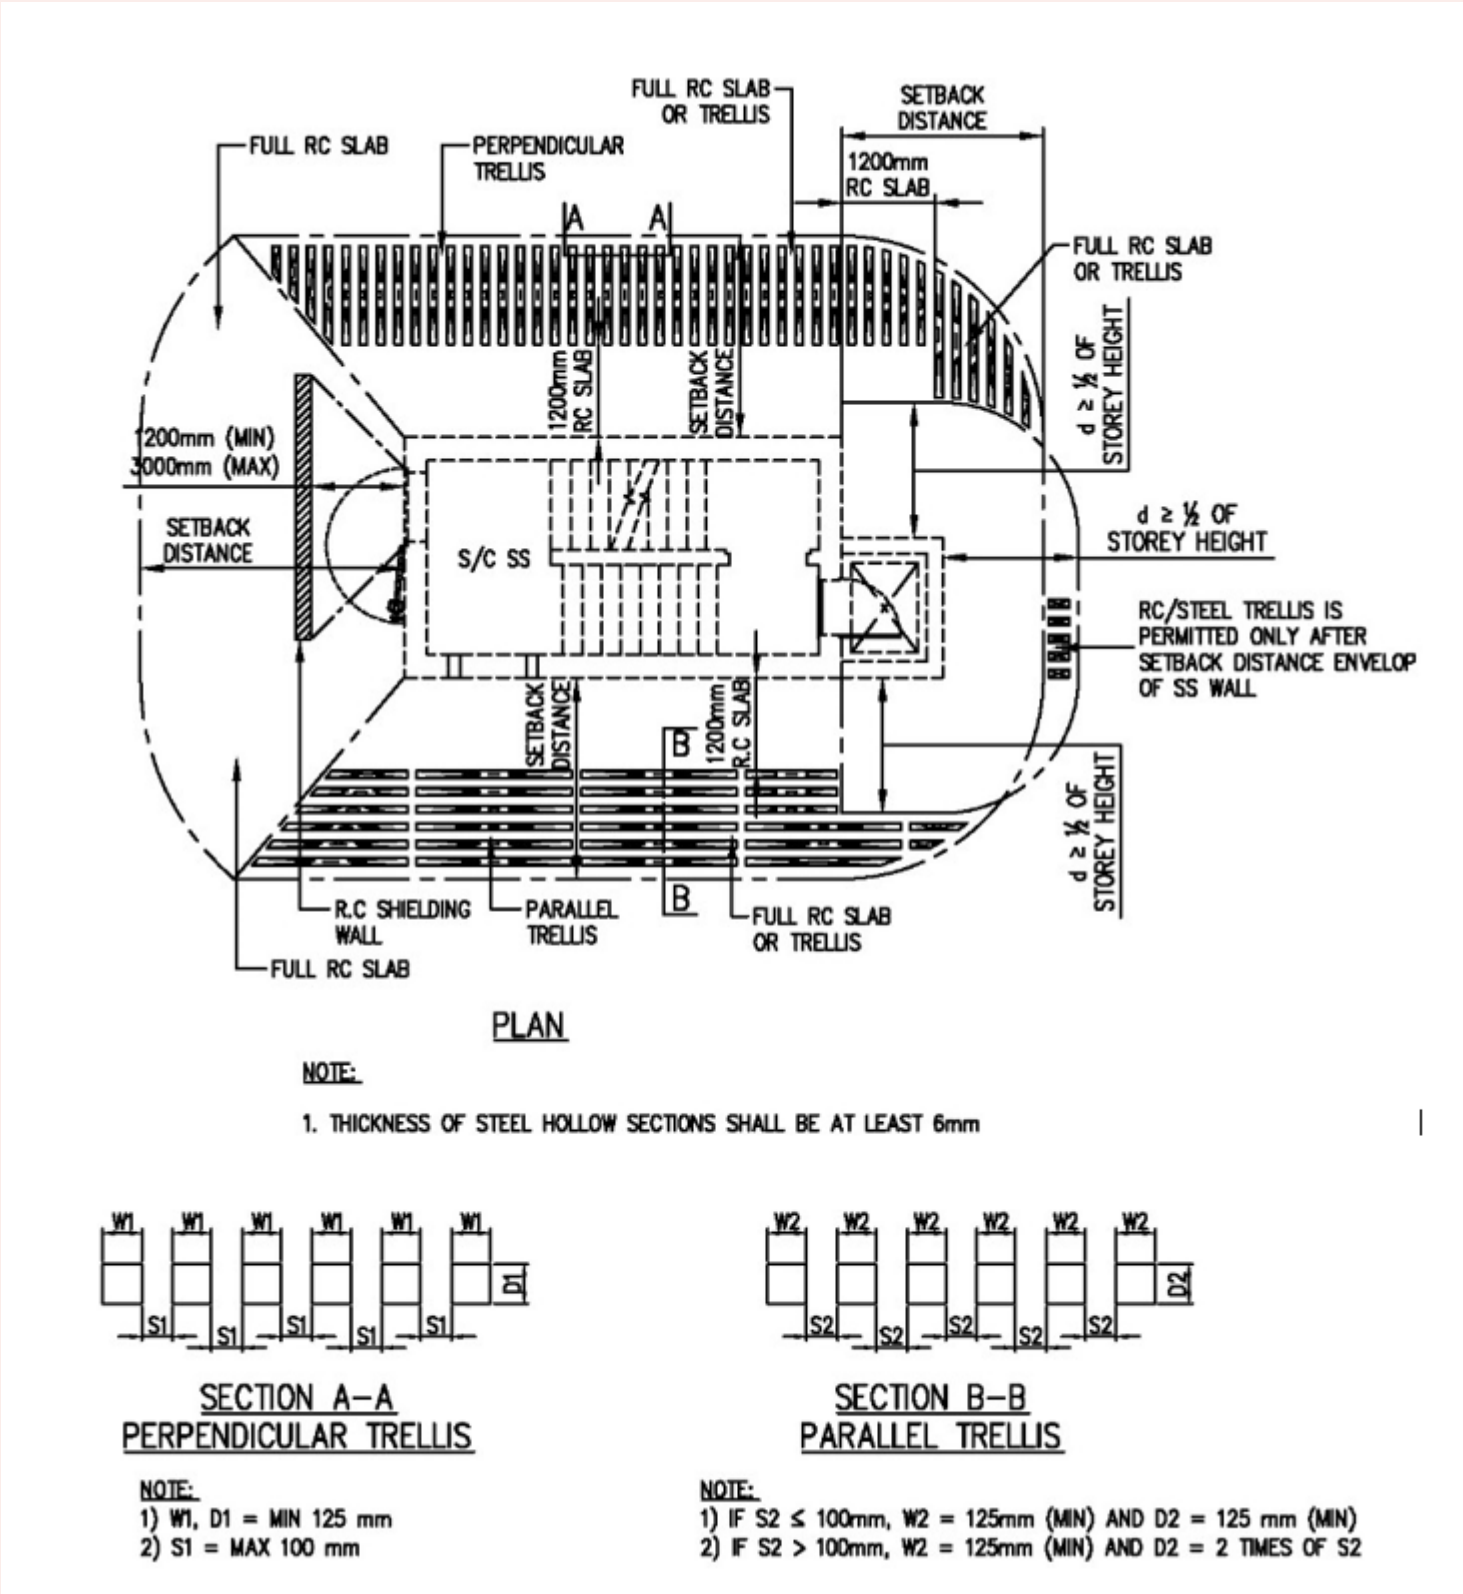

2.4.4 Setback Distances of SS Walls (with Reinforced Concrete Down-hang Beams)

a. Where RC down-hang beams are provided within setback and more than 1200mm away from the SS wall, the minimum setback distance of these SS walls can be reduced based on the effective storey height and in accordance with TABLE 2.4.4. The effective storey height is determined by the storey height less the dimension 'd' of the RC down-hang beam. Refer to FIGURE 2.4.4(a) and 2.4.4(b).


Figures & Tables

TABLE 2.4.4 : MINIMUM SETBACK DISTANCES OF SS WALLS WITH REINFORCED CONCRETE DOWN-HANG BEAM

TABLE 2.4.4 : MINIMUM SETBACK DISTANCES OF SS WALLS WITH REINFORCED CONCRETE DOWN-HANG BEAM		
Effective Storey Height (SH) (Mm)	Setback Distance of SS Wall with SS Door	Setback Distance of SS walls without SS Door
Column(1)	(mm) Column(2)	(mm) Column(3)
2200 < SH ≤ 2500	3000	2100
2500 < SH ≤ 2800	3000	2200
2800 < SH ≤ 3100	3200	2400
3100 < SH ≤ 3200	3250	2450
3200 < SH ≤ 3400	3300	2500
3400 < SH	3400	2600

≤ 3500		
$3500 < SH \leq 4000$	3600	2800
$4000 < SH \leq 4500$	3850	3050
$4500 < SH \leq 5000$	4100	3300
$5000 < SH \leq 5500$	4300	3500
$5500 < SH \leq 6000$	4550	3750
$6000 < SH \leq 6500$	4800	4000
$6500 < SH \leq 7000$	5000	4200
$7000 < SH \leq 7500$	5250	4450
$7500 < SH \leq 8000$	5500	4700
$8000 < SH \leq 8500$	5750	4950
$8500 < SH \leq 9000$	6000	5200
$9000 < SH \leq 9500$	6250	5450
$9500 < SH \leq 10000$	6500	5700

FIGURE 2.4.4(a): REQUIREMENT ON SETBACK DISTANCE OF SS WALLS (WITH DOWN-HANG BEAM) (EFFECTIVE STOREY HEIGHT = STOREY HEIGHT - DIMENSION 'd' OF DOWN-HANG BEAM)

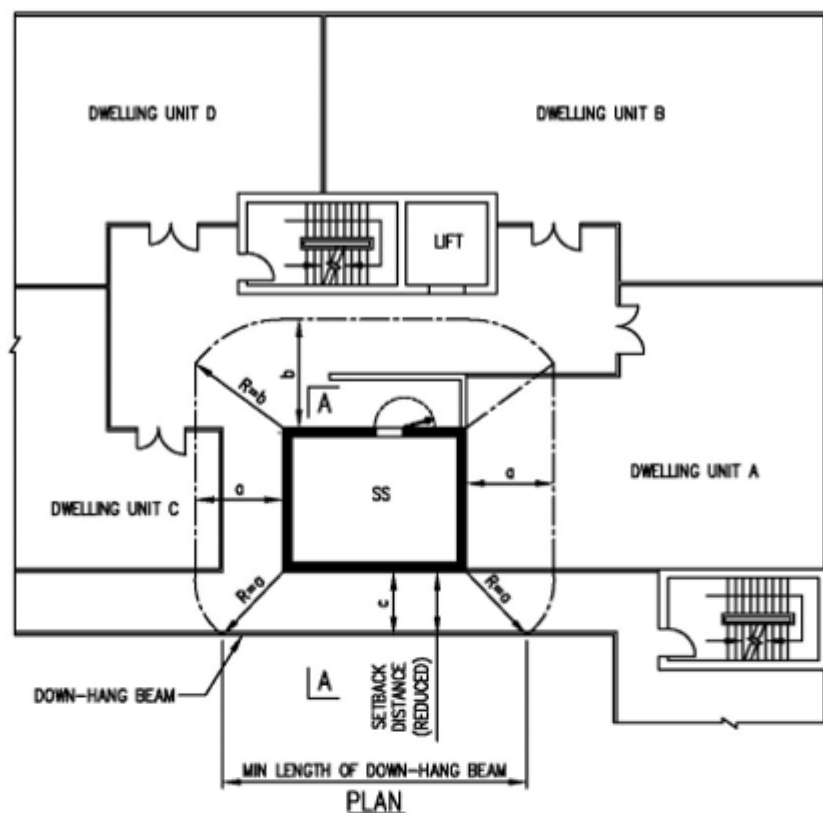

NOTE:
1) $b > a$, $a > c$


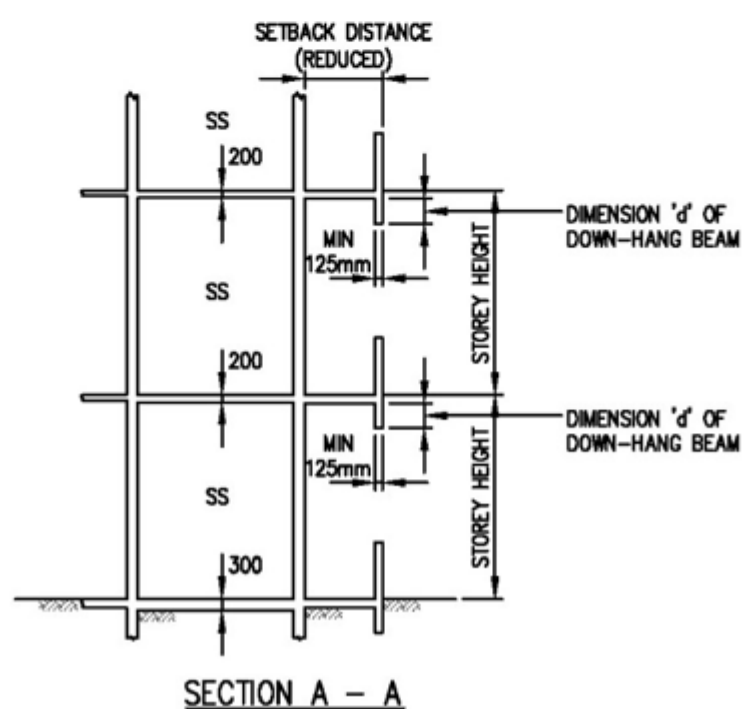



FIGURE 2.4.4(b): DOWN-HANG BEAM LOCATED ALONG THE SETBACK DISTANCE

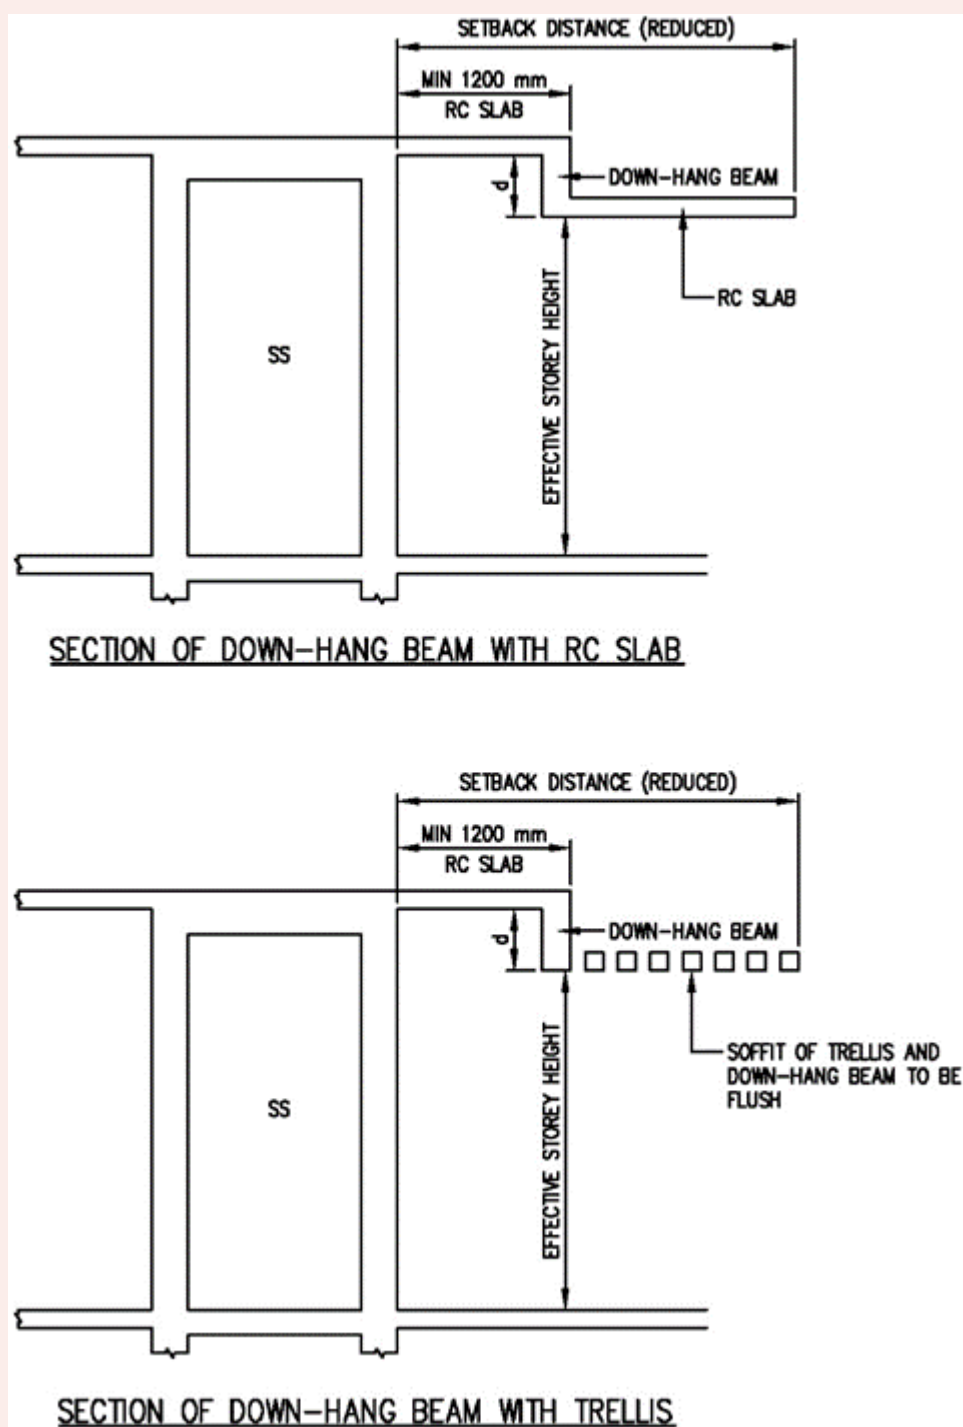

- b. For SS wall (with door), the setback distance requirement shall be read in conjunction with [Clause 2.5.4](#).
- c. [Clause 2.4.4](#) shall apply only if the width of the reinforced concrete down-hang beam is at least 125mm.
- d. Where the storey height of a SS on the first storey is up to 3.6m and is greater than the storey height of the SS directly above it, the minimum setback distances of the SS on the 1st storey shall be at least the same as the setback distances of the SS above it. Where a RC down-hang beam is provided at the 2nd storey ceiling slab, the same down-hang beam shall be provided at the 1st storey ceiling slab.
- e. For SS walls (where the SS door is not located), RC ledge or trellis constructed of RC or steel hollow section may be used to make up for the shortfall in setback distance. However, a minimum 1200mm RC ceiling slab from the SS wall shall be provided as shown in [FIGURE 2.4.4\(b\)](#).

Figures & Tables


FIGURE 2.4.4(b): DOWN-HANG BEAM LOCATED ALONG THE SETBACK DISTANCE

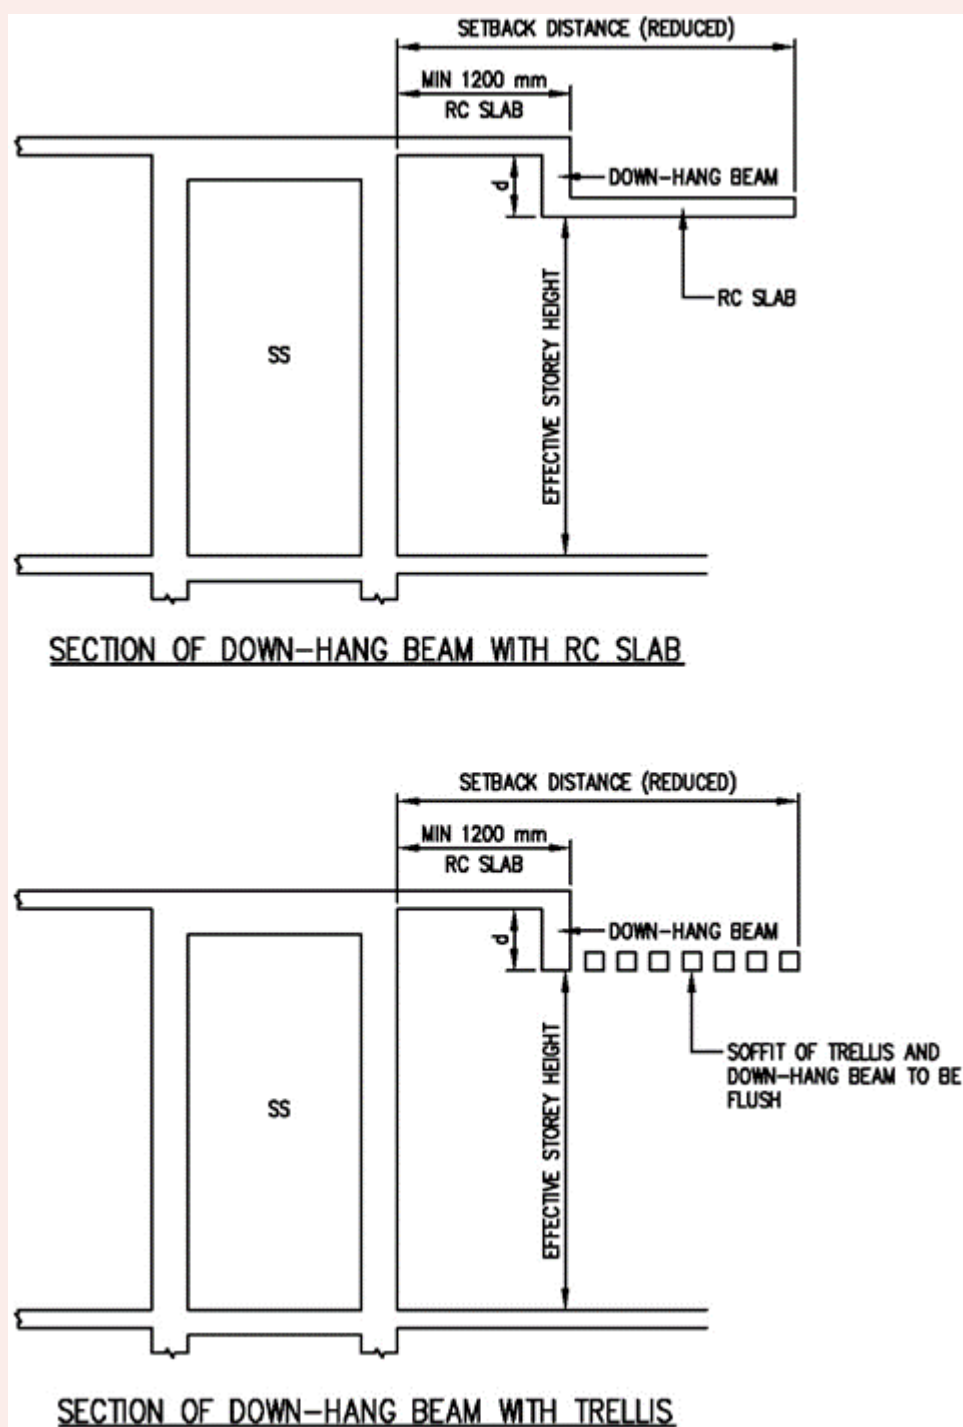


f. A perpendicular or parallel trellis arrangement, or a combination of both, with respect to the SS wall concerned, shall comply with the geometrical configuration as shown in FIGURE 2.4.3(e) and 2.4.3(f).

Figures & Tables

FIGURE 2.4.3(e): USAGE OF TRELLIS (RC/STEEL HOLLOW SECTION) TO MAKE UP FOR SHORTFALL IN SETBACK DISTANCE (SS)

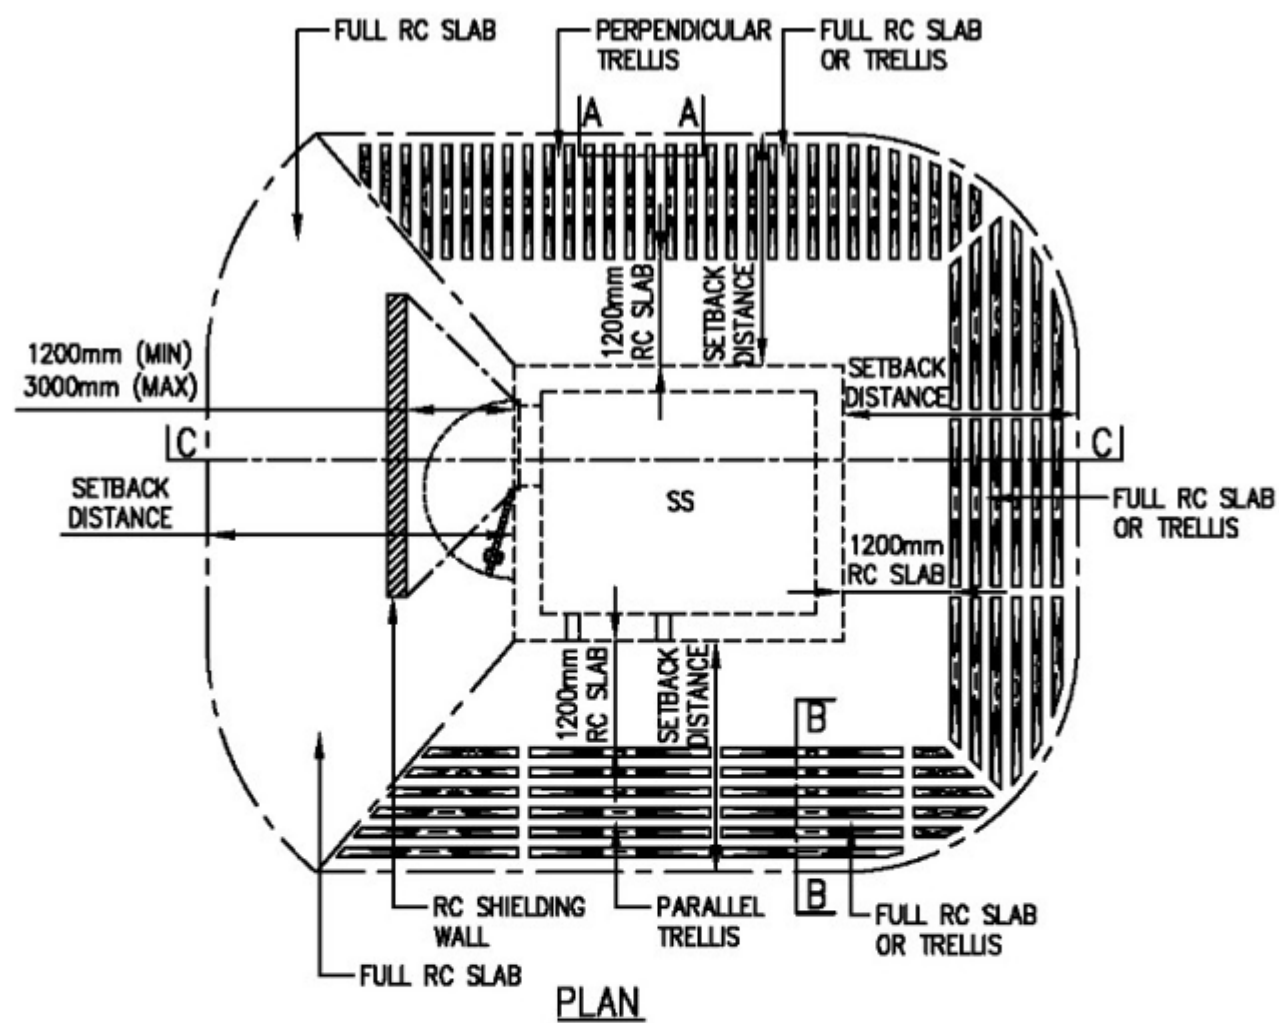


NOTE:
1) THICKNESS OF STEEL HOLLOW SECTIONS SHALL BE AT LEAST 6mm

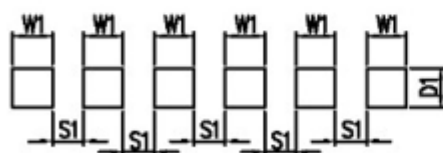

SECTION A-A
PERPENDICULAR TRELLIS


NOTE:
1) W1, D1 = MIN 125 mm
2) S1 = MAX 100 mm

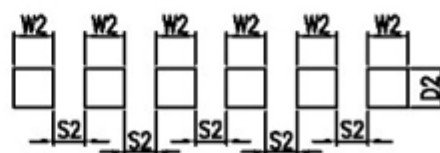

SECTION B-B
PARALLEL TRELLIS

NOTE:
1) IF $S2 \leq 100\text{mm}$, $W2 = 125\text{mm (MIN)}$ AND $D2 = 125\text{ mm (MIN)}$
2) IF $S2 > 100\text{mm}$, $W2 = 125\text{mm (MIN)}$ AND $D2 = 2\text{ TIMES OF } S2$


FIGURE 2.4.3(f): USAGE OF TRELLIS (RC/STEEL HOLLOW SECTION) TO MAKE UP FOR SHORTFALL IN SETBACK DISTANCE (S/C SS)

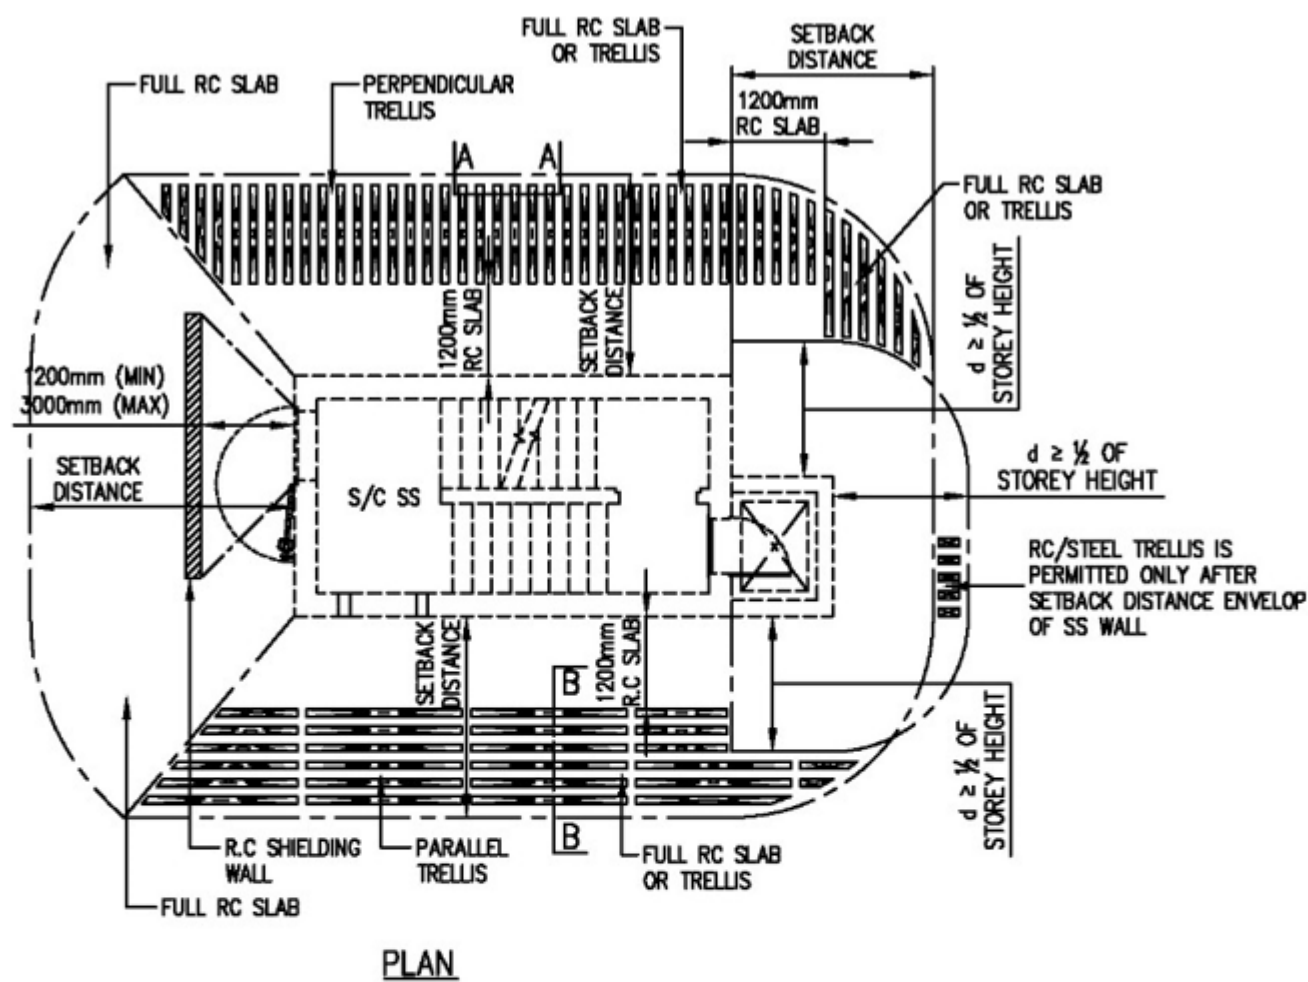

PLAN

NOTE:

1. THICKNESS OF STEEL HOLLOW SECTIONS SHALL BE AT LEAST 6mm

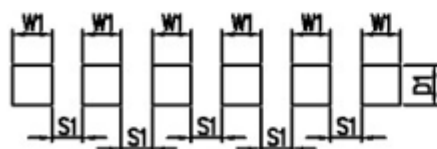

**SECTION A-A
PERPENDICULAR TRELLIS**

NOTE:

- 1) W1, D1 = MIN 125 mm
- 2) S1 = MAX 100 mm



**SECTION B-B
PARALLEL TRELLIS**

NOTE:


- 1) IF $S2 \leq 100\text{mm}$, $W2 = 125\text{mm (MIN)}$ AND $D2 = 125\text{ mm (MIN)}$
- 2) IF $S2 > 100\text{mm}$, $W2 = 125\text{mm (MIN)}$ AND $D2 = 2\text{ TIMES OF } S2$

2.4.5 RC Lift Core or/ and RC Refuse Chute or/ and Service Risers, within Setback Distances of SS Walls

- a. RC lift core can be located within the setback distance of SS, S/C SS or scissor S/C SS walls. An additional 50mm thickness shall be provided to the SS, S/C SS or scissor S/C SS wall abutting the RC lift core as shown in FIGURE 2.4.1.

Figures & Tables

FIGURE 2.4.1: SS LOCATED NEXT TO LIFT SHAFT

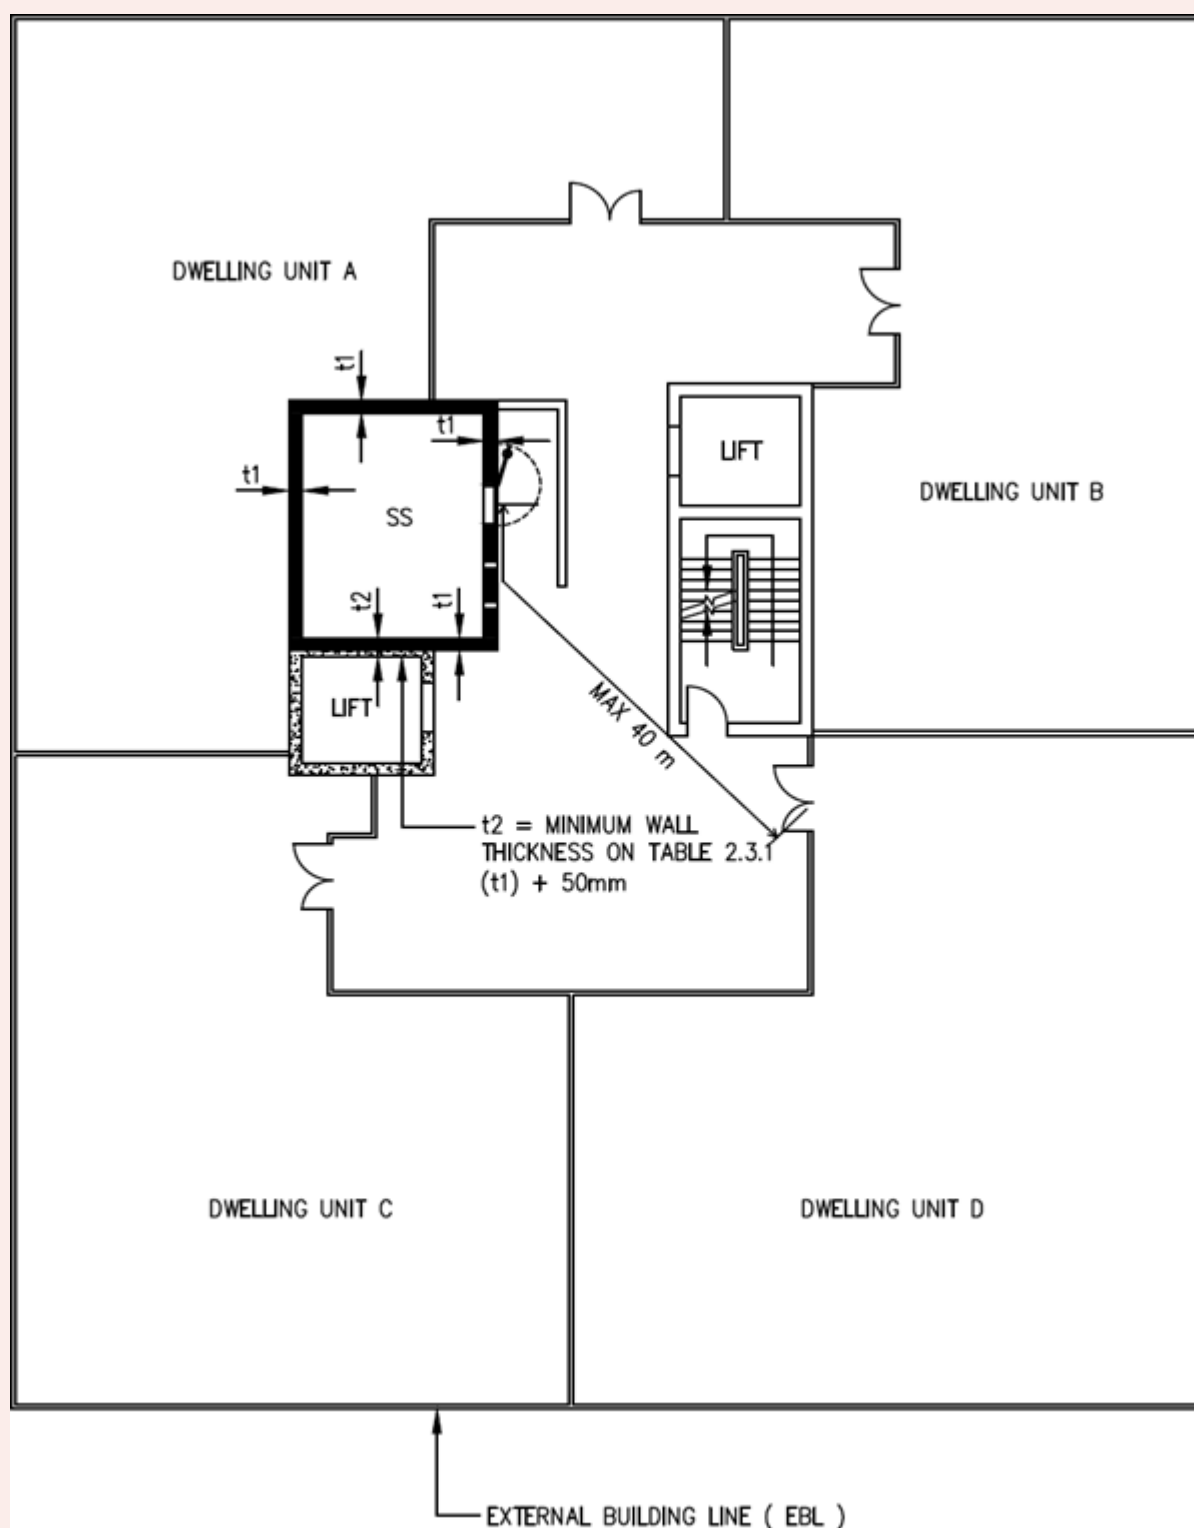

b. RC refuse chute are allowed within the setback distance envelope of the SS wall provided that the design of the RC refuse chute walls and ventilated openings at the roof level comply with the details as shown in FIGURE 2.4.5(a) and 2.4.5(b).

Figures & Tables

FIGURE 2.4.5(a): PROTECTION REQUIREMENT AT ROOF LEVEL FOR PROVISION OF RC REFUSE CHUTE LOCATED WITHIN SETBACK DISTANCE ENVELOP


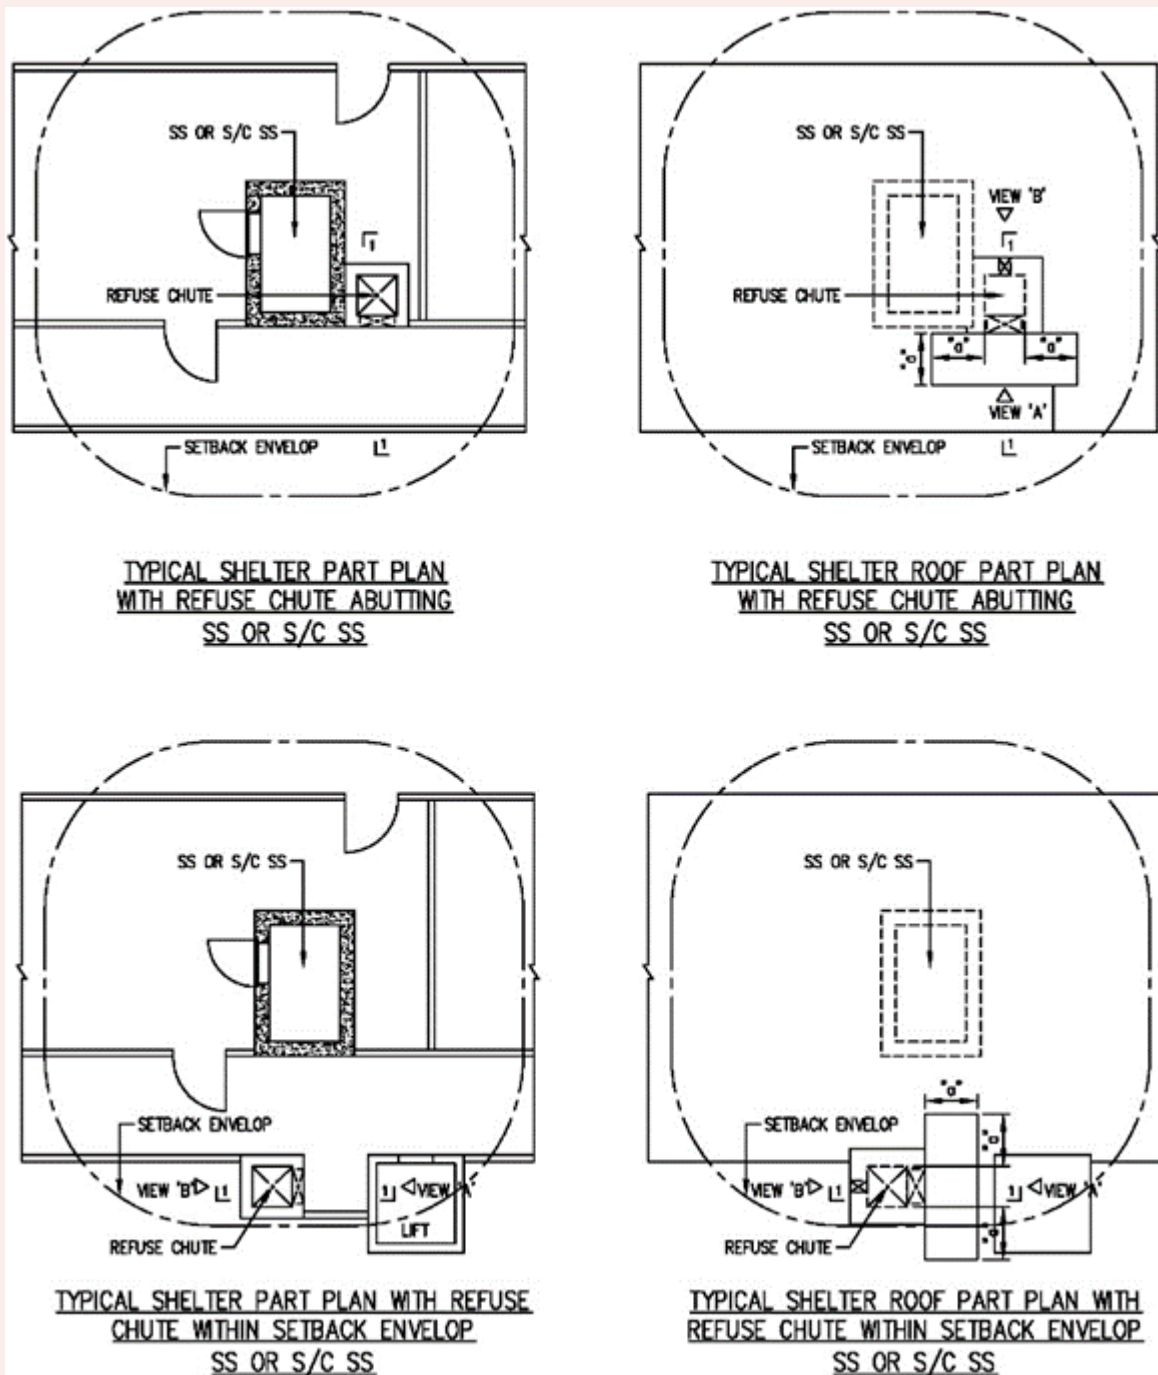



FIGURE 2.4.5(b): PROTECTION REQUIREMENT AT ROOF LEVEL FOR PROVISION OF RC REFUSE CHUTE LOCATED WITHIN SETBACK DISTANCE ENVELOP

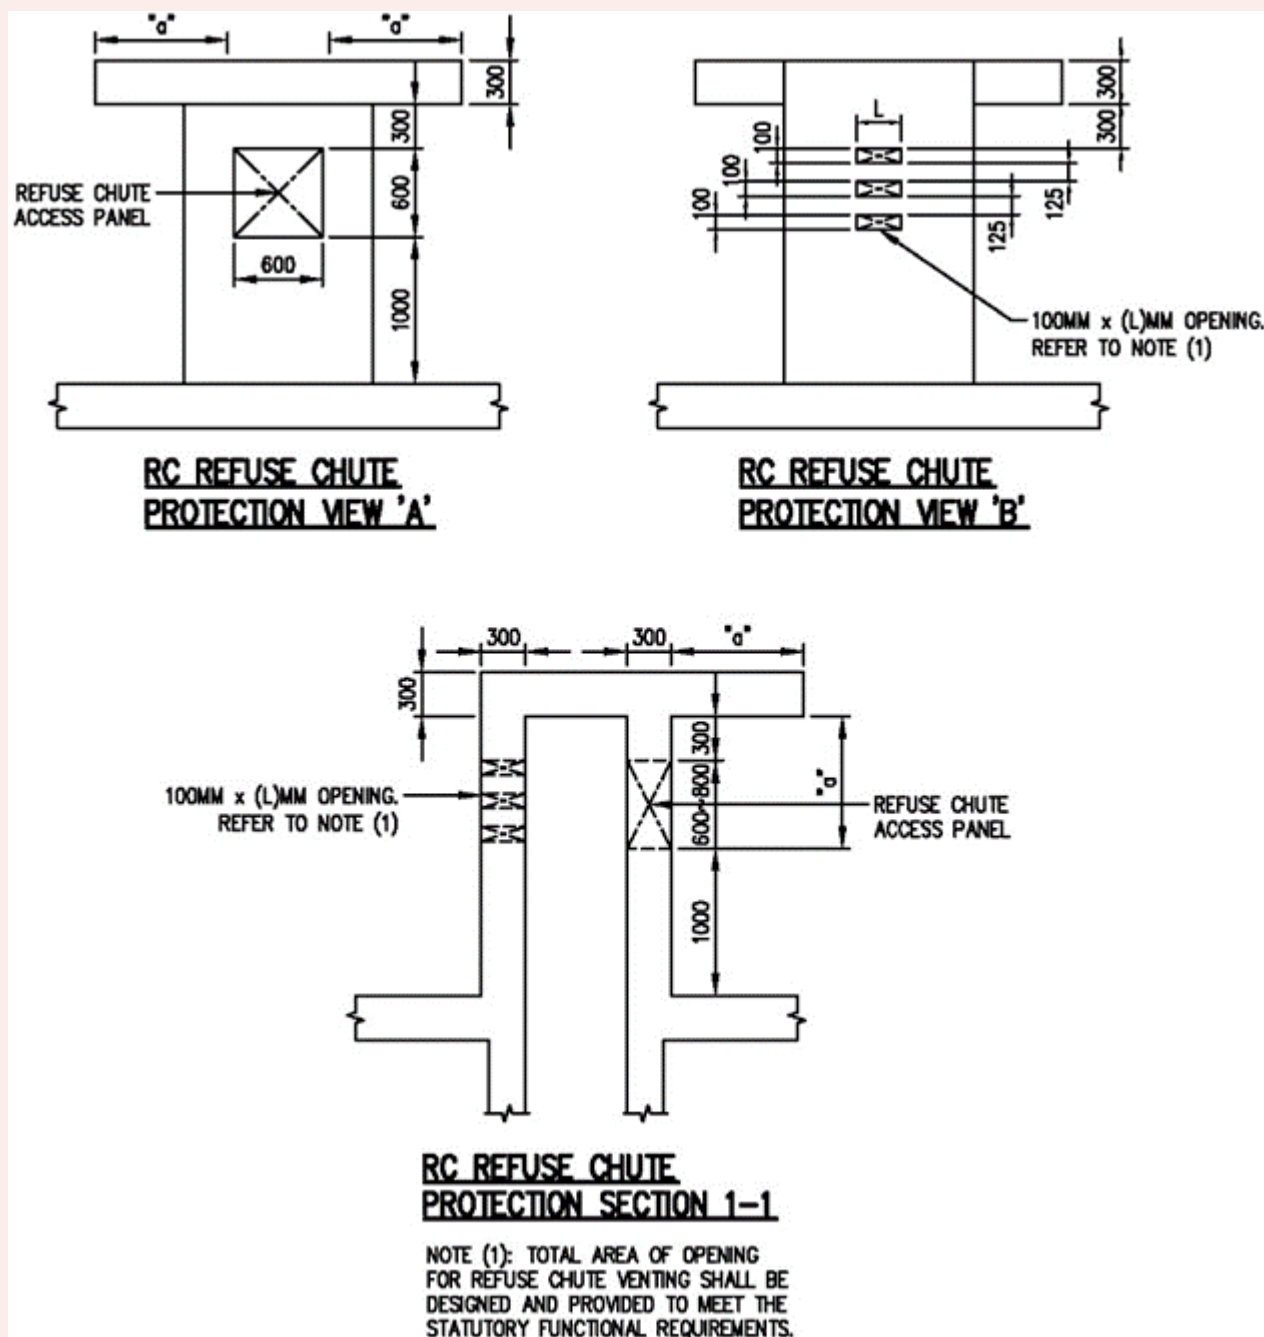


c. Service risers are allowed within the setback distance envelope of the SS wall (with or without door). The design shall comply with the details as shown in FIGURE 2.4.5(c) and 2.4.5(d), provided that the ceiling slab at the roof level is of reinforced concrete, and the relevant fire safety requirements for compartmentalisation of the service risers.

Figures & Tables

FIGURE 2.4.5(c): SERVICE RISERS ABUTTING S/C SS WALLS

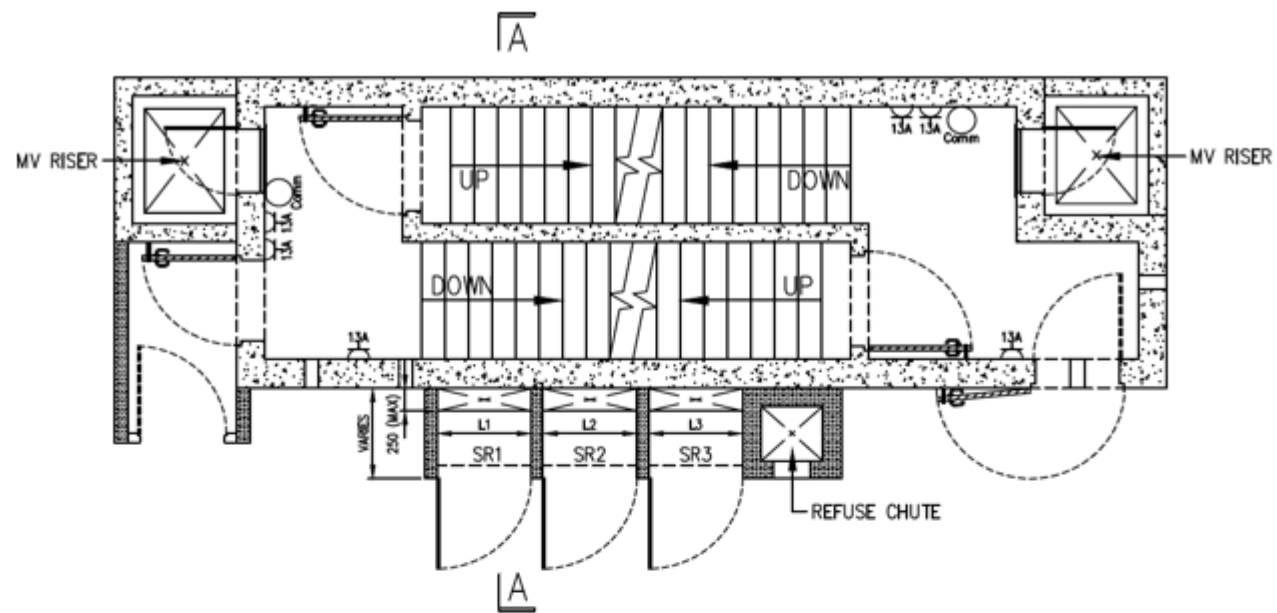

TOP-MOST COMPARTMENT PLAN FOR
STAIRCASE STOREY SHELTER

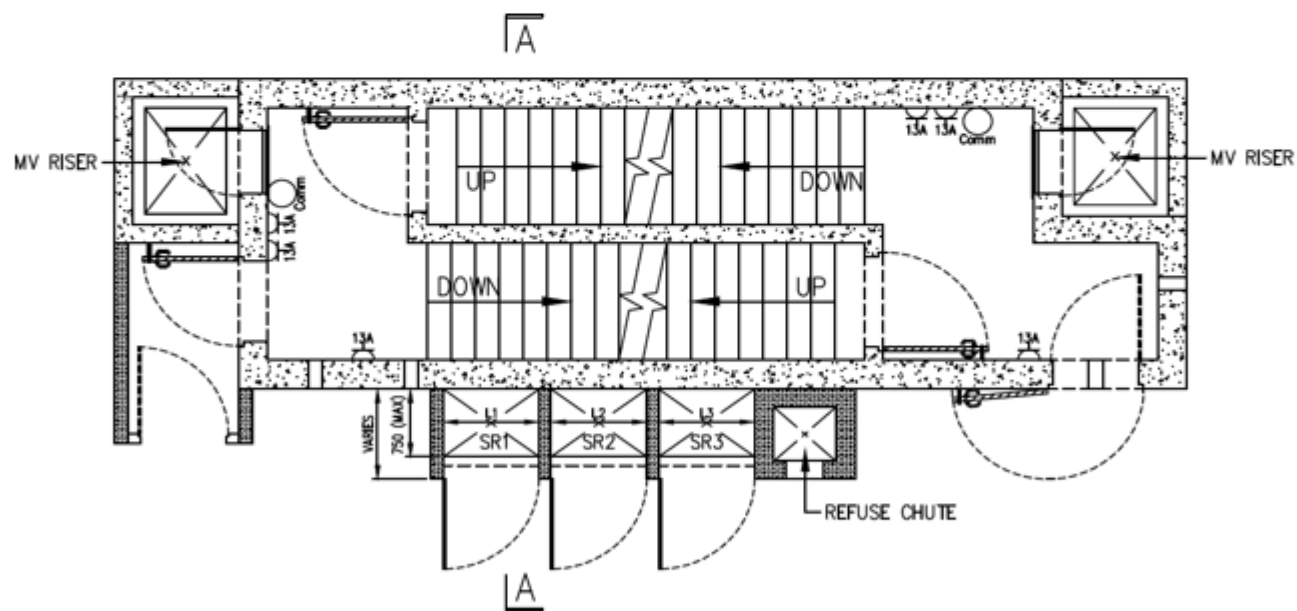


TYPICAL STOREY COMPARTMENT PLAN FOR
STAIRCASE STOREY SHELTER

NOTE:

- 1) SR = SERVICE RISER
- 2) L1, L2, & L3 = 2000mm(MAX)
- 3) DESIGN OF SERVICE RISER SHALL COMPLY WITH STATUTORY REQUIREMENTS, INCLUDING PROVISION OF MS GRATING OR WALKWAY MESH WITH ANGLE CLEAT ON EVERY STOREY TO COMPLY WITH SAFETY FROM FALLING

FIGURE 2.4.5(d): SERVICE RISERS ABUTTING S/C SS WALLS

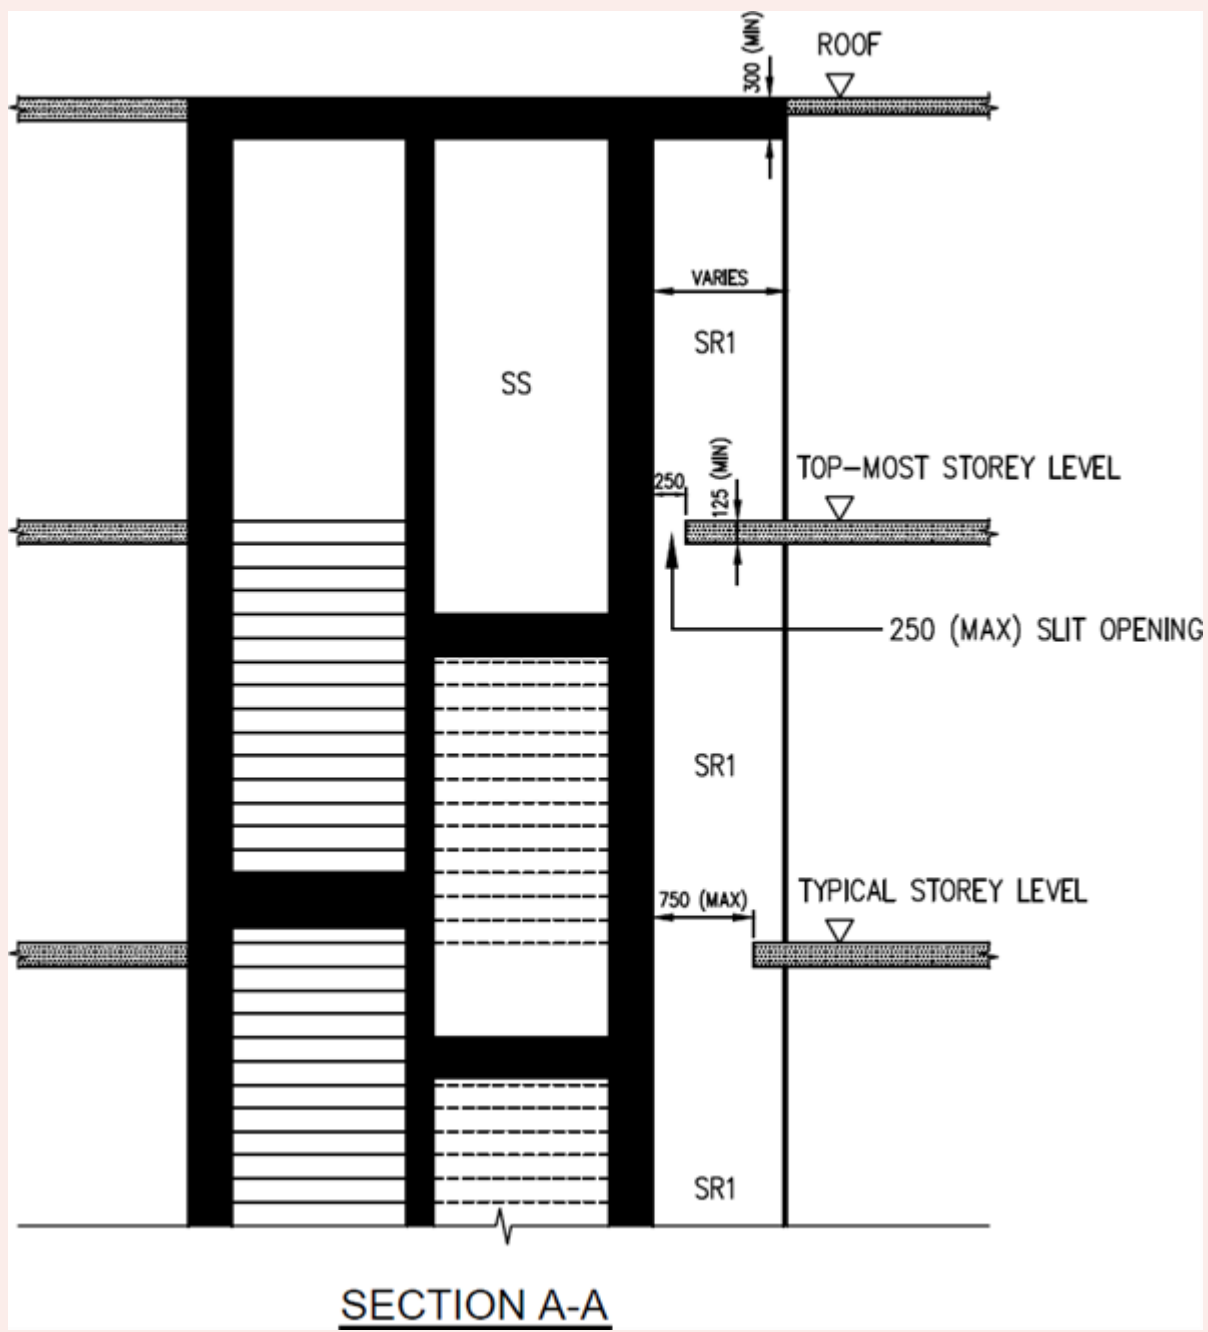

d. For gas riser and any service risers within the setback distance and protrude above the main roof, the design shall comply with the requirements as shown in FIGURE 2.4.5(e) to 2.4.5(g)

Figures & Tables

FIGURE 2.4.5(e): PROTECTION REQUIREMENT AT ROOF LEVEL FOR PROVISION OF GAS AND WATER RISER LOCATED WITHIN SETBACK DISTANCE ENVELOP (TYPE A)

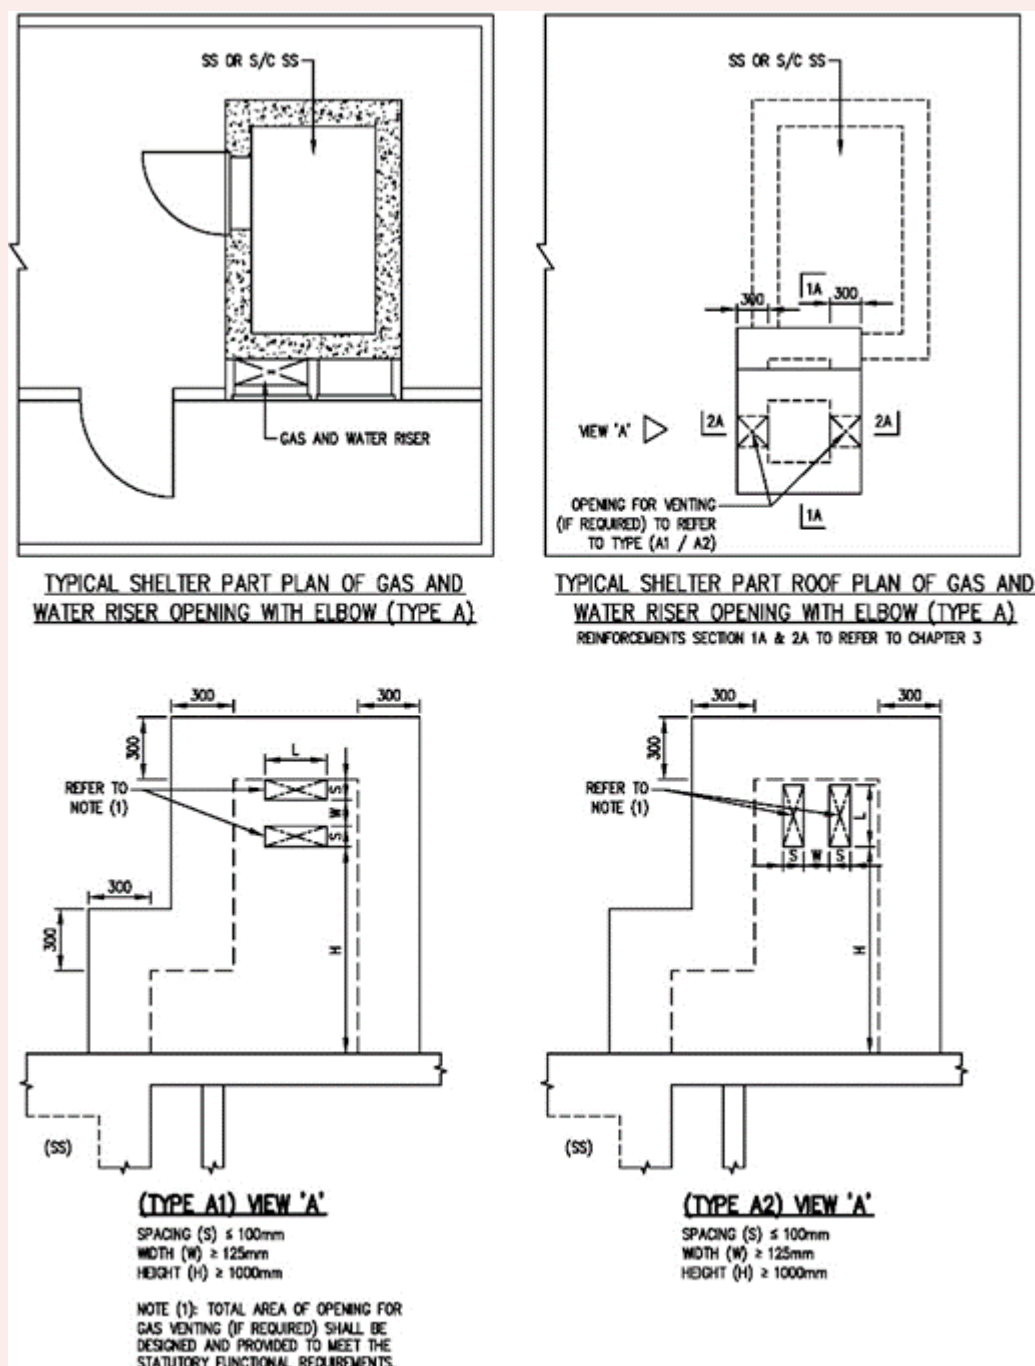


FIGURE 2.4.5(f): PROTECTION REQUIREMENT AT ROOF LEVEL FOR PROVISION OF GAS AND WATER RISER LOCATED WITHIN SETBACK DISTANCE ENVELOP (TYPE B)


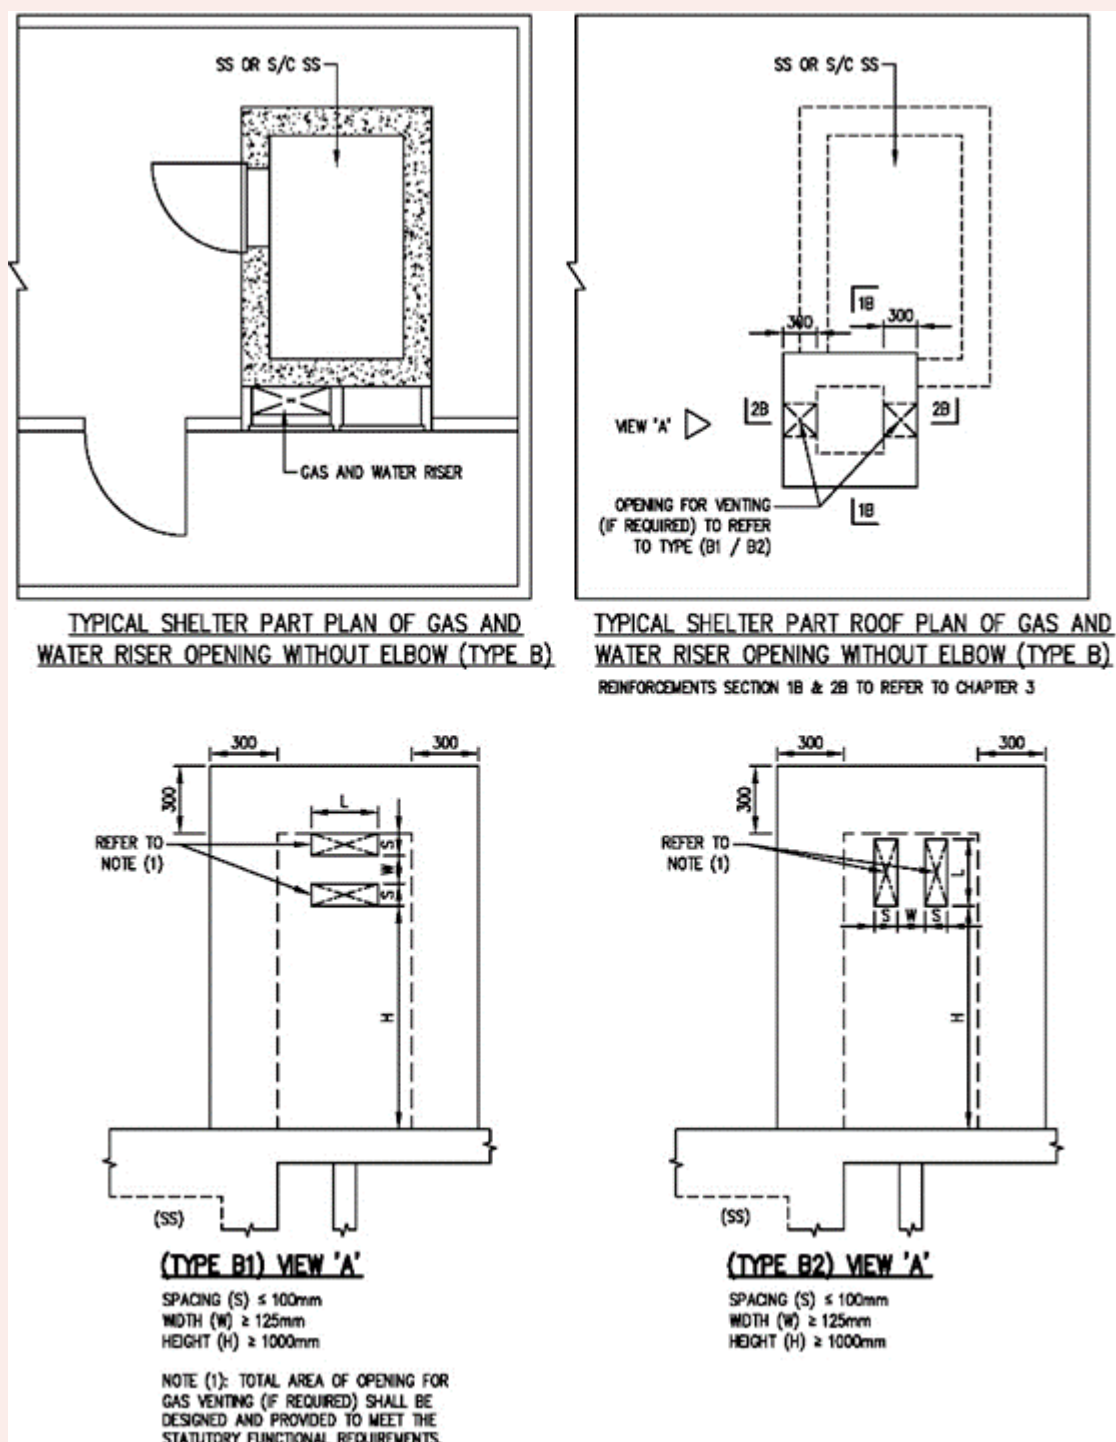



FIGURE 2.4.5(g): PROTECTION REQUIREMENT AT ROOF LEVEL FOR PROVISION OF ANY OTHER SERVICE RISERS WITH SERVICE DOOR OPENING, LOCATED WITHIN SETBACK DISTANCE ENVELOP

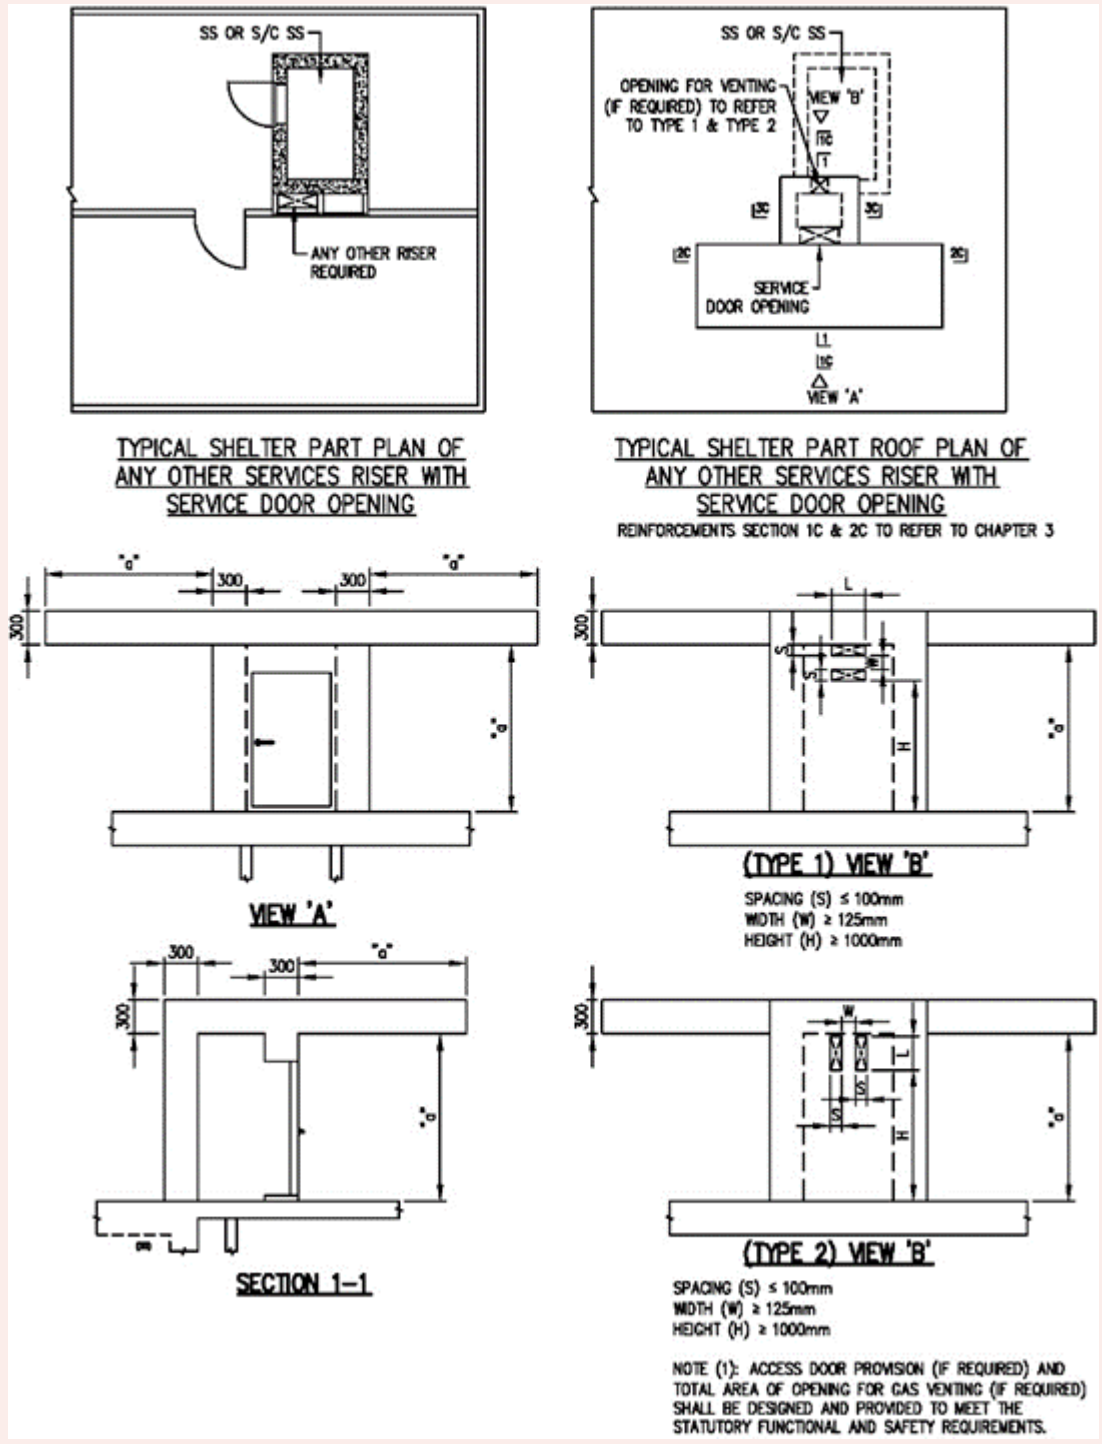

e. The gas riser and/or RC refuse chute and any service risers that protrude above the main roof, designed within the setback distance envelope of the SS wall (with door) shall be located away from 45° influence zone from SS door. Refer to FIGURE 2.5.4(e).

Figures & Tables

FIGURE 2.5.4(e): SHIELDING FOR SS DOOR

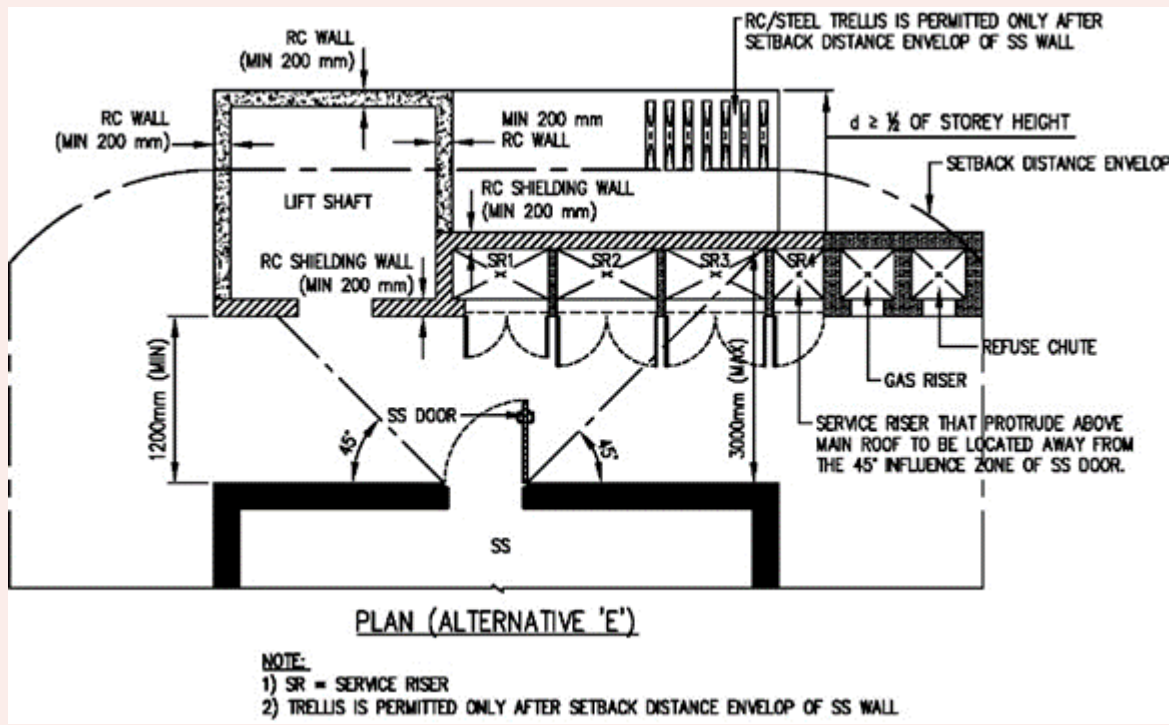


2.4.6 Voids within SS Setback Distances

Voids can be located within the SS setback distance and shall comply with the following requirements. Refer to FIGURE 2.4.6.

Figures & Tables

FIGURE 2.4.6: CONTROL REQUIRMENTS FOR VOIDS

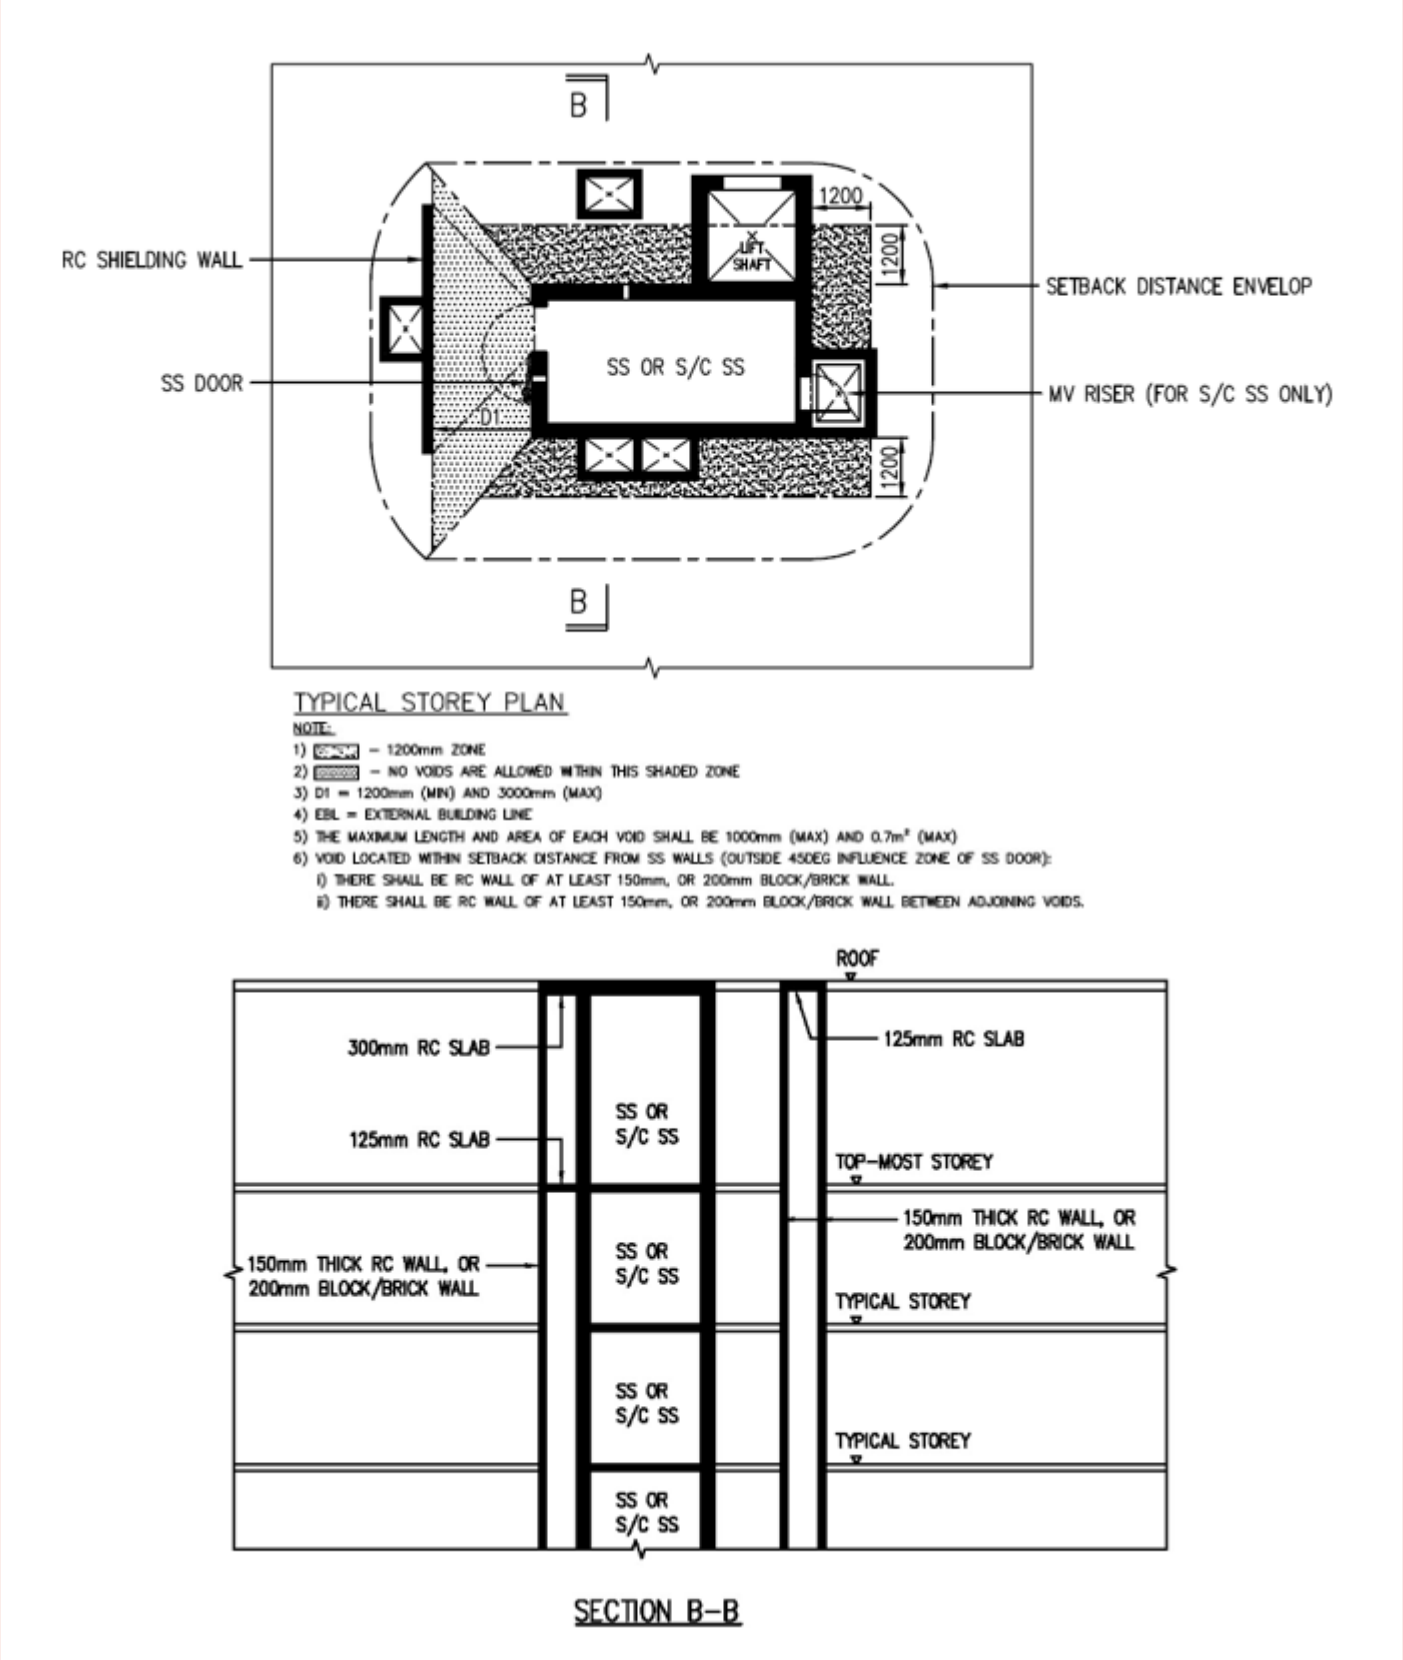


- a. Void located within 1200mm boundary from SS walls:
 - i. The void shall be enclosed by minimum thickness of 150mm RC walls or 200mm block/ brick walls.
 - ii. The maximum length and area of each void shall be 1000mm and 0.7m² respectively.
 - iii. There shall be at least a 150mm RC wall or 200mm block/ brick wall between adjoining voids.
 - iv. RC slab of at least 300mm thick shall be provided at the roof of the void.
 - v. RC slab of at least 125mm thick shall be provided to cover the void at the top- most storey level immediately below the roof slab.
- b. Void located beyond 1200mm boundary from SS walls:
 - i. The voids shall be enclosed by minimum thickness of 150mm RC walls or 200mm block/ brick walls.
 - ii. The maximum length and area of each void shall be 1000mm and 0.7m² respectively.
 - iii. There shall be at least a 150mm RC wall or 200mm block/ brick wall between adjoining voids.
 - iv. RC slab of at least 125mm thick shall be provided at the roof of the void.

CLAUSE 2.5 SS DOOR

2.5.1 Opening Dimensions

The opening dimensions of SS door shall be:

- a. For SS – 900(W) mm x 1900(H) mm
- b. For S/C SS and scissor S/C SS
 - i. For entrance SS door, the dimension shall be 900(W) mm or 1000(W) mm x 2055(H) mm.
 - ii. For internal SS door at mid-landing or main landing in the staircase, the dimension shall be 1000(W) mm x 2055(H) mm.
- c. SS door frame that is cast together with the SS wall shall have single or double door rebate. Refer to FIGURE 2.5.1(a) and 2.5.1(b).

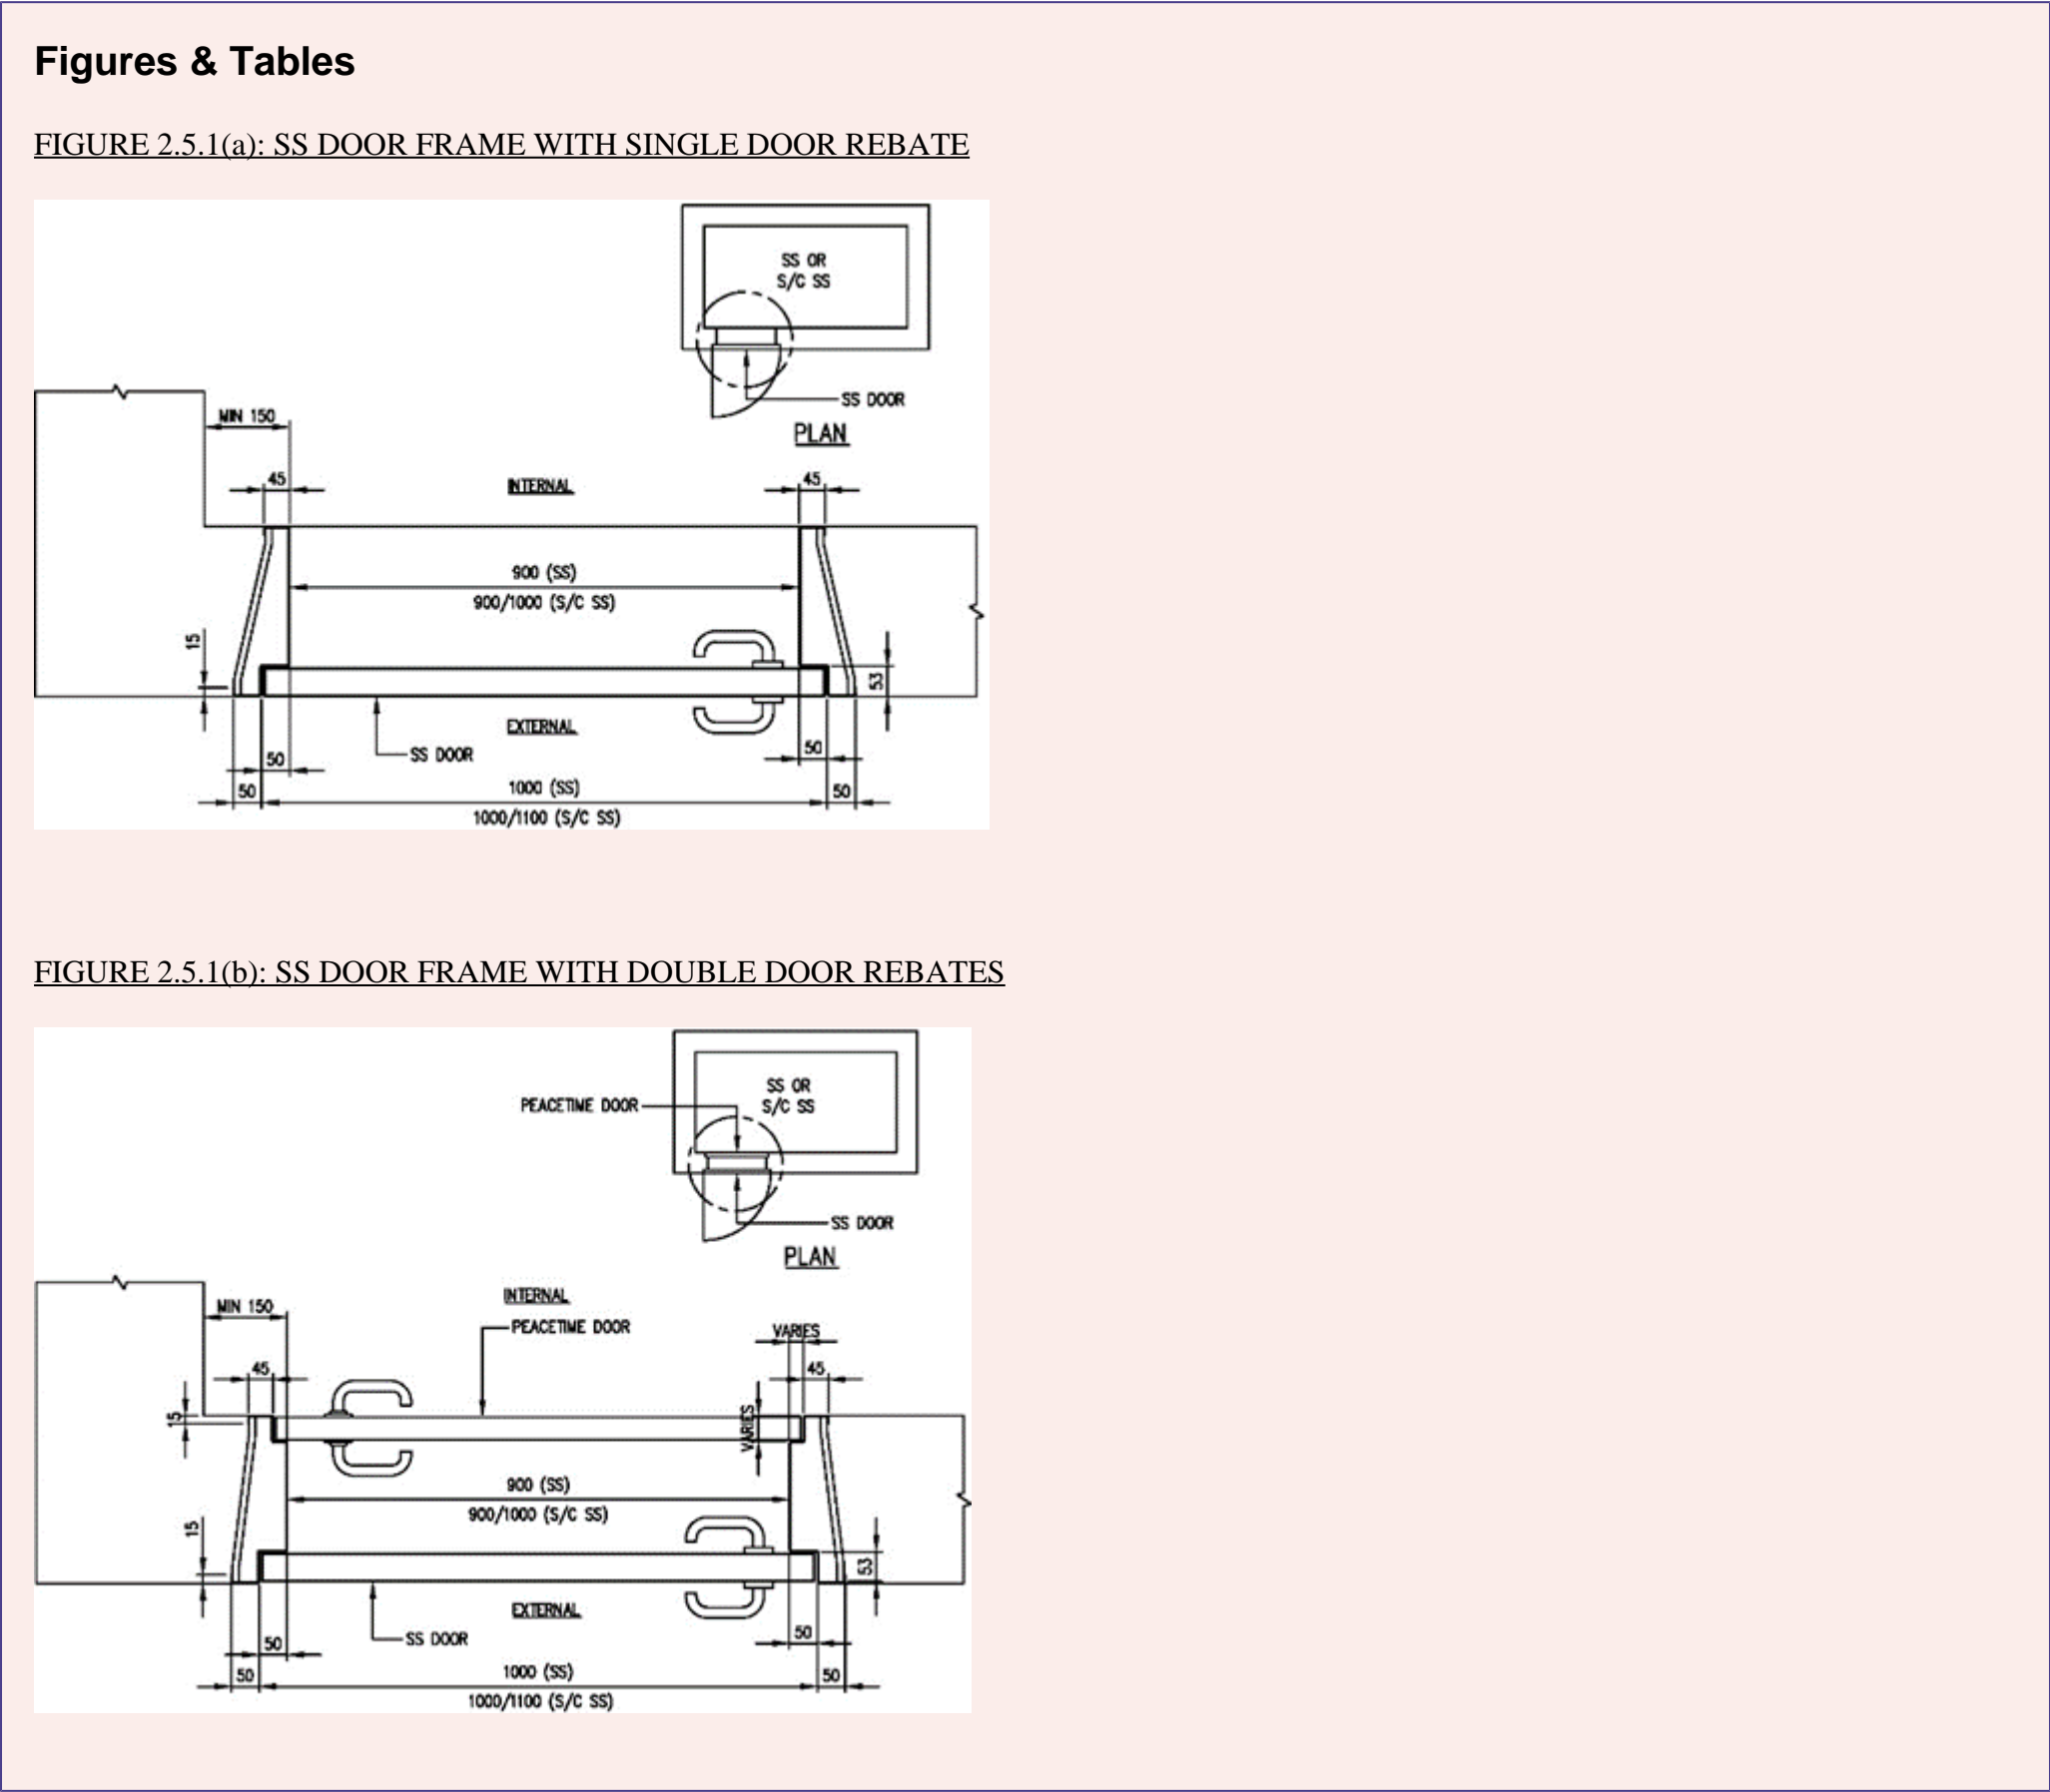


2.5.2 Location

The SS door shall be located in a SS wall with a minimum setback distance of 3000mm and shall not swing in a direction that will clash with the swing path of another peacetime door. Refer to FIGURE 2.5.2.

Figures & Tables

FIGURE 2.5.2: STAIRCASE SS COMPARTMENT WITH CLEAR DOOR SWING ZONE OF FIRE DOOR AND INTERNAL OR EXTERNAL SS DOOR OPENING IN SAME LOCATION

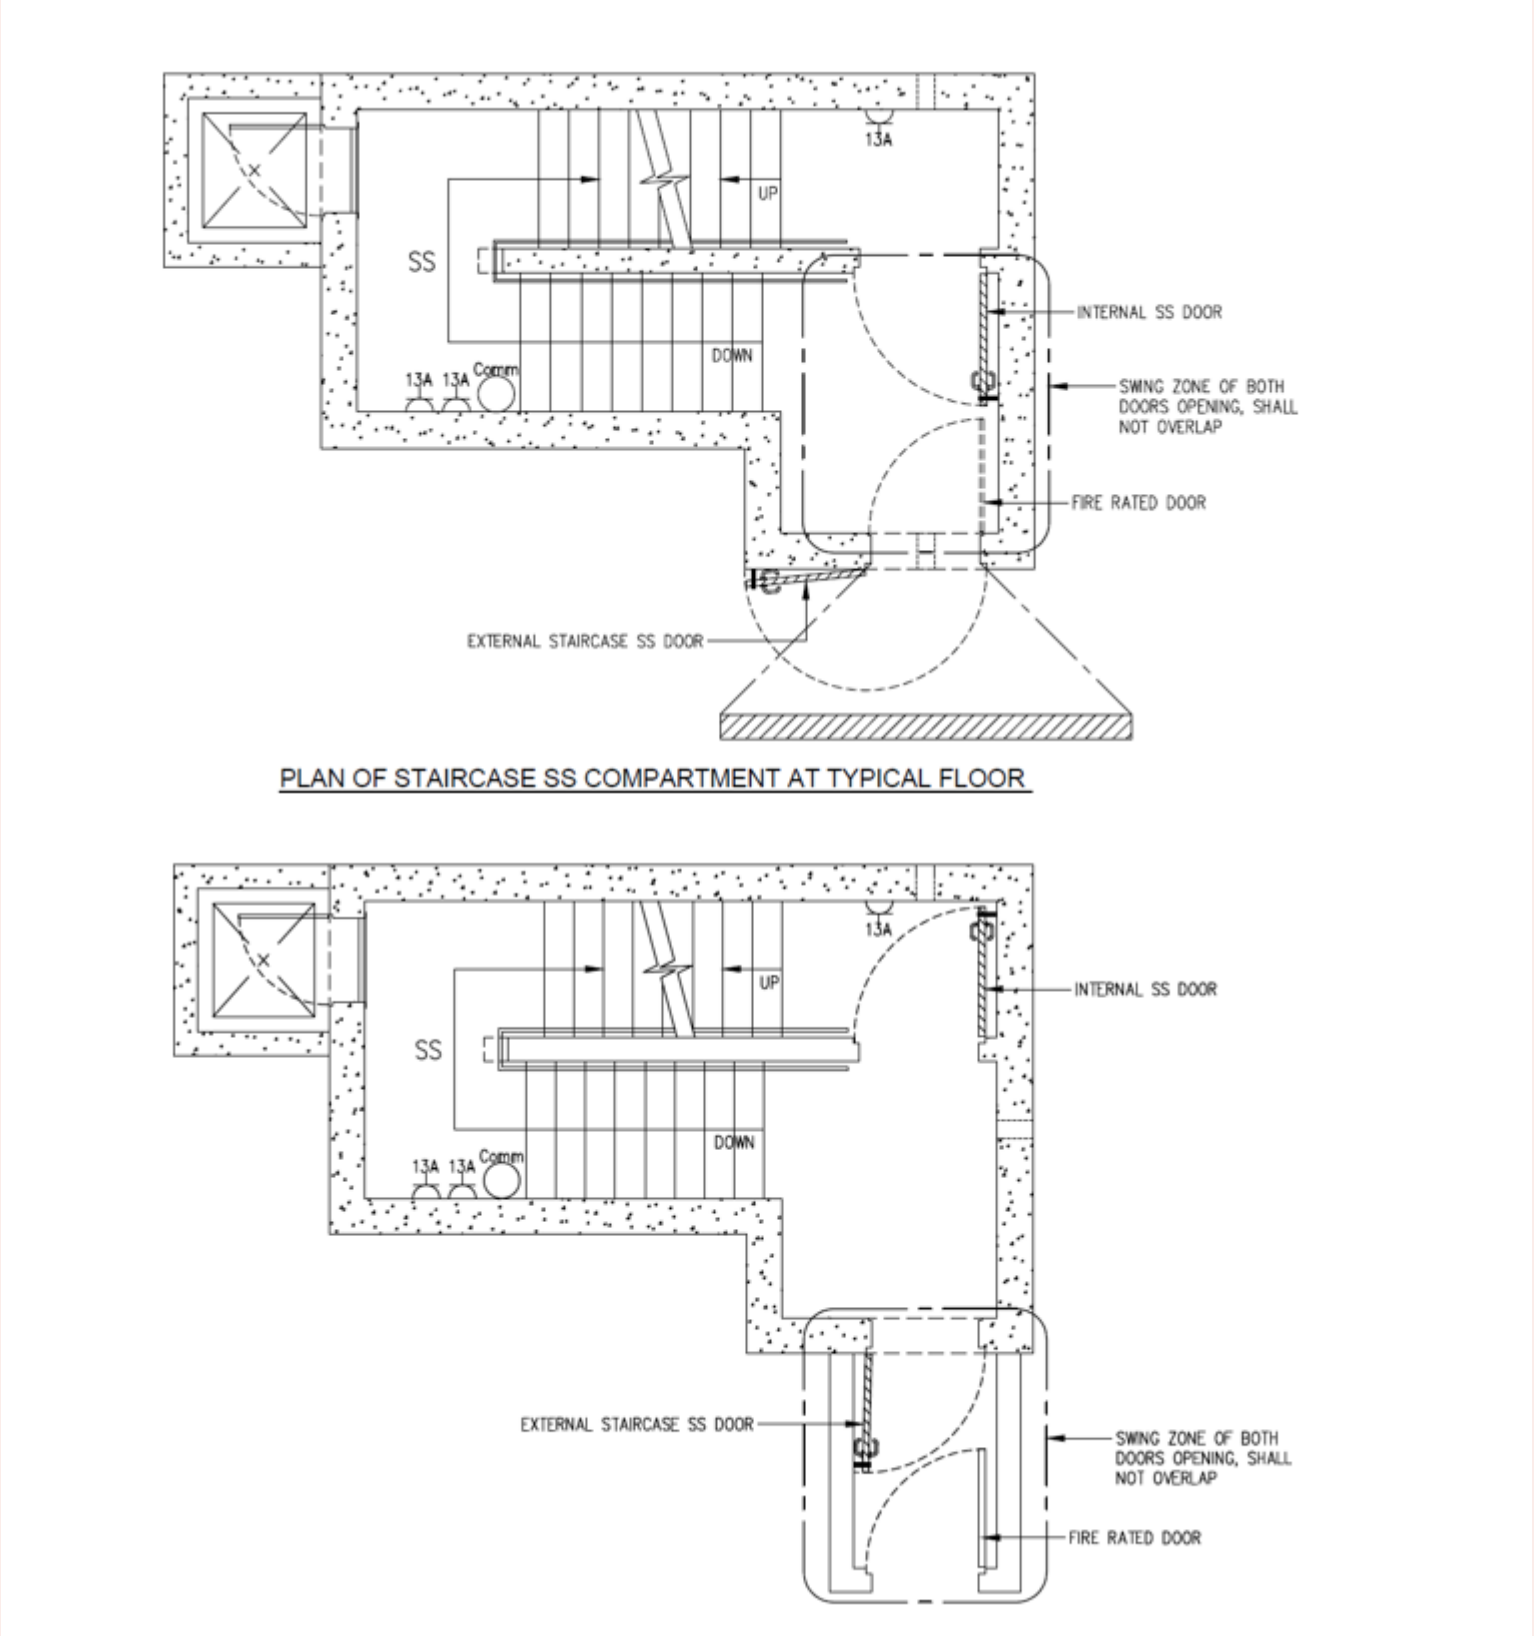

2.5.3 Door Frame

- a. There shall be a minimum 150mm reinforced concrete wall segment next to vertical edge of SS or S/C SS door frame. Refer to FIGURE 2.5.3(a) and 2.5.3(c).

Figures & Tables

FIGURE 2.5.3(a): CONCRETE WALL SEGMENT AT SS DOOR


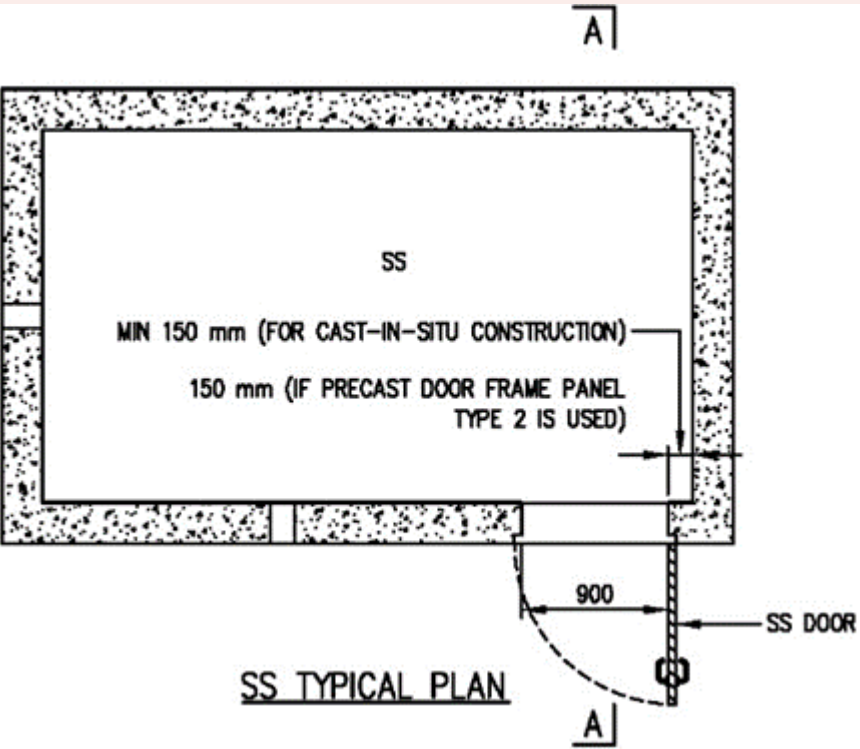



FIGURE 2.5.3(c): CONCRETE WALL SEGMENT AT S/C SS DOORS AND BLAST HATCH

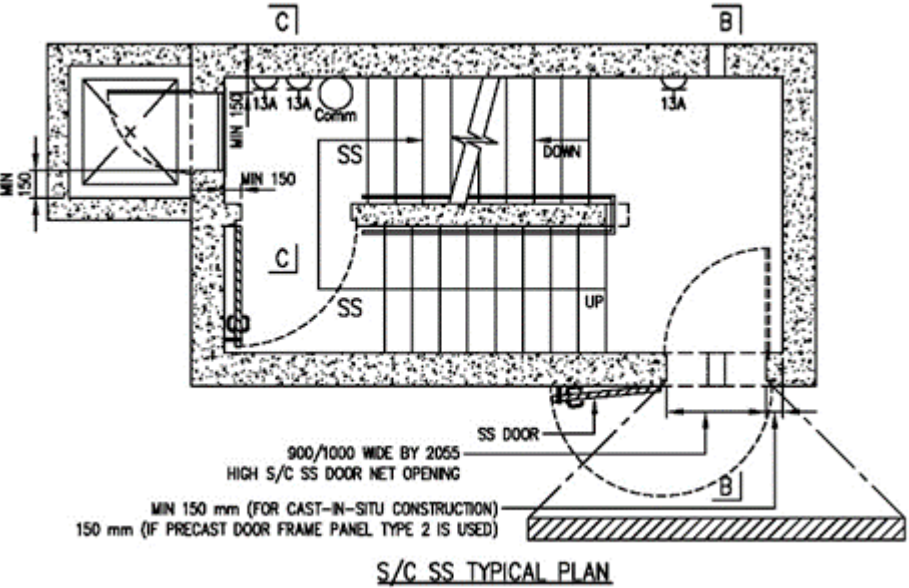

b. For pre-cast door frame panel of Type 1, the reinforced concrete next to two vertical edges of the SS door frame shall be 300mm each. Refer to FIGURE 3.5.5(a).

Figures & Tables

FIGURE 3.5.5(a): PLAN OF SS WALLS WITH PRECAST SS DOOR FRAME PANEL (TYPE 1)

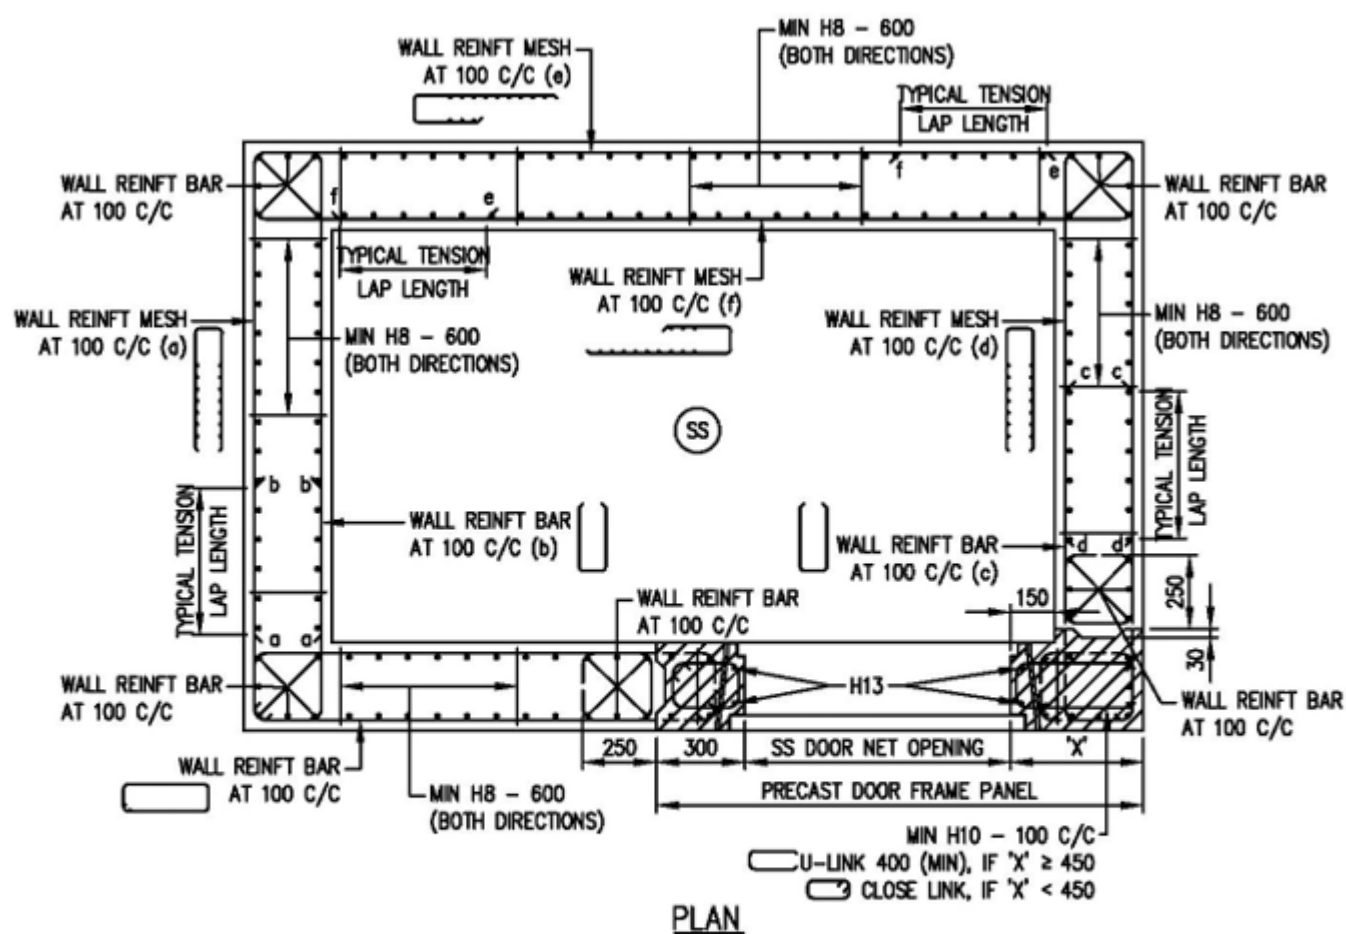


NOTE:

1. WALL REINFORCEMENT REFER TO TABLE 3.4.2.1
2. WALL REINFORCEMENTS AT VENTILATION SLEEVE LOCATION REFER TO FIGURE 3.5.5(o)(i) & (ii)

d. For pre-cast door frame panel of Type 3, the reinforced concrete panel with full length or width of SS wall must be properly connected to the in-situ SS walls and slabs. Refer to FIGURE 3.5.5(k).

Figures & Tables

FIGURE 3.5.5(k) PLAN OF SS WALLS WITH PRECAST SS DOOR FRAME PANEL (TYPE 3)

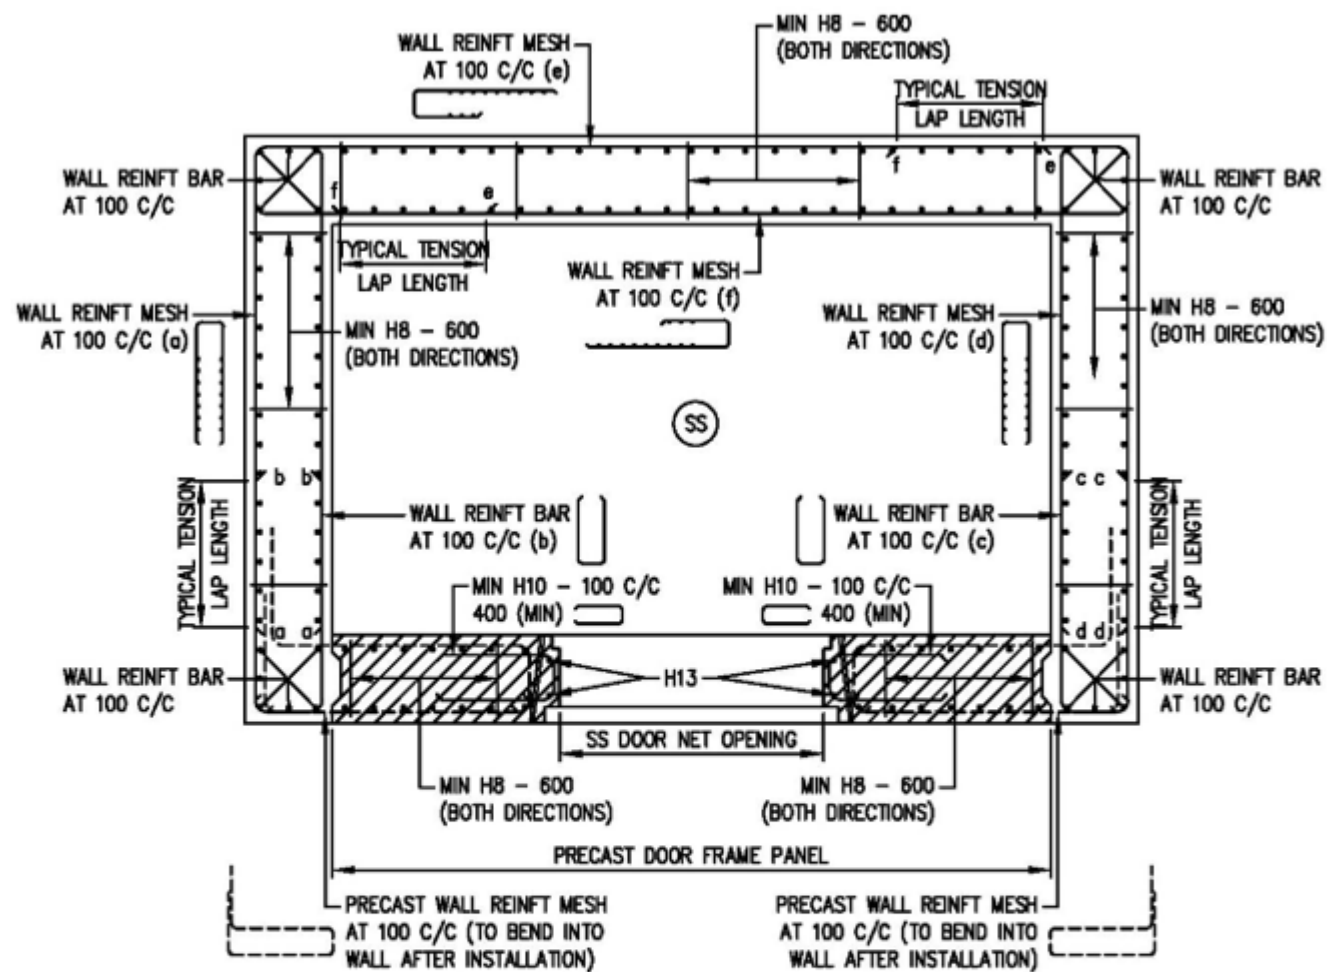

PLAN

NOTE:

1. WALL REINFORCEMENT REFER TO TABLE 3.4.2.1
2. WALL REINFORCEMENTS AT VENTILATION SLEEVE LOCATION REFER TO FIGURE 3.5.5(o)(i) & (ii)

e. The SS or S/C SS door frame must be positioned such that its door is above FFL and can be opened at least 90°. Refer to FIGURE 2.5.3(b) and 2.5.3(d).

Figures & Tables

FIGURE 2.5.3(b): SS DOOR KERB


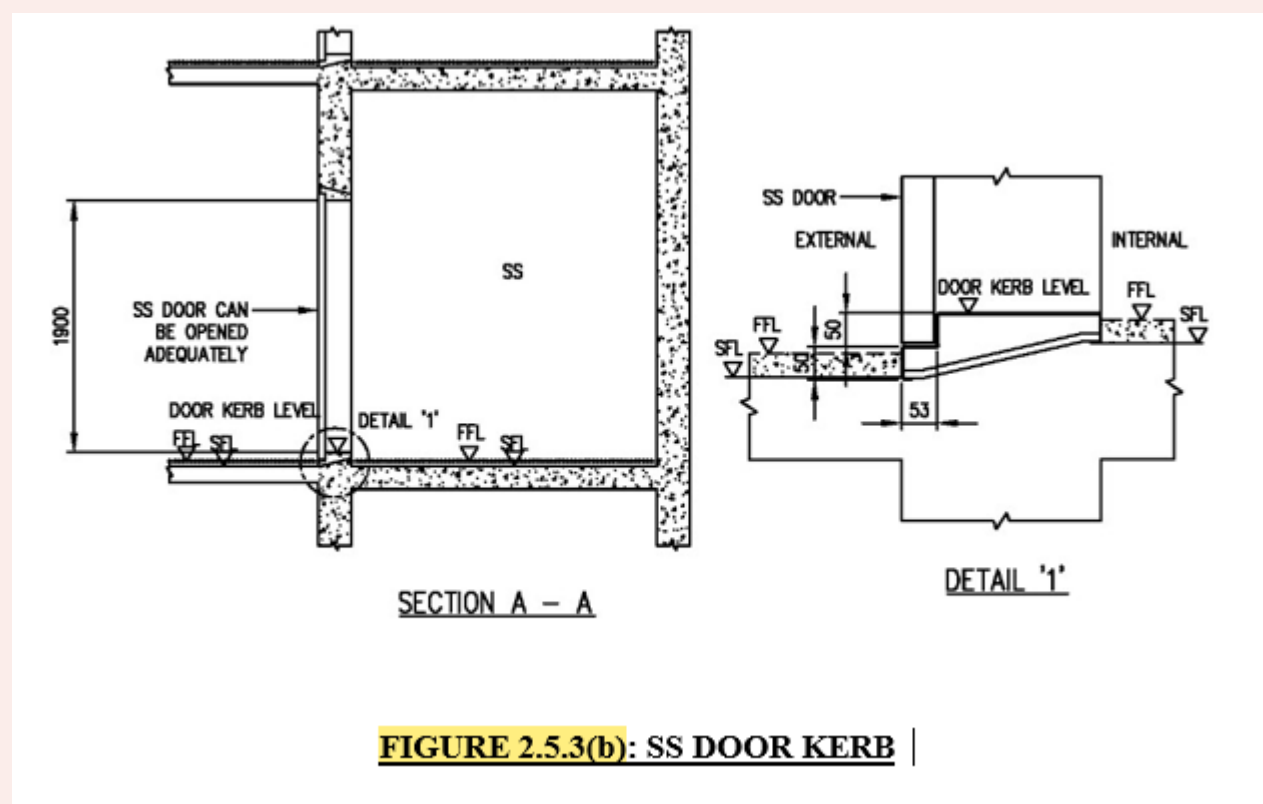


FIGURE 2.5.3(b): SS DOOR KERB

FIGURE 2.5.3(d): S/C SS DOOR KERB

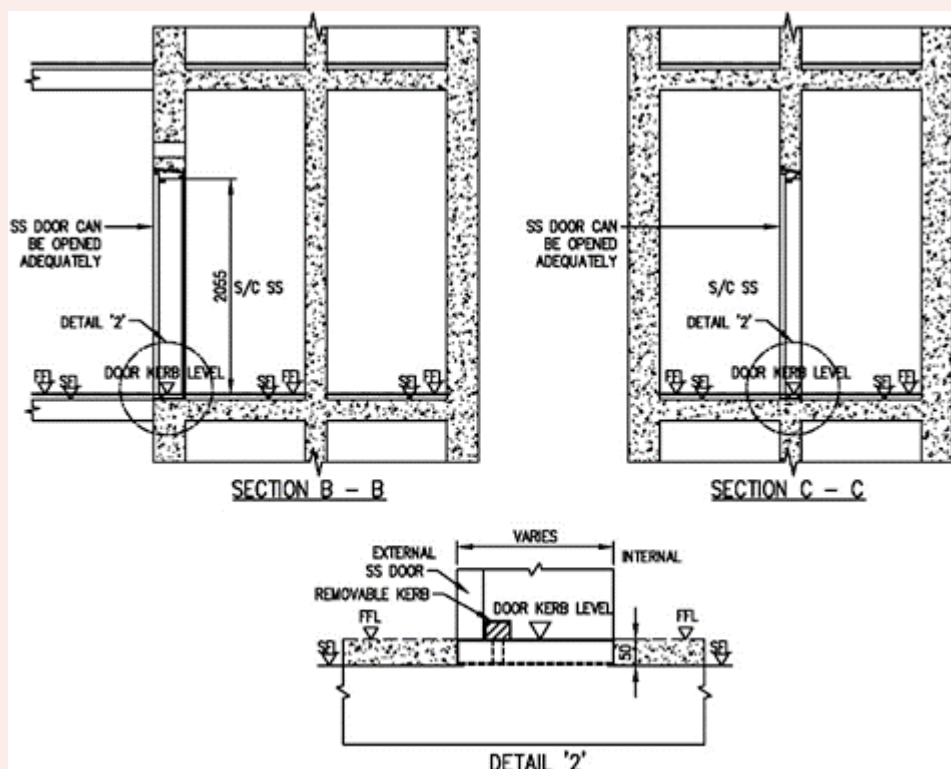

2.5.4 Shielding Wall

- a. A full-height reinforced concrete shielding wall, with a minimum thickness of 200mm (with protective slab extended by at least $\frac{1}{2}$ of storey height from the shielding wall) or 300mm (if the protective slab is extended by less than $\frac{1}{2}$ of storey height), has to be provided in front of the entrance SS door.
- b. The shielding wall to the SS door can be positioned and arranged in the following manner:
 - i. A shielding wall has to be positioned such that it is at least 1200mm but not more than 3000mm from the SS door and is within influence zone of 45-degree from the SS door. Refer to FIGURE 2.5.4(a) to 2.5.4(f). The shielding wall forming part of the dwelling unit's wall shall be clearly indicated on plans.

Figures & Tables

FIGURE 2.5.4(a): SHIELDING FOR SS DOOR

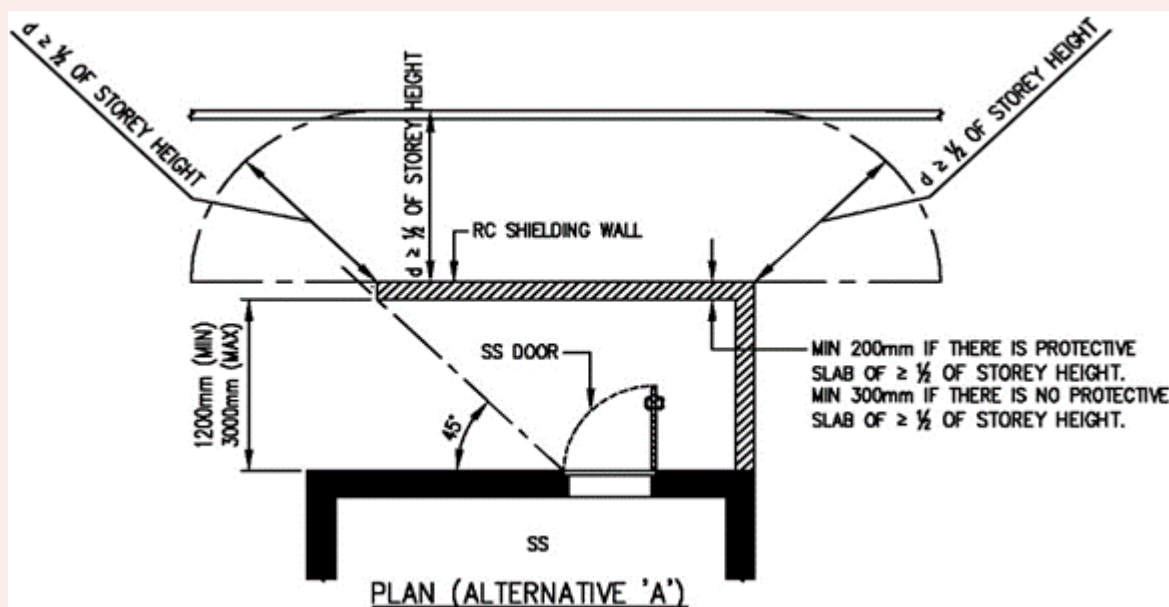


FIGURE 2.5.4(b): SHIELDING FOR SS DOOR

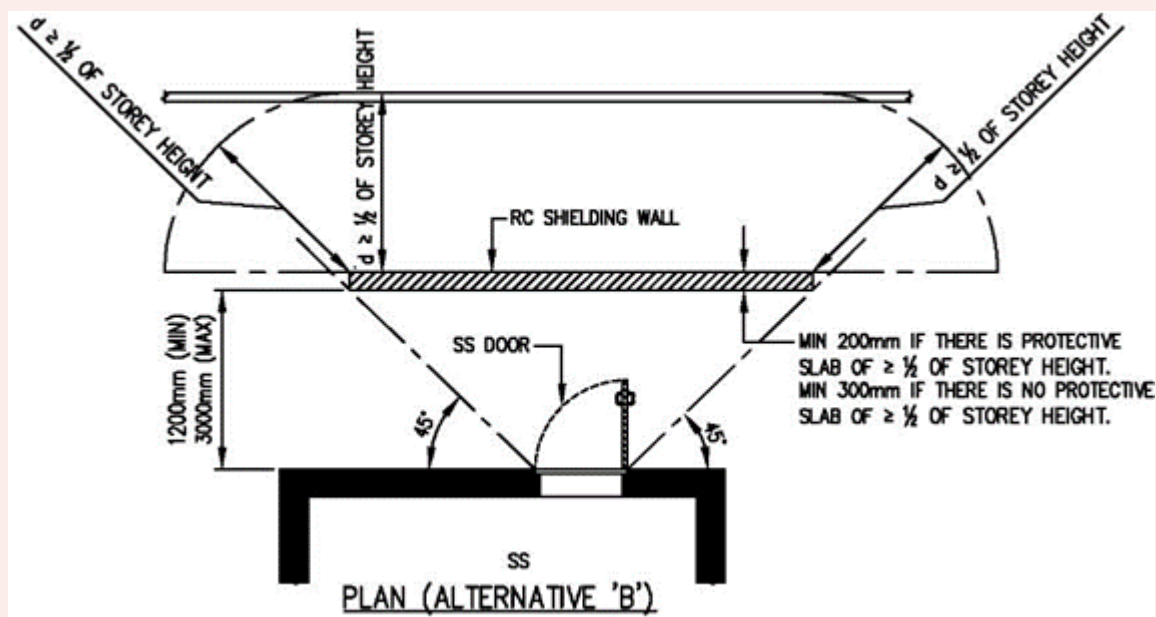


FIGURE 2.5.4(c): SHIELDING FOR SS DOOR

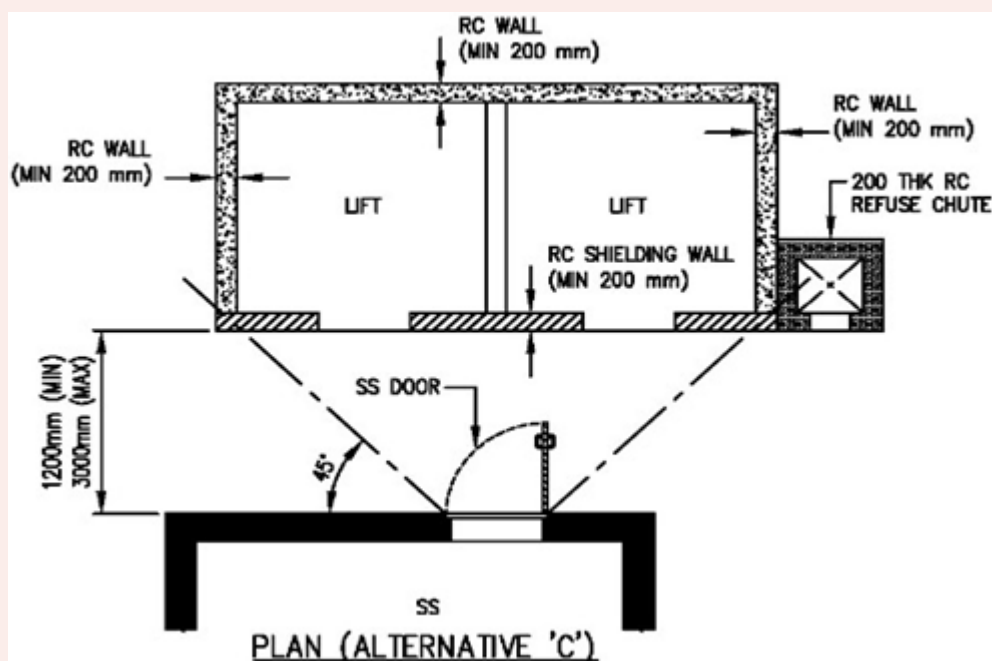


FIGURE 2.5.4(d): SHIELDING FOR SS DOOR

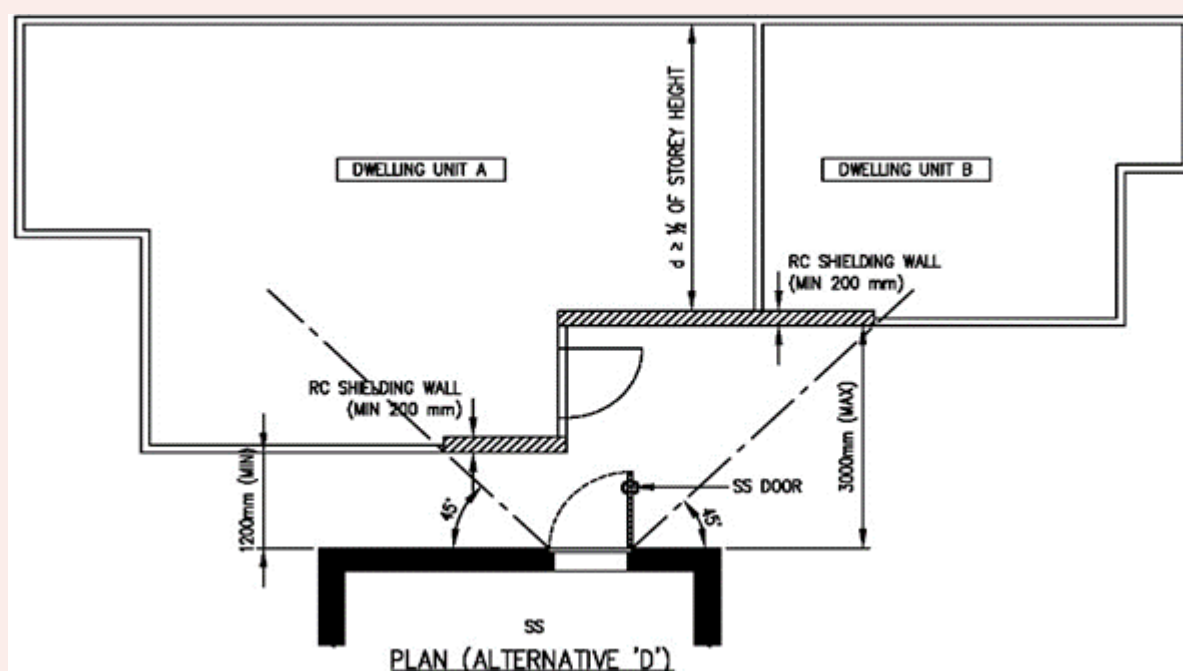


FIGURE 2.5.4(e): SHIELDING FOR SS DOOR




FIGURE 2.5.4(a): SHIELDING FOR SS DOOR



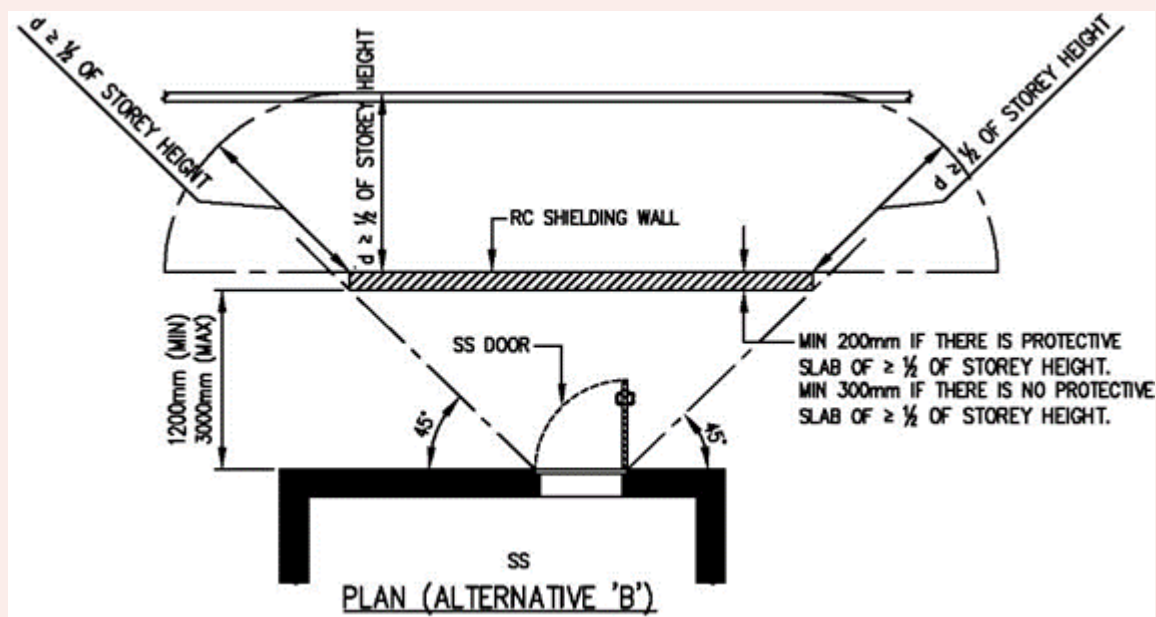


FIGURE 2.5.4(d): SHIELDING FOR SS DOOR

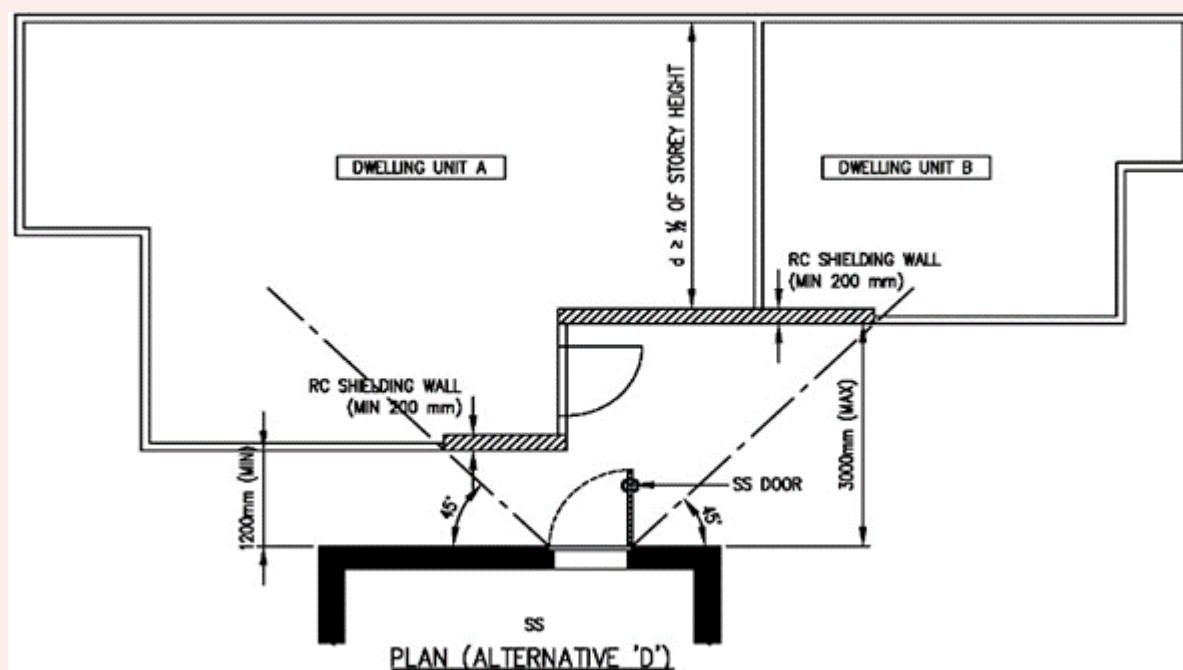


FIGURE 2.5.4(e): SHIELDING FOR SS DOOR


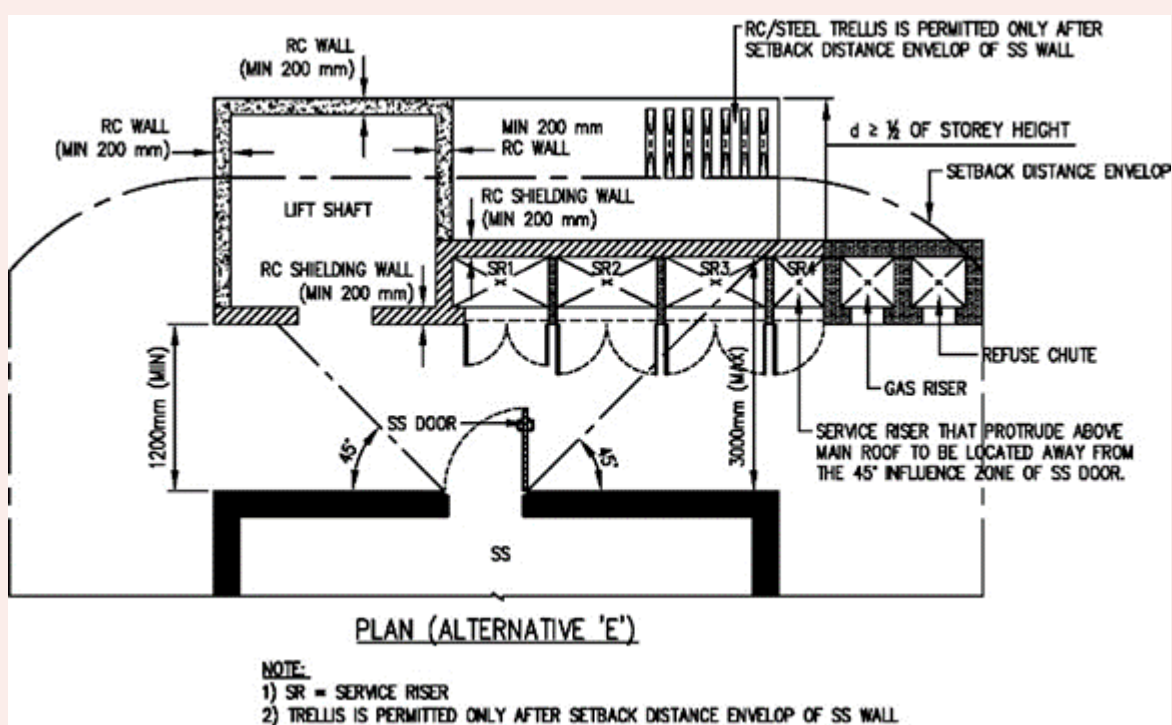



FIGURE 2.5.4(f): SHIELDING FOR SS DOOR

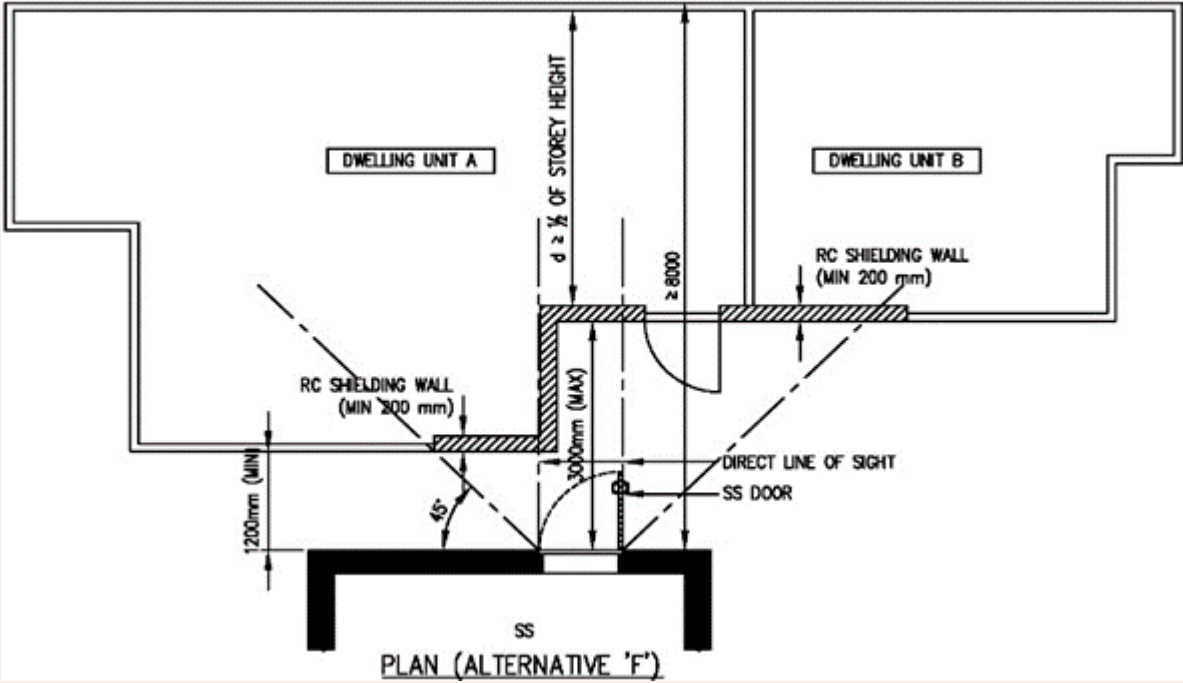

iii. Where the lift shaft is facing the SS door, the RC wall of the shaft can be used as a shielding wall provided its thickness is at least 200mm. Refer to FIGURE 2.5.4(c). For such case, the surrounding lift shaft wall and roof slab of lift motor room shall be reinforced concrete.

Figures & Tables


FIGURE 2.5.4(c): SHIELDING FOR SS DOOR

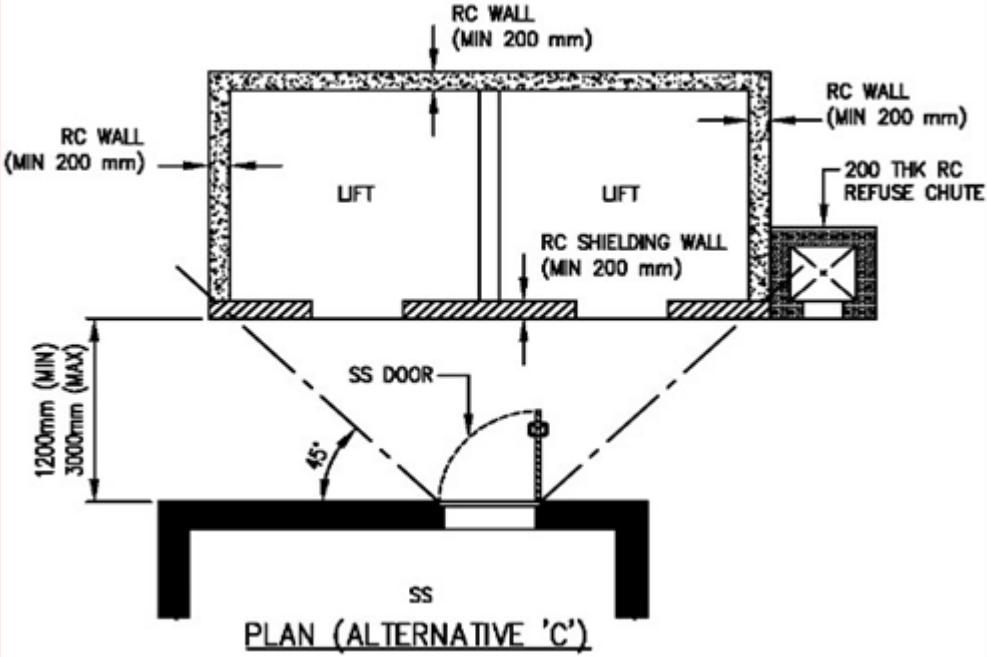

iv. For service risers located within influence zone, the RC walls of the risers can be used as shielding wall provided its thickness is at least 200mm. Refer to FIGURE 2.5.4(e).

Figures & Tables

FIGURE 2.5.4(e): SHIELDING FOR SS DOOR

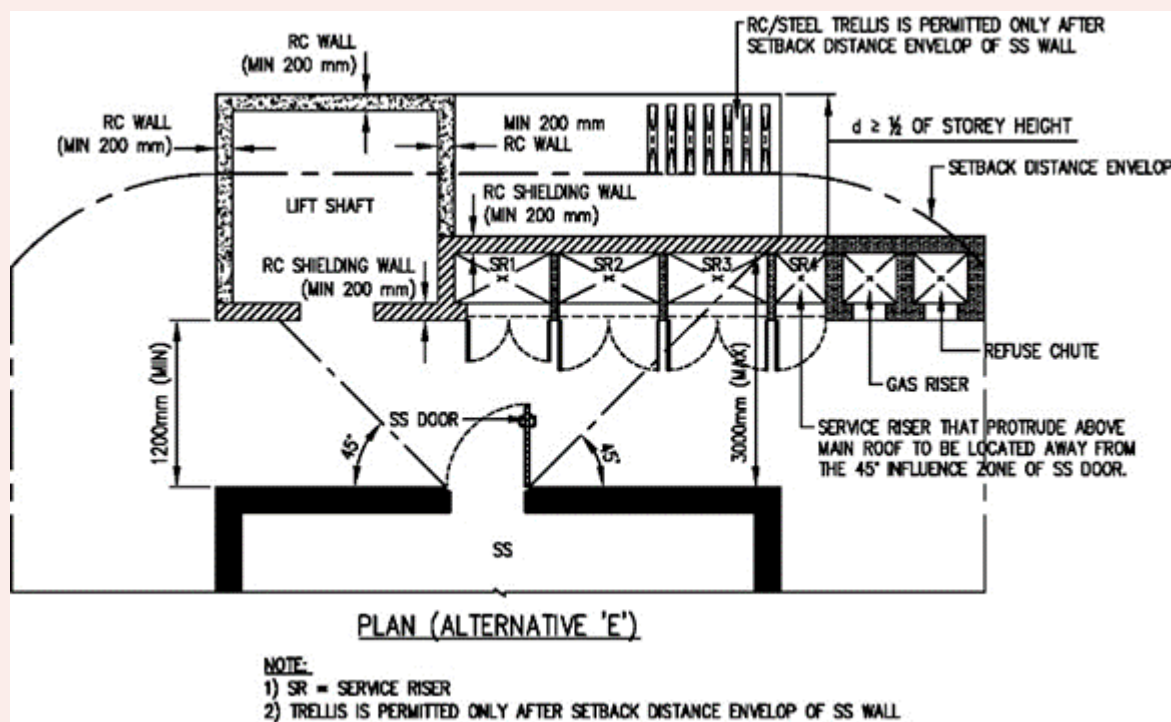

v. Where the shielding wall located within influence zone is discontinuous, the opening in this wall shall not be in the line of sight of SS door. In the case of the opening not in the line of sight of SS door but facing the SS wall, there shall be RC slabs with a minimum distance of 8000mm provided from the SS wall. Refer to FIGURE 2.5.4(d) and 2.5.4(f).

Figures & Tables

FIGURE 2.5.4(d): SHIELDING FOR SS DOOR


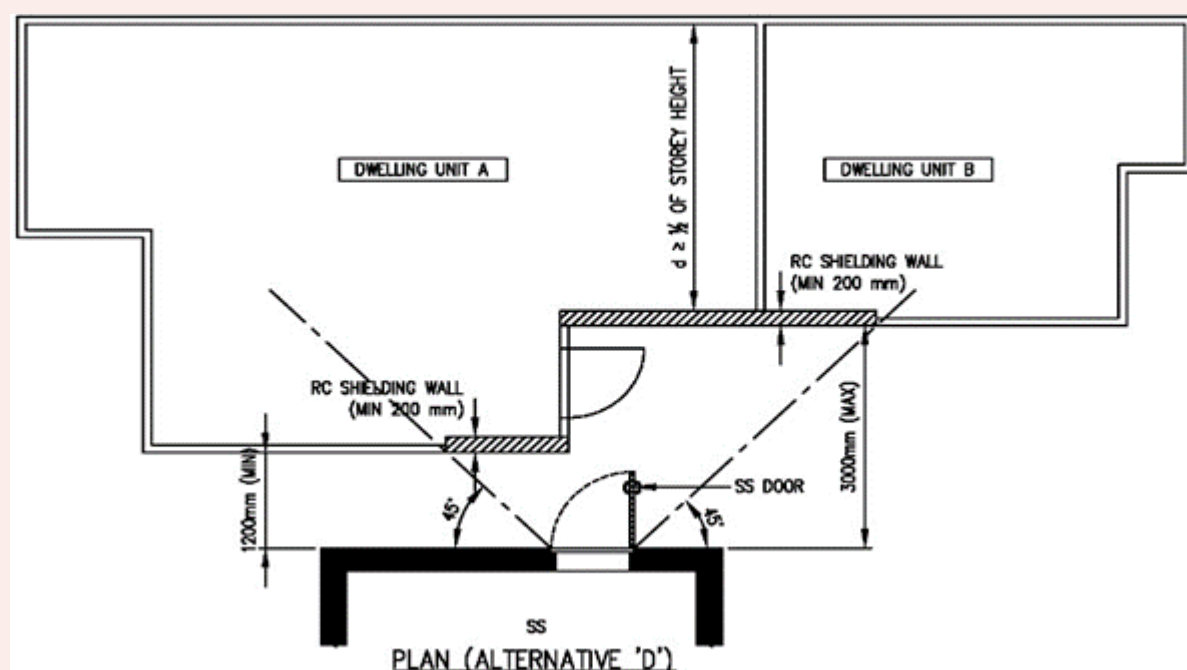


FIGURE 2.5.4(f): SHIELDING FOR SS DOOR

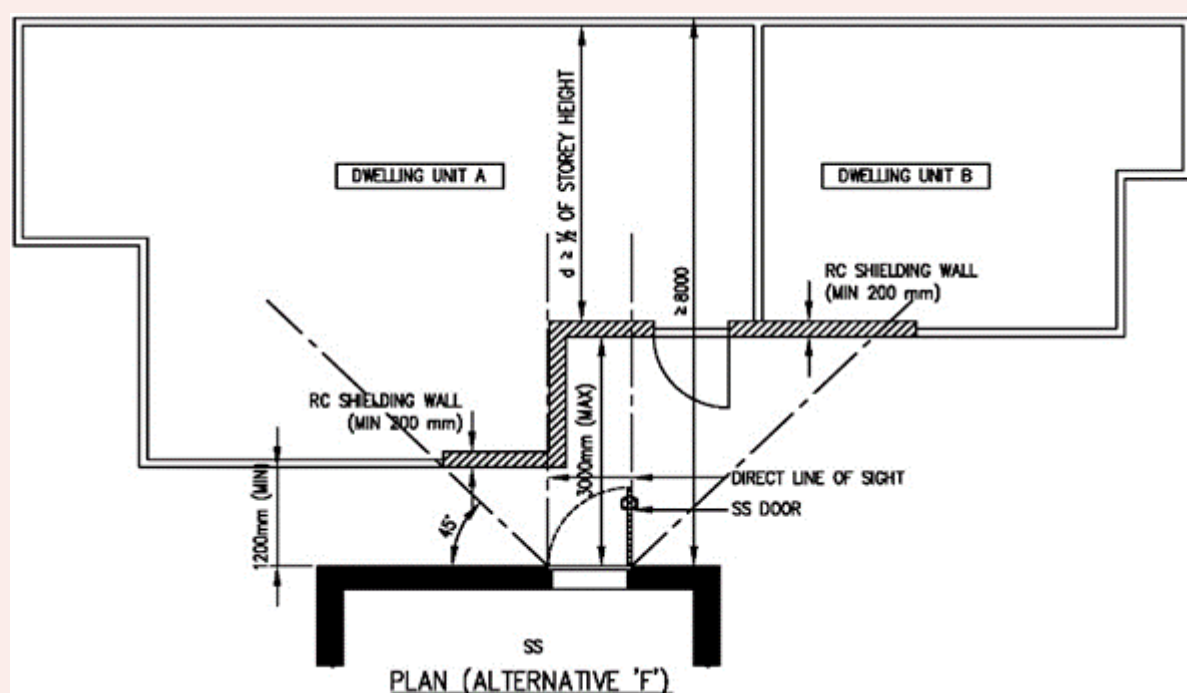


2.5.5 Strengthened Ceiling Slab outside SS Door

The minimum thickness of the reinforced concrete ceiling slab immediately outside the SS door shall be 150mm and structurally connected to SS tower.

The dimensions of this strengthened portion shall be as shown in FIGURE 2.5.5.

Figures & Tables

FIGURE 2.5.5: REQUIREMENTS FOR STRENGTHENING CEILING SLAB IN FRONT OF SS DOOR

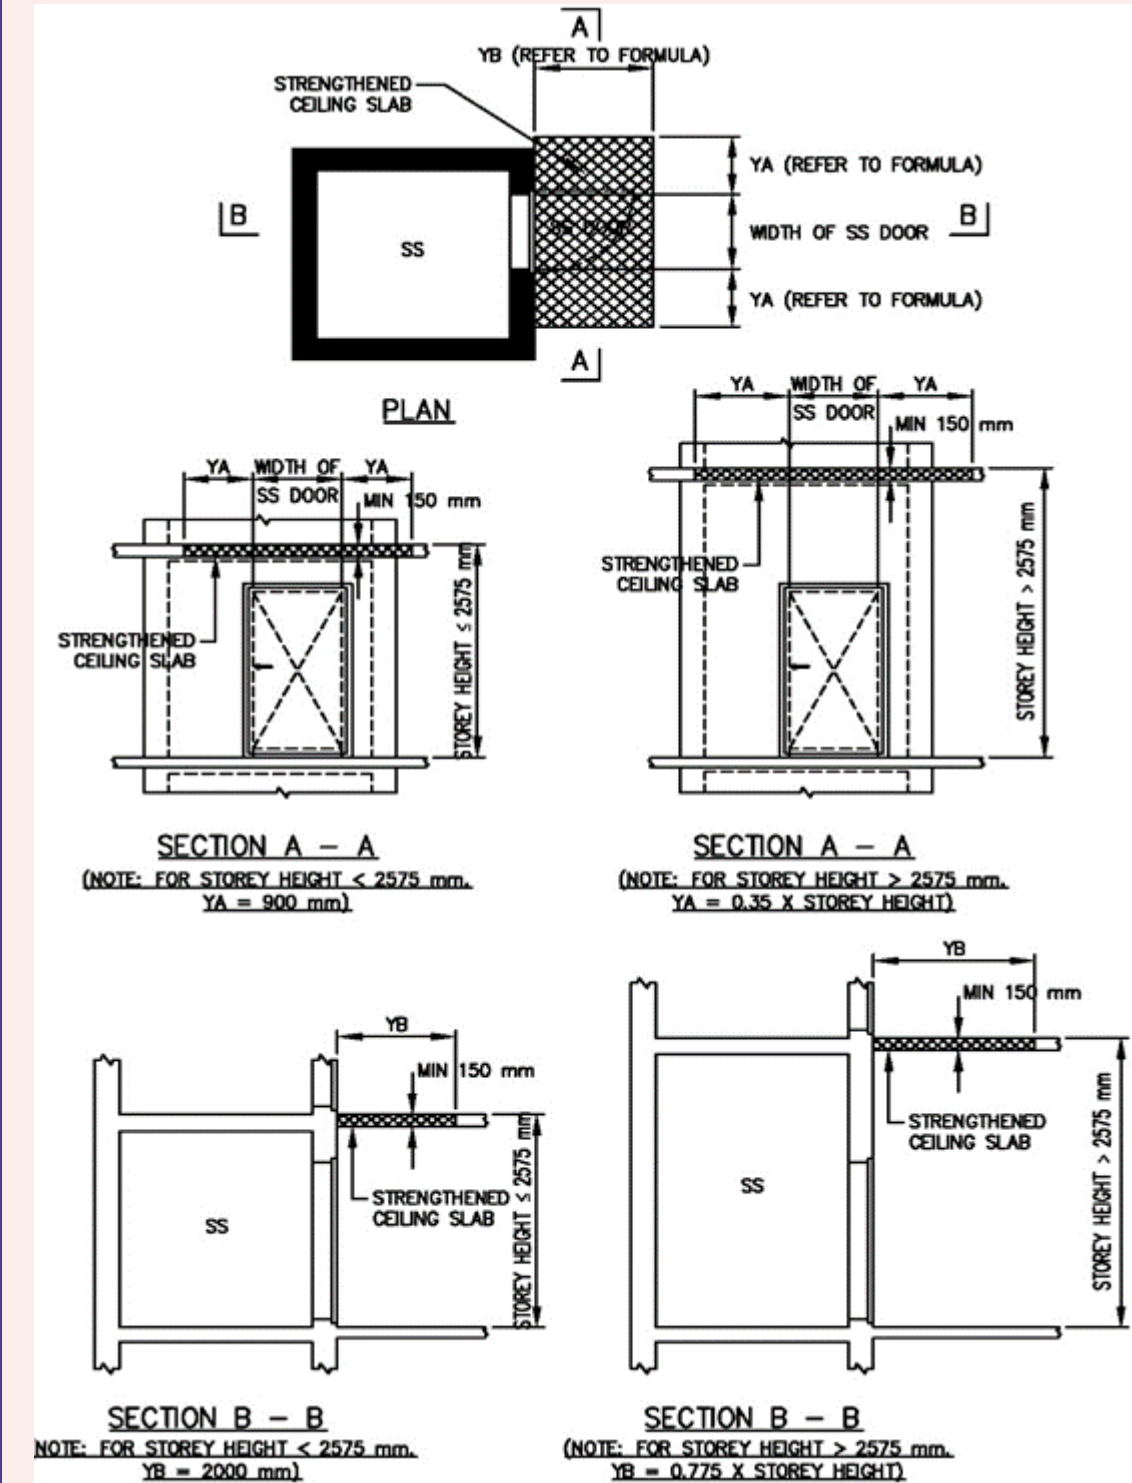

2.6.1 General

- a. The following electrical and communication fixtures (Refer to FIGURE 2.6.1(a), 2.6.1(b), 2.12.1(f) and 2.12.2(j)) in steel or PVC conduit system shall be provided inside each SS or S/C SS compartment to provide adequate stay-in and/ or communication facilities:

Figures & Tables

FIGURE 2.6.1(a): SPECIFIC SS FIXTURE AND OPENINGS

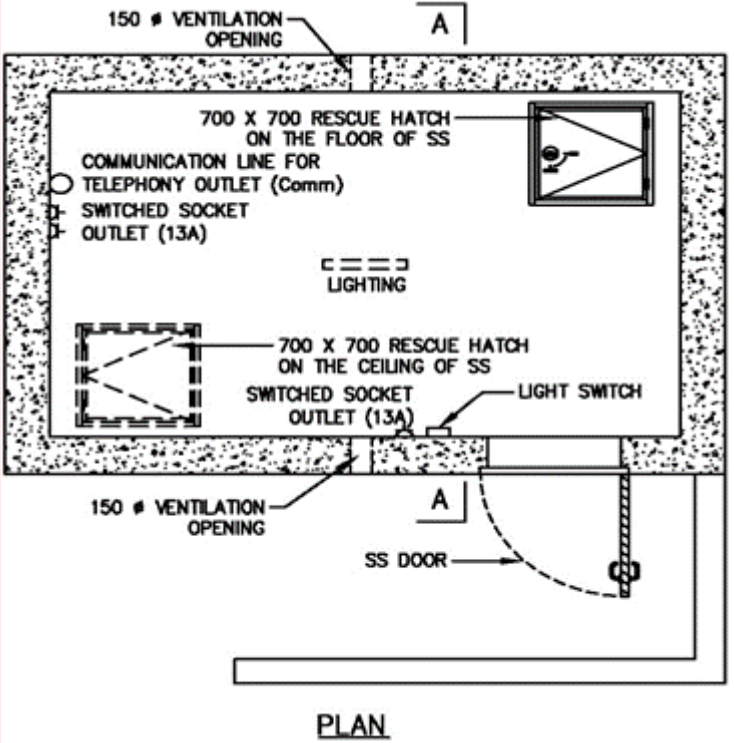


FIGURE 2.6.1(b): FIXTURE IN SS


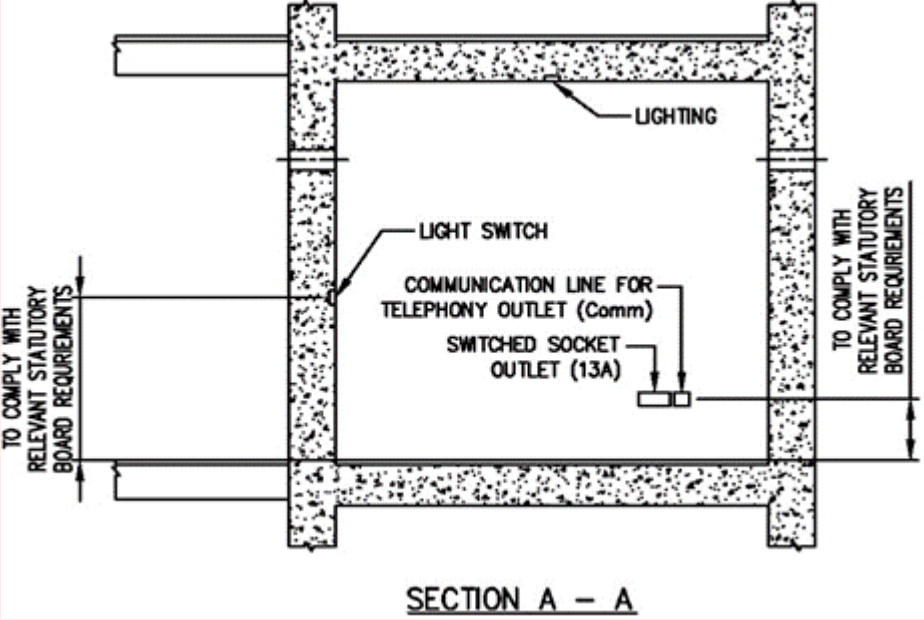


FIGURE 2.12.1(f): TYPICAL PLAN OF S/C SS COMPARTMENT

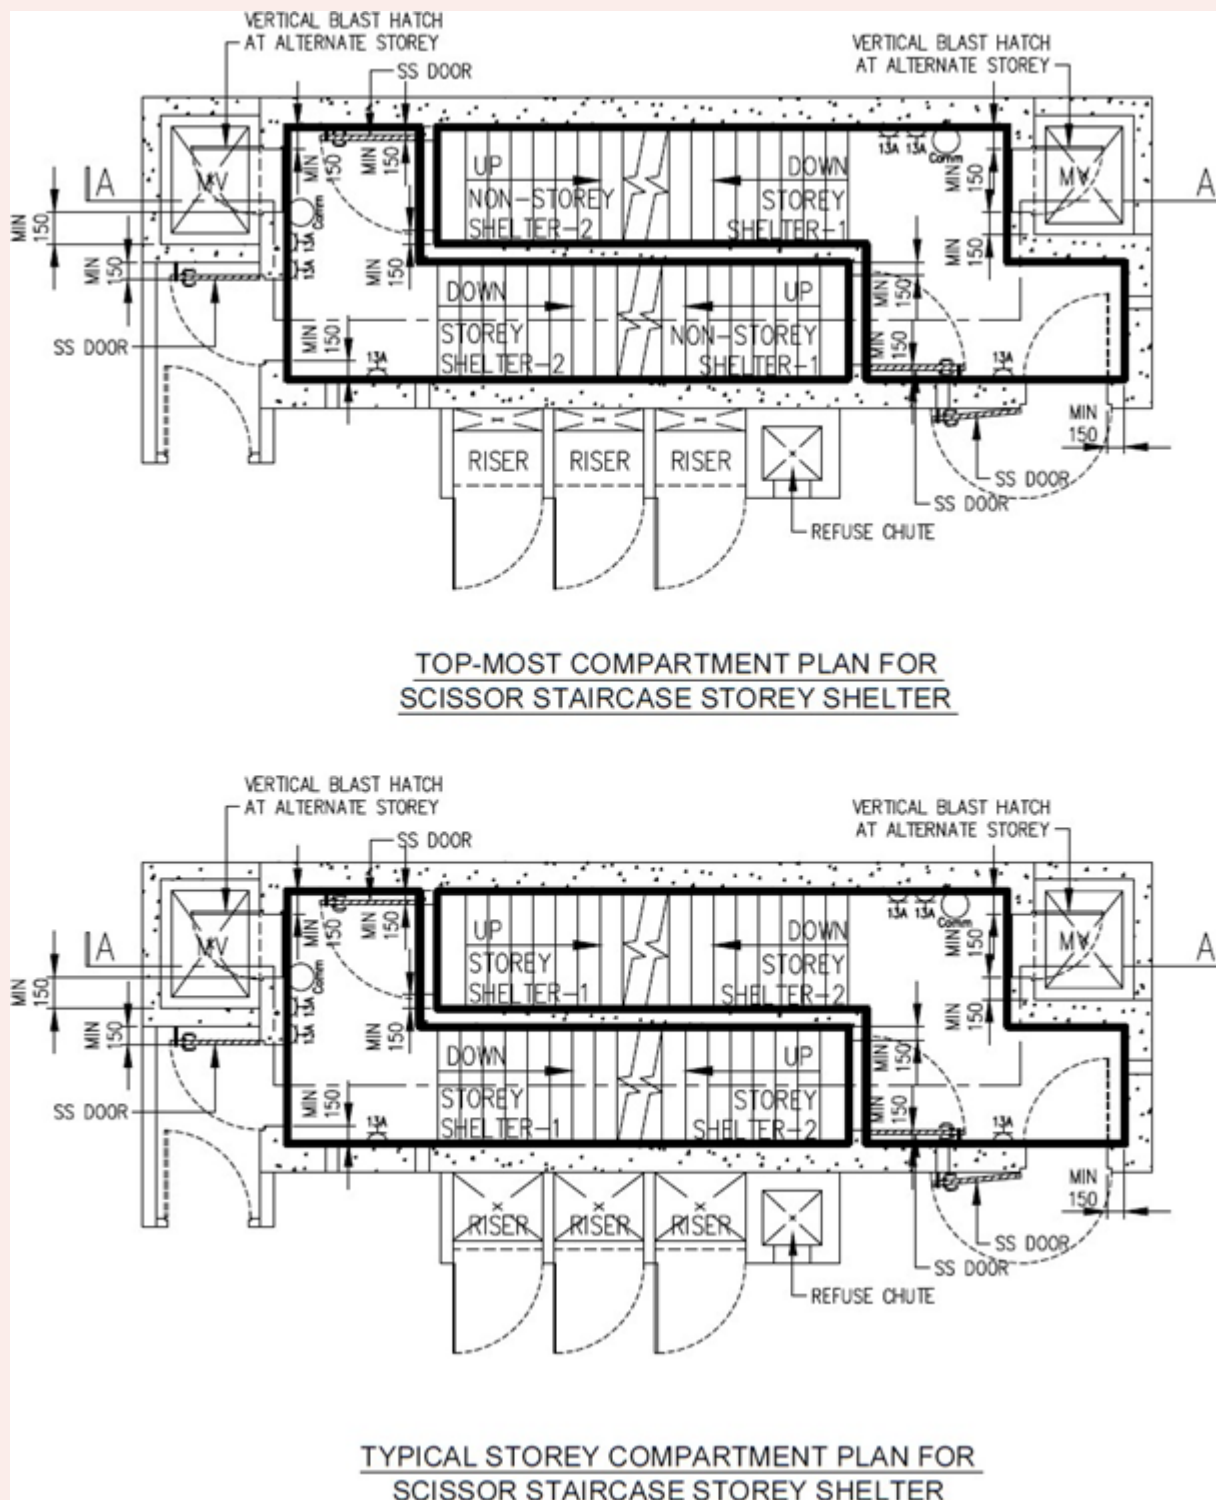


- i. 13A switch socket outlets;
- ii. Switch and lighting points;
- iii. Communication line for telephony outlet.

- b. The electrical and communication fixtures shall be designed and installed in accordance with the relevant local Codes of Practice and statutory requirements for peacetime usage.
- c. The communication line for telephony outlet in each SS or S/C SS compartment shall have its own independent line where it is connected from the fibre termination point in the compartment to the fibre interface point in the relevant riser of the development.
- d. A maximum of ten numbers of 25mm diameter service conduits for electrical and communication cables serving the SS are allowed. Refer to [Clause 3.6.1](#) for embedment details.
- e. The electrical and communication fixtures shall be located away from the rescue hatch openings in the SS. Refer to [FIGURE 2.6.1\(a\)](#).

Figures & Tables


FIGURE 2.6.1(a): SPECIFIC SS FIXTURE AND OPENINGS

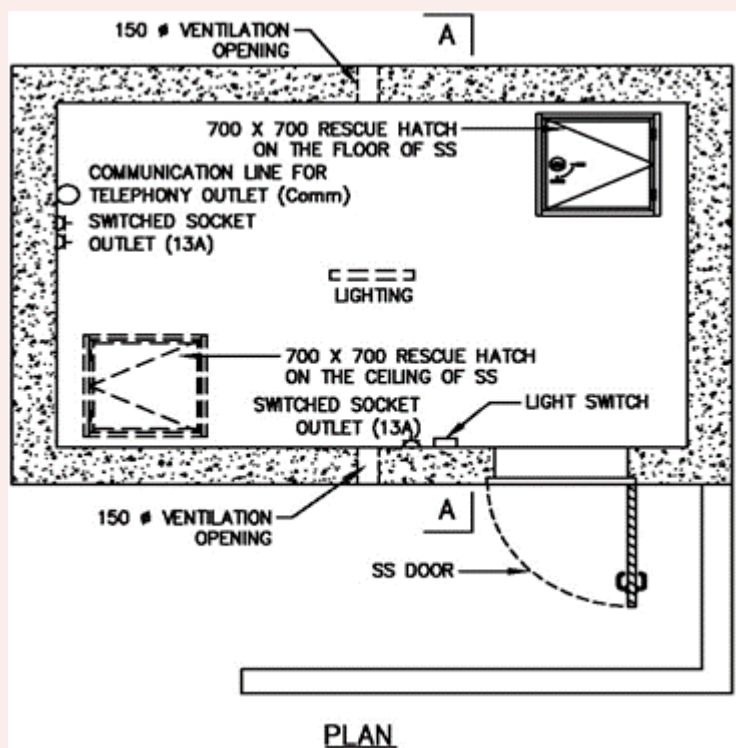

f. The mounting height of the lighting switch and other electrical and communication fixture shall comply with the relevant statutory board requirements for peacetime use. Refer to FIGURE 2.6.1(b).

Figures & Tables

FIGURE 2.6.1(b): FIXTURE IN SS

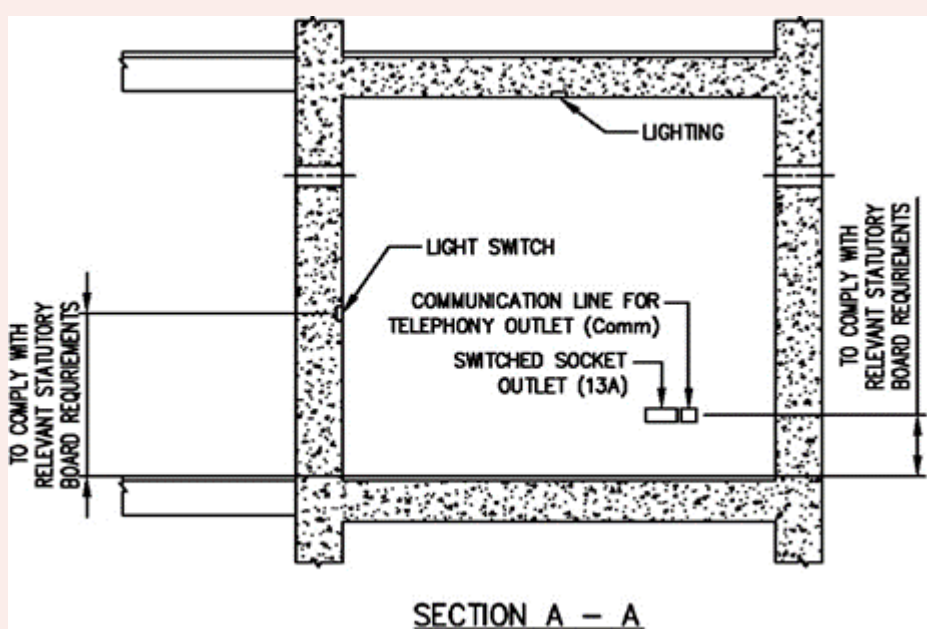

g. Other fixtures, such as cabinets and shelves, which are required for peacetime use in SS, are allowed provided they are easily dismantled and removed.


2.6.2 Switch Socket Outlets

a. For SS:

Three (3) 13A switch socket outlets shall be provided inside each SS. Two switch socket outlets shall be in the vicinity of the communication for telephony outlet located away from the SS door. The third switch socket outlet shall be located near the ventilation sleeve opening. Refer to FIGURE 2.6.1(a).

Figures & Tables

FIGURE 2.6.1(a): SPECIFIC SS FIXTURE AND OPENINGS

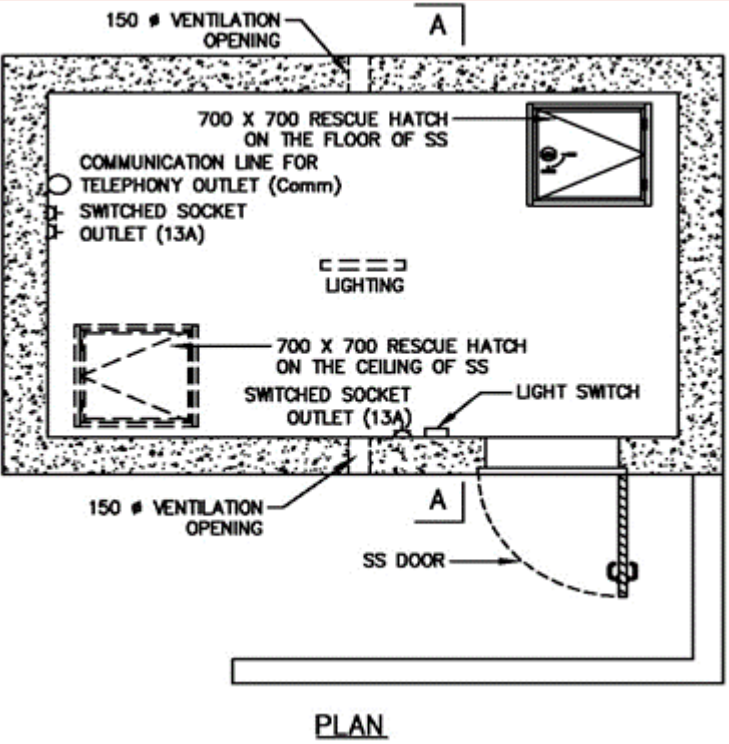


b. For S/C SS

Three (3) 13A switch socket outlets shall be provided inside each S/C SS compartment. At least one switch socket outlet shall be provided at the main landing. The other two switch socket outlets shall be provided at the intermediate landing together with the communication for telephony outlet. Refer to FIGURE 2.12.1(f) for details.

Figures & Tables

FIGURE 2.12.1(f): TYPICAL PLAN OF S/C SS COMPARTMENT

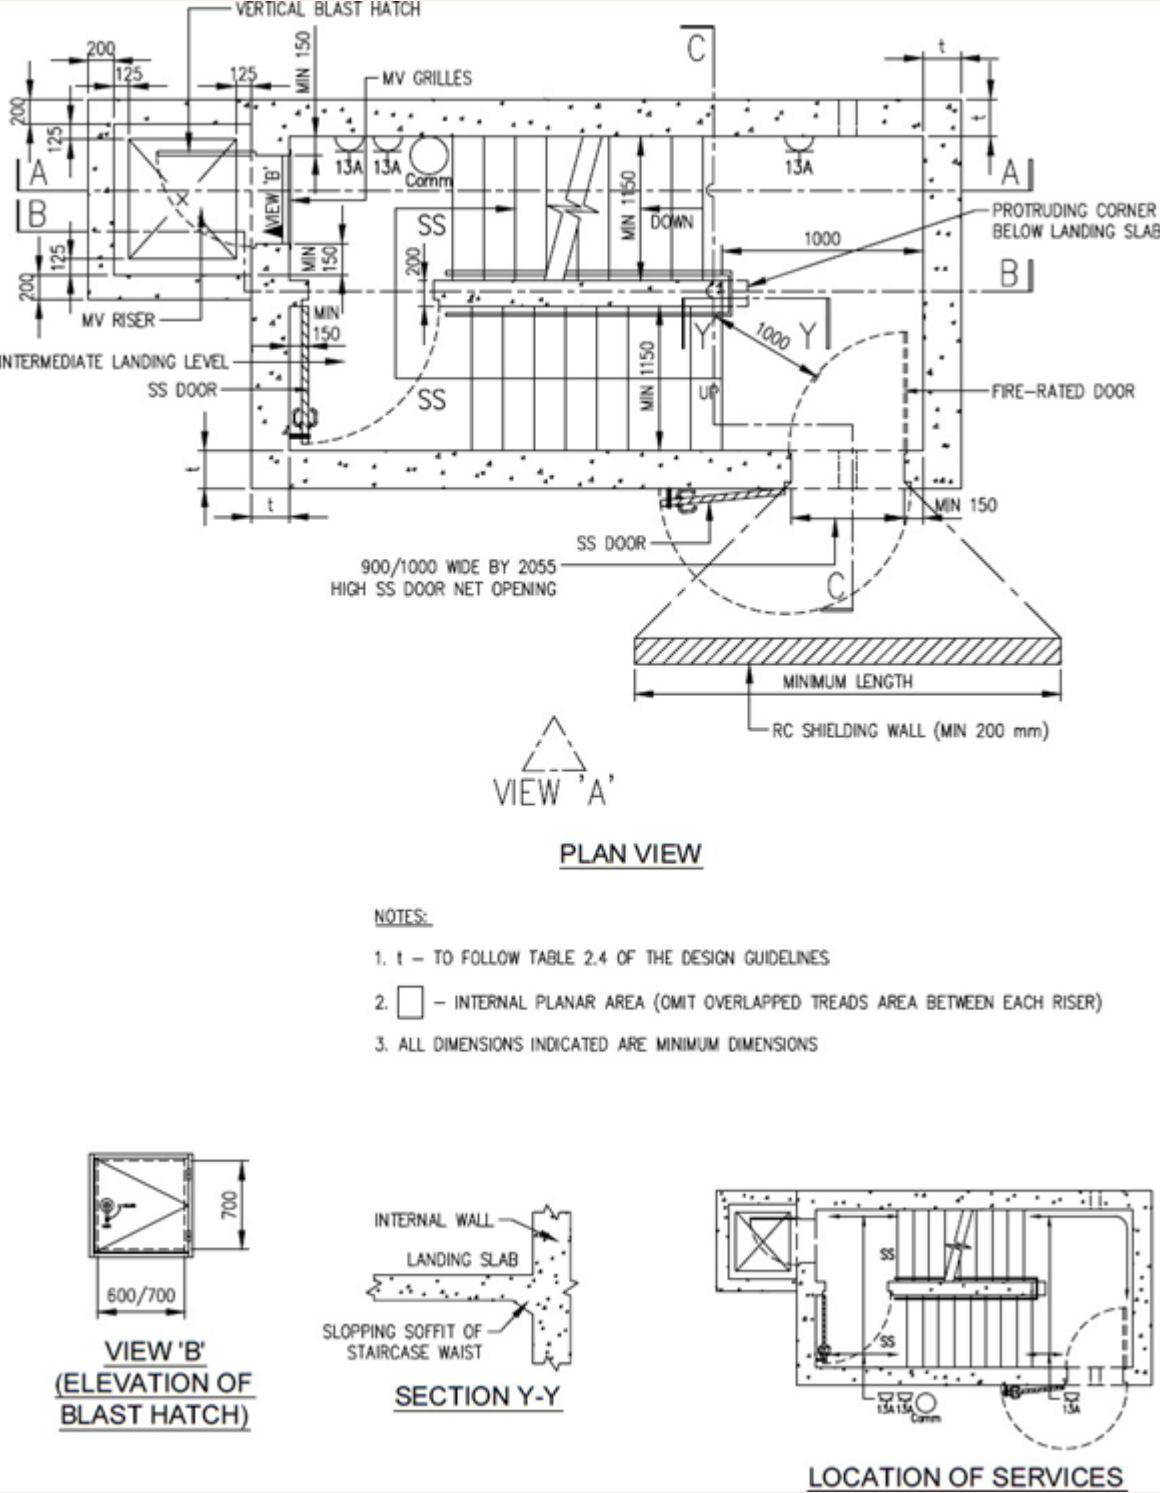


c. For Scissor S/C SS

Three (3) 13A switch socket outlets shall be provided inside each scissor S/C SS compartment. At least one switch socket outlet shall be provided at the main landing at the upper floor of the SS compartment. The other two switch socket outlets shall be provided at the main landing, together with the communication for telephony outlet at the lower floor of the SS compartment. Refer to FIGURE 2.12.2(j) for details.

Figures & Tables

FIGURE 2.12.2(j): SCISSOR S/C SS COMPARTMENT PLAN

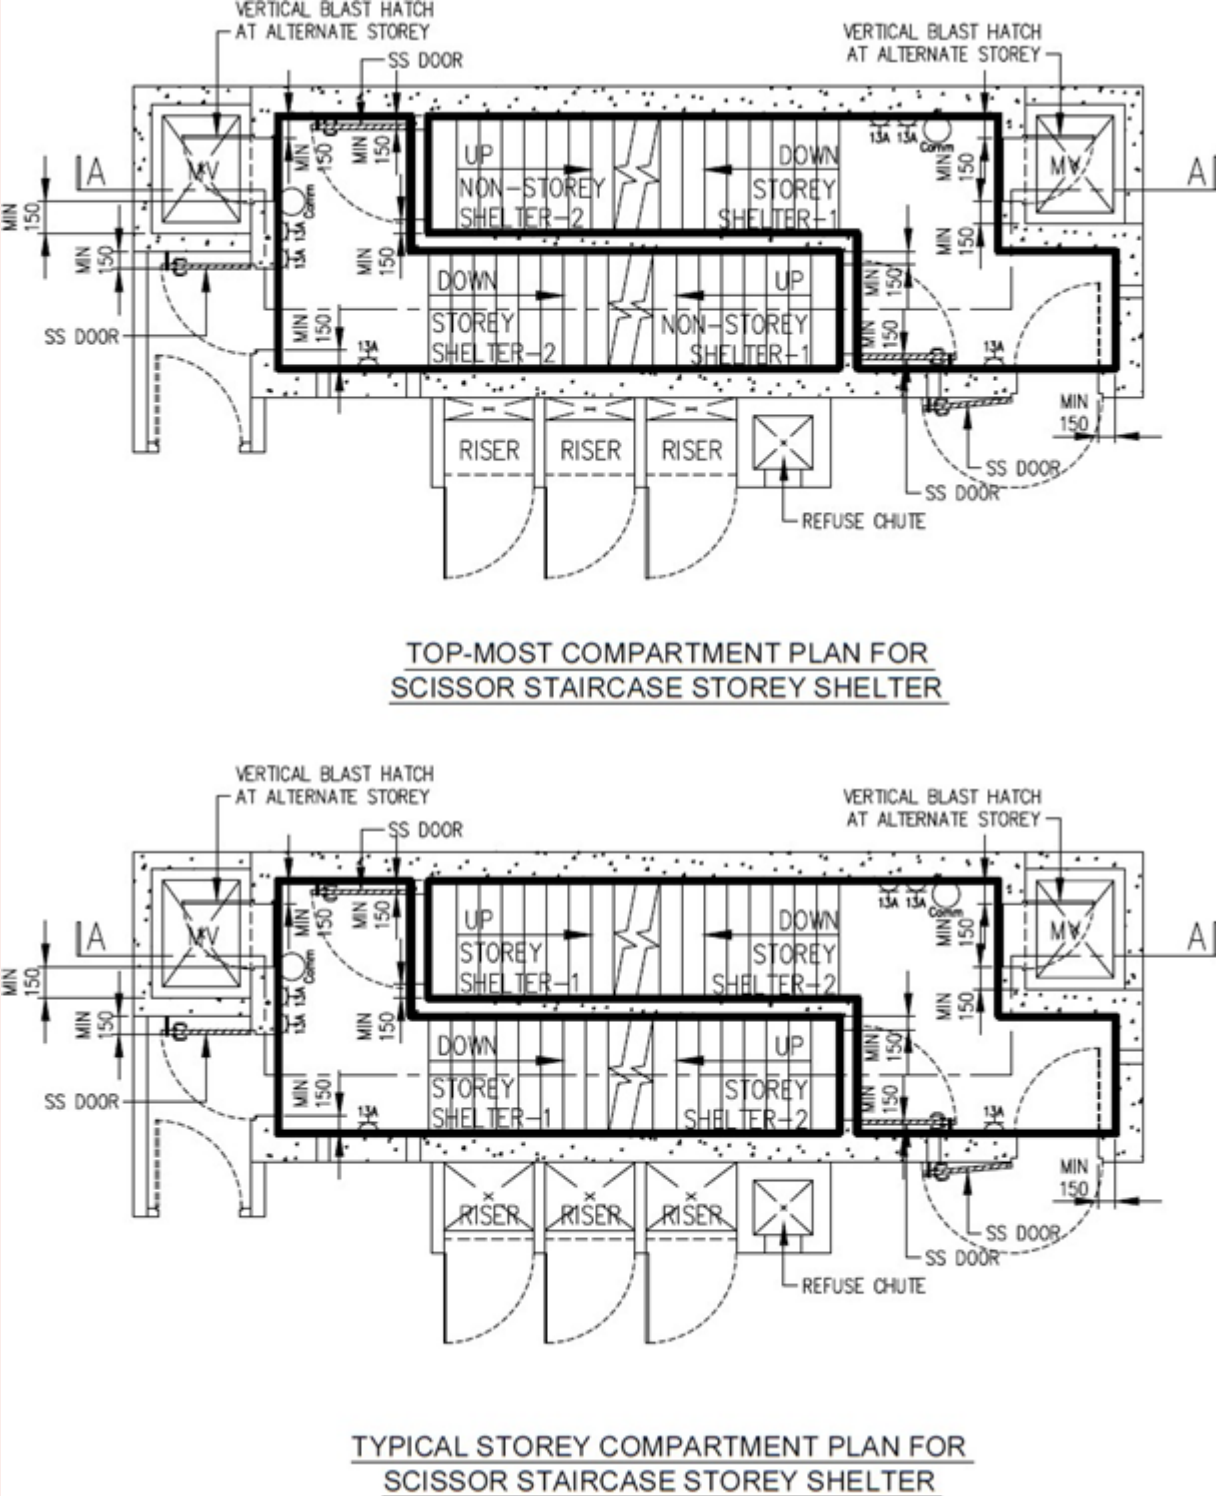

2.6.3 Light Fitting

Light fittings shall be mounted only on the soffit of SS ceiling with screws, using non-metallic inserts. Wall mounted luminaries are not permitted.

2.6.4 Cable Entries and Openings

All cable entries shall be fully and properly sealed for air-tightness as stipulated in [Clause 3.6.1](#).







CLAUSE 2.7 NS IN SS TOWER

2.7.1 Aggregate Wall Height of NS

- a. Several NS can be stacked one on top of the other within an SS tower, without the need for NS floor slab to be connected to external floor slab, provided that the aggregate wall height of the NS does not exceed 12m. Refer to FIGURE 2.7.1.

Figures & Tables

FIGURE 2.7.1: NS IN SS TOWER

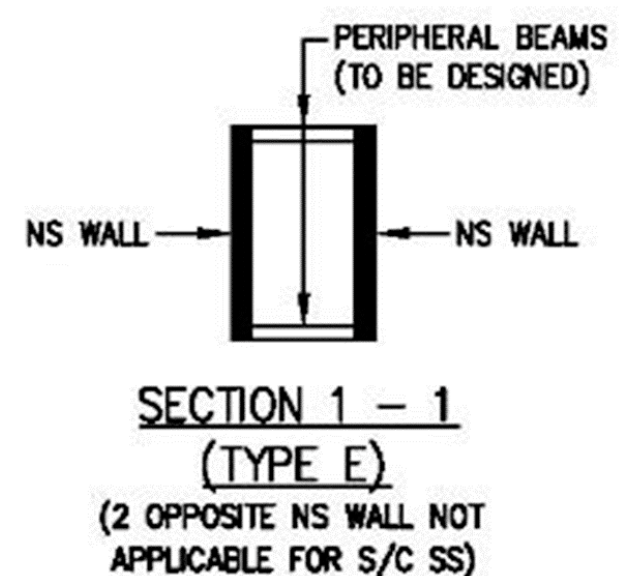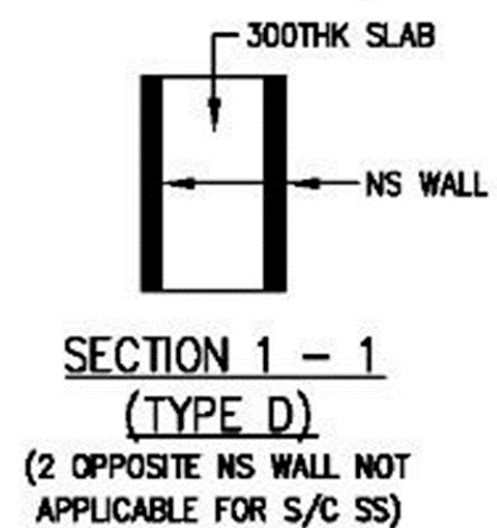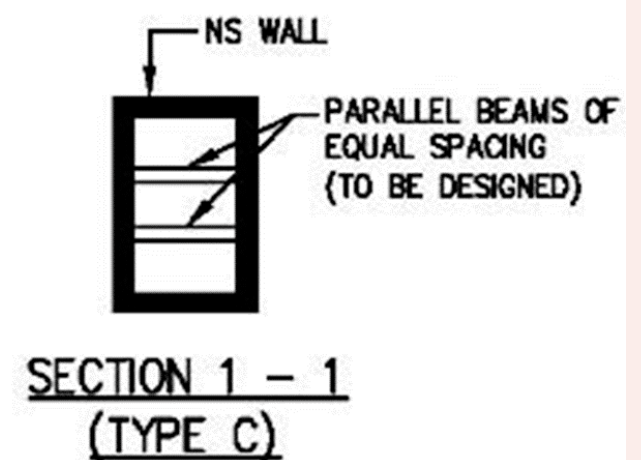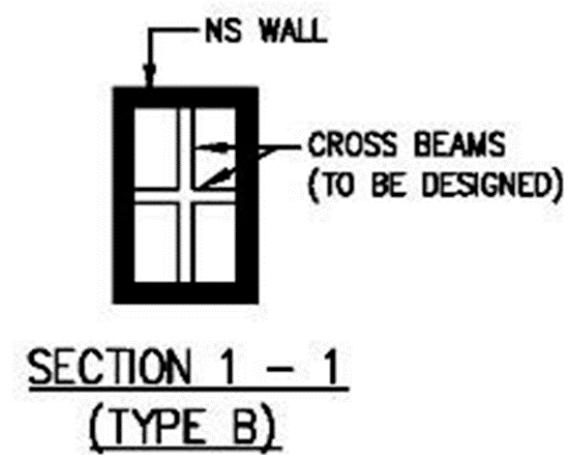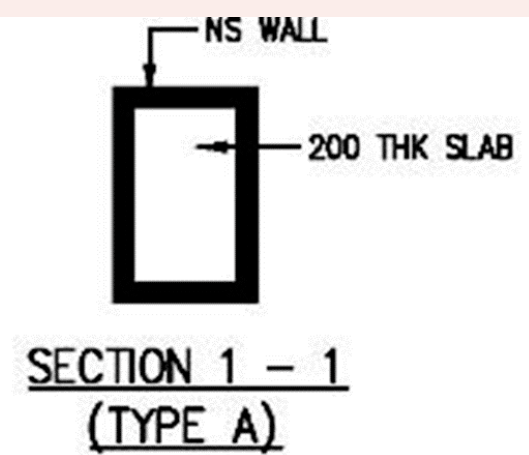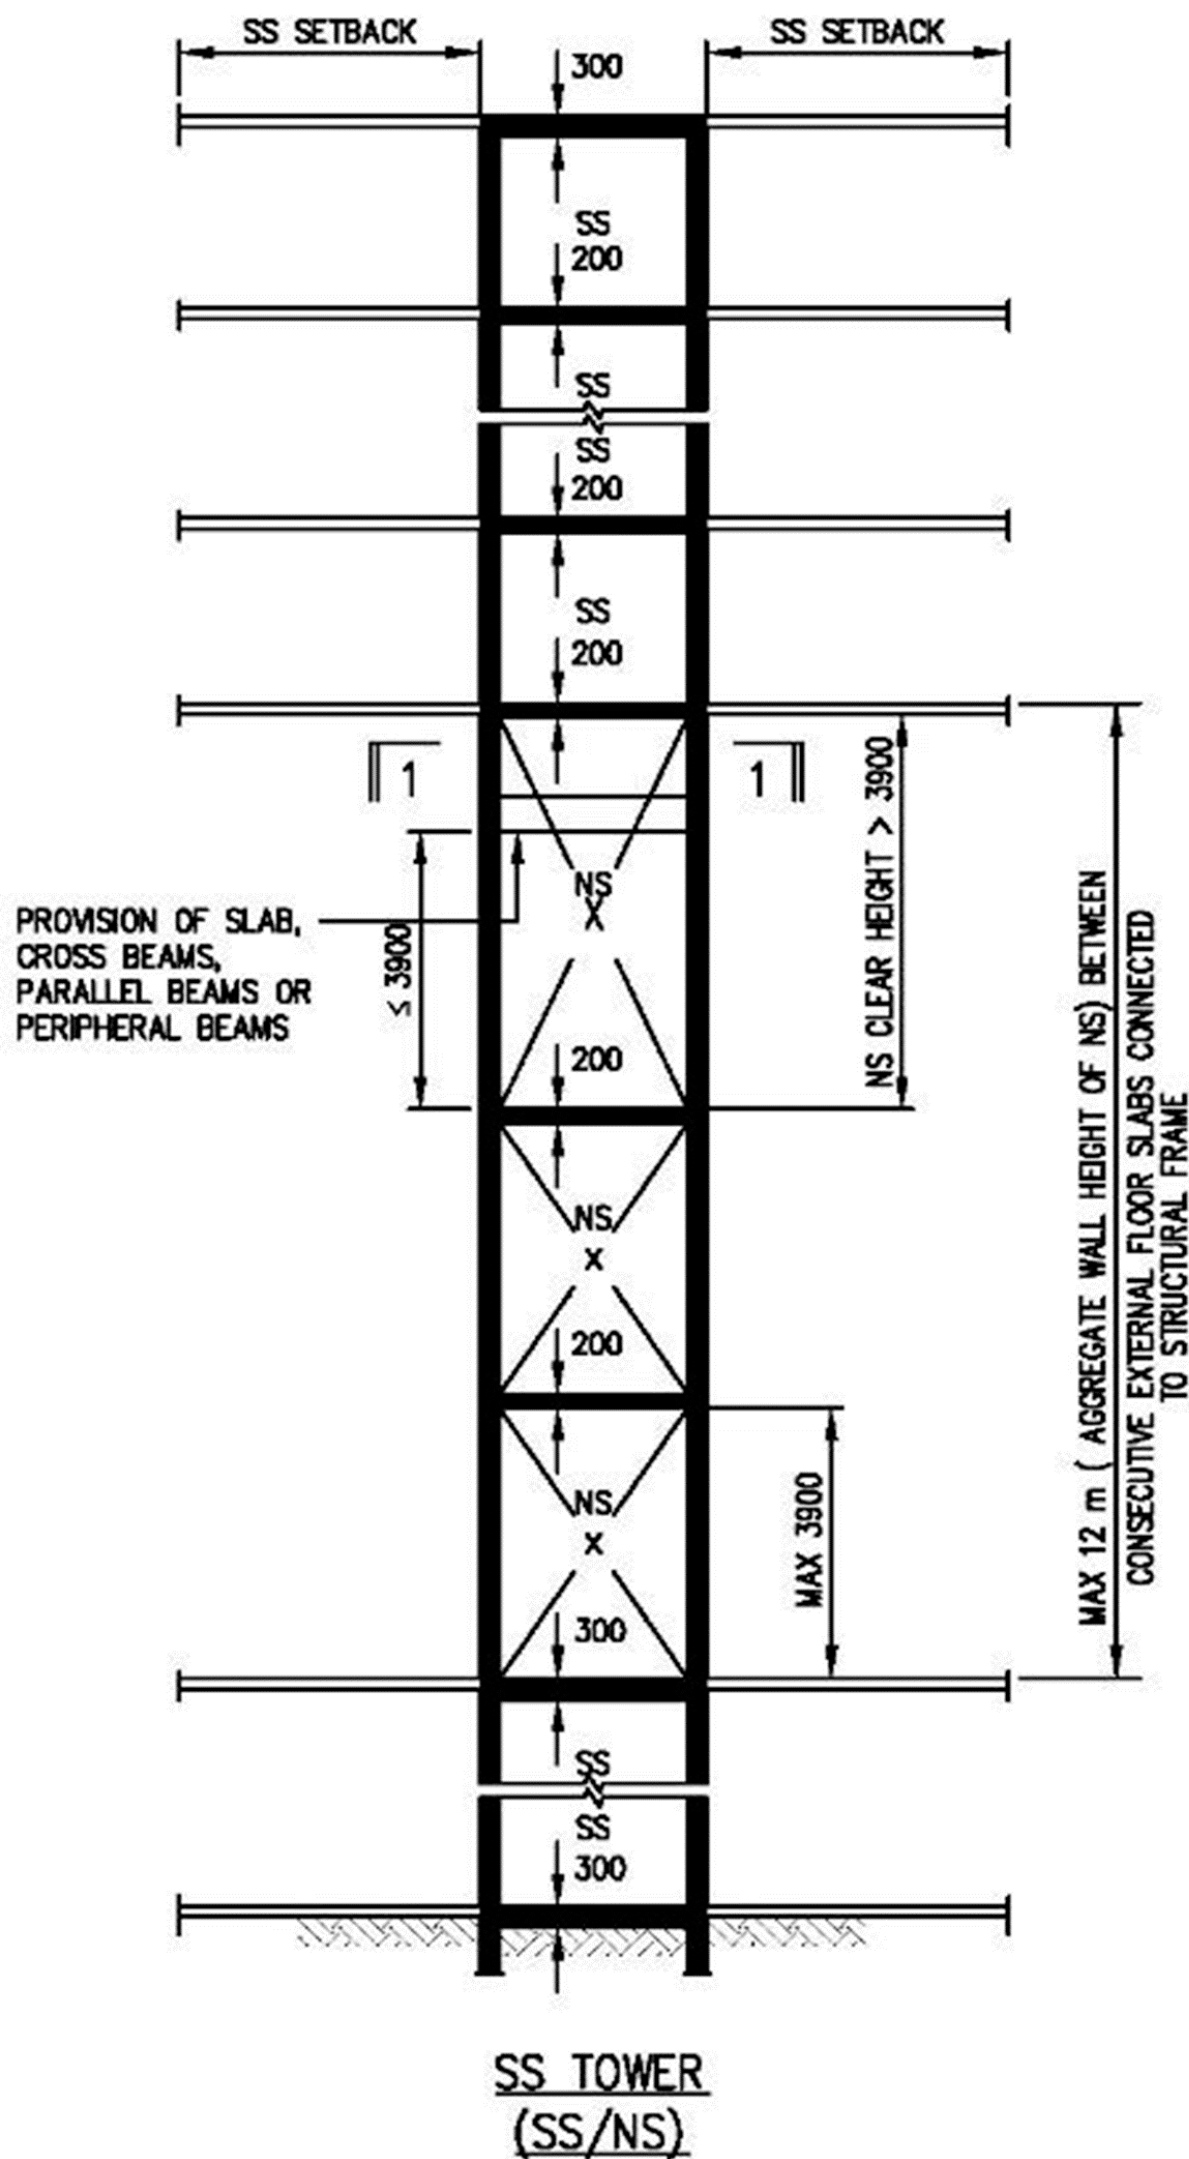

b. Aggregate wall height of NS refers to the sum of the height(s) of NS between two levels of the SS tower where the full external perimeter of the SS tower at those levels are structurally connected by floor slabs or tie beams to the structural frame of the building. Where tie beams are used, they shall

be designed with at least equivalent stiffness to the floor slabs.

2.7.2 Shielded and Unshielded NS Walls

The relevant architectural technical requirements of the shielded or unshielded NS Walls as stipulated in [Clause 3.3.3](#) & [3.3.4](#) shall be complied with.

CLAUSE 2.8 FINISHES IN SS

Finishes within a SS shall comply with the following:


- a. The walls and the ceiling slab shall be cast with a smooth concrete finish.:
- b. The walls and ceiling slab may be finished with a skim coat of not thicker than 2mm.
- c. No plastering or tiling shall be permitted on the walls and ceiling slab.
- d. Floor tiles or floor finishes, which are laid on wet cement mortar, are permitted.
- e. Skirting tiles laid on wet cement mortar are permitted up to a maximum 100mm high above the FFL.

CLAUSe 2.9 EXIT STAIRCASE

- a. Where there is only one exit staircase or scissors-staircase serving the dwelling units, the minimum waist of exit staircase and the thickness of the intermediate landing slab shall be 150mm. The staircase shall be constructed of reinforced concrete.
- b. If the exit staircase or scissors-staircase are designed as the S/C SS, the waist of the staircase shall be minimum 200mm.

CLAUSE 2.10 DOOR RECESS

A door recess on SS or S/C SS external wall, to accommodate the protrusion of the door handle when the SS door is fully open, shall be provided. Refer to FIGURE 2.10.

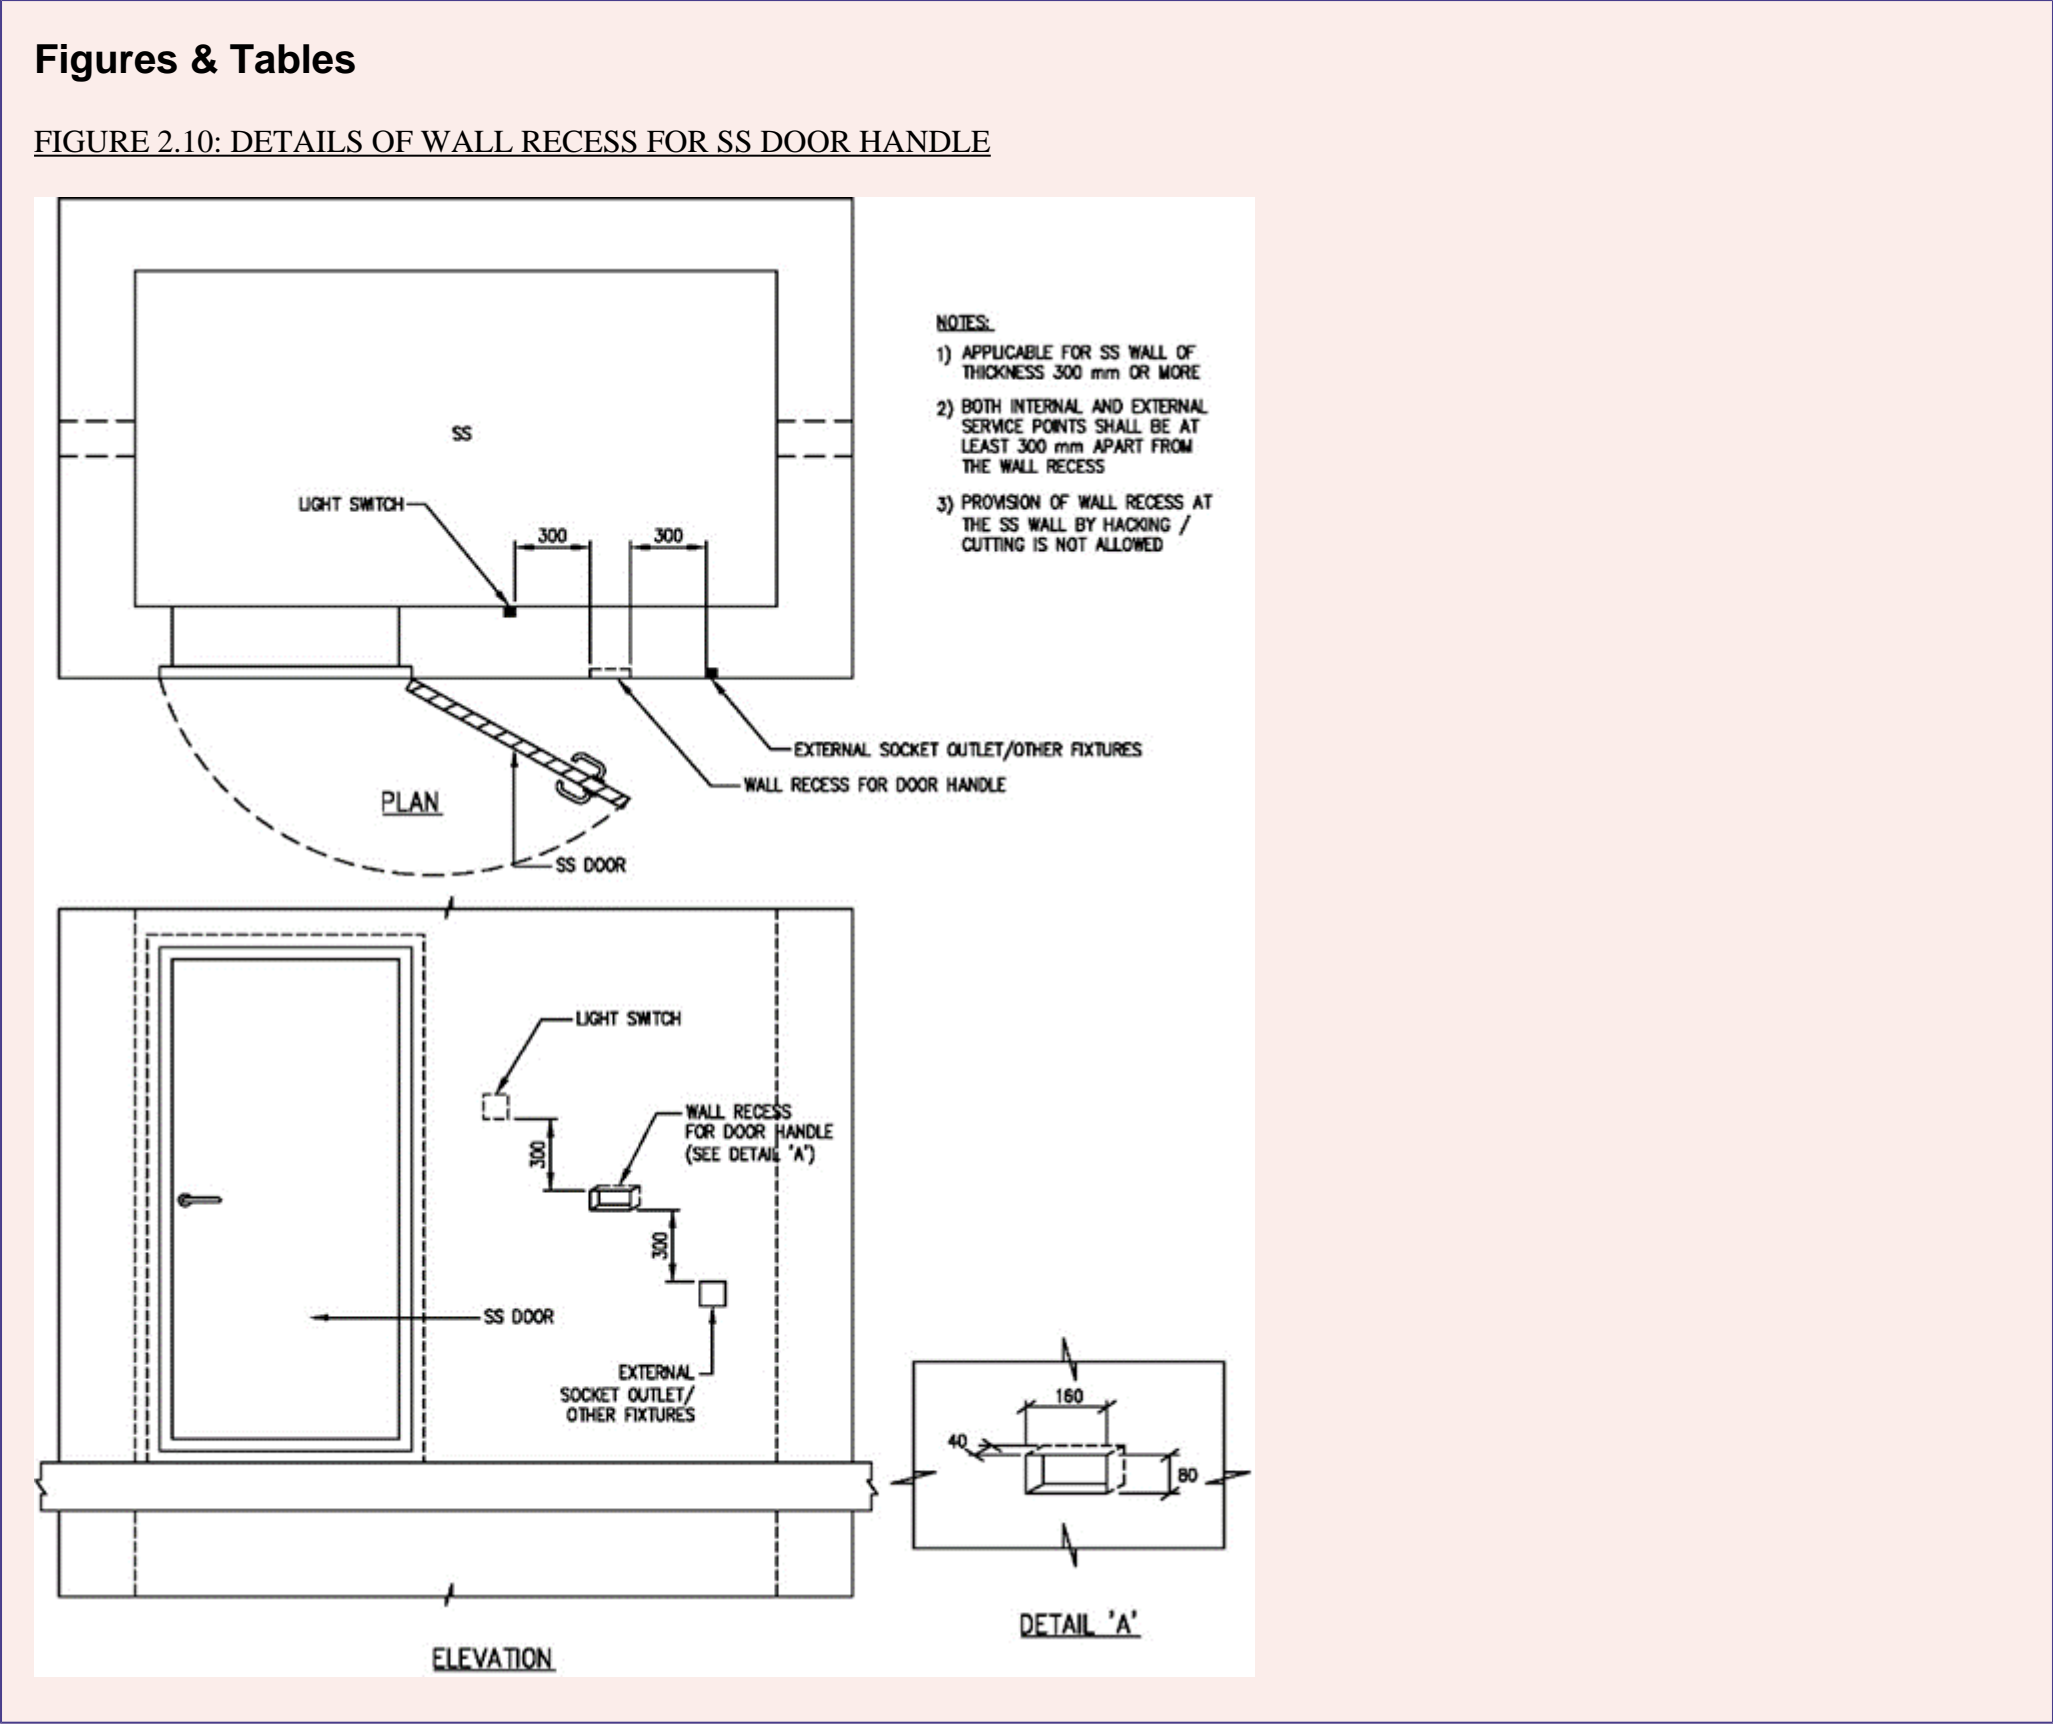

a. The dimensions shall not be larger than 160mm (length) x 80mm (height) x 40mm (depth) for SS or S/C SS wall of minimum 300mm thickness and shall accommodate the door handle adequately.

b. The clear spacing between the SS door handle recess and the external socket outlet/ other fixtures or internal fixtures shall be at least 300mm apart.

CLAUSE 2.11 DESIGN REQUIREMENTS OF SS

2.11.1 Rescue Hatch

- a. A rescue hatch shall be provided on the floor and ceiling on every SS in a SS tower, except that the bottom-most SS shall not have a rescue hatch in its floor and the top- most SS shall not have a rescue hatch in its ceiling. The hatch shall be made of airtight sealed galvanised steel and shall comply with relevant fire safety requirements for compartmentalisation of the SS*. (* QP is advised to look into the fire safety requirements of their designs for compartmentalisation of the SS).
- b. The rescue hatch opening in an SS shall be positioned adjacent to the SS walls with minimum dimensions as shown in FIGURE 2.11.1(a). The vertical centreline of the rescue hatch opening in the ceiling shall be offset from the centreline of the rescue hatch in the floor of the same SS by at least 1400mm. Refer to FIGURE 2.11.1(b).

Figures & Tables

FIGURE 2.11.1(a): MINIMUM DISTANCE OF RESCUE HATCH FROM SS WALL


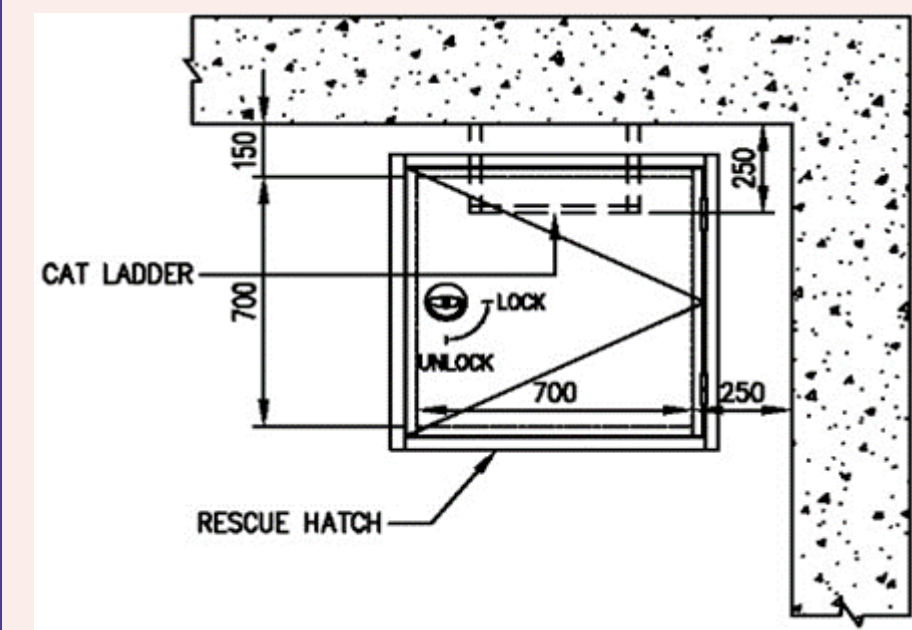



FIGURE 2.11.1(b): MINIMUM DISTANCE BETWEEN CENTRE LINES OF RESCUE HATCH

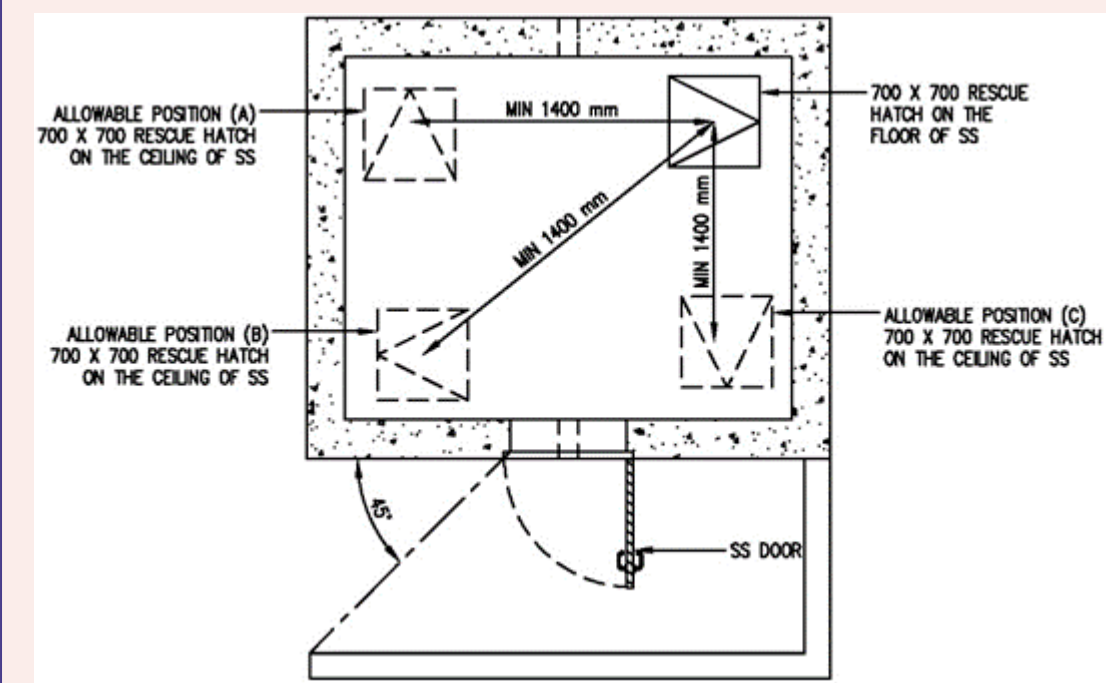

- c. The clear opening of the rescue hatch shall be 700mm x 700mm. The dimensions of the rescue hatch are as shown in FIGURE 2.11.1(c).

Figures & Tables

FIGURE 2.11.1(c): MINIMUM DIMENSIONS OF RESCUE HATCH

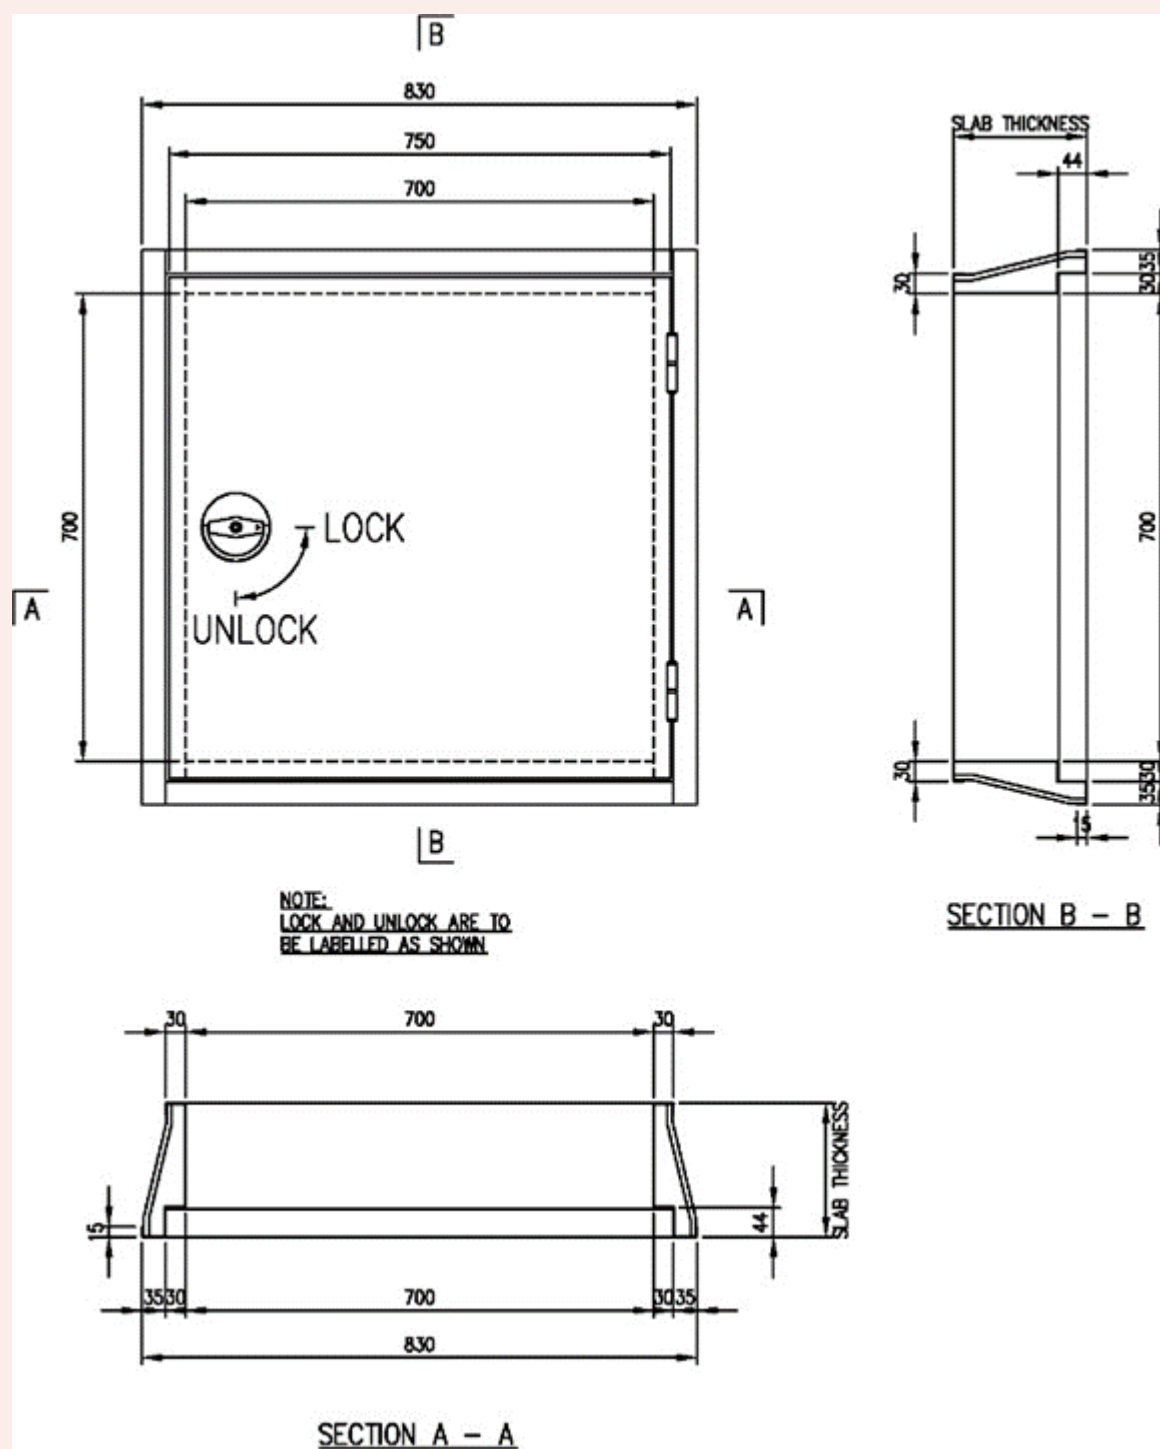


2.11.2 Cat-Ladder

Cat-ladder shall be provided for access through rescue hatch opening. The cat-ladder shall be made of either stainless steel or aluminium or equivalent. The mounting connections of cat- ladder to the SS wall shall be designed to withstand shock loads of at least 12.5g in all directions, where g is the gravitational acceleration, details and dimensions as shown in FIGURE 2.11.2.


Figures & Tables

FIGURE 2.11.2: DETAILS OF CAT LADDER TO SS WALL

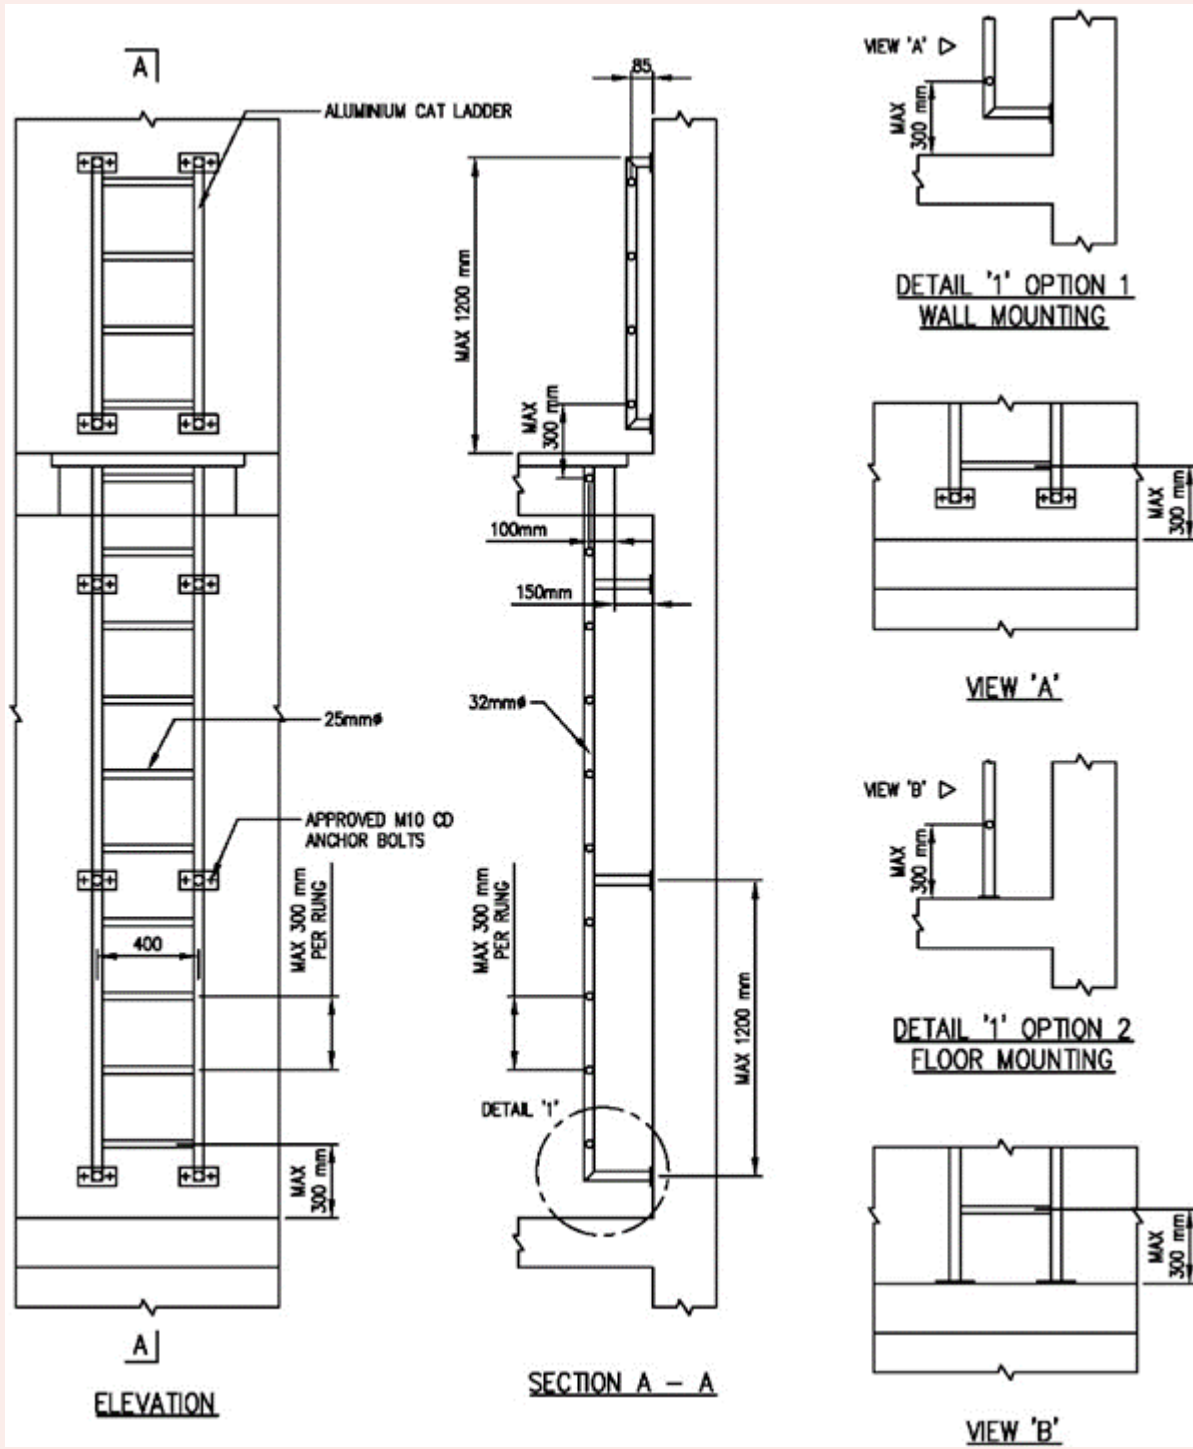

2.12.1 General

- a. The protection carcass shall be formed by external SS wall, floor slab of the bottom- most shelter compartment and the ceiling slab of the top-most shelter compartment. FIGURE 2.12.1(a) to 2.12.1(c).

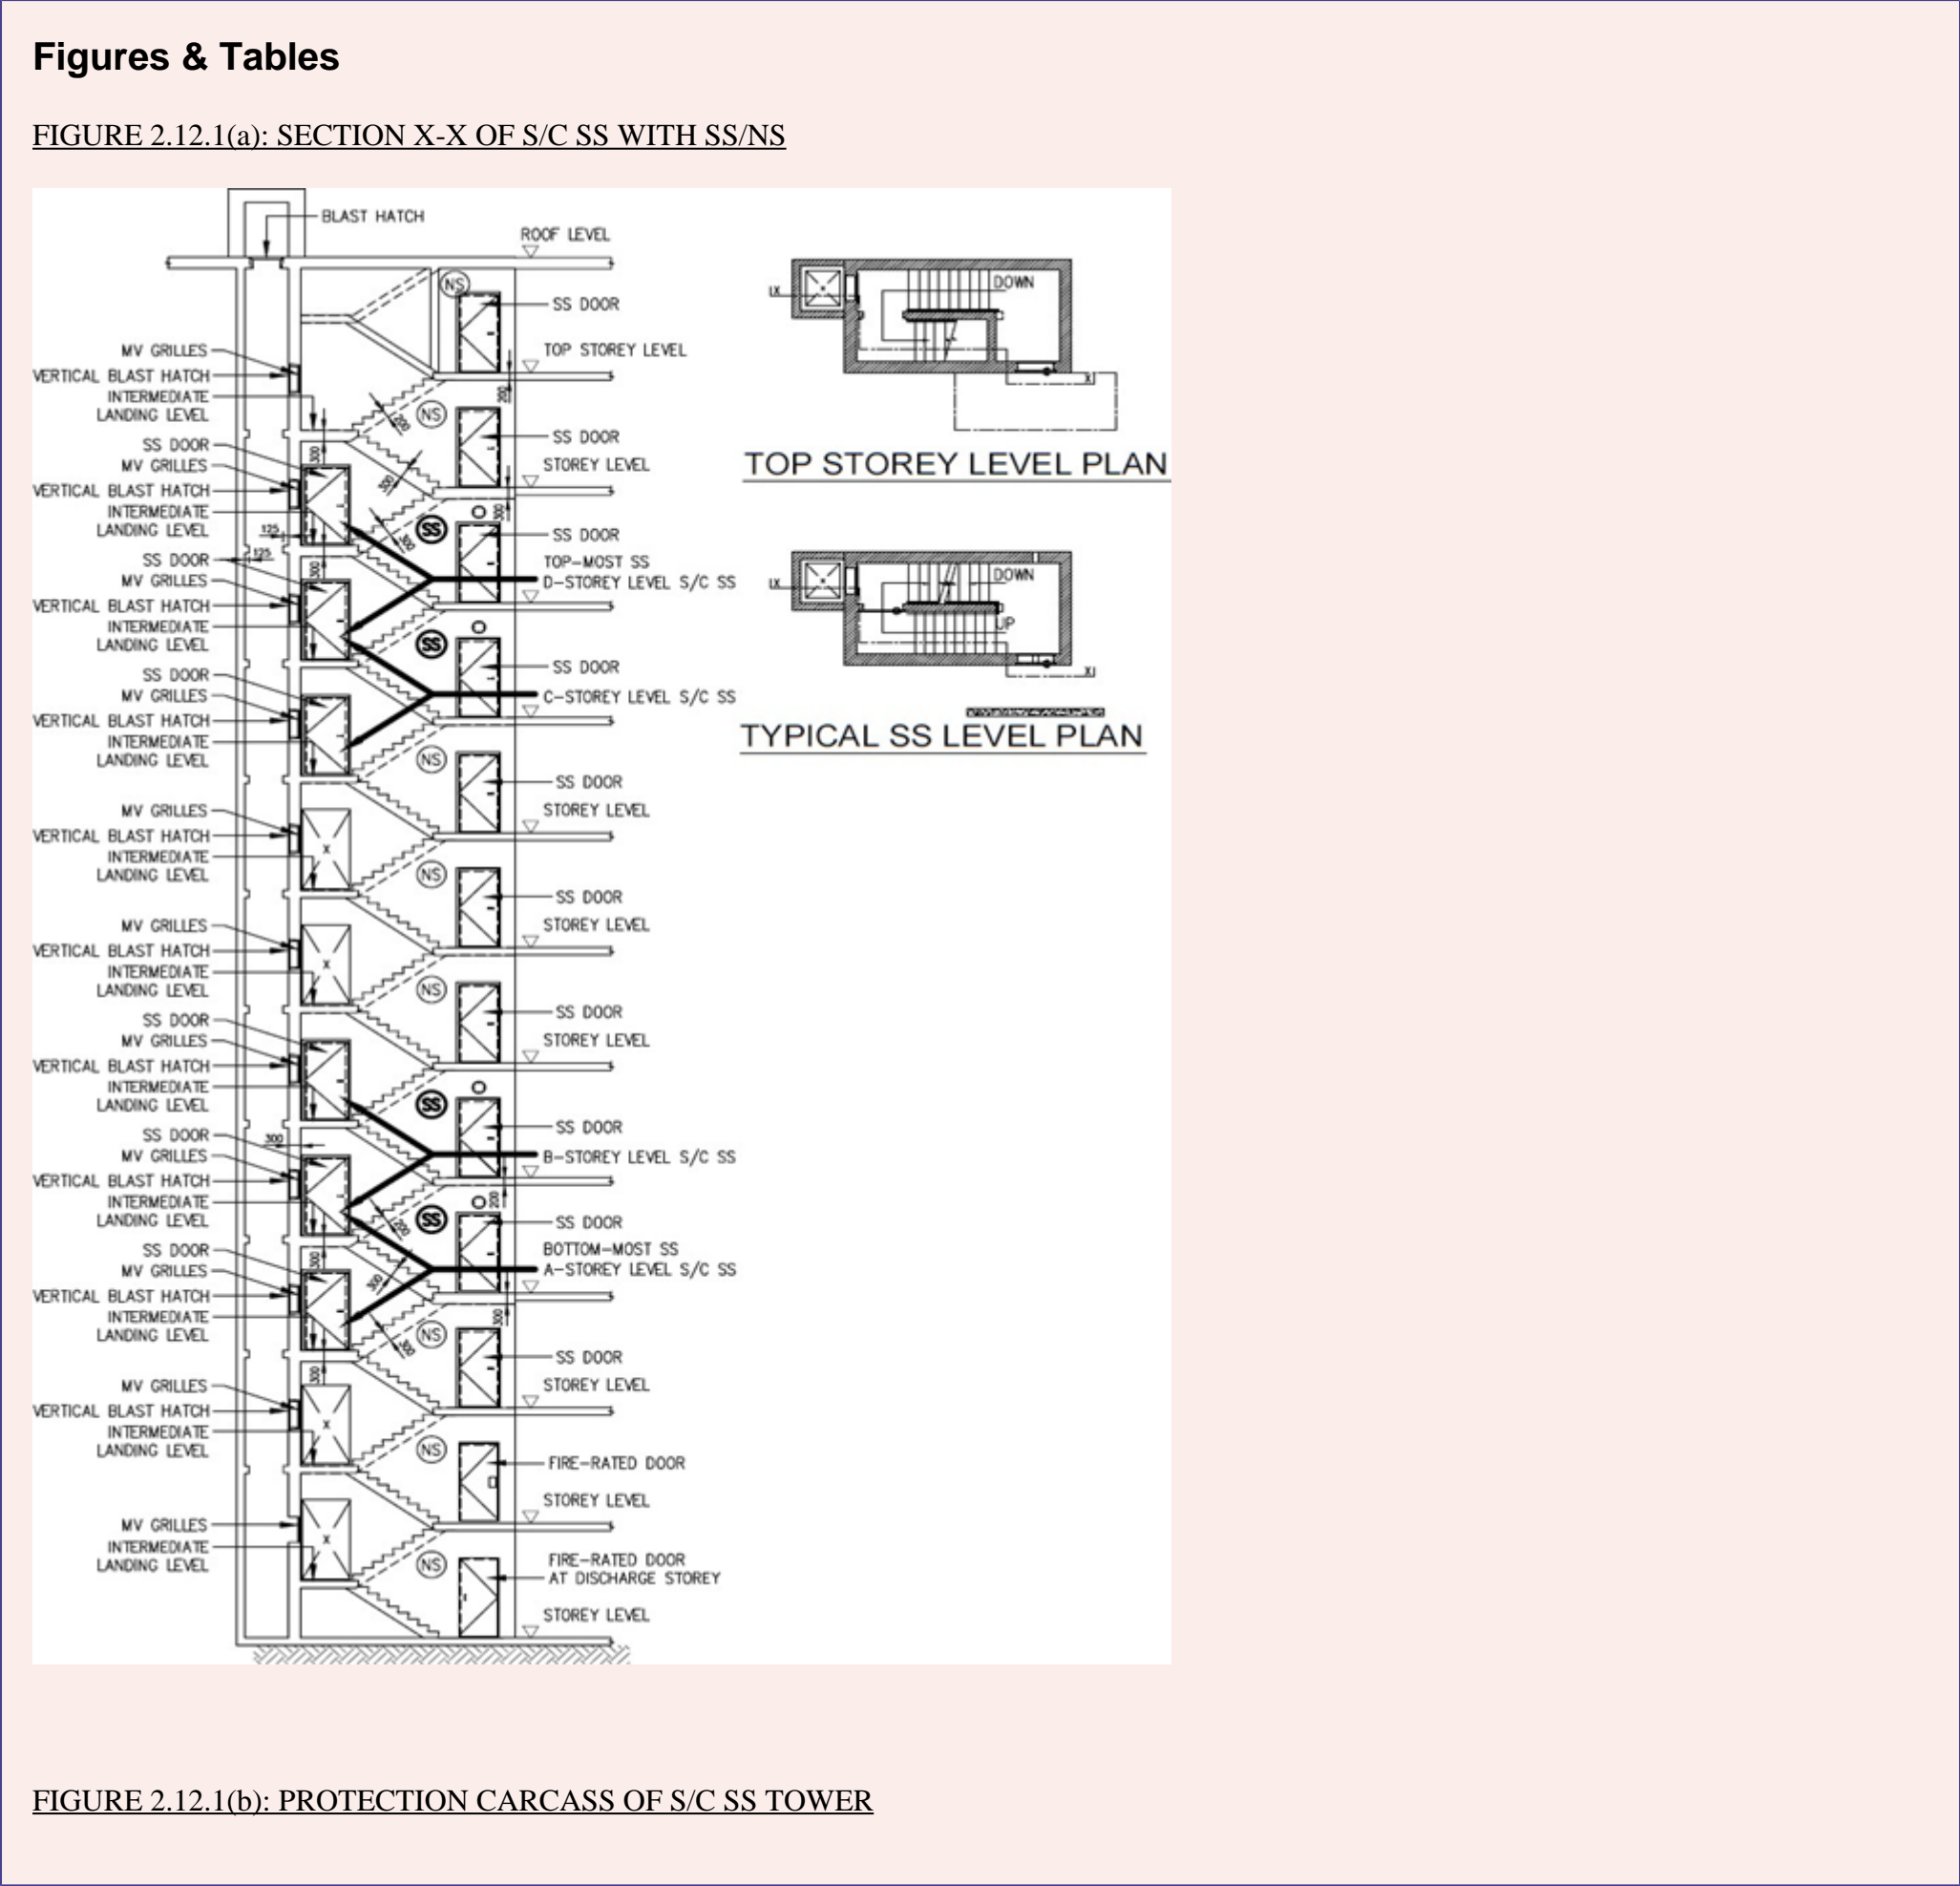

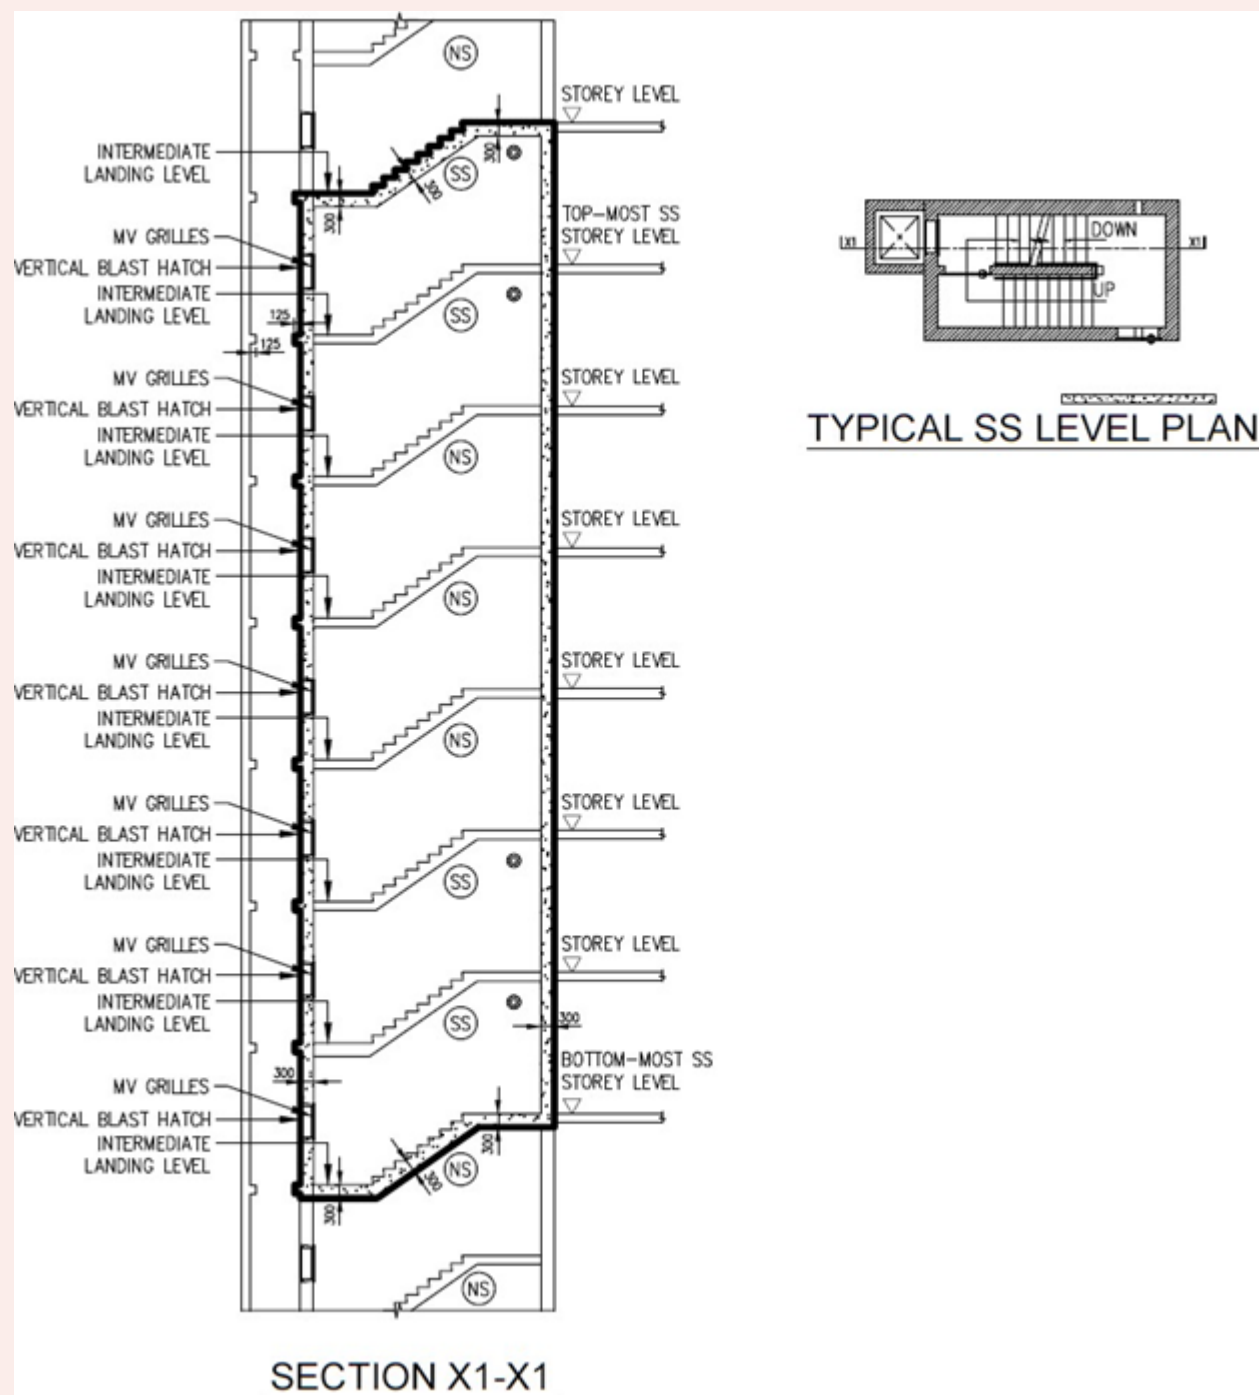


FIGURE 2.12.1(c): PROTECTION CARCASS OF S/C SS TOWER

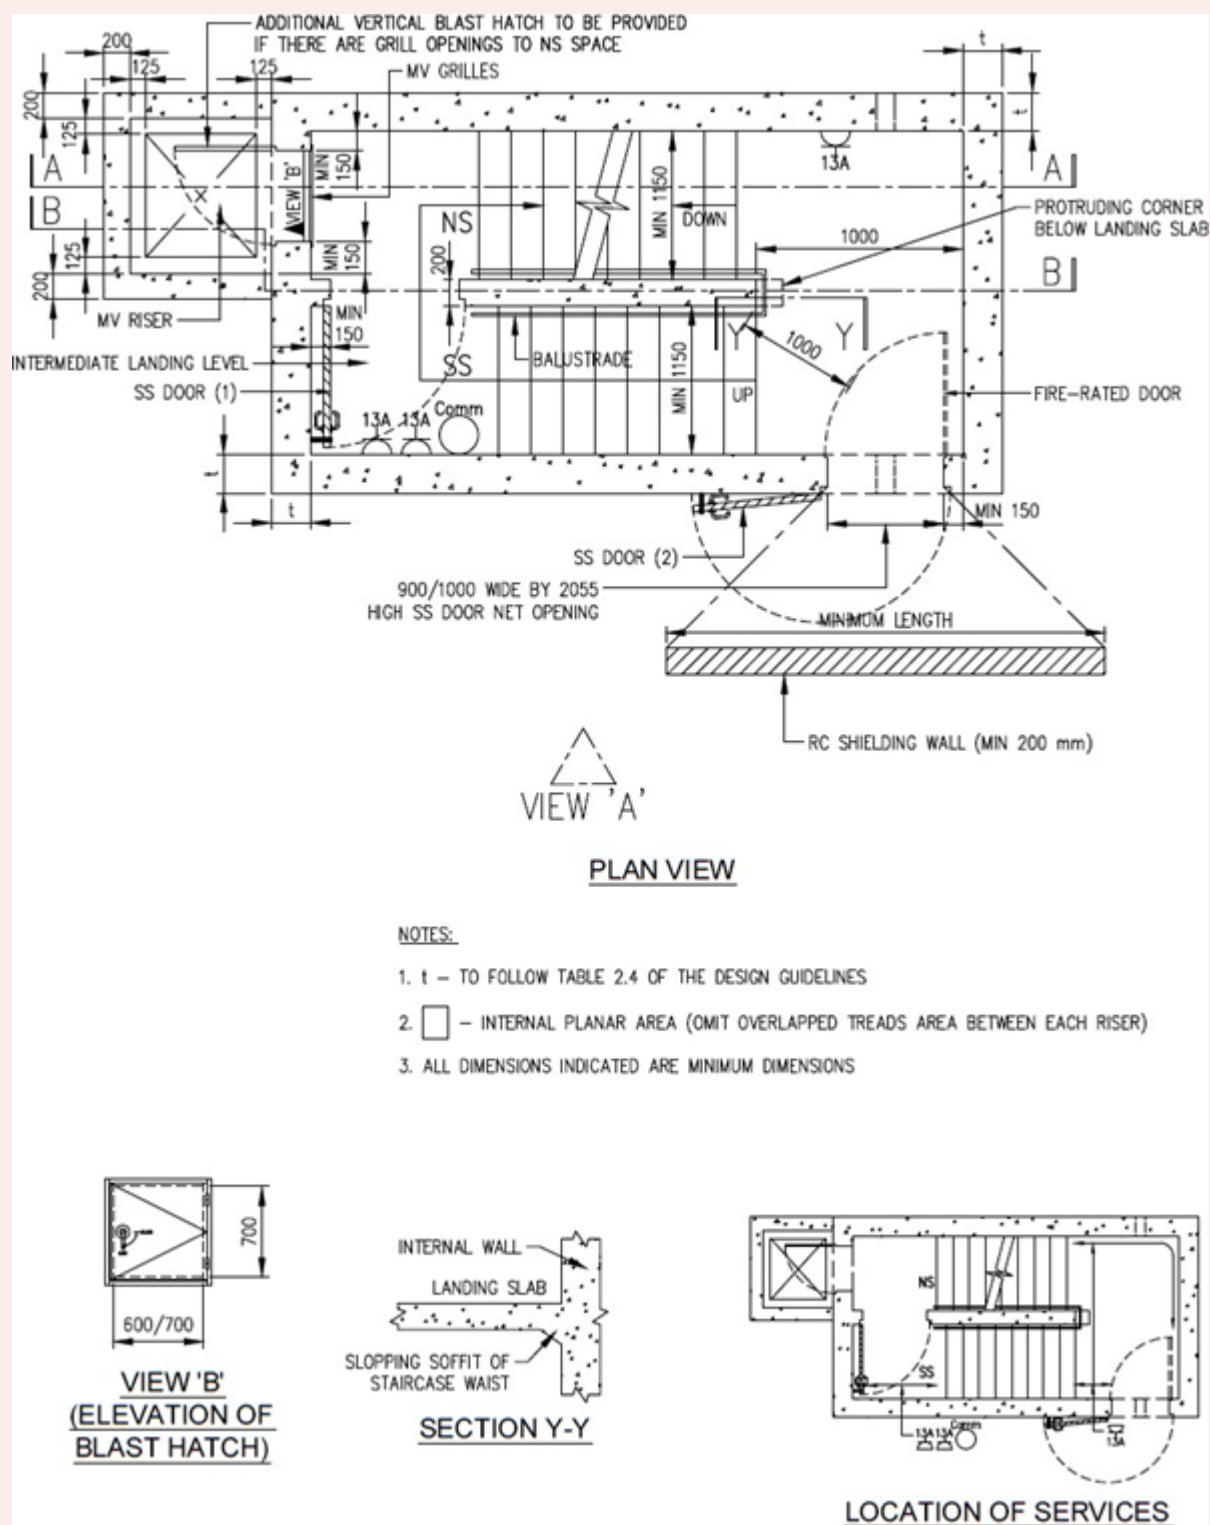


FIGURE 2.12.1(f): TYPICAL PLAN OF S/C SS COMPARTMENT


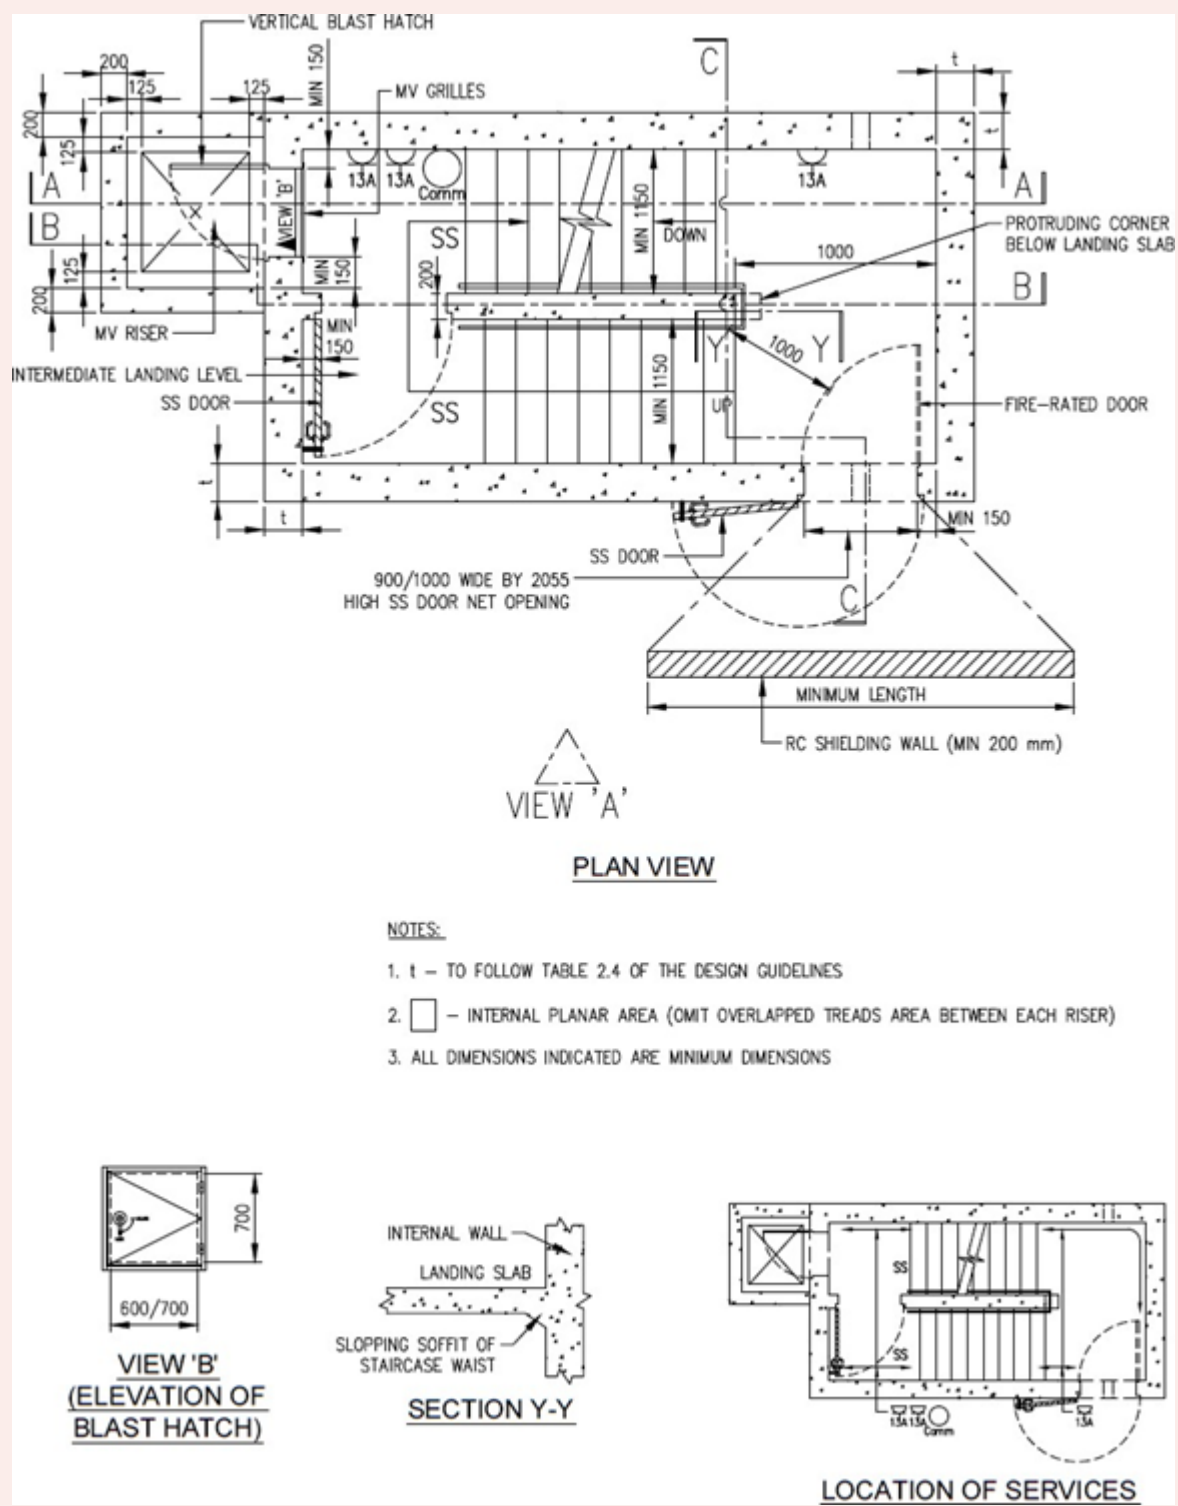


FIGURE 2.12.1(g): PLAN OF BOTTOM-MOST S/C SS COMPARTMENT

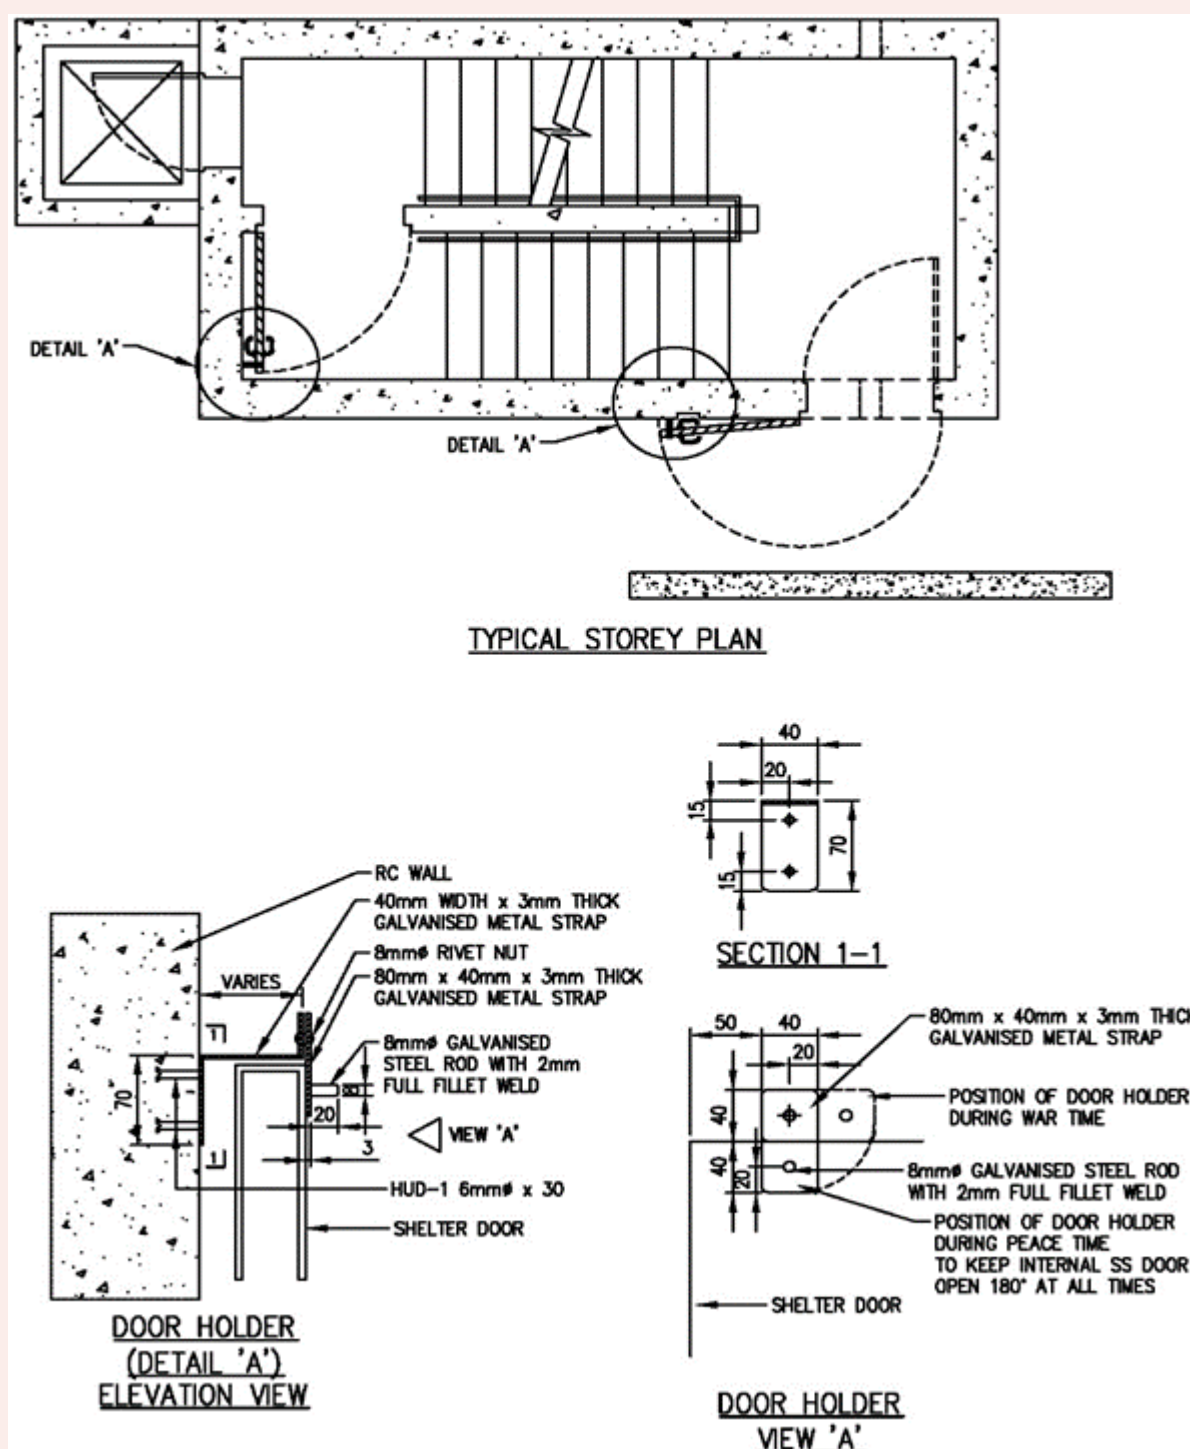

d. S/C SS and scissor S/C SS have to be mechanically ventilated for peacetime purpose. The number of mechanical ventilation (MV) openings is based on the peacetime MV design. Where there are MV openings, grille openings for entry of ventilating air via mechanical ventilation (MV) riser are permitted. Refer to Figure 2.12.2(c). Typically, for a scissor S/C SS, the MV openings are at alternate floors of each SS tower as shown in FIGURE 2.12.2(j) and 2.12.2(k).

Figures & Tables

FIGURE 2.12.2(c): SS WITH NS ABOVE TOP-MOST SS COMPARTMENT, INTERMEDIATE SS COMPARTMENT AND SS WITH NS BELOW BOTTOM-MOST SS COMPARTMENT



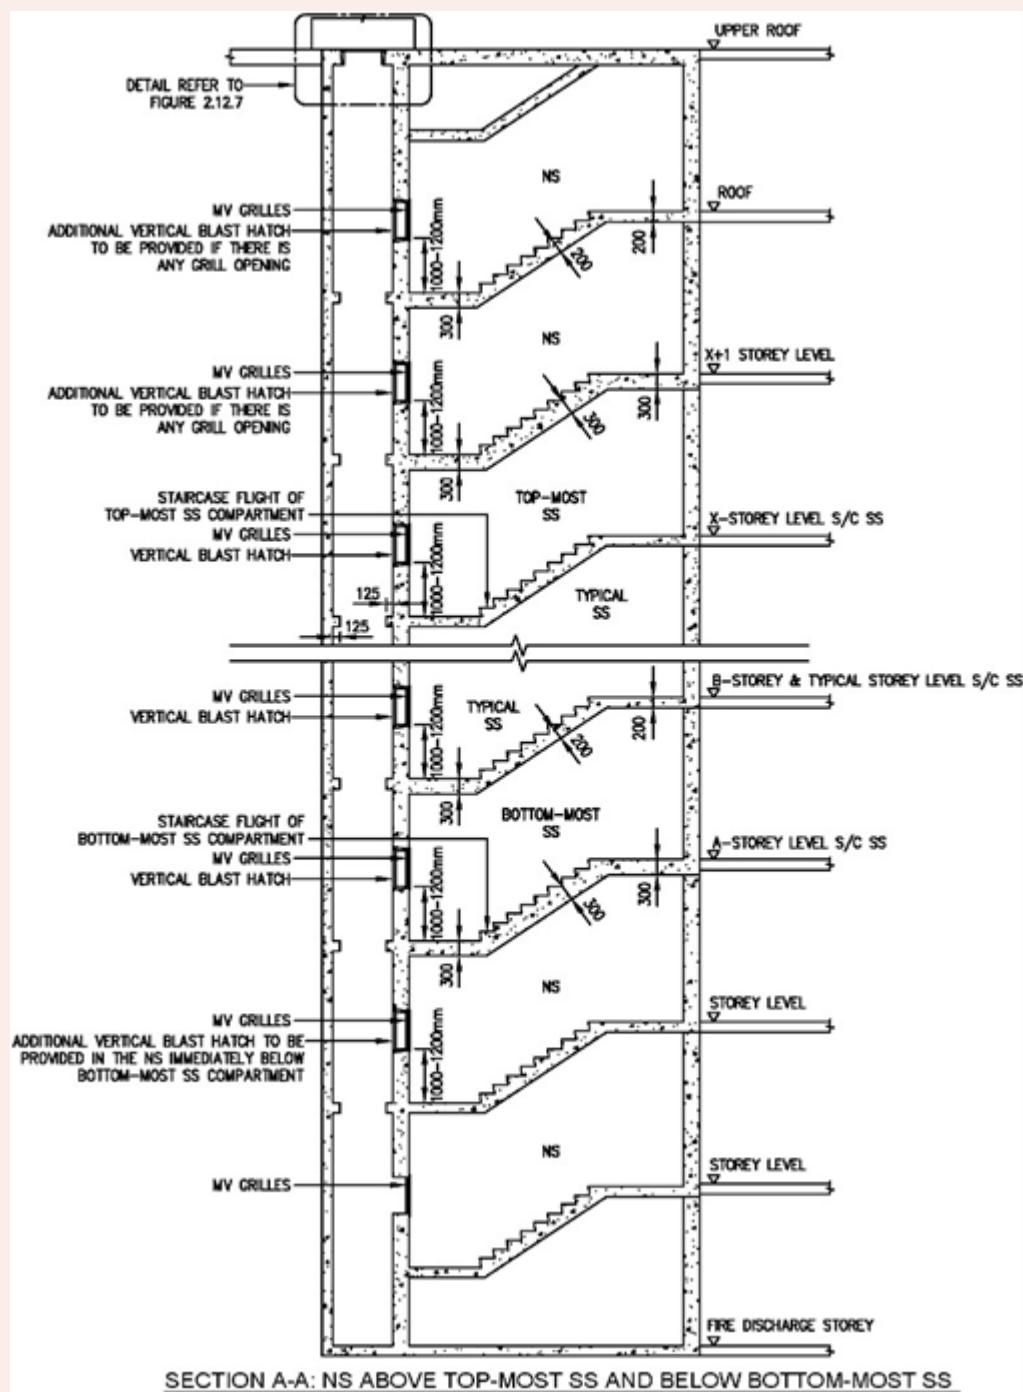


FIGURE 2.12.2(j): SCISSOR S/C SS COMPARTMENT PLAN

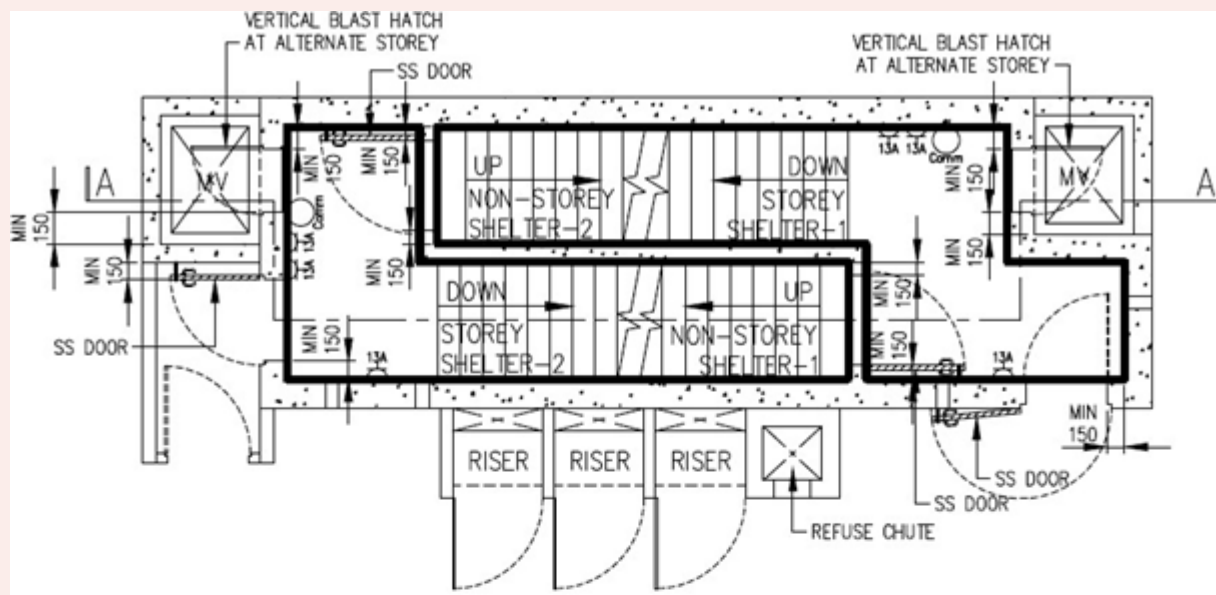


TOP-MOST COMPARTMENT PLAN FOR
SCISSOR STAIRCASE STOREY SHELTER

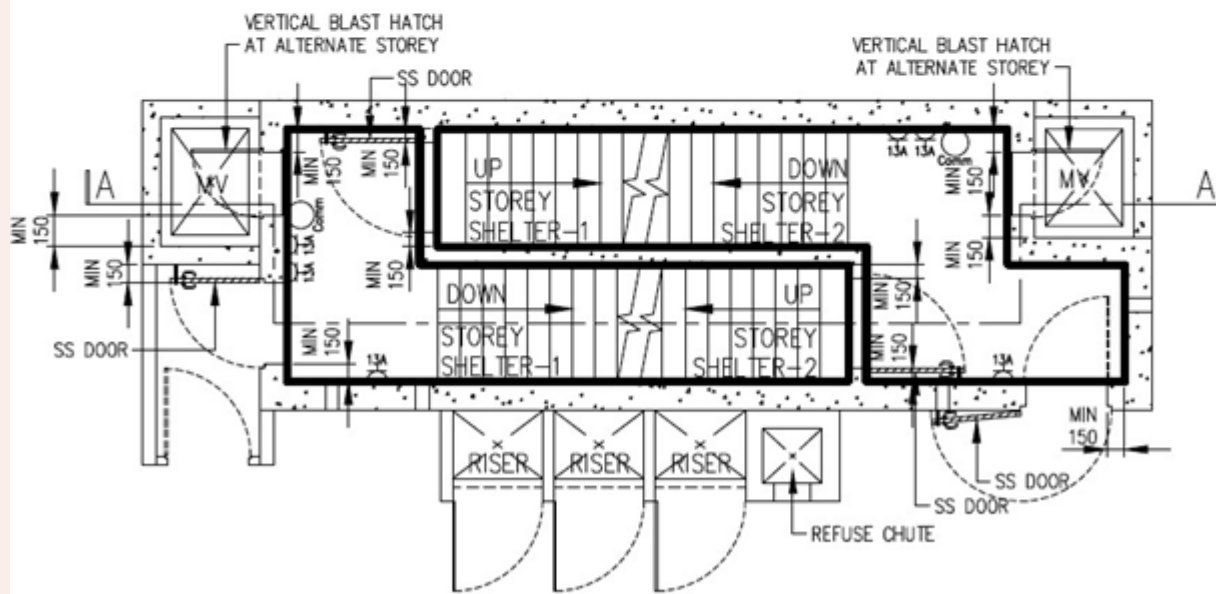

TYPICAL STOREY COMPARTMENT PLAN FOR
SCISSOR STAIRCASE STOREY SHELTER

FIGURE 2.12.2(k): SECTION OF SCISSOR S/C SS COMPARTMENT

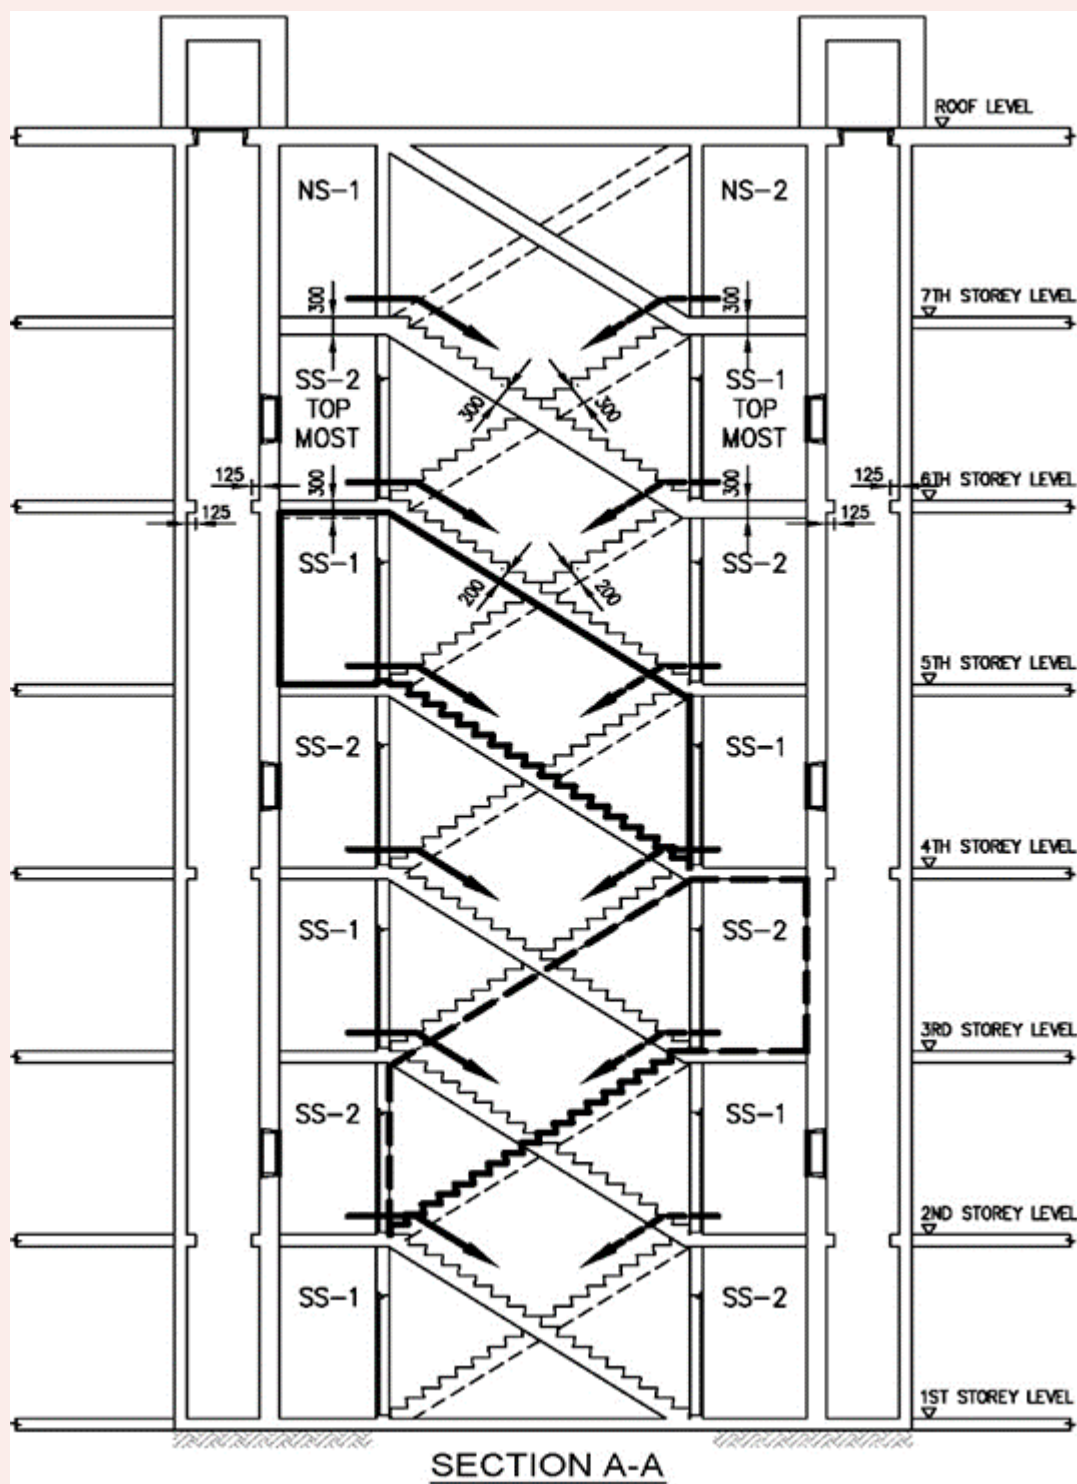

e. No other openings shall be permitted in each S/C SS compartment except for the two ventilation sleeves, which are placed in closed position, and the required MV opening..

2.12.2 S/C SS Doors at Shelter Entrance

a. At every storey, one SS door with removable door kerb, is to be provided at the shelter entrance and shall be kept in the open position during peacetime. Refer to FIGURE 2.12.2(b), 2.12.2(d) to 2.12.2(k). A door holder shall be provided to hold the internal SS door in open position. Refer to FIGURE 2.12.2(l). As this SS door swing against the direction of exit travel, it shall be not doubled up as the peacetime fire-rated door.

Figures & Tables

FIGURE 2.12.2(b): SS WITH NS ABOVE TOP-MOST SS COMPARTMENT, INTERMEDIATE SS COMPARTMENT AND SS WITH NS BELOW BOTTOM-MOST SS COMPARTMENT

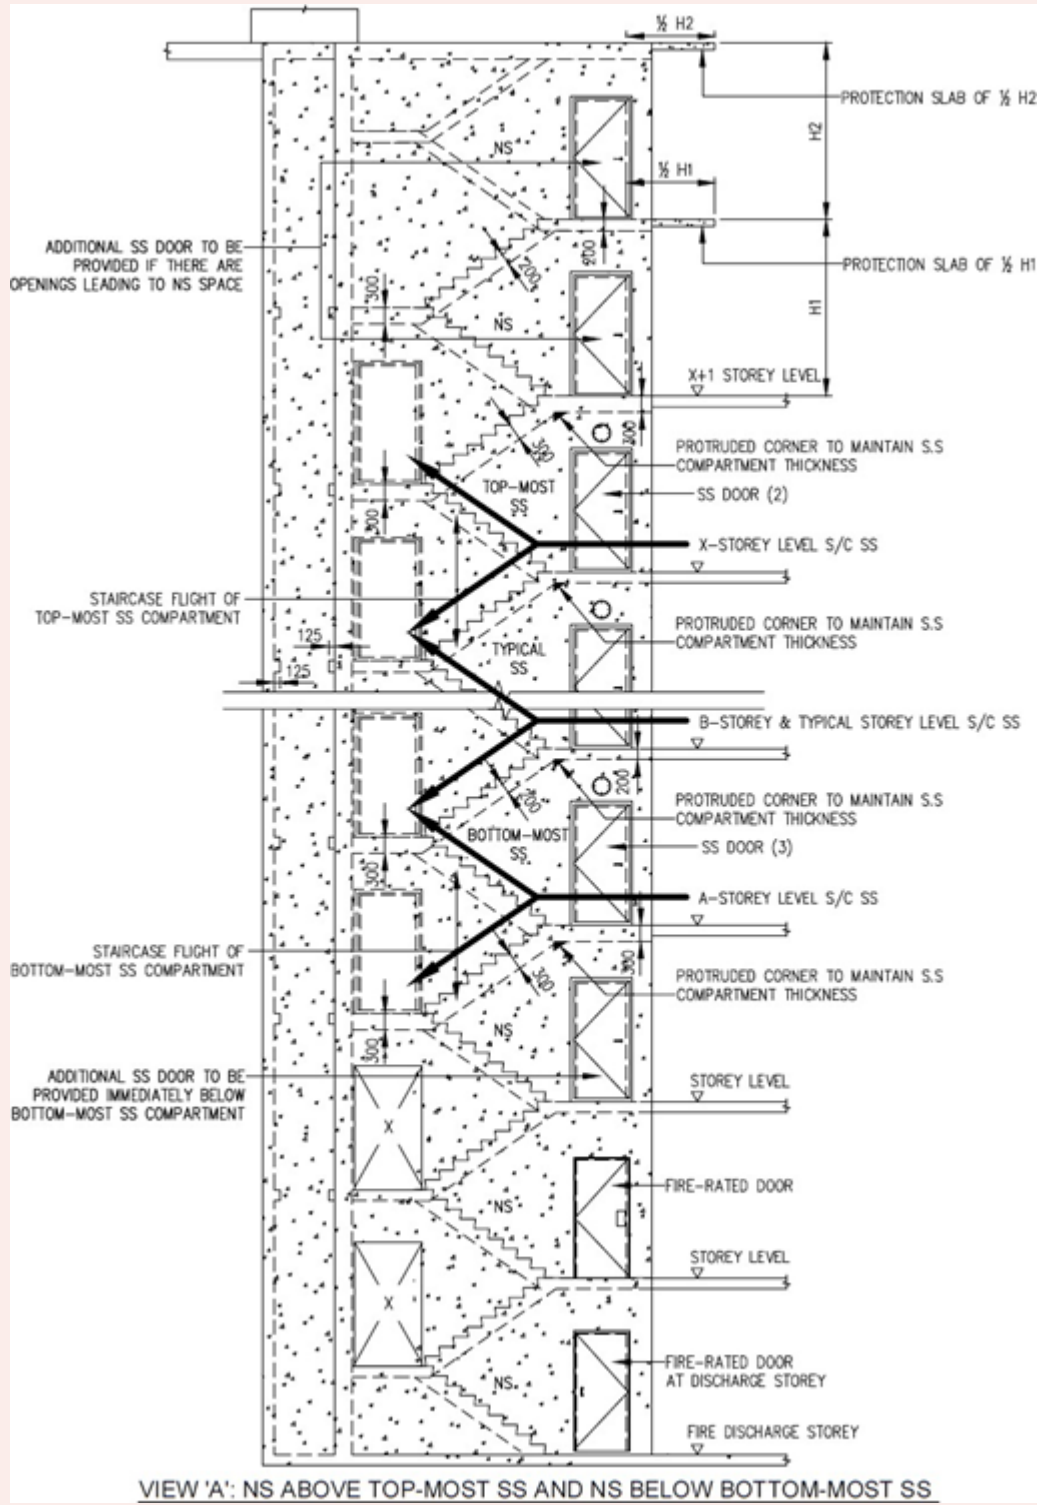


FIGURE 2.12.2(d): SS WITH NS ABOVE TOP-MOST SS COMPARTMENT, INTERMEDIATE SS COMPARTMENT AND SS WITH NS BELOW BOTTOM-MOST SS COMPARTMENT

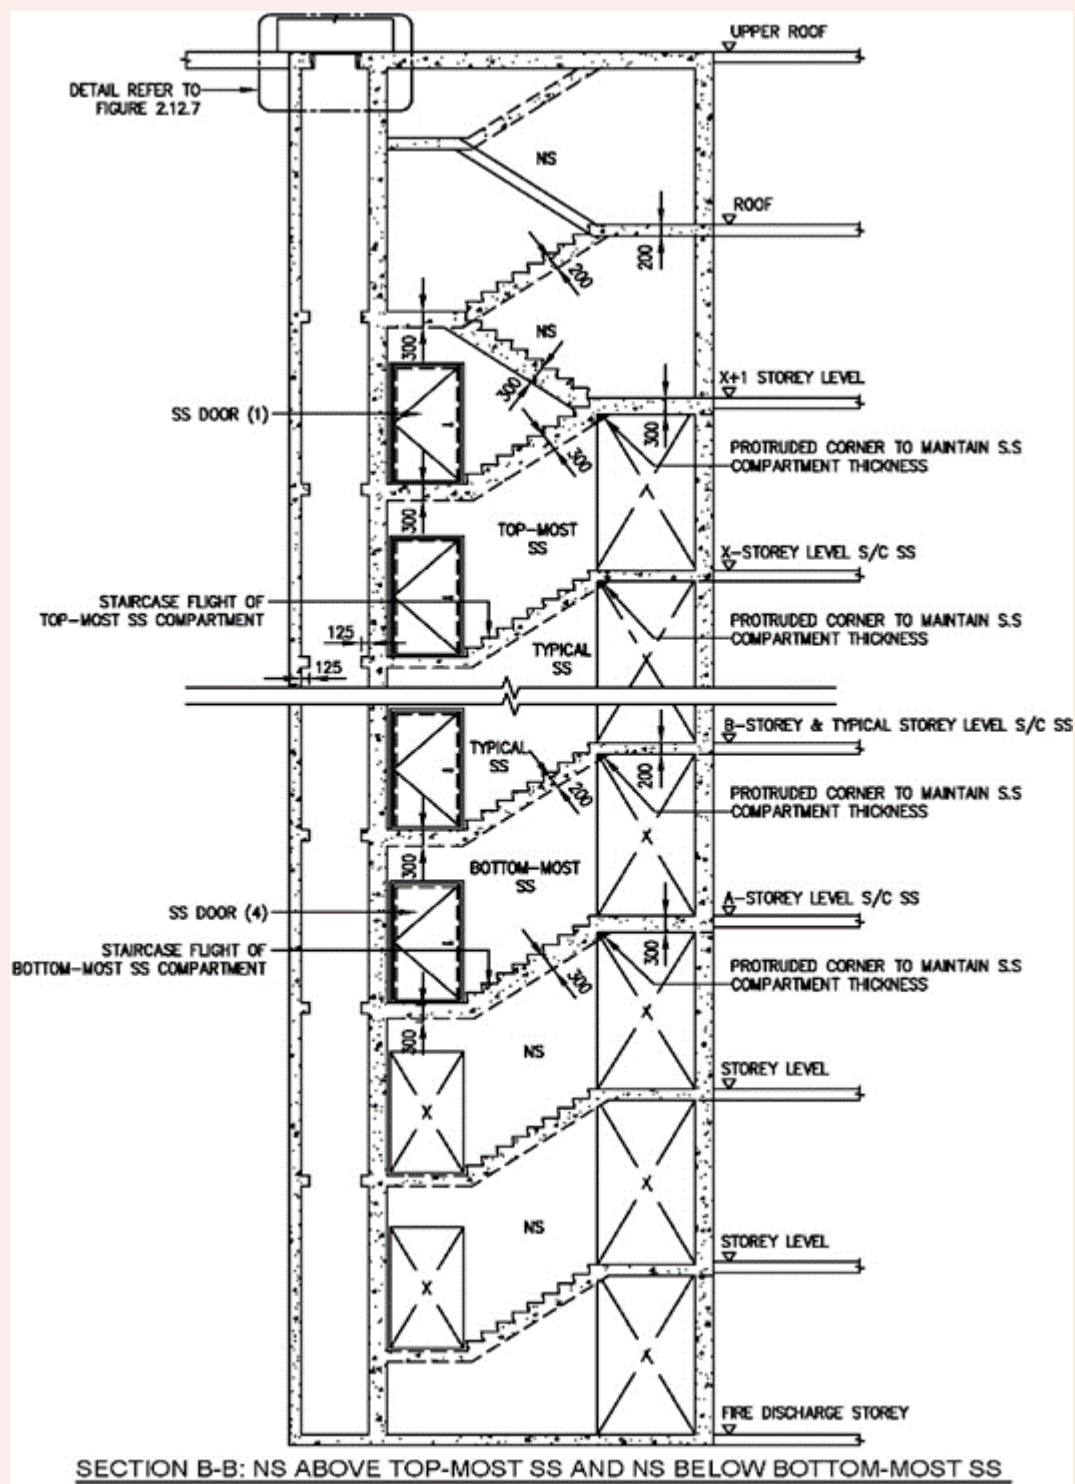


FIGURE 2.12.2(e): SS WITH NS ABOVE TOP-MOST SS COMPARTMENT, INTERMEDIATE SS COMPARTMENT AND SS WITH NS BELOW BOTTOM-MOST SS COMPARTMENT

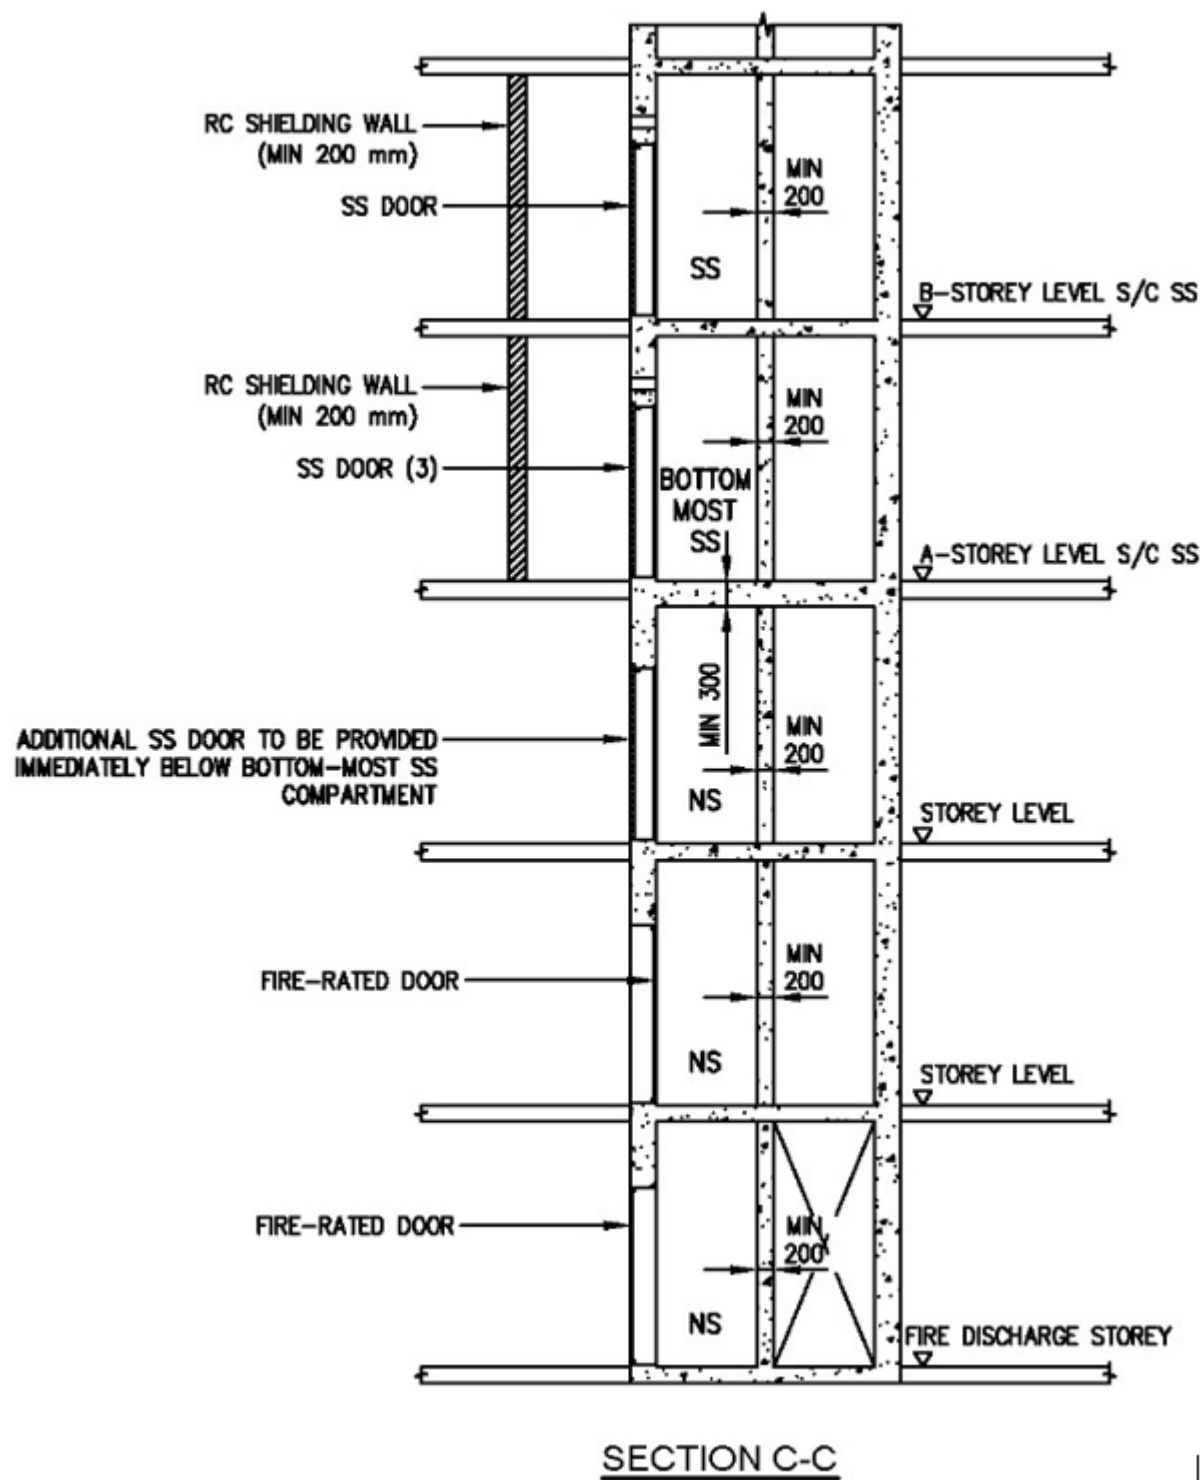


FIGURE 2.12.2(f): DETAIL PLAN OF S/C SS AND NS AT FIRE DISCHARGE STOREY

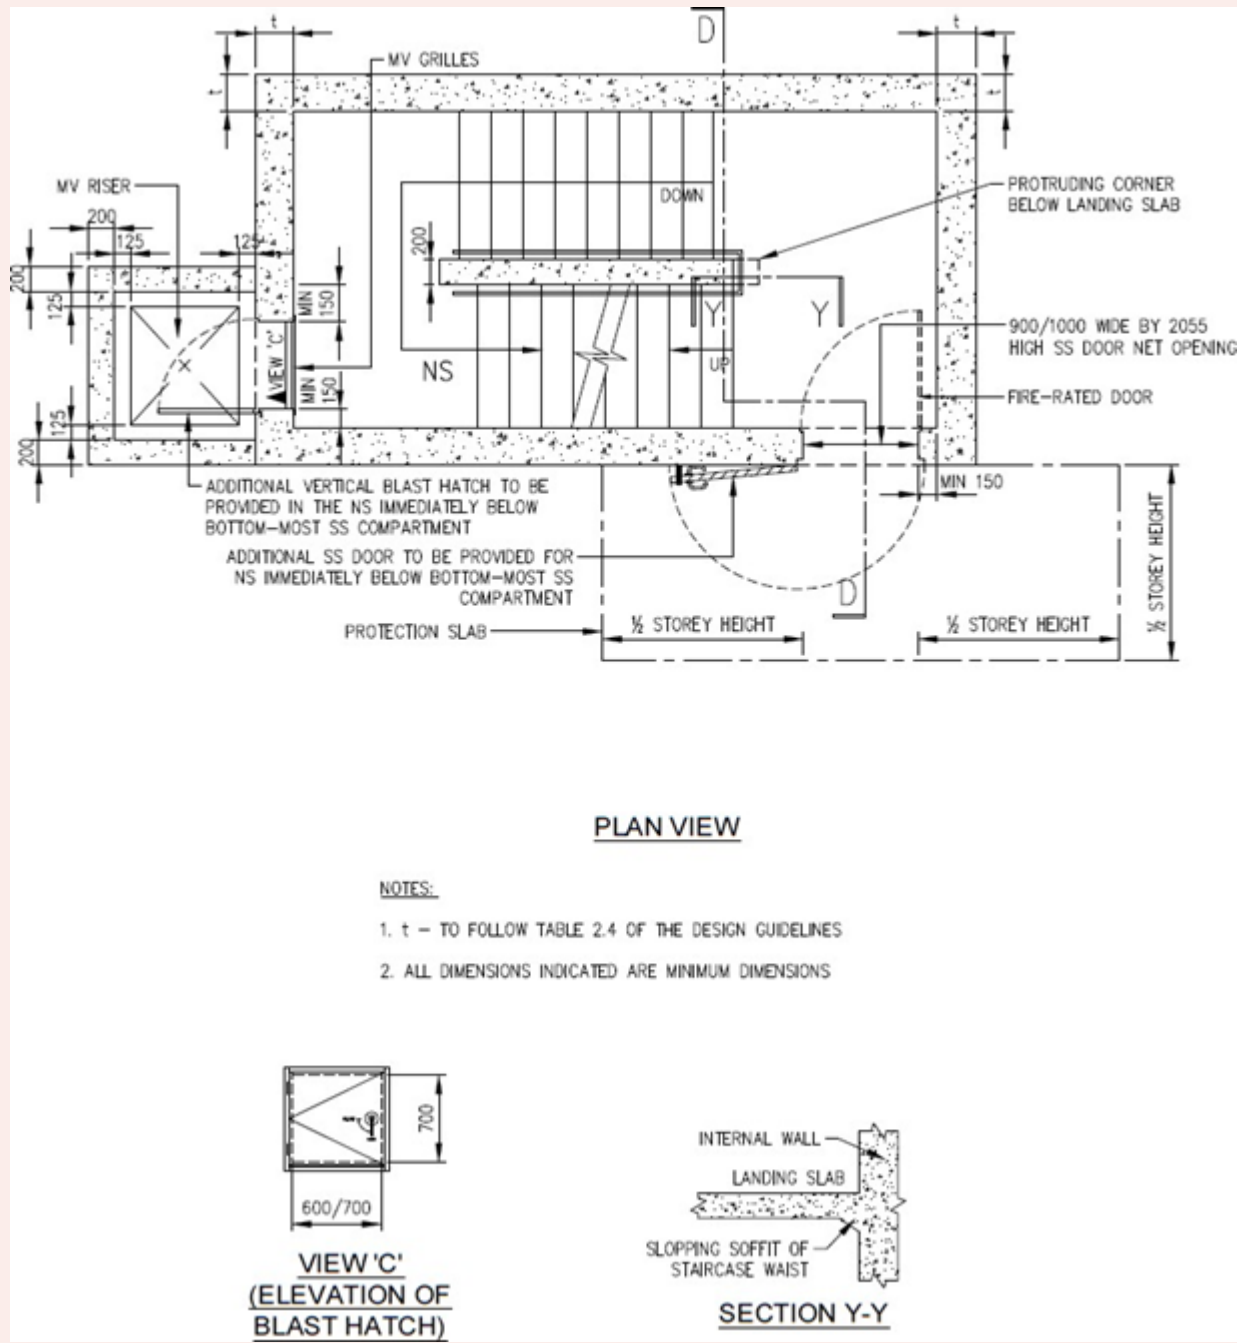


FIGURE 2.12.2(h): DETAIL SECTION OF SS AND NS AT FIRE DISCHARGE STOREY



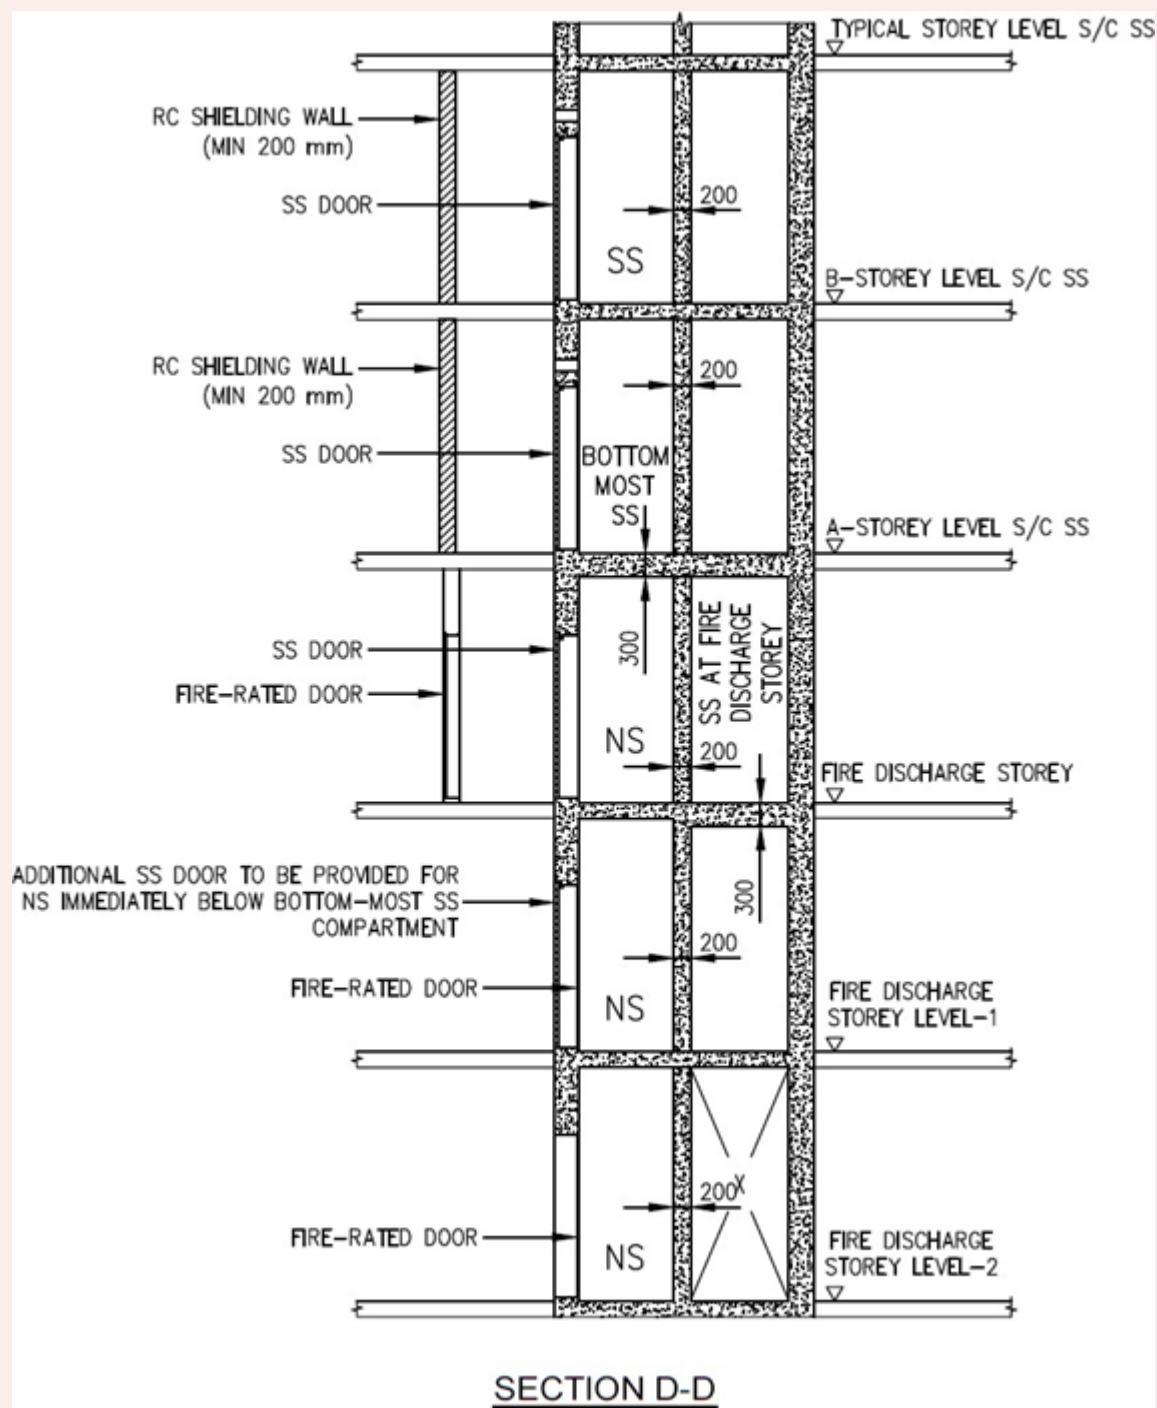


FIGURE 2.12.2(i): SS WITH NS COMPARTMENT WITH LAST BOTTOM-MOST SS DOOR ON 300MM THICK INTERNAL WALL

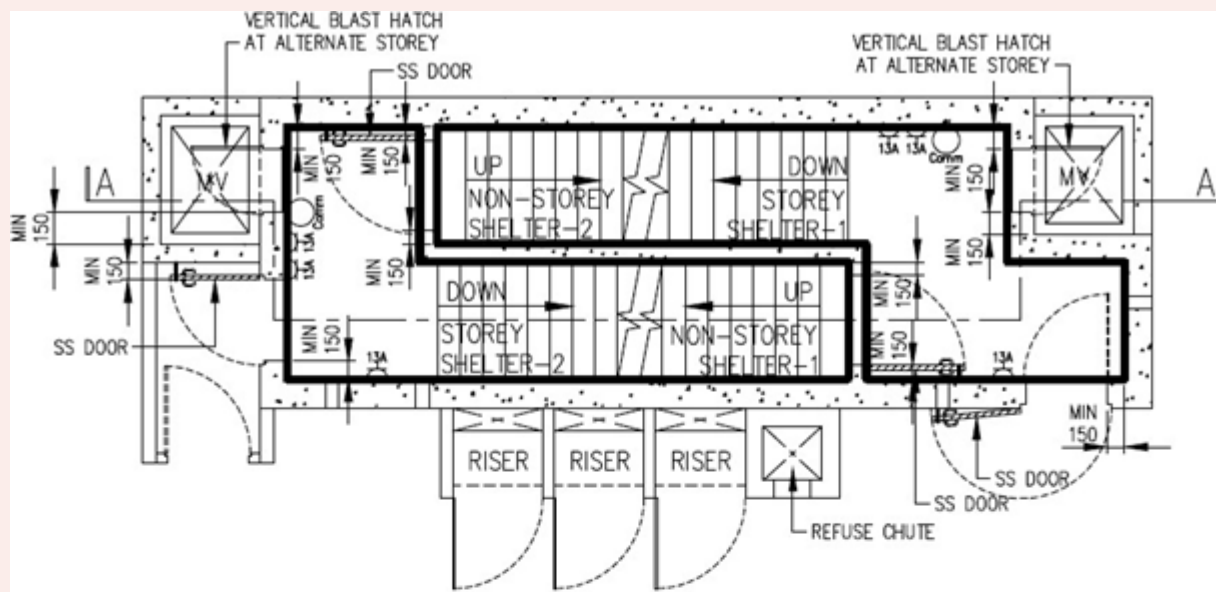

TOP-MOST COMPARTMENT PLAN FOR
SCISSOR STAIRCASE STOREY SHELTER

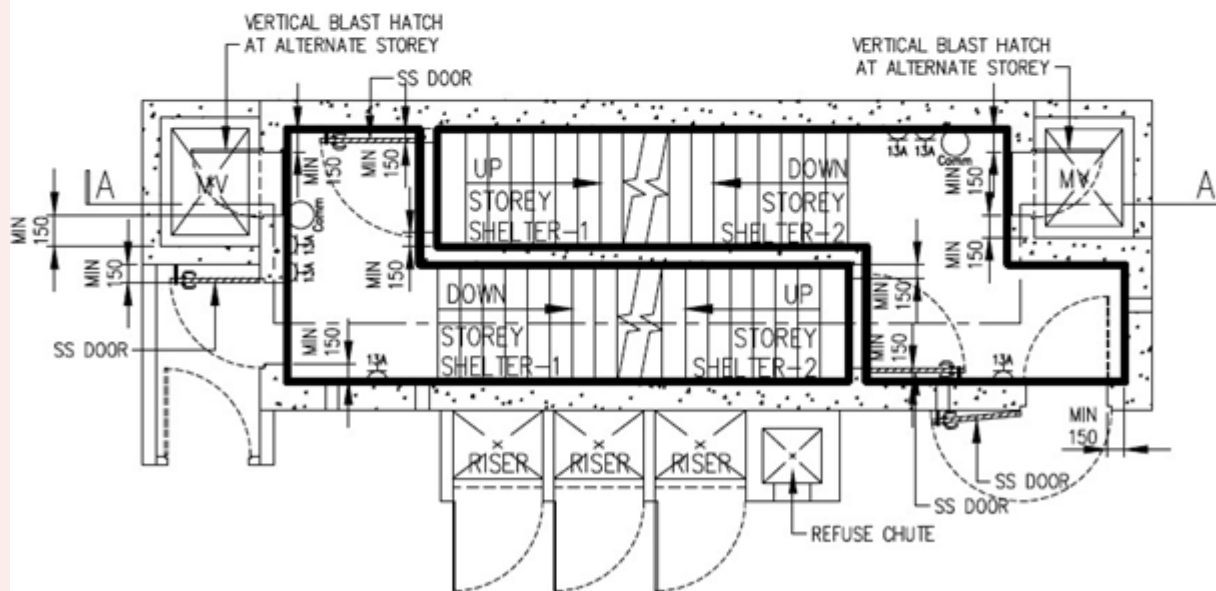

TYPICAL STOREY COMPARTMENT PLAN FOR
SCISSOR STAIRCASE STOREY SHELTER

FIGURE 2.12.2(k): SECTION OF SCISSOR S/C SS COMPARTMENT


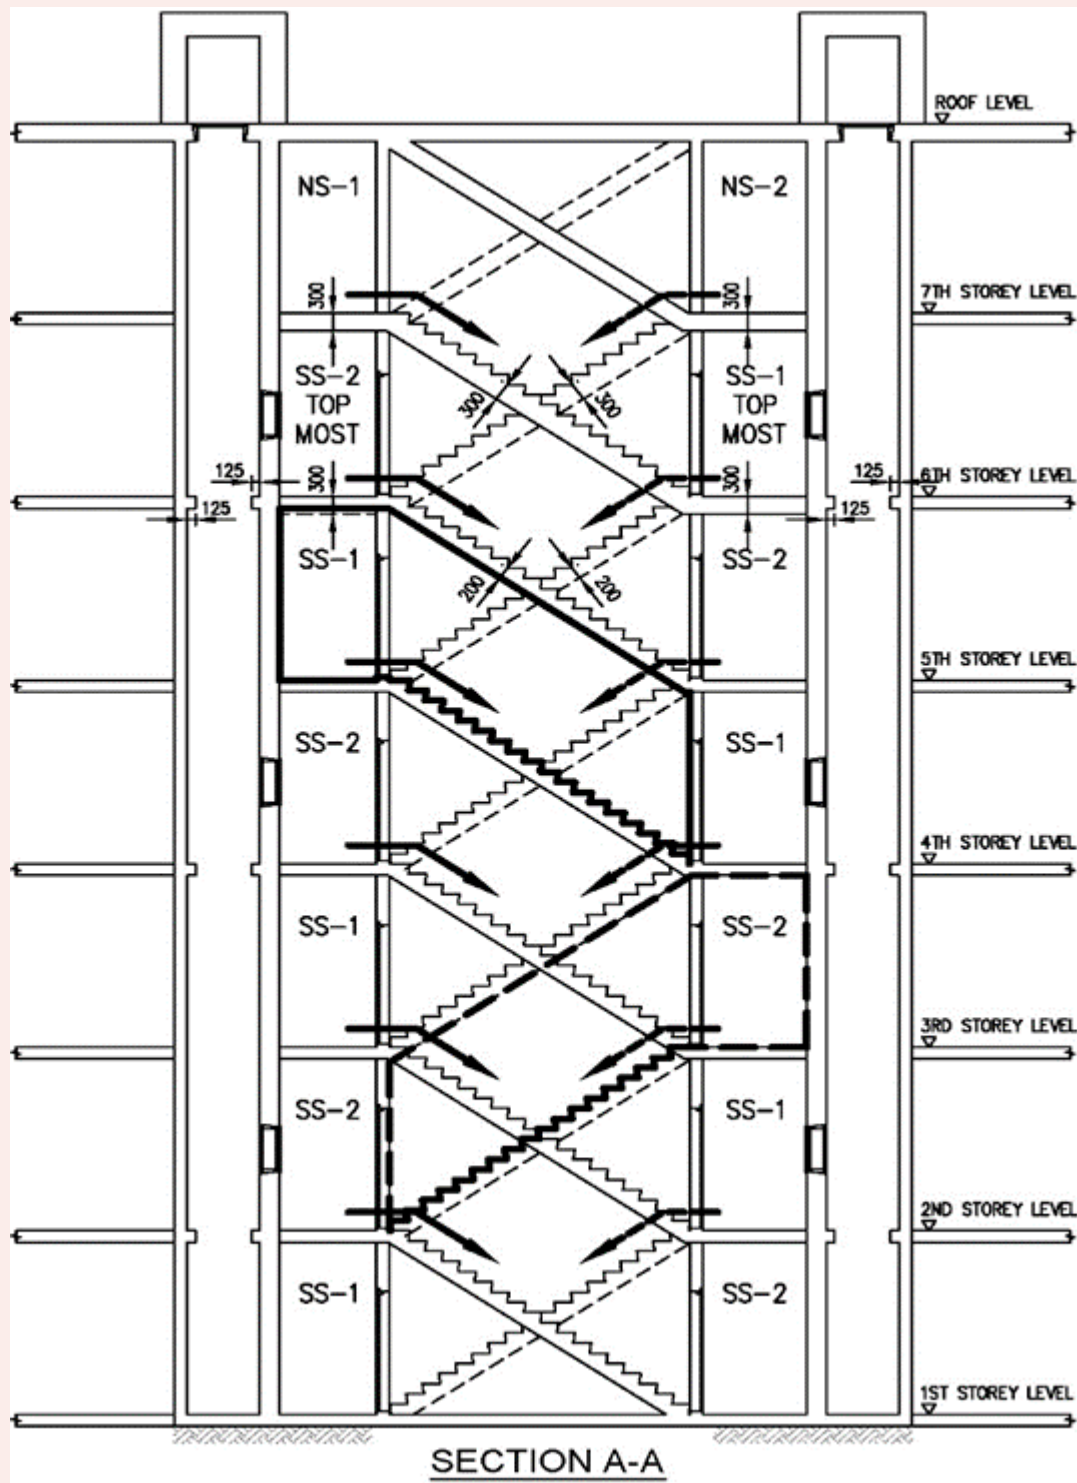


FIGURE 2.12.2(1): DETAIL OF SS DOOR HOLDER

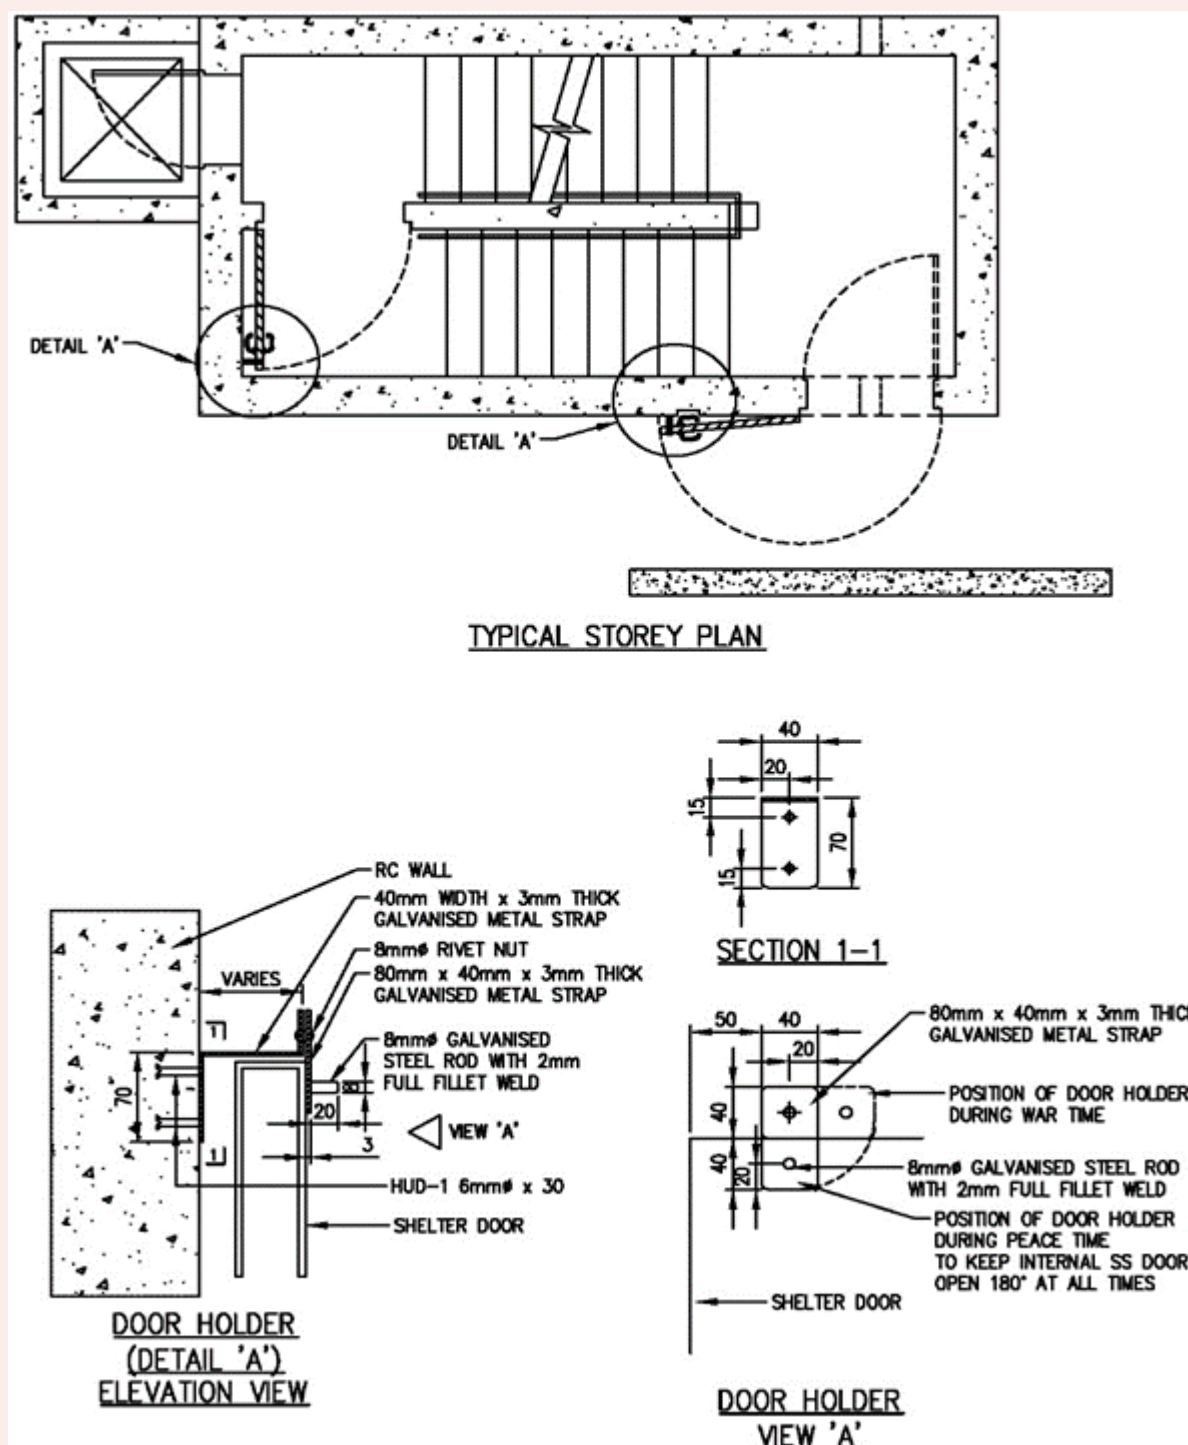

b. Where the staircase leads to the roof level, an external SS door swinging outwards from the staircase, has to be provided at the staircase entrance. This external SS door shall also be permanently kept open during peacetime and shall be suitably protected from the weather if it is exposed to external space.

2.12.3 Internal S/C SS Wall and SS Door

a. Inside the S/C SS, there has to be a continuous reinforced concrete internal wall of minimum 200mm thickness running through the full height of the S/C SS tower. At every storey, one internal SS door swinging in the direction of exit travel, with removable door kerb, is to be provided either at the staircase entrance landing or at the intermediate landing. Refer to FIGURE 2.12.1(f), 2.12.2(b), 2.12.2(j) and 2.12.2(k). The SS door clear opening dimensions shall be:

Figures & Tables

FIGURE 2.12.1(f): TYPICAL PLAN OF S/C SS COMPARTMENT

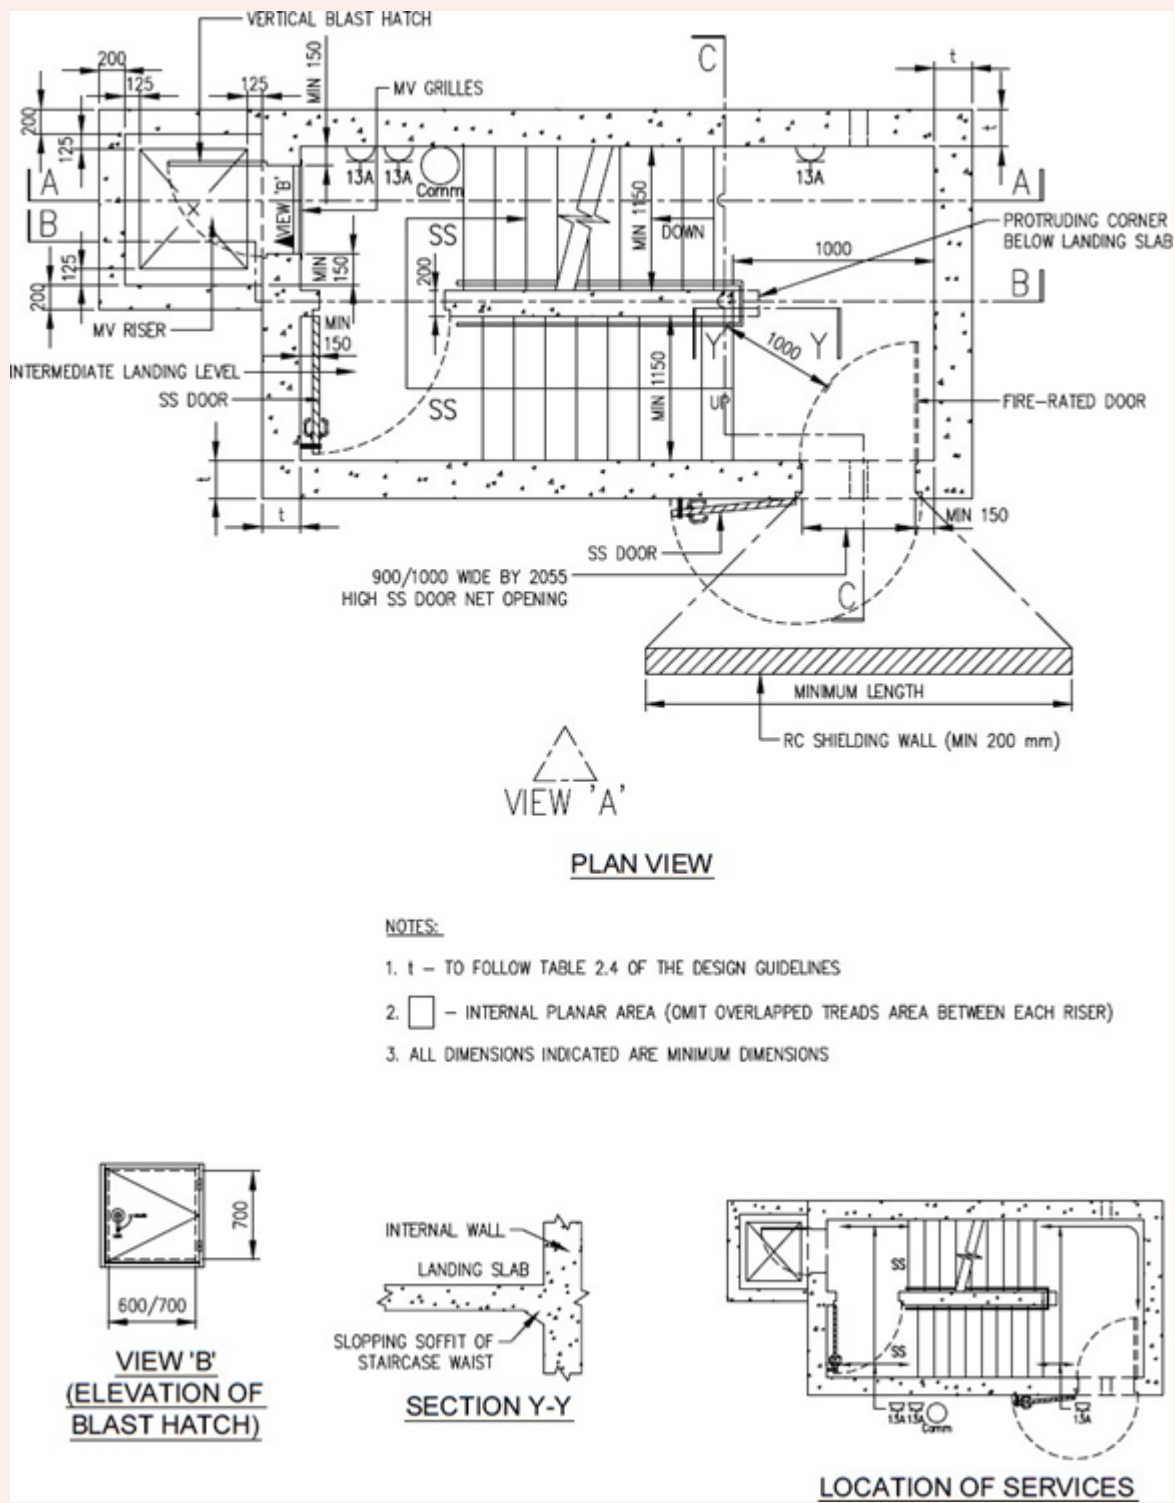


FIGURE 2.12.2(b): SS WITH NS ABOVE TOP-MOST SS COMPARTMENT, INTERMEDIATE SS COMPARTMENT AND SS WITH NS BELOW BOTTOM-MOST SS COMPARTMENT



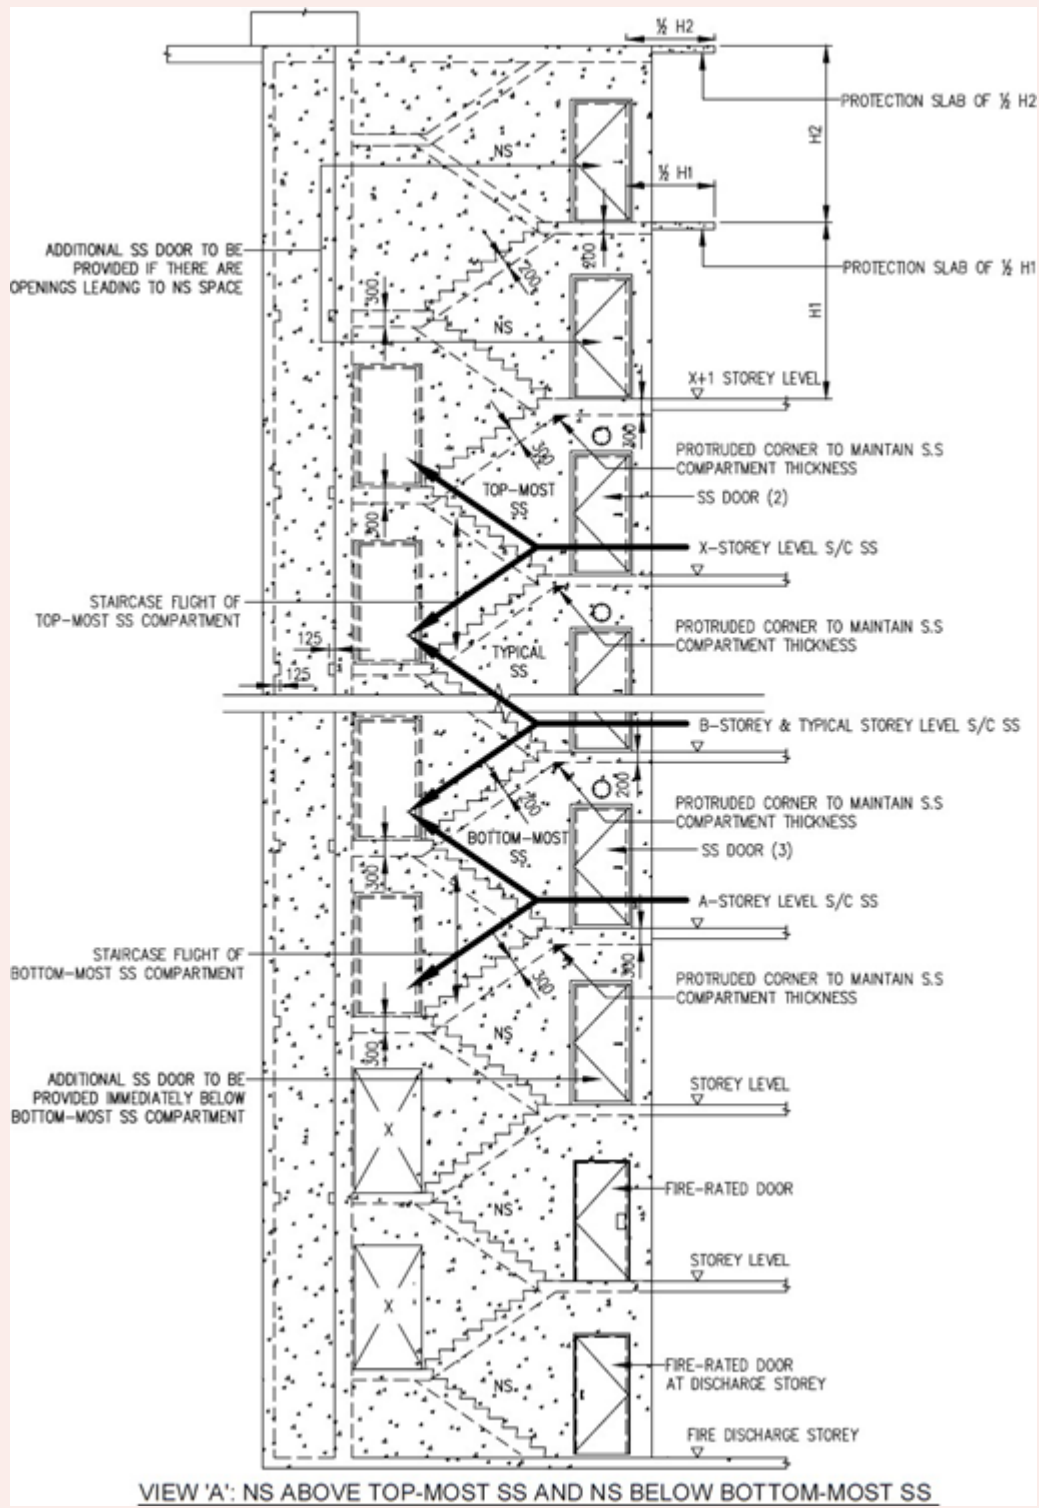


FIGURE 2.12.2(j): SCISSOR S/C SS COMPARTMENT PLAN

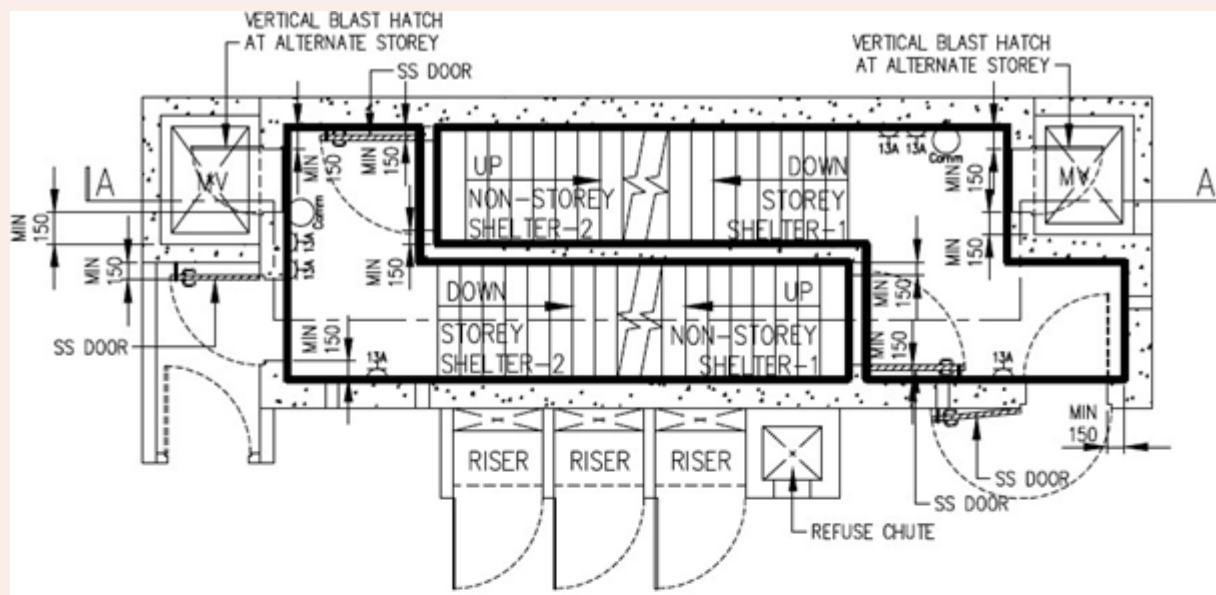


TOP-MOST COMPARTMENT PLAN FOR
SCISSOR STAIRCASE STOREY SHELTER

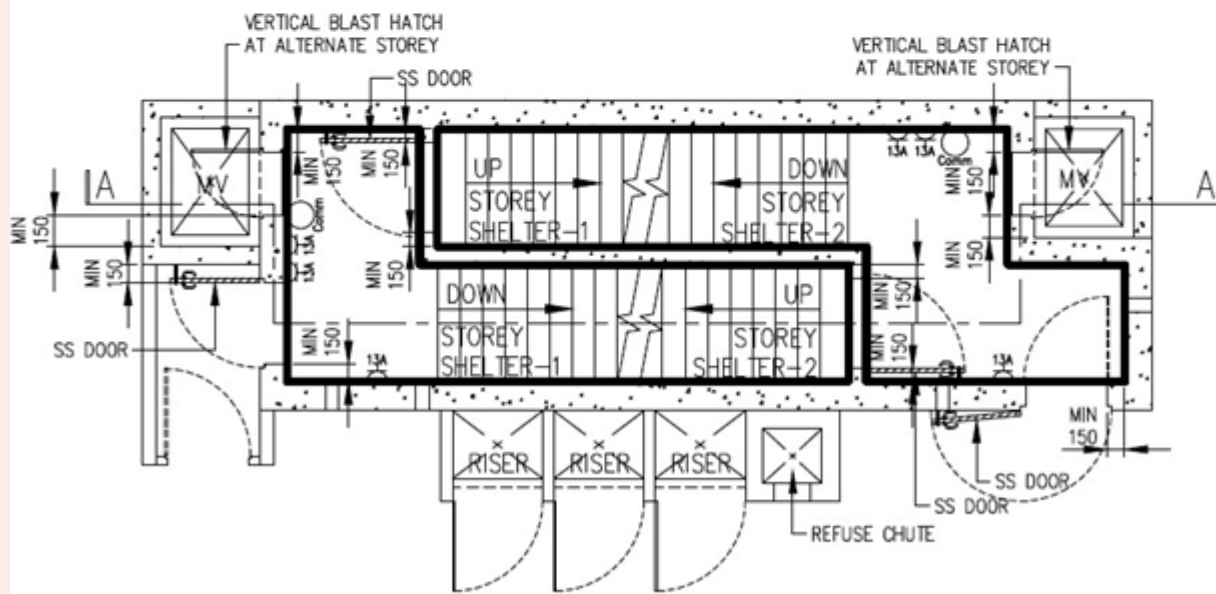

TYPICAL STOREY COMPARTMENT PLAN FOR
SCISSOR STAIRCASE STOREY SHELTER

FIGURE 2.12.2(k): SECTION OF SCISSOR S/C SS COMPARTMENT

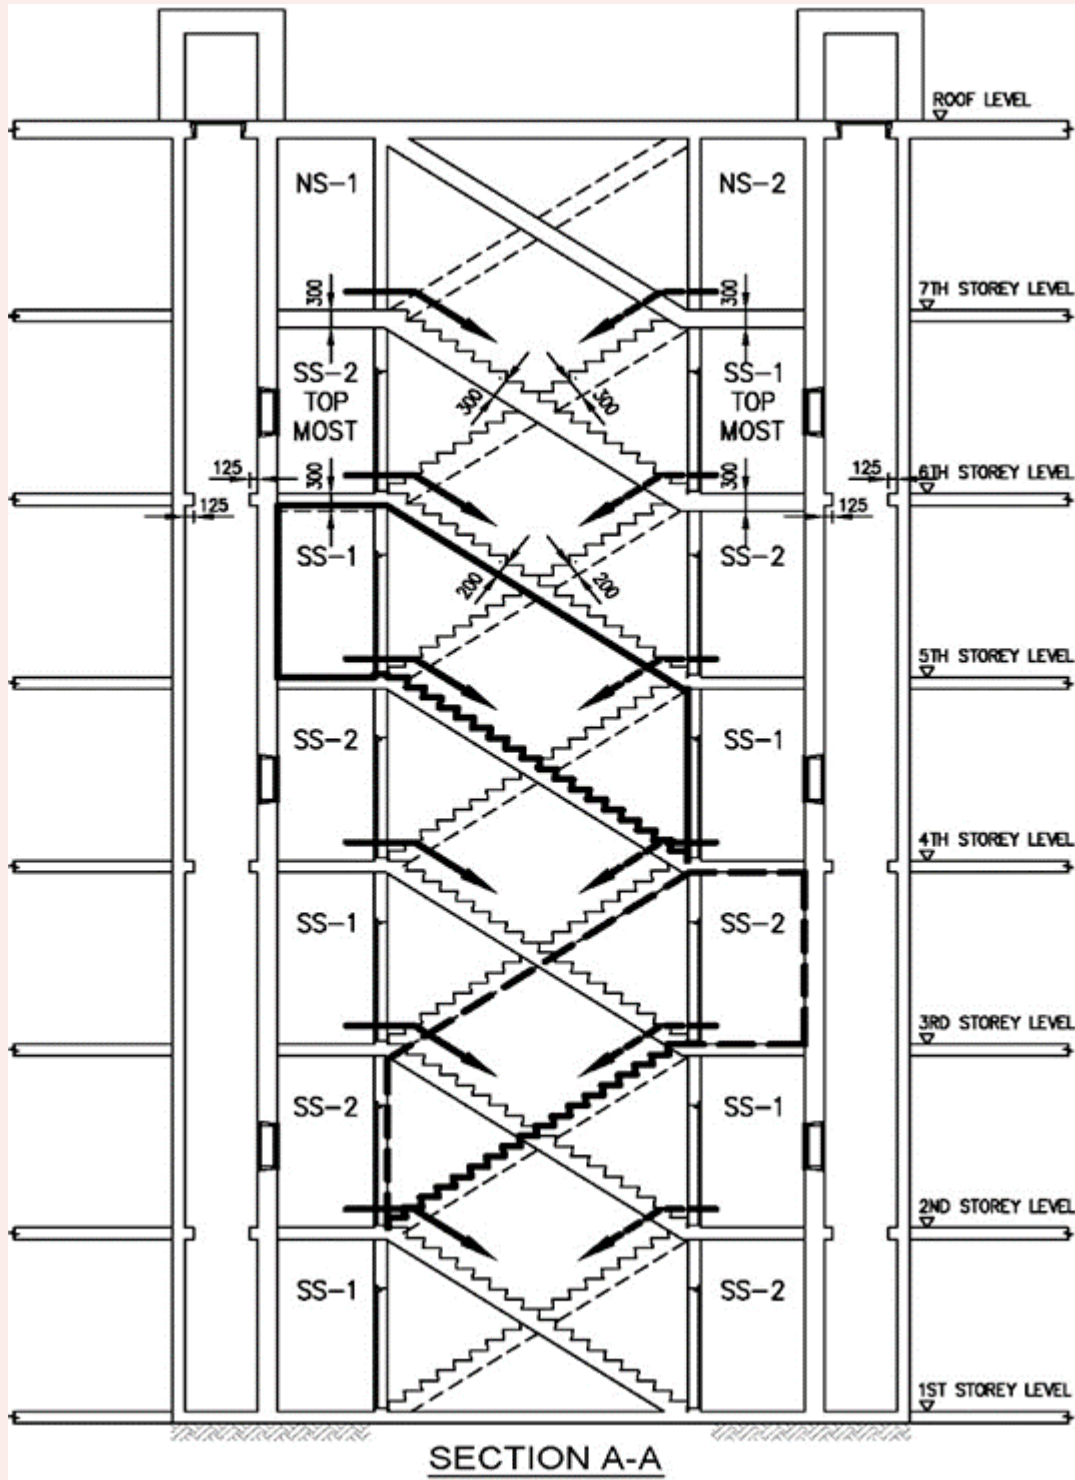


i. Door opening width - 1000mm..

ii. Door opening height - 2055mm.

b. This SS door is to be kept permanently open during peacetime. A door holder shall be provided to hold the internal SS door in open position. Refer to FIGURE 2.12.2(1).

Figures & Tables

FIGURE 2.12.2(1): DETAIL OF SS DOOR HOLDER

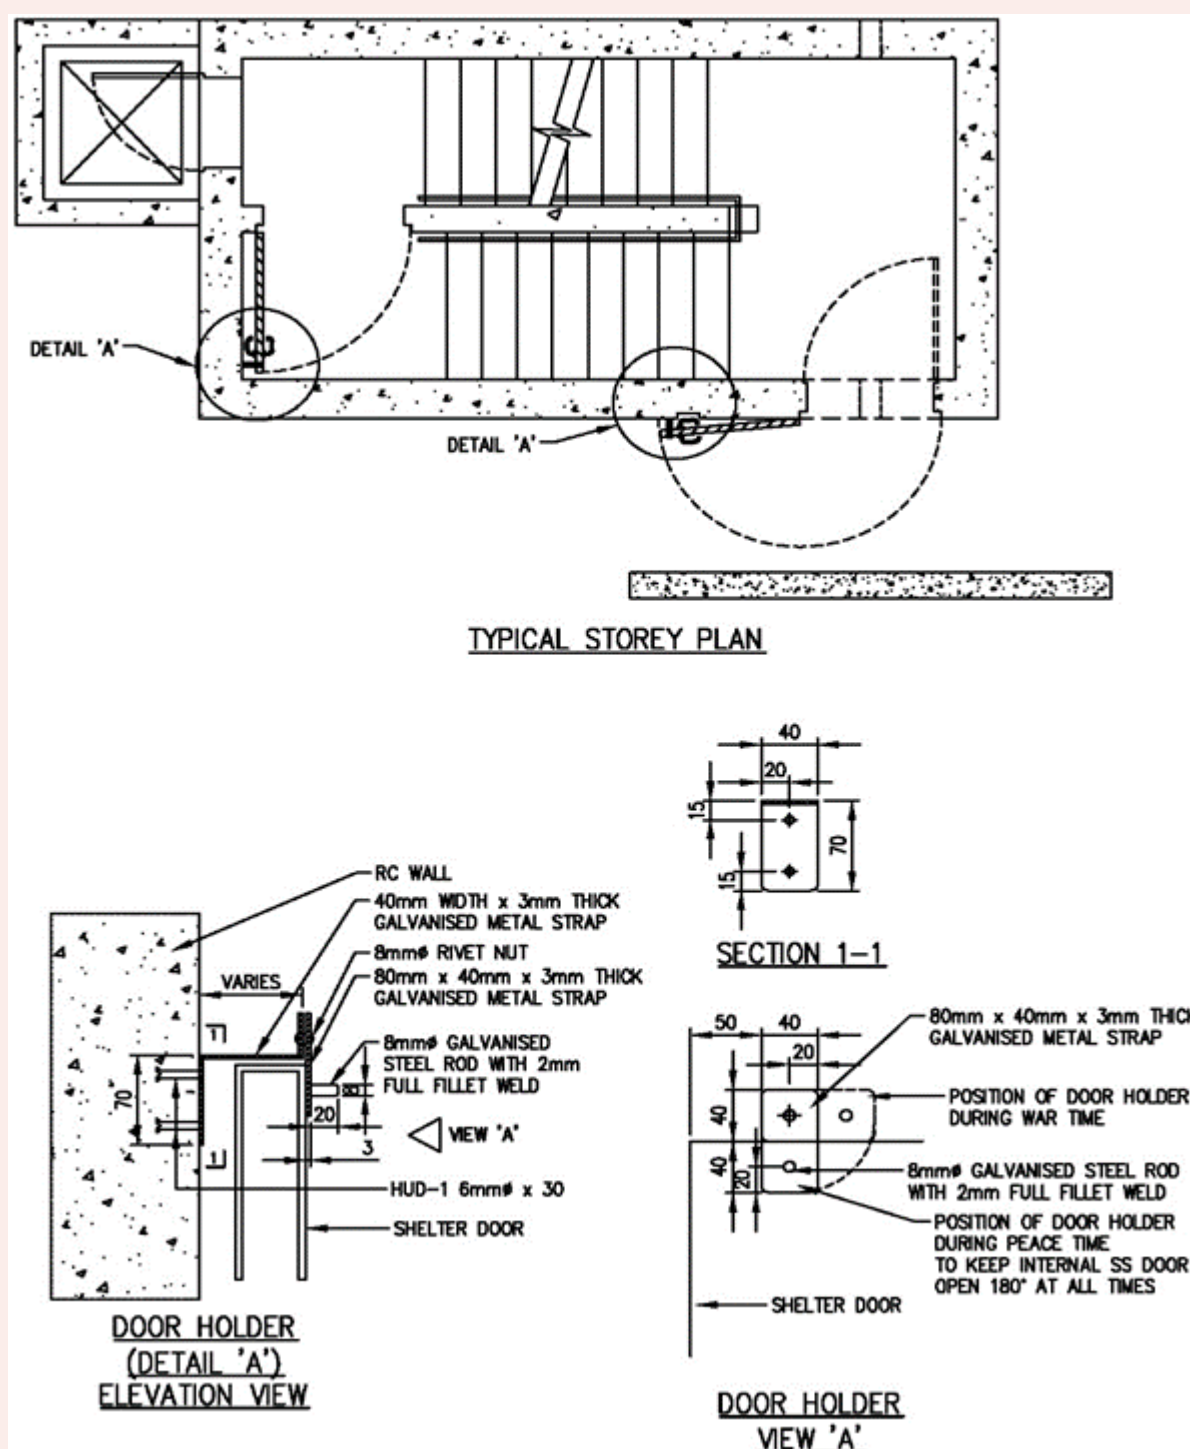

c. The RC wall and the internal SS door (when placed in closed position) serve to compartmentalise the staircase shaft into a series of staircase SS i.e. one SS compartment for each storey.

2.12.4 Shelter Compartment

a. S/C SS comprises one SS compartment each storey. Each shelter compartment shall be made up of one entrance SS door and 2 internal SS doors, i.e. one at each intermediate landing or main landing. Refer to FIGURE 2.12.1(f) and 2.12.2(b). For fire discharge level, refer to FIGURE 2.12.2(f) to 2.12.2(h).

Figures & Tables

FIGURE 2.12.1(f): TYPICAL PLAN OF S/C SS COMPARTMENT

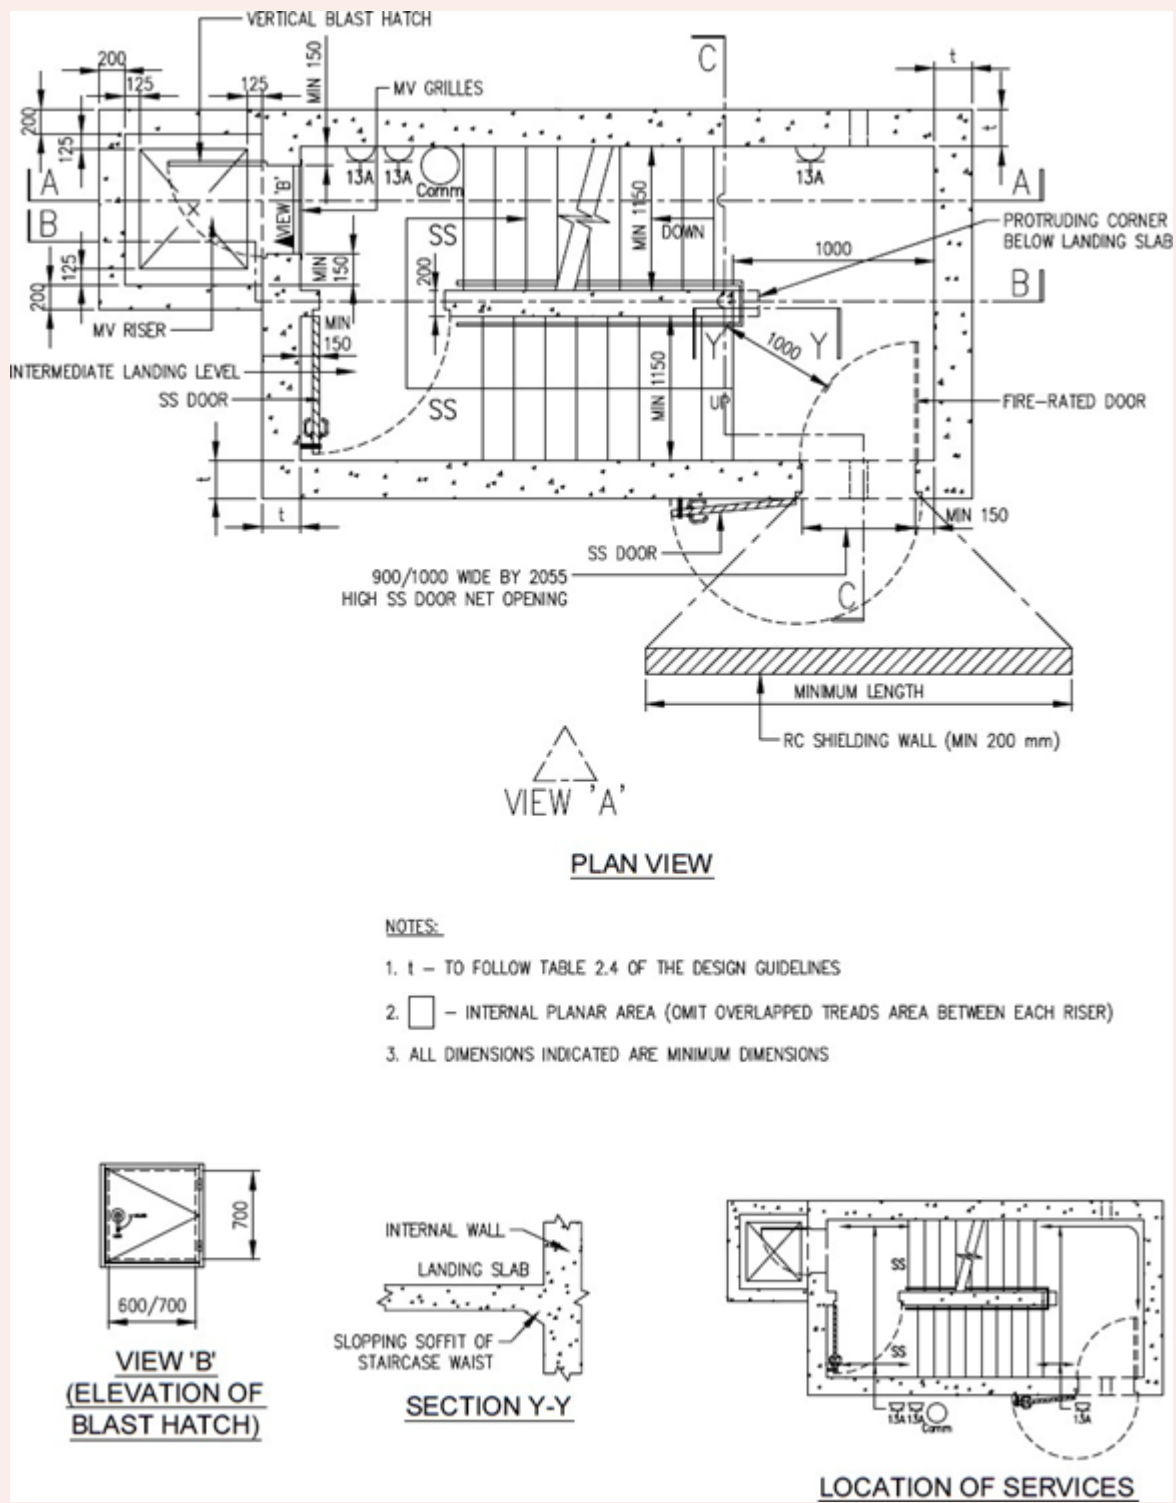


FIGURE 2.12.2(b): SS WITH NS ABOVE TOP-MOST SS COMPARTMENT, INTERMEDIATE SS COMPARTMENT AND SS WITH NS BELOW BOTTOM-MOST SS COMPARTMENT

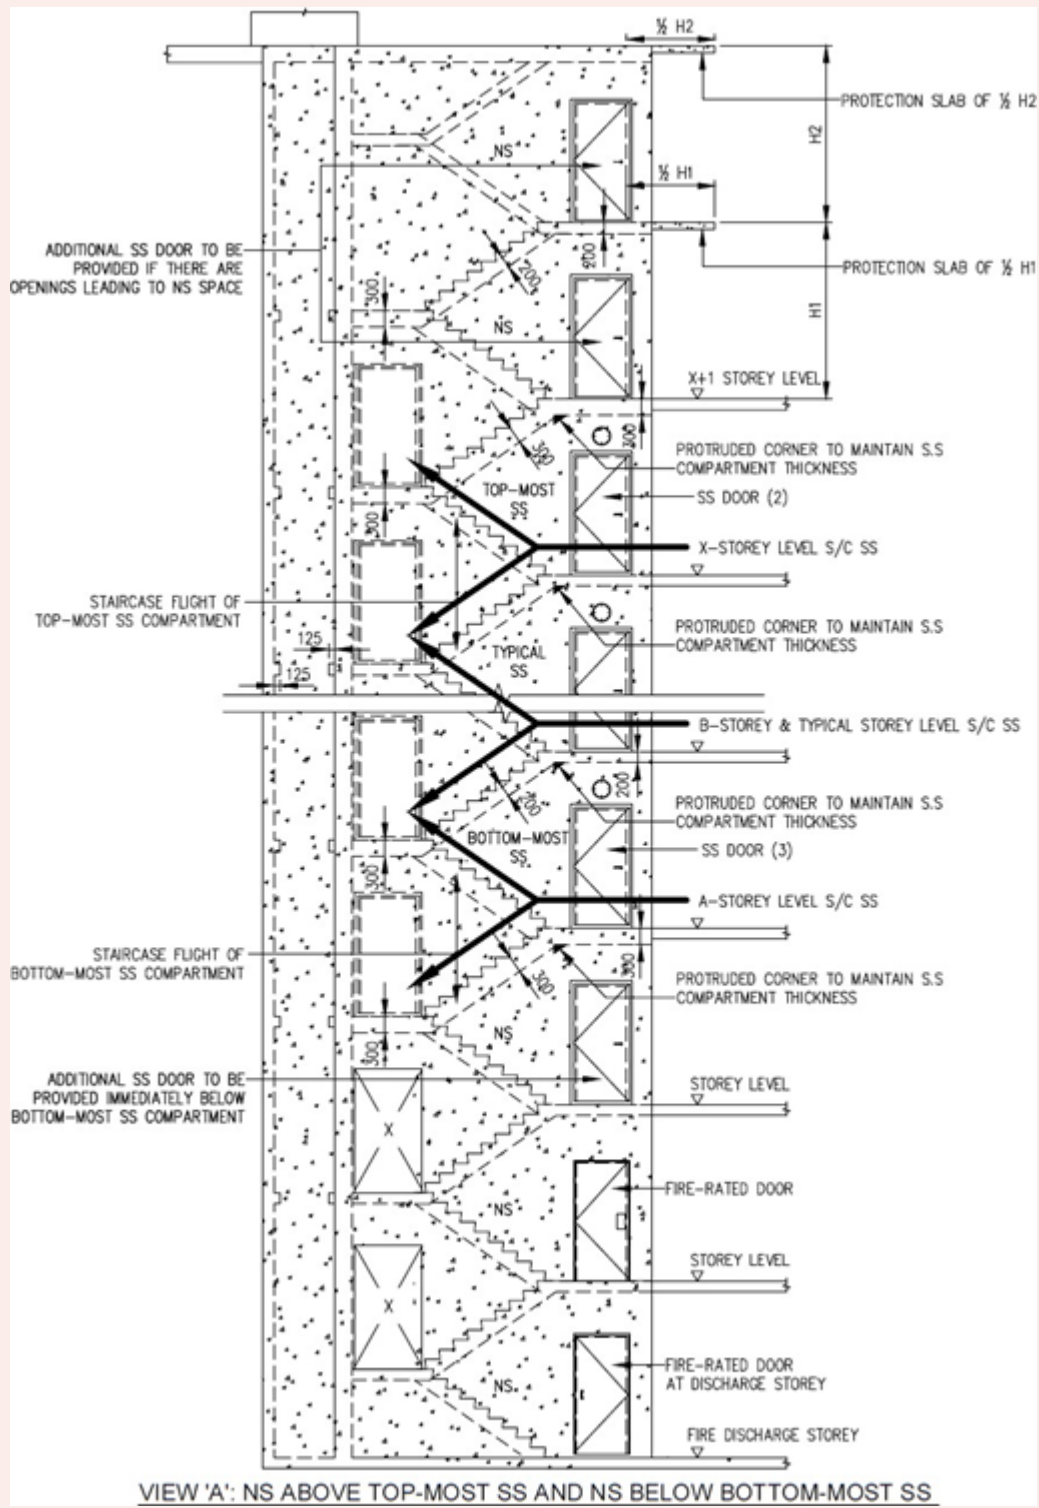


FIGURE 2.12.2(f): DETAIL PLAN OF S/C SS AND NS AT FIRE DISCHARGE STOREY


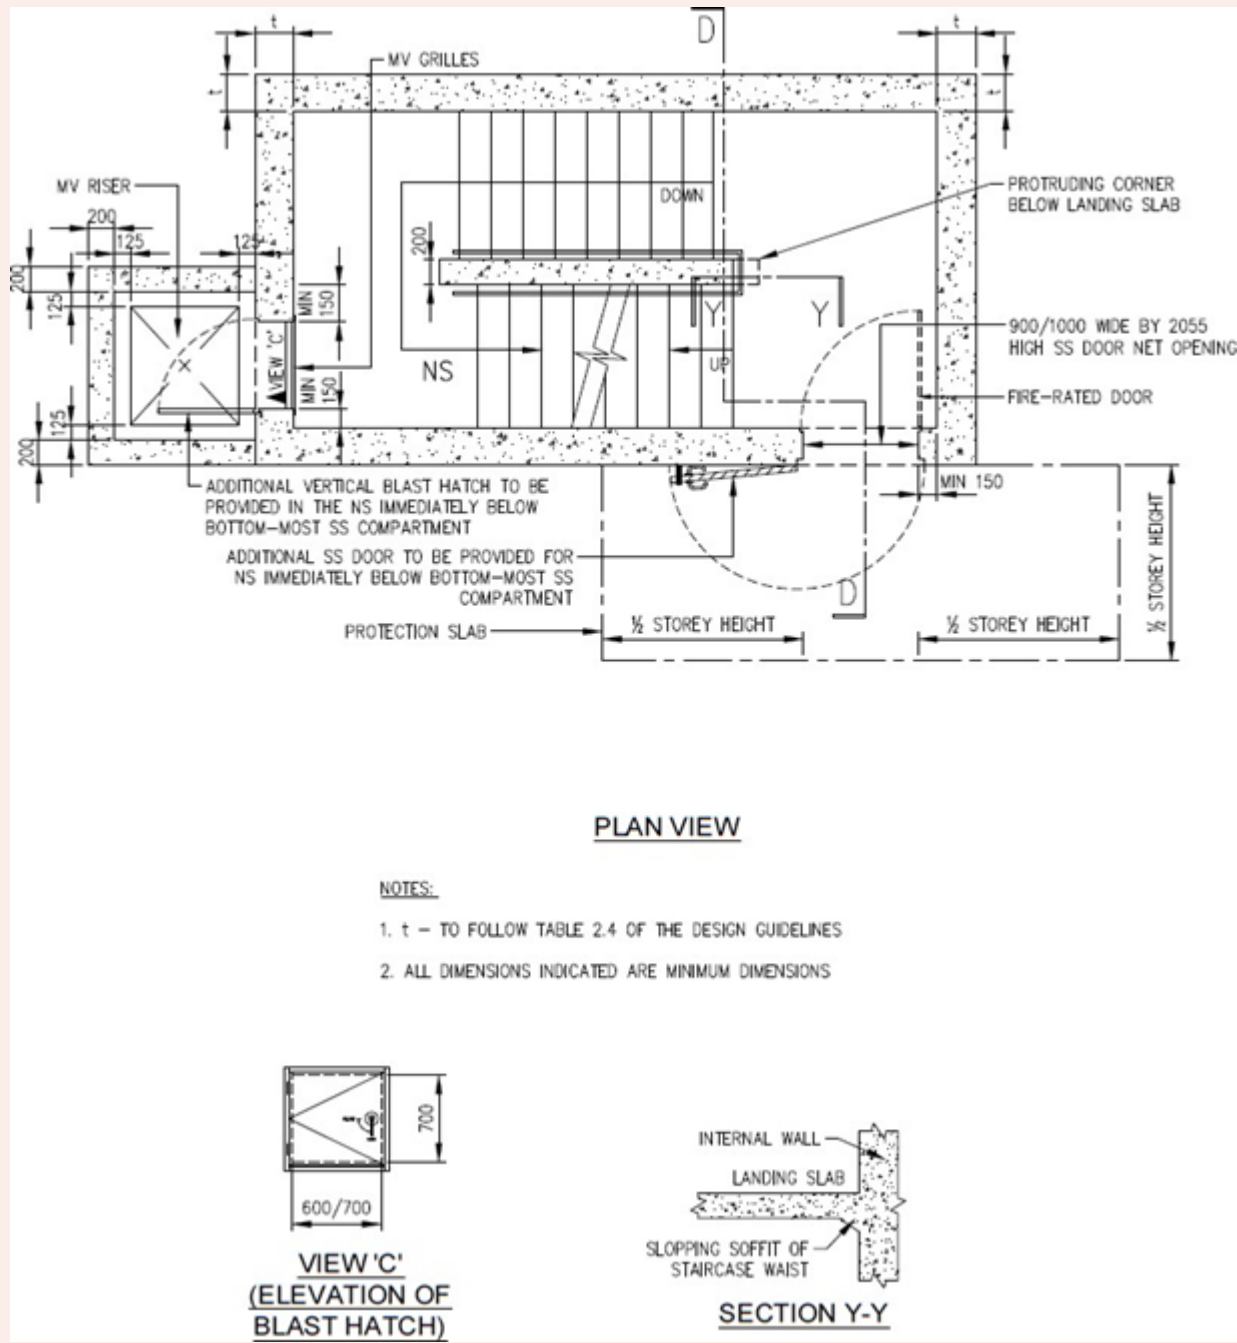



FIGURE 2.12.2(h): DETAIL SECTION OF SS AND NS AT FIRE DISCHARGE STOREY

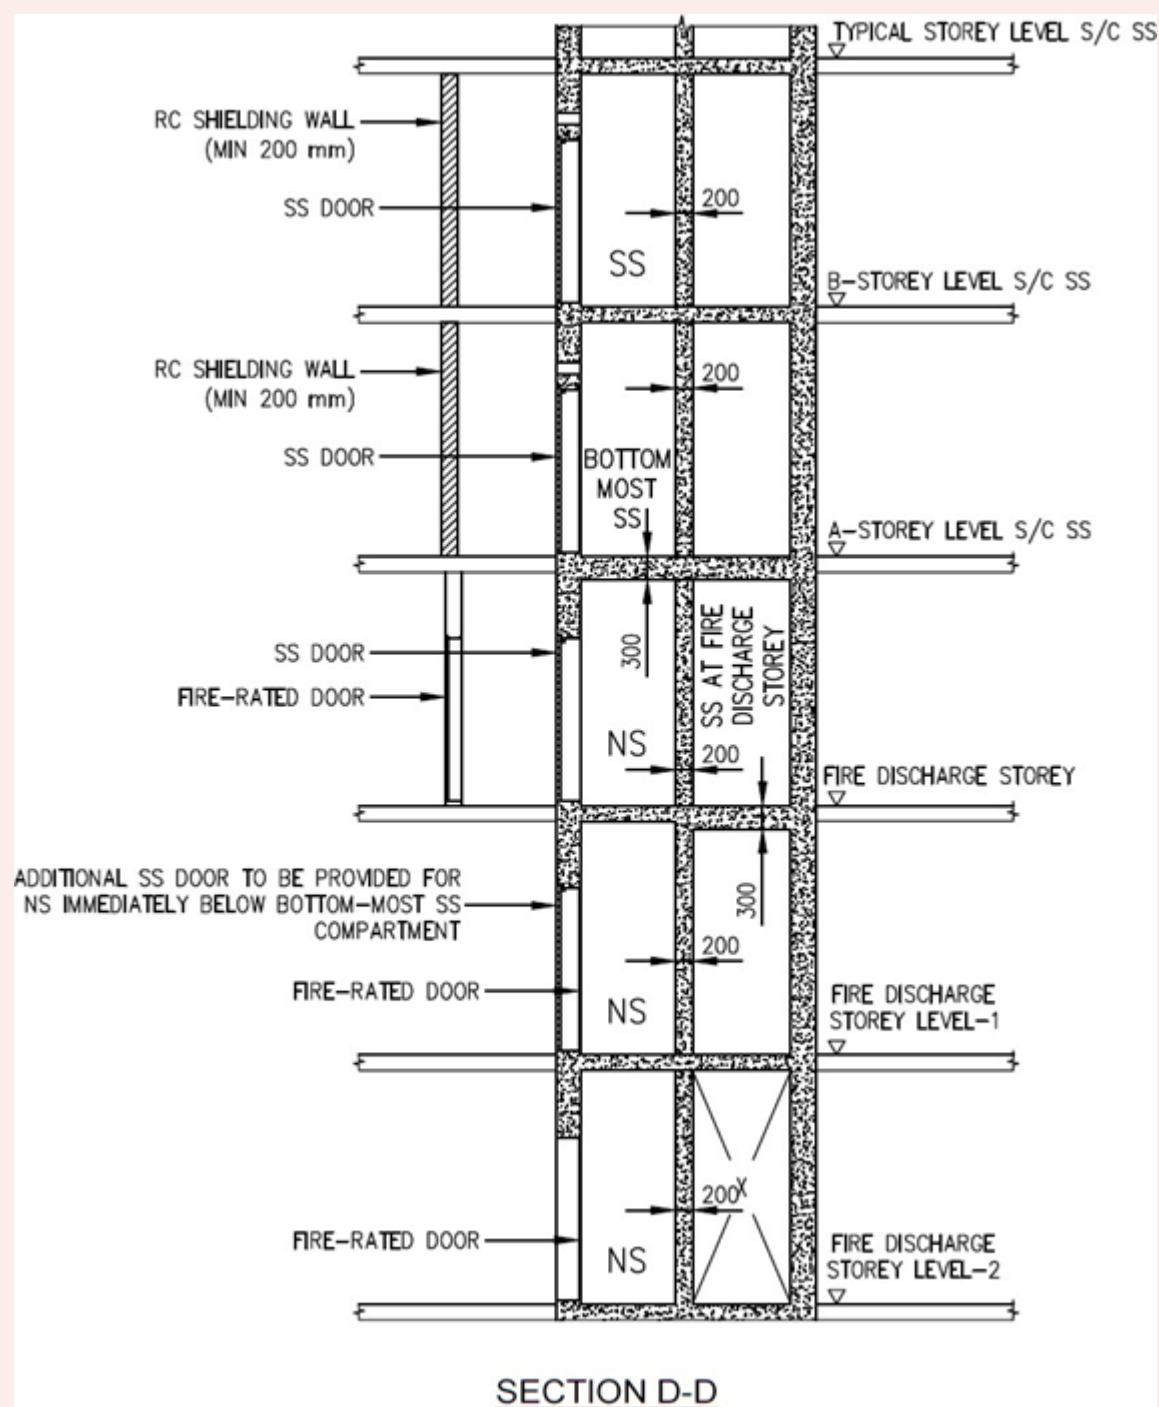


b. Scissor S/C SS comprises two SS at each storey. Each SS compartment shall be made up of one entrance SS door and 2 internal SS doors. Refer to FIGURE 2.12.2(j) and 2.12.2(k). Signage shall be provided adjacent to each SS door entrance showing the designated dwelling units assigned to each shelter compartment.

Figures & Tables

FIGURE 2.12.2(j): SCISSOR S/C SS COMPARTMENT PLAN

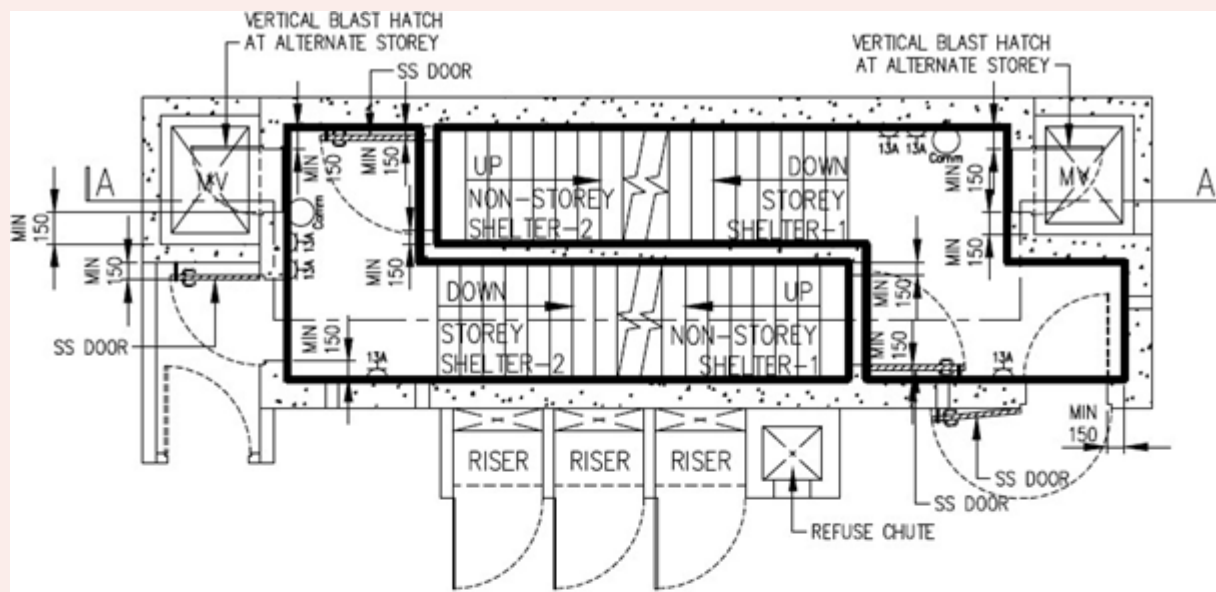


TOP-MOST COMPARTMENT PLAN FOR
SCISSOR STAIRCASE STOREY SHELTER

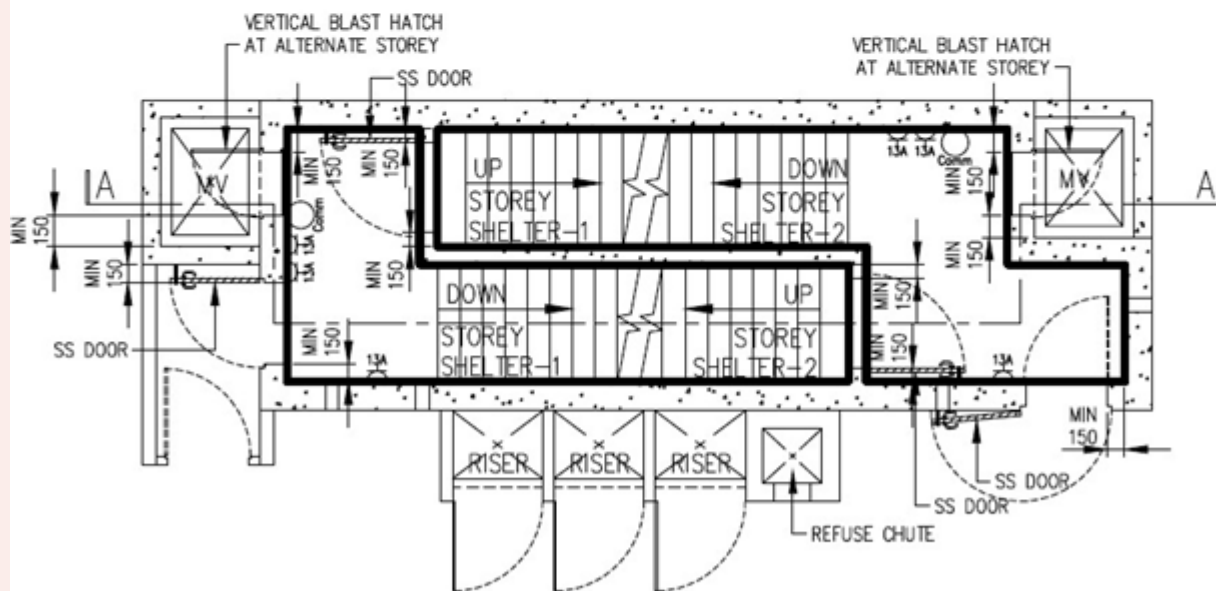

TYPICAL STOREY COMPARTMENT PLAN FOR
SCISSOR STAIRCASE STOREY SHELTER

FIGURE 2.12.2(k): SECTION OF SCISSOR S/C SS COMPARTMENT

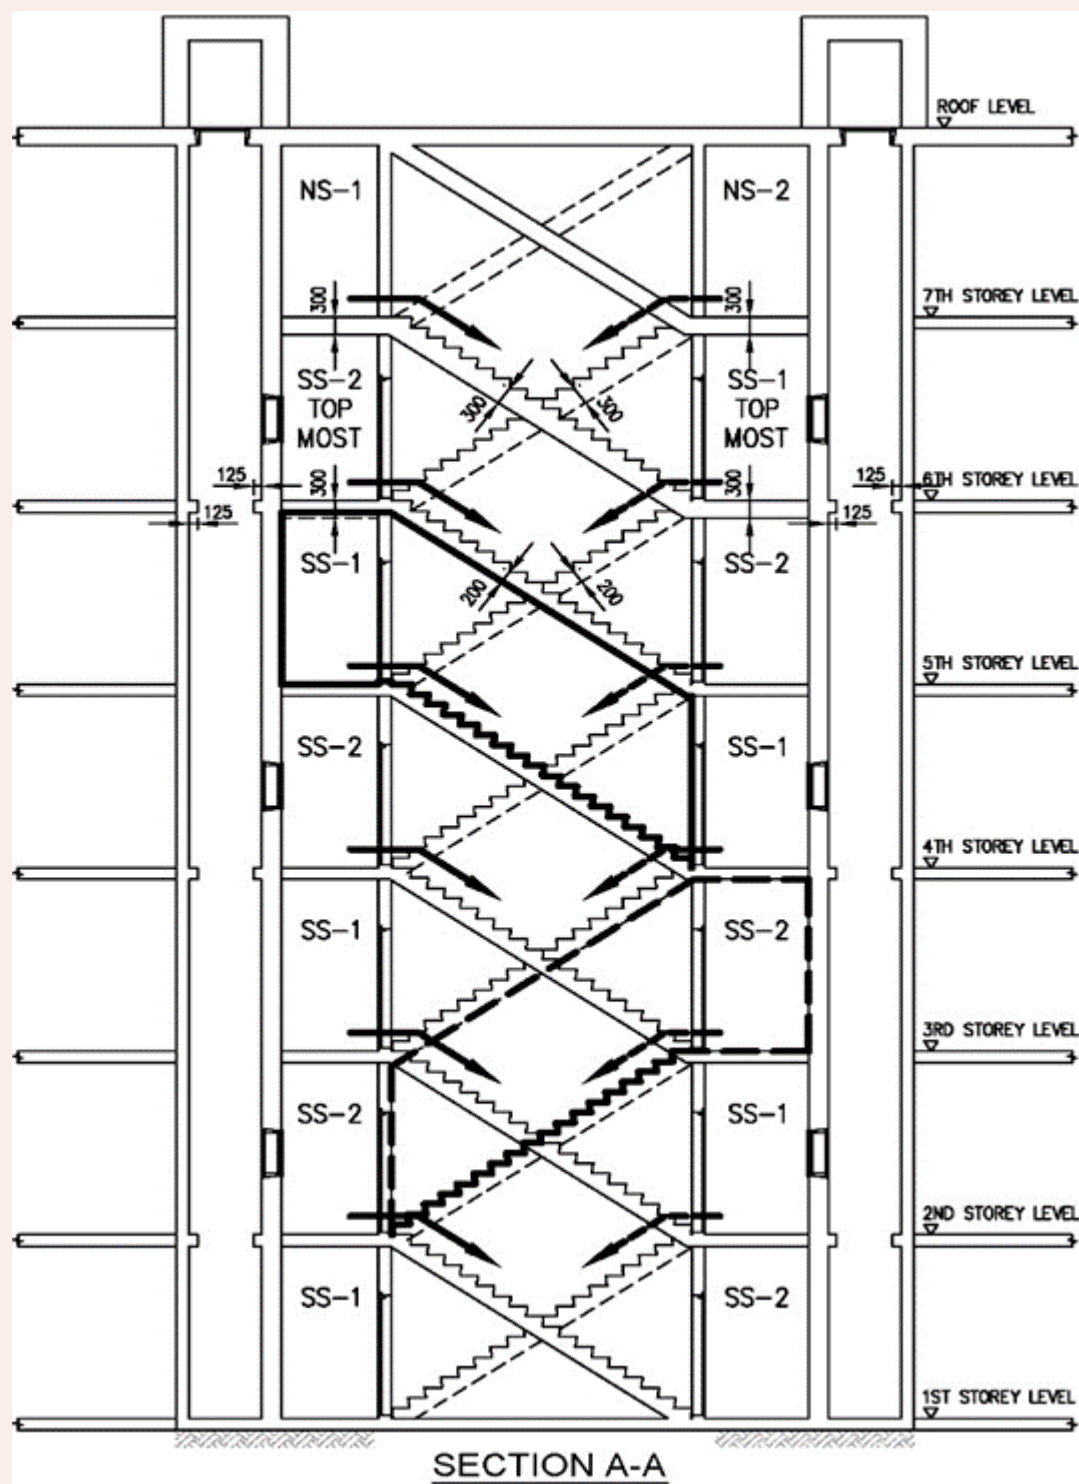

c. The slopping soffit of the staircase waist shall be continuous to meet the staircase. This shall include the part of slopping soffit projected from the 200mm thick internal wall as shown in FIGURE 2.12.1(f) and 2.12.2(d).

Figures & Tables

FIGURE 2.12.1(f): TYPICAL PLAN OF S/C SS COMPARTMENT


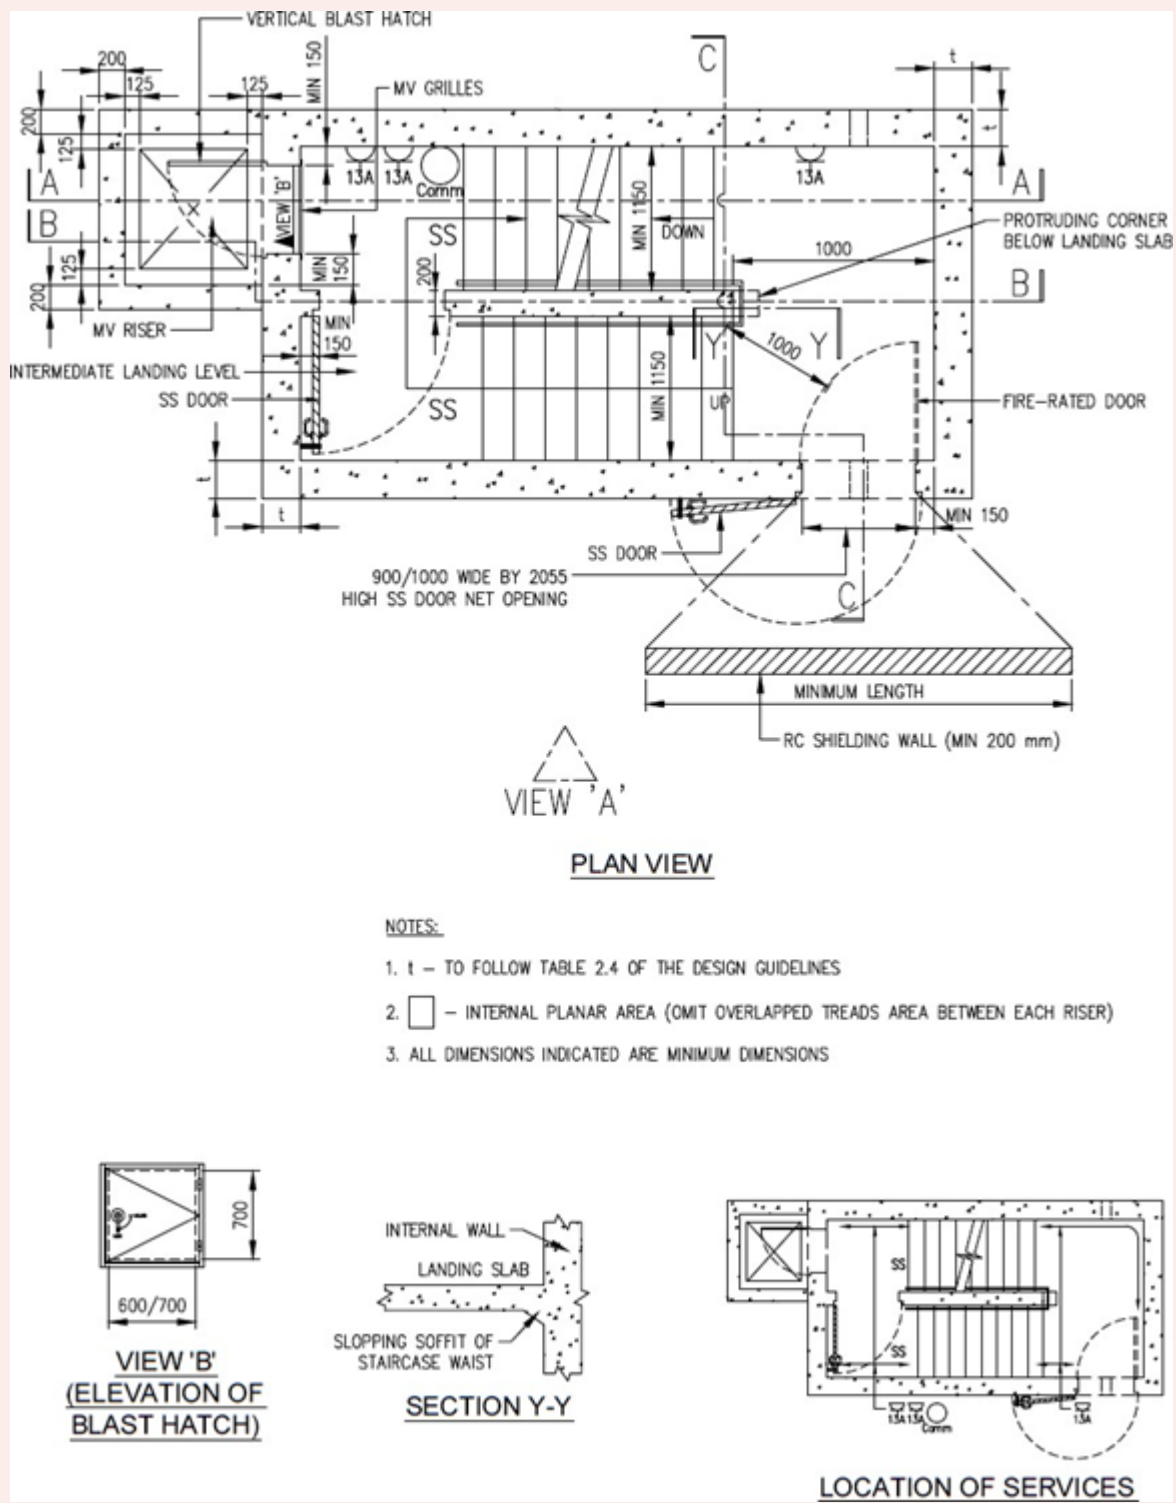


FIGURE 2.12.2(d): SS WITH NS ABOVE TOP-MOST SS COMPARTMENT, INTERMEDIATE SS COMPARTMENT AND SS WITH NS BELOW BOTTOM-MOST SS COMPARTMENT

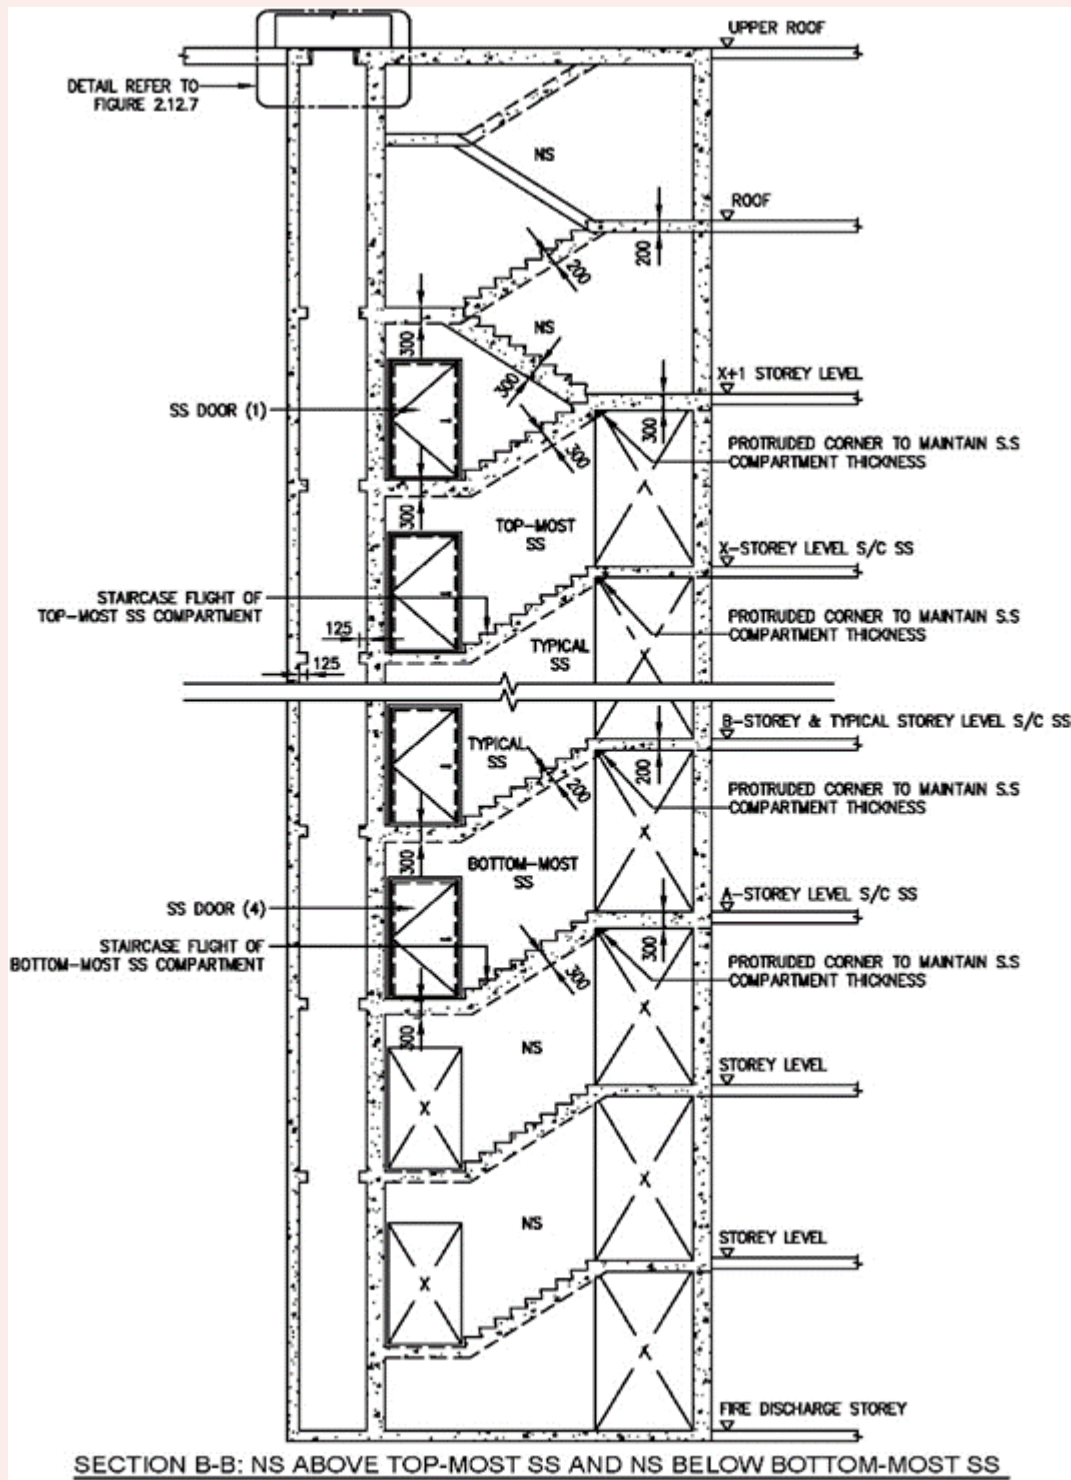


2.12.5 Blast Hatch at MV Opening

- There shall be a minimum 150mm reinforced concrete wall segment next to vertical edge of the blast hatch. Refer to FIGURE 2.5.3(c).

Figures & Tables

FIGURE 2.5.3(c): CONCRETE WALL SEGMENT AT S/C SS DOORS AND BLAST HATCH

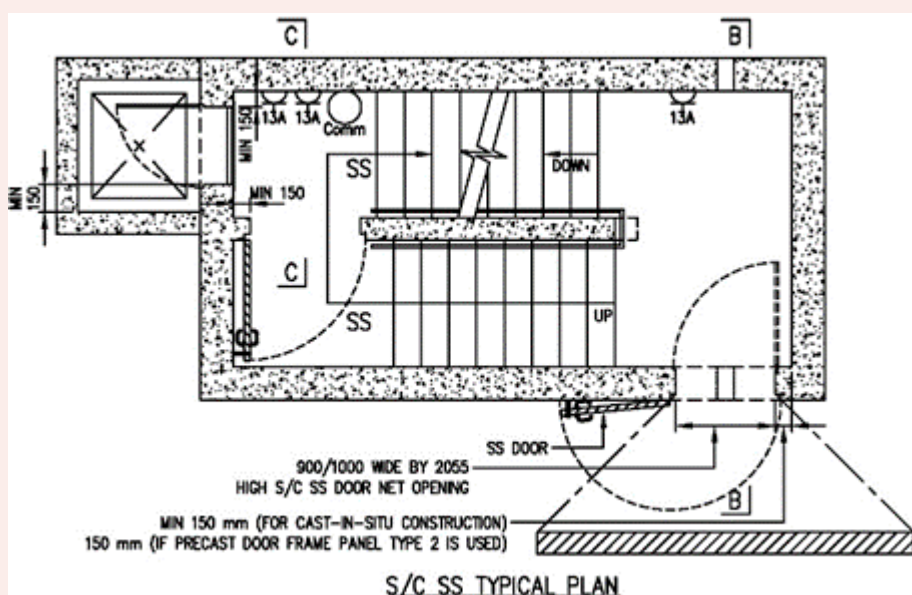

- As the S/C SS and scissor S/C SS are to be mechanically ventilated, there would be vertical grille openings in S/C SS or scissor S/C SS wall. Where there are such openings (subject to the mechanical ventilation design), there shall be vertical blast hatch at the height of 1000mm-1200mm from the FFL, swung open into the MV riser, provided at these openings. Refer to FIGURE 2.12.2(c), 2.12.2(j) and 2.12.2(k). These openings shall be closed and made airtight by vertical blast hatches when the S/C SS or scissor S/C SS is converted for use as SS.

Figures & Tables

FIGURE 2.12.2(c): SS WITH NS ABOVE TOP-MOST SS COMPARTMENT, INTERMEDIATE SS COMPARTMENT AND SS WITH NS BELOW BOTTOM-MOST SS COMPARTMENT



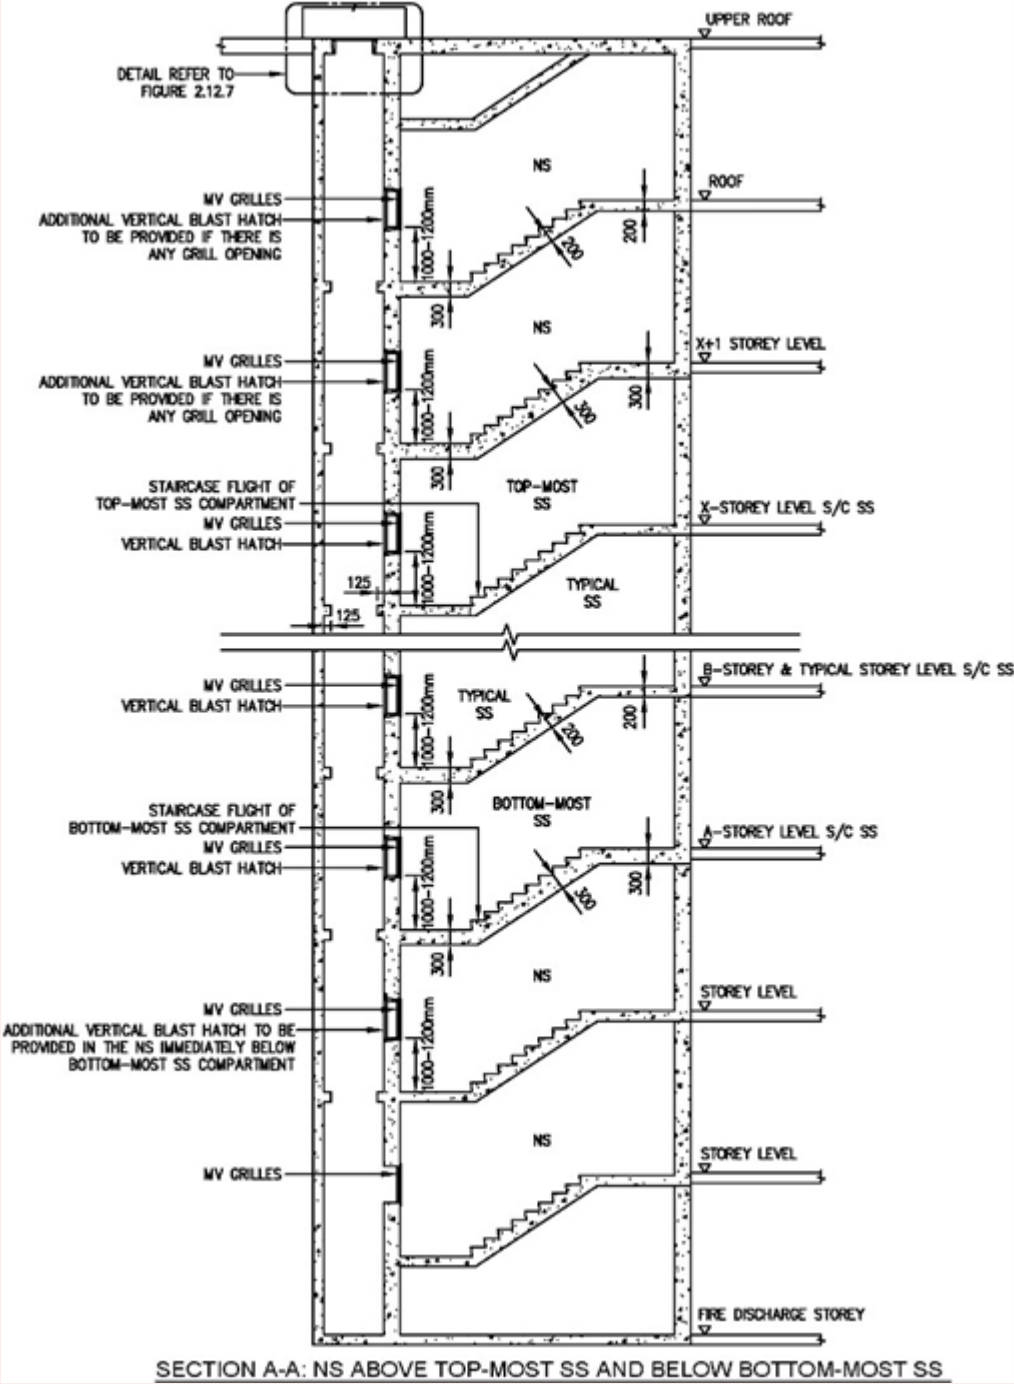


FIGURE 2.12.2(j): SCISSOR S/C SS COMPARTMENT PLAN

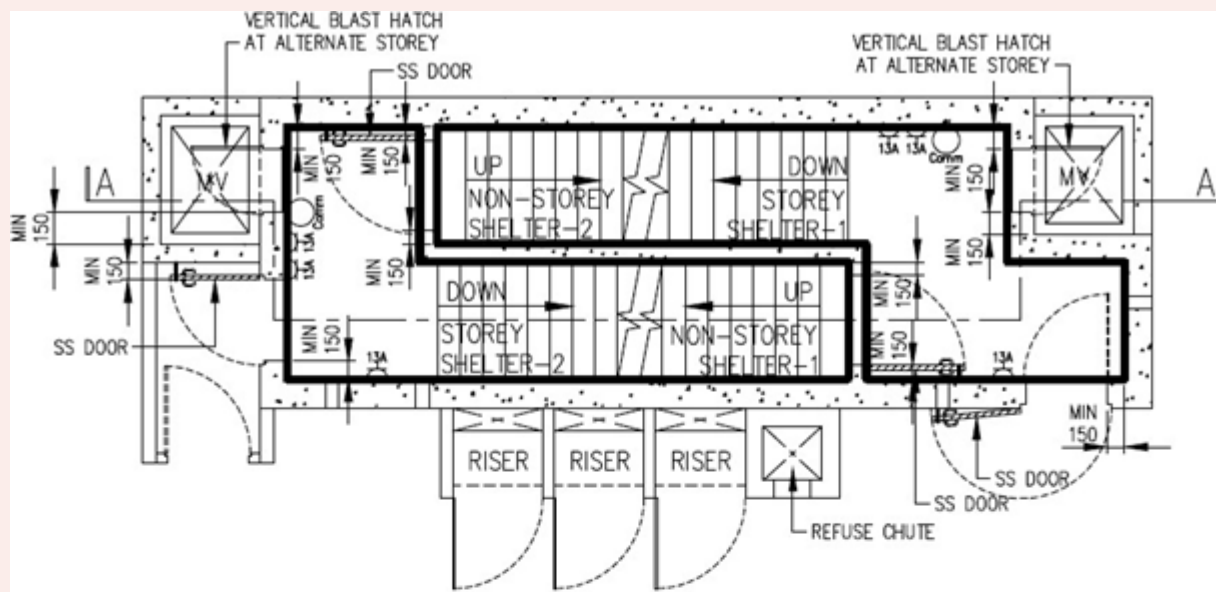

TOP-MOST COMPARTMENT PLAN FOR
SCISSOR STAIRCASE STOREY SHELTER

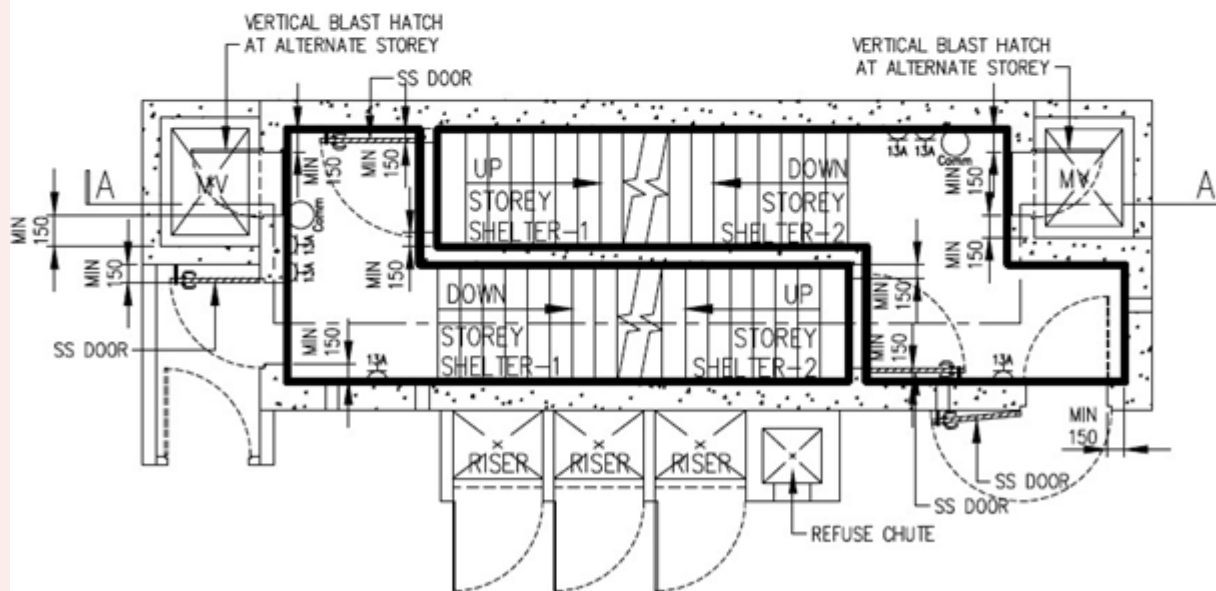

TYPICAL STOREY COMPARTMENT PLAN FOR
SCISSOR STAIRCASE STOREY SHELTER

FIGURE 2.12.2(k): SECTION OF SCISSOR S/C SS COMPARTMENT

FIGURE 2.12.6(b): SECTION Y-Y OF S/C SS

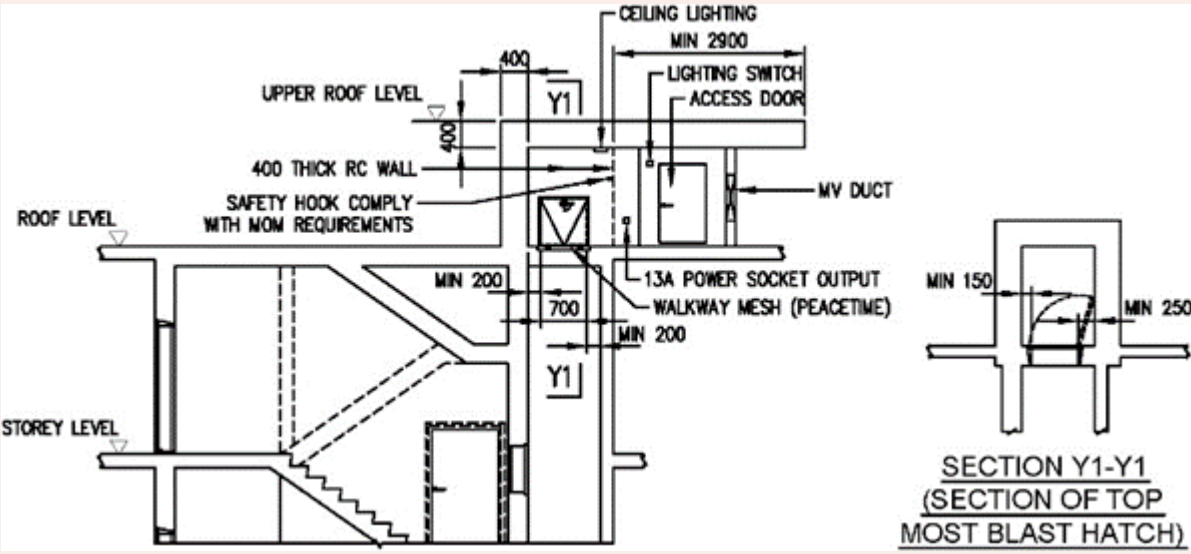


FIGURE 2.12.6(c): PLAN OF S/C SS AT UPPER ROOF LEVEL


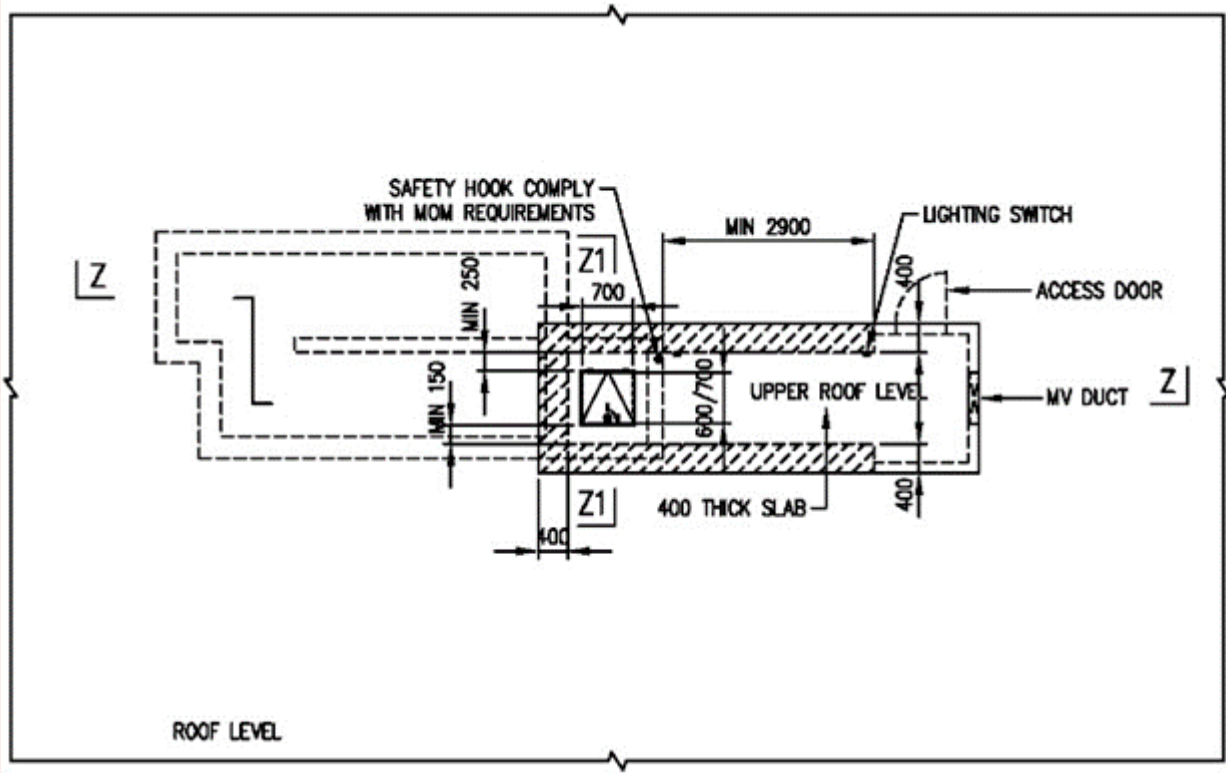


FIGURE 2.12.6(d): SECTION Z-Z OF S/C SS

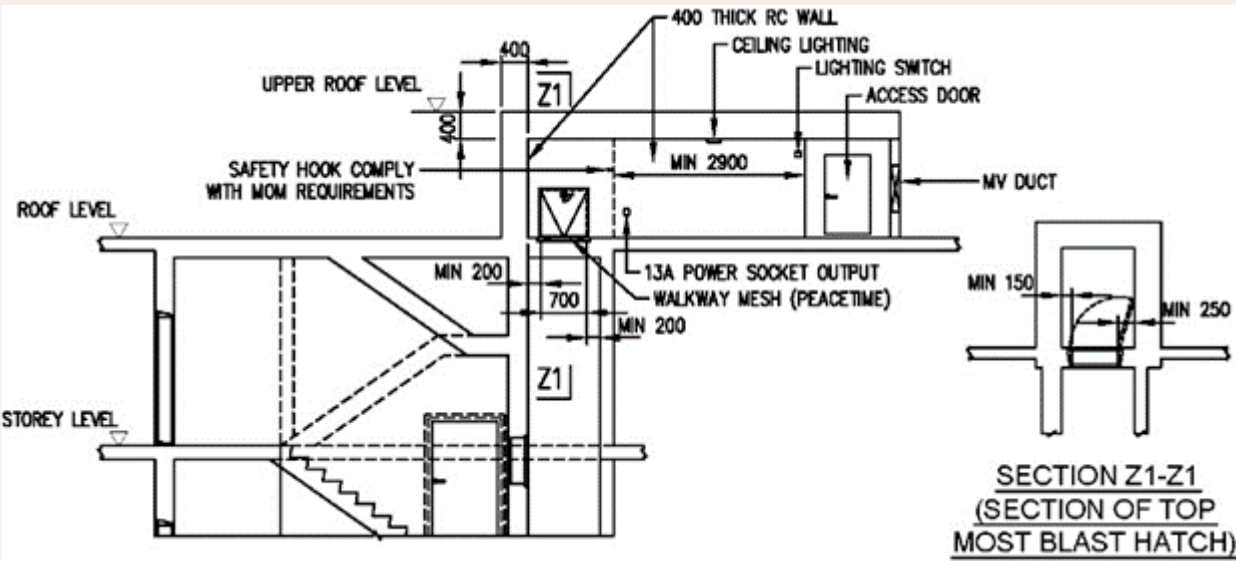

b. Safety hook shall be provided in the protective wall next to the horizontal blast hatch opening at roof level as shown in FIGURE 2.12.6(a) to 2.12.6(d).

Figures & Tables

FIGURE 2.12.6(a): PLAN OF S/C SS AT UPPER ROOF LEVEL

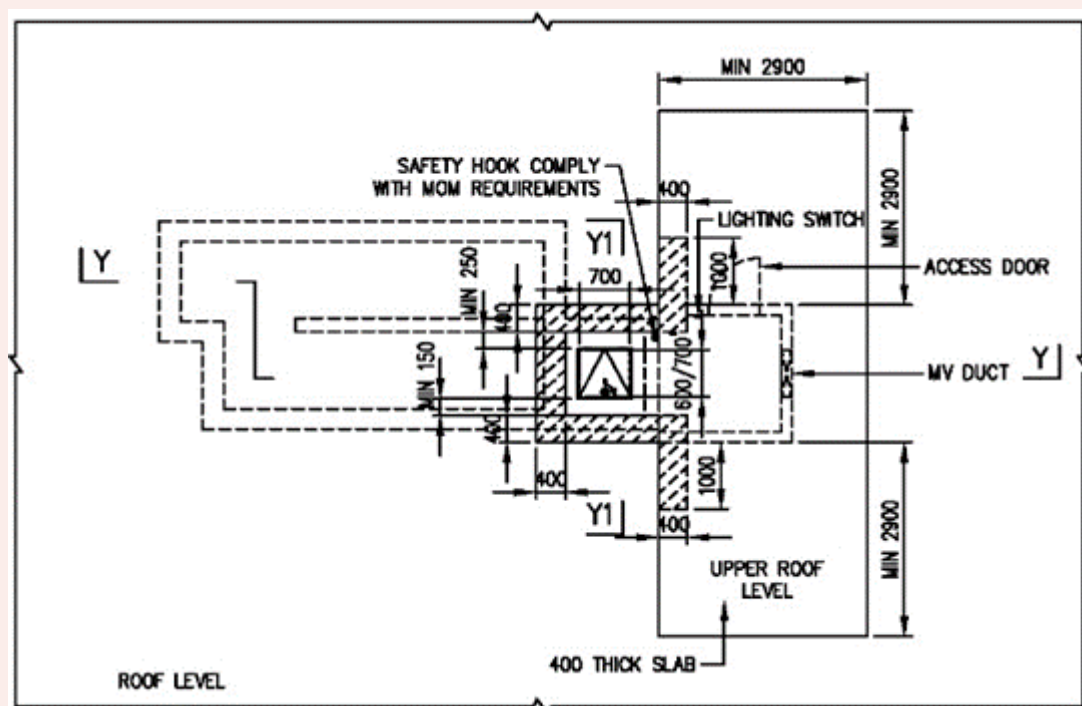


FIGURE 2.12.6(b): SECTION Y-Y OF S/C SS

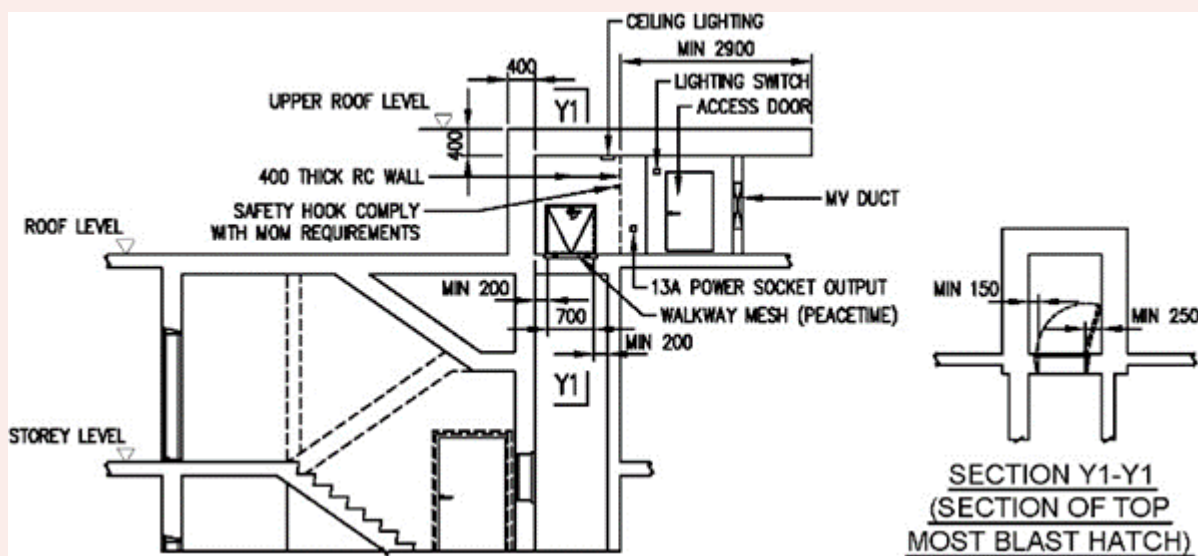


FIGURE 2.12.6(c): PLAN OF S/C SS AT UPPER ROOF LEVEL


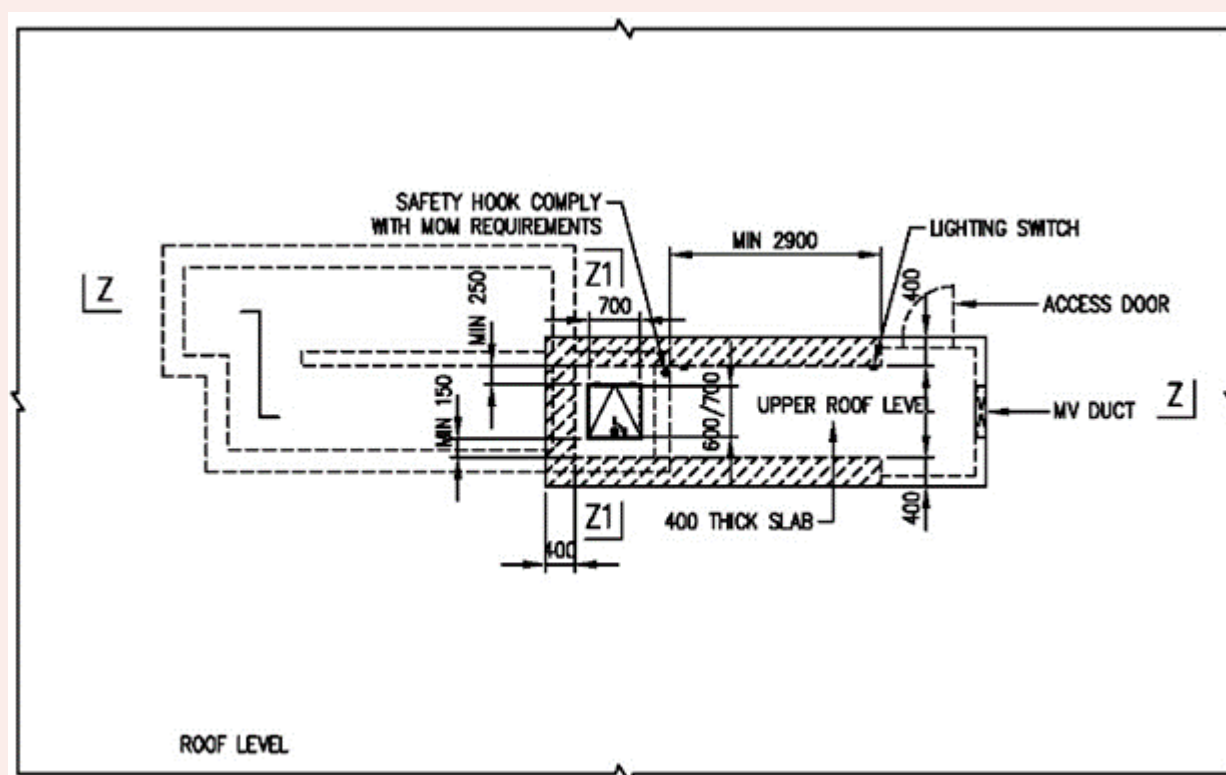


FIGURE 2.12.6(d): SECTION Z-Z OF S/C SS

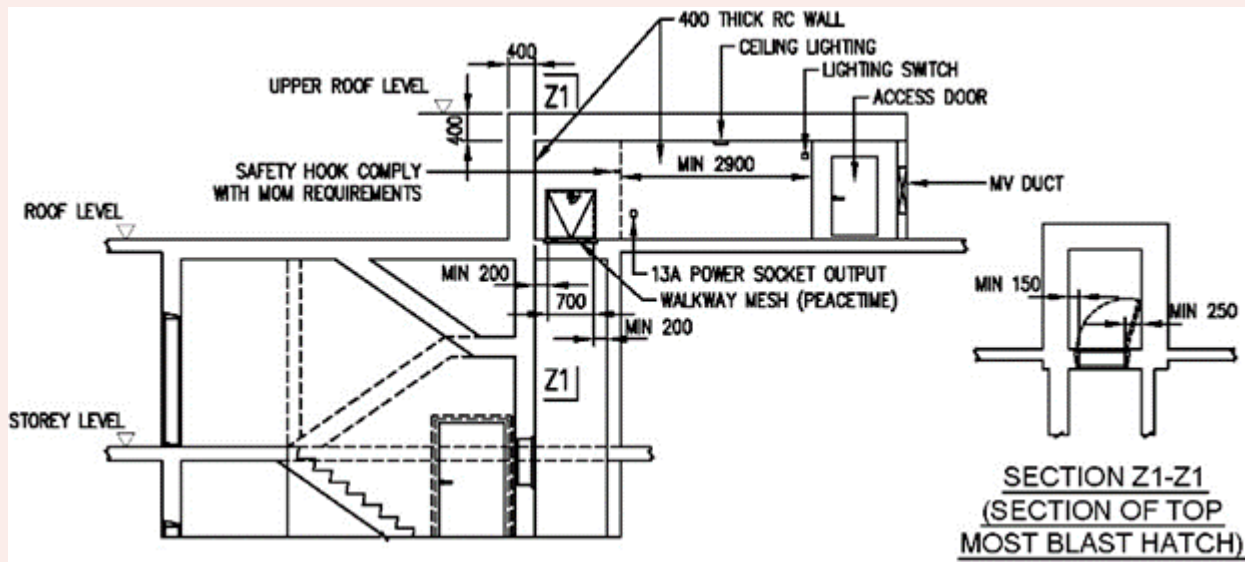

c. An unobstructed passageway shall be provided to the roof level for the operation and maintenance of the blast hatch in the MV chamber.

d. Ceiling light, switch, single power socket outlet and safety steel mess shall be provided in the MV chamber as shown in FIGURE 2.12.6(a) to 2.12.6(d).

Figures & Tables

FIGURE 2.12.6(a): PLAN OF S/C SS AT UPPER ROOF LEVEL

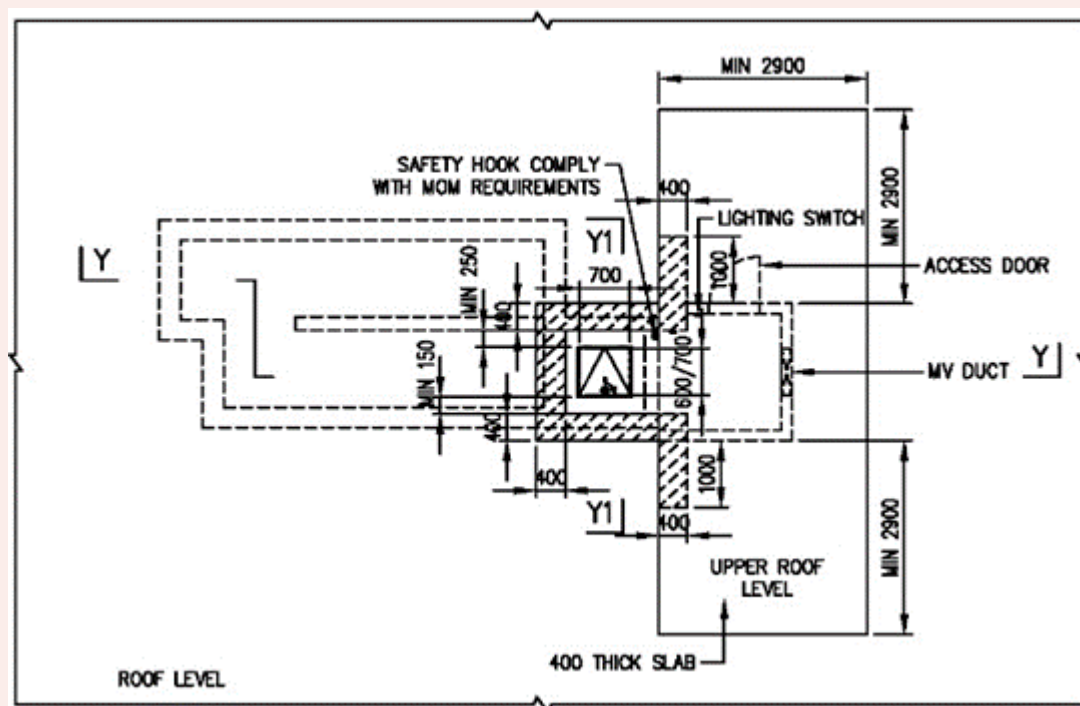


FIGURE 2.12.6(b): SECTION Y-Y OF S/C SS

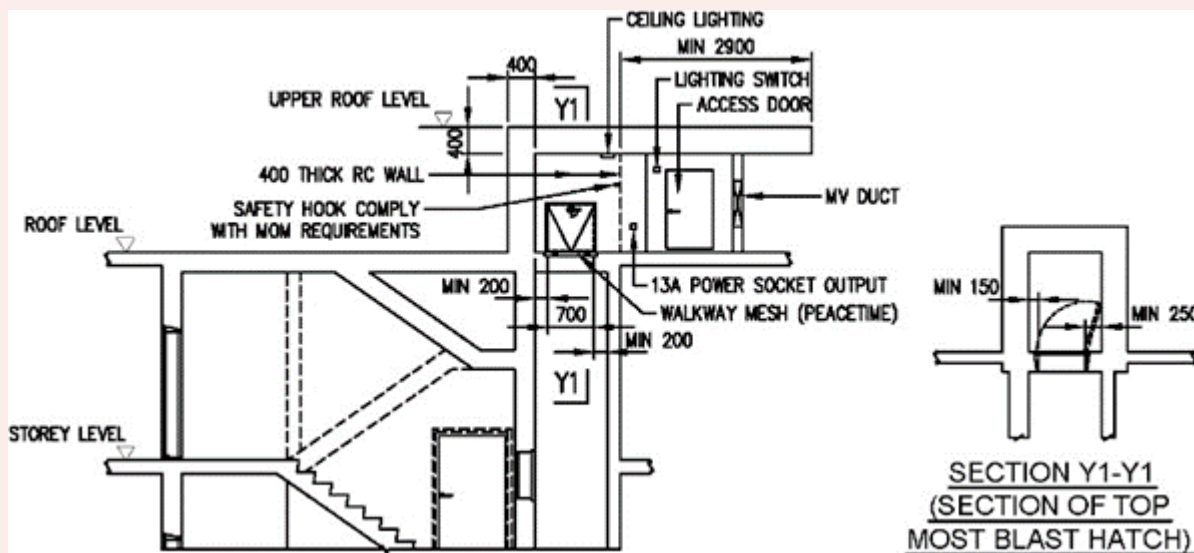


FIGURE 2.12.6(c): PLAN OF S/C SS AT UPPER ROOF LEVEL


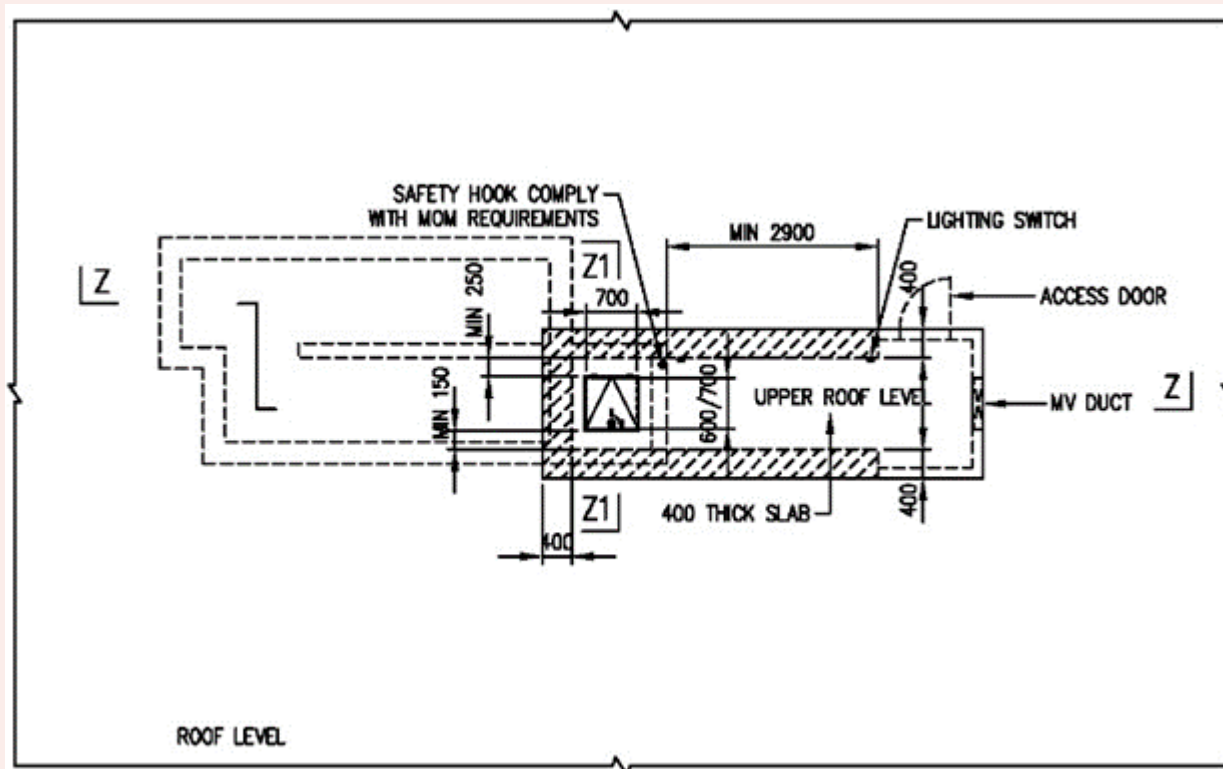


FIGURE 2.12.6(d): SECTION Z-Z OF S/C SS

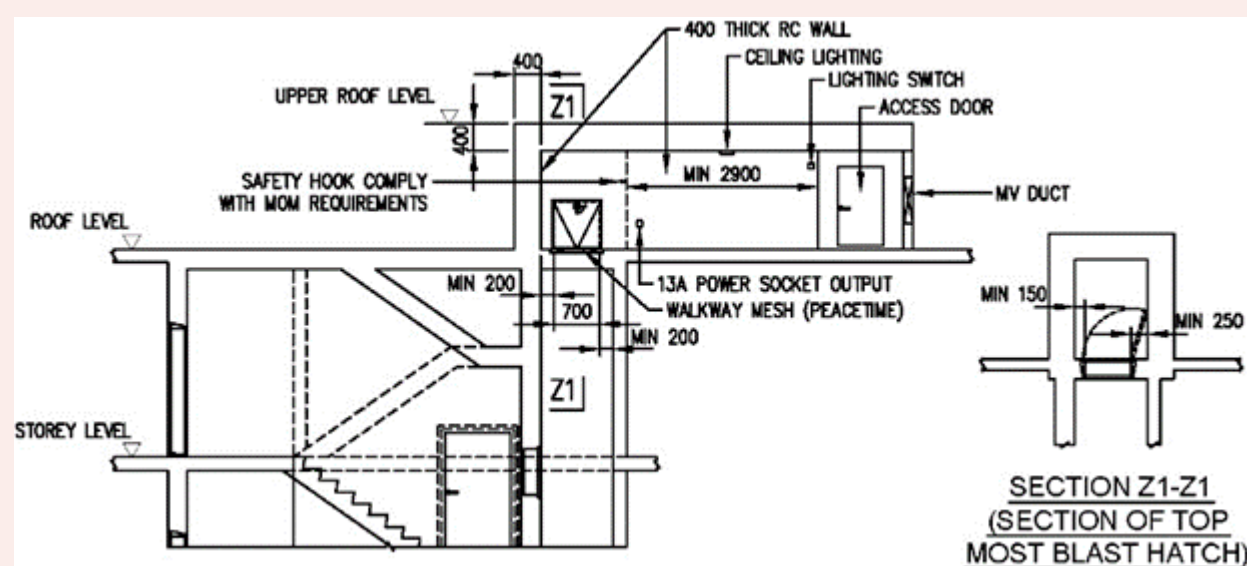


2.12.7 Dimensions and Other Requirements of Blast Hatch


- The minimum size of the vertical panel or MV grille for access to open/close the vertical blast hatch between the MV riser and staircase SS shall be 600/700mm by 700mm. The internal SS door shall be positioned such that it swings away from the vertical blast hatch opening. Refer to FIGURE 2.12.1(f) and 2.12.2(j).

Figures & Tables

FIGURE 2.12.1(f): TYPICAL PLAN OF S/C SS COMPARTMENT

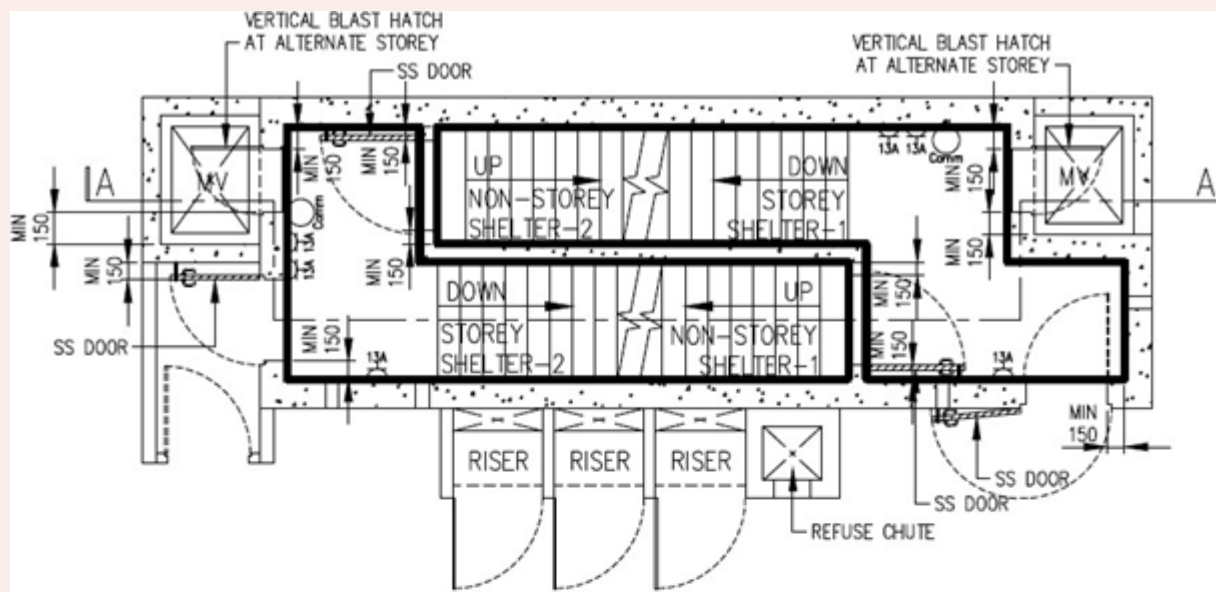

**TOP-MOST COMPARTMENT PLAN FOR
SCISSOR STAIRCASE STOREY SHELTER**

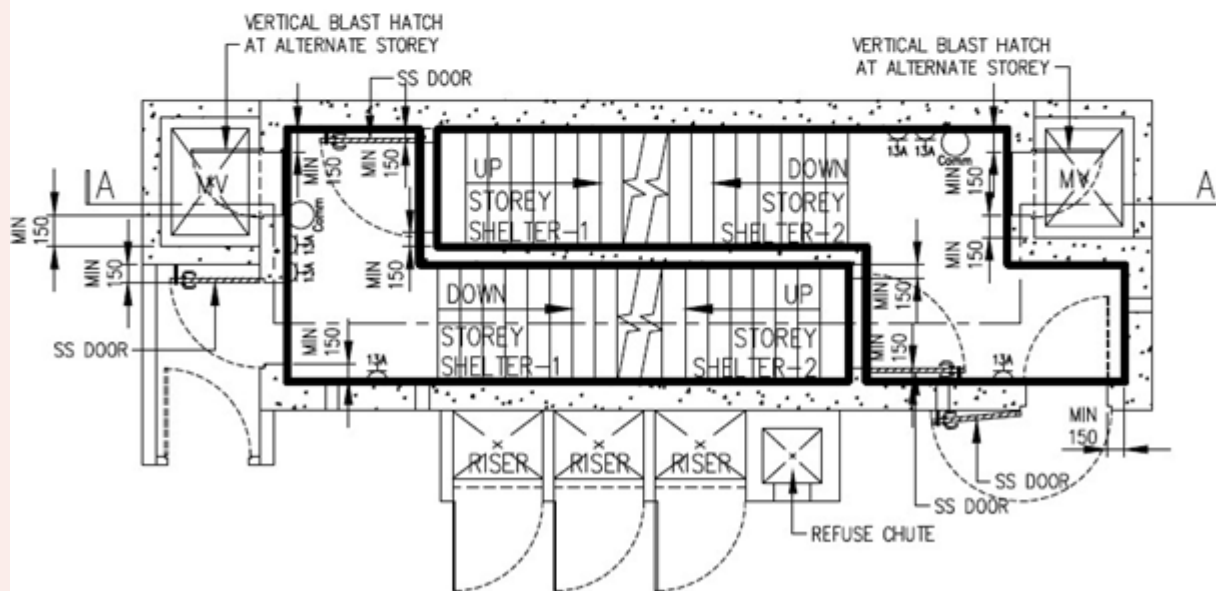

**TYPICAL STOREY COMPARTMENT PLAN FOR
SCISSOR STAIRCASE STOREY SHELTER**

b. There shall be reinforced concrete ledge or steel ledge provided around the MV duct for inspection and maintenance of the vertical blast hatch.
Refer to FIGURE 2.12.1(f), 2.12.2(c) and 2.12.2(k).

Figures & Tables

FIGURE 2.12.1(f): TYPICAL PLAN OF S/C SS COMPARTMENT


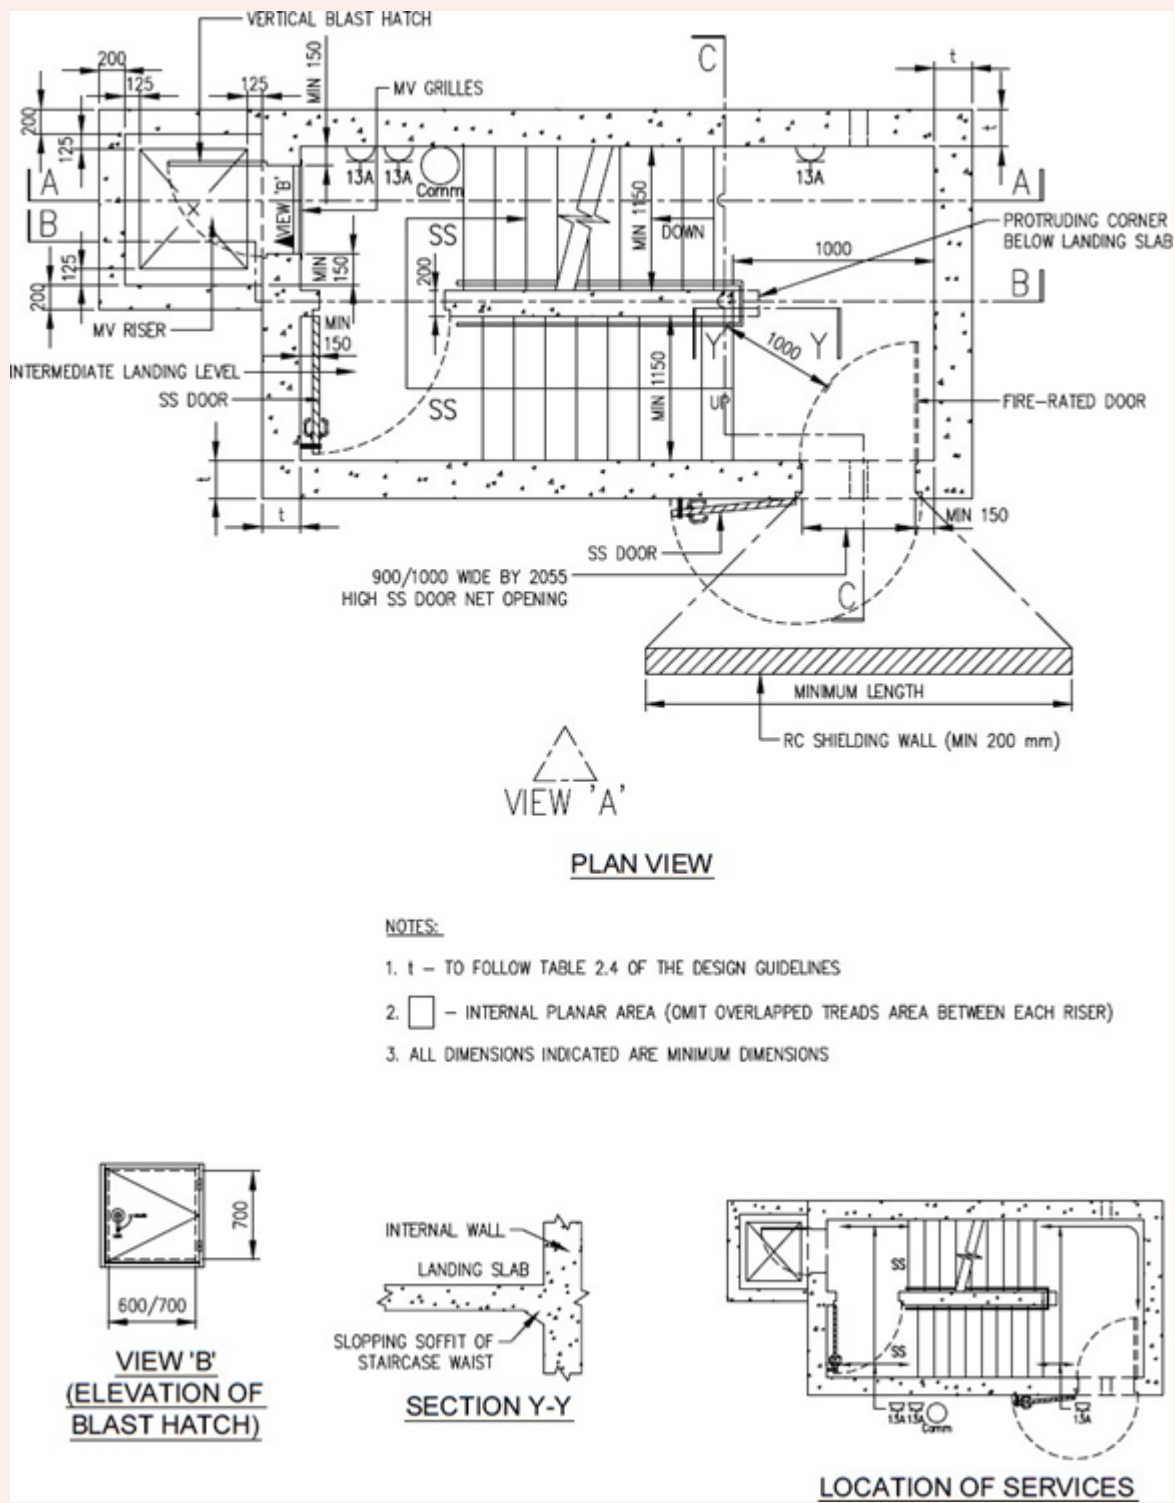


FIGURE 2.12.2(c): SS WITH NS ABOVE TOP-MOST SS COMPARTMENT, INTERMEDIATE SS COMPARTMENT AND SS WITH NS BELOW BOTTOM-MOST SS COMPARTMENT

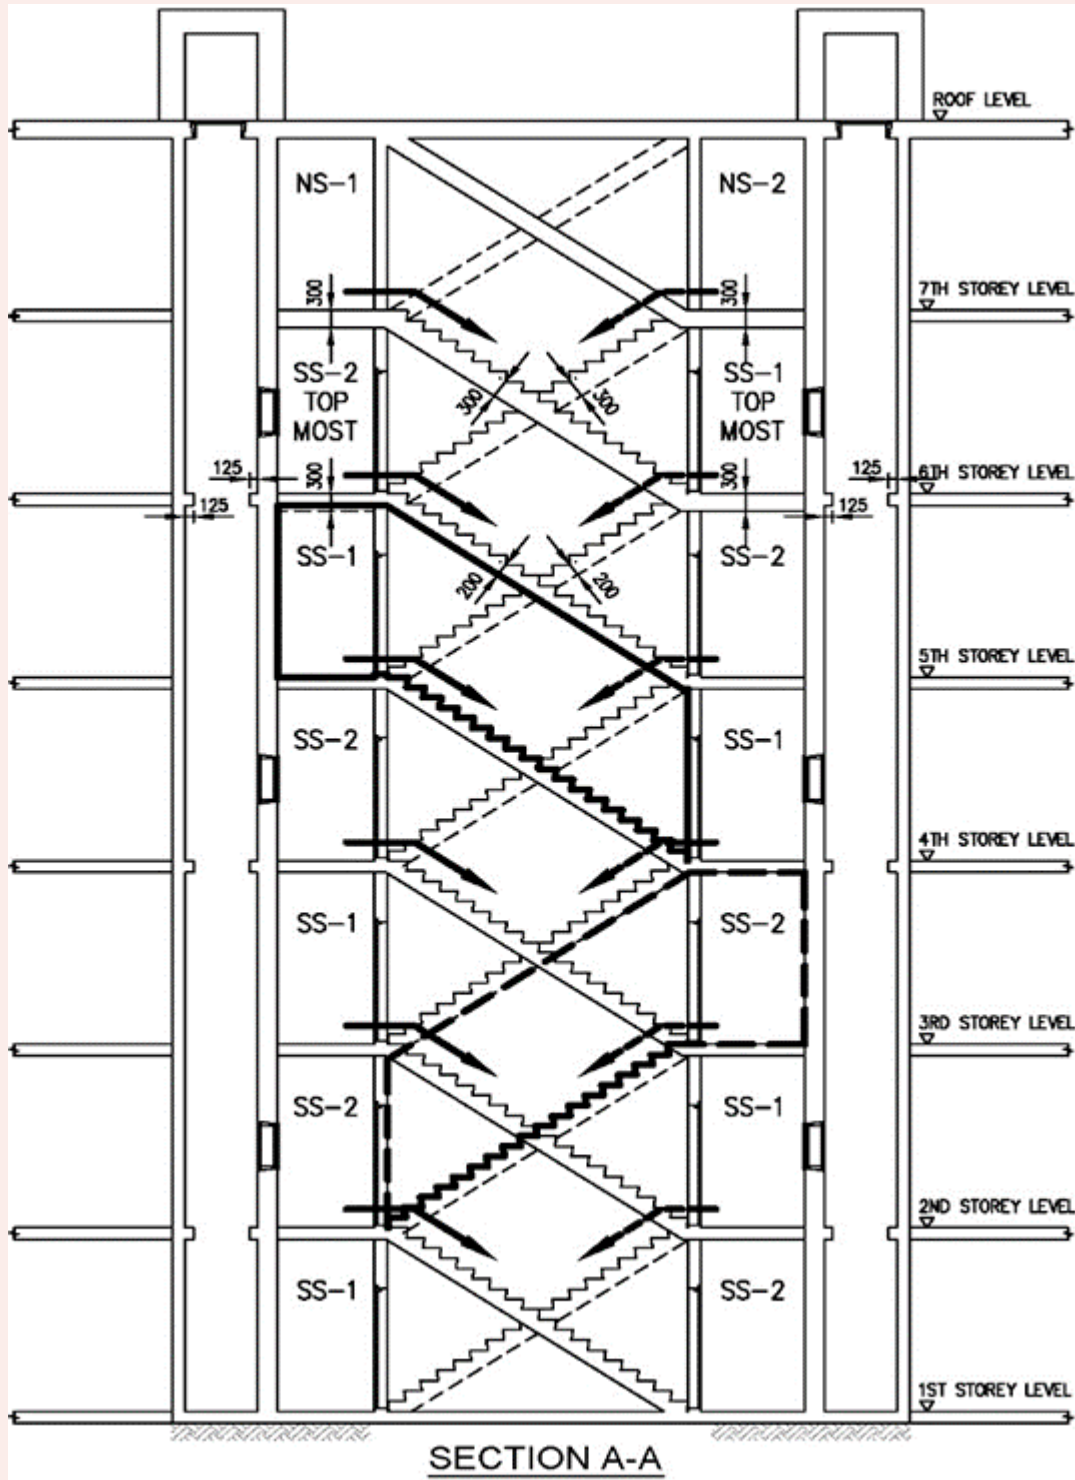

c. The details of the nib dimensions for horizontal blast hatch opening at the MV chamber are as shown in FIGURE 2.12.6(a) to 2.12.6(d).

Figures & Tables

FIGURE 2.12.6(a): PLAN OF S/C SS AT UPPER ROOF LEVEL

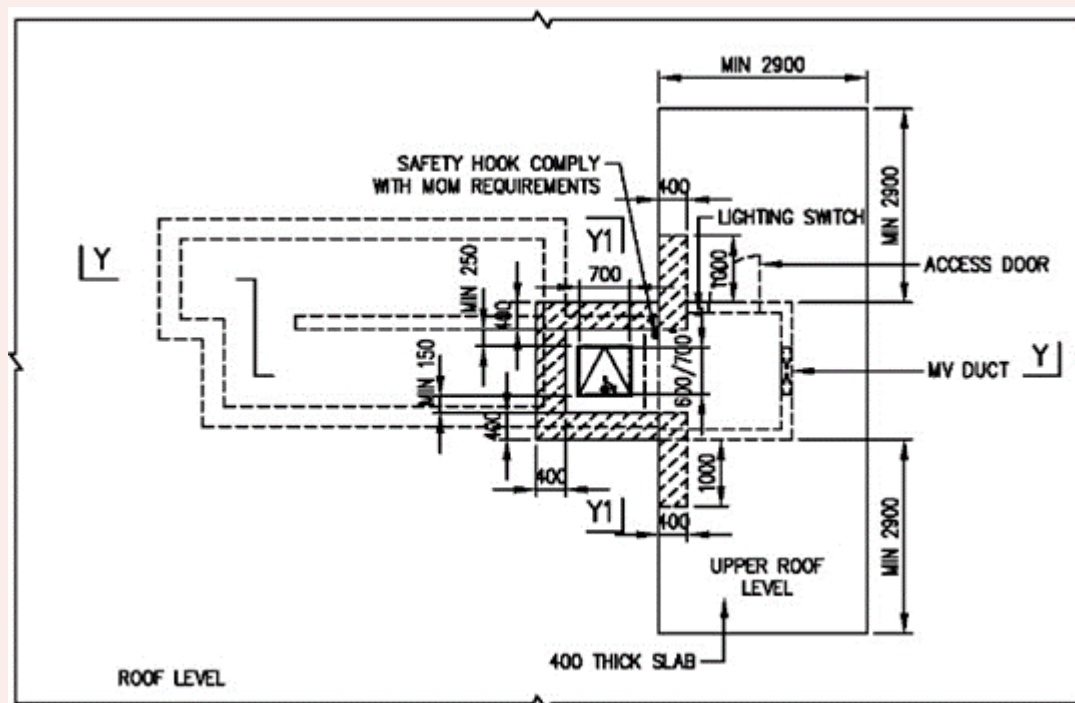


FIGURE 2.12.6(b): SECTION Y-Y OF S/C SS

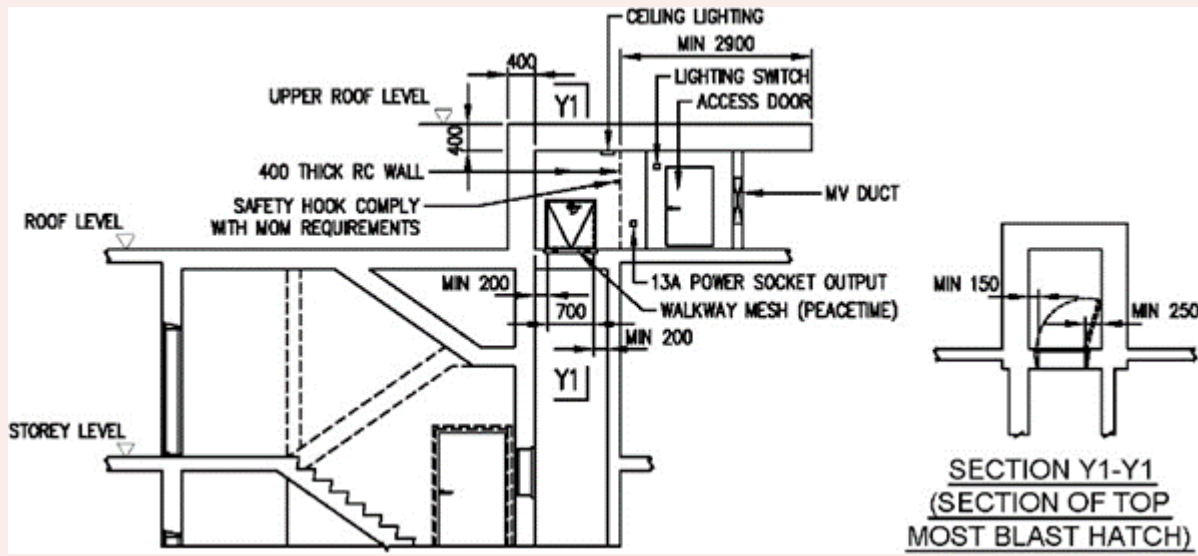


FIGURE 2.12.6(c): PLAN OF S/C SS AT UPPER ROOF LEVEL


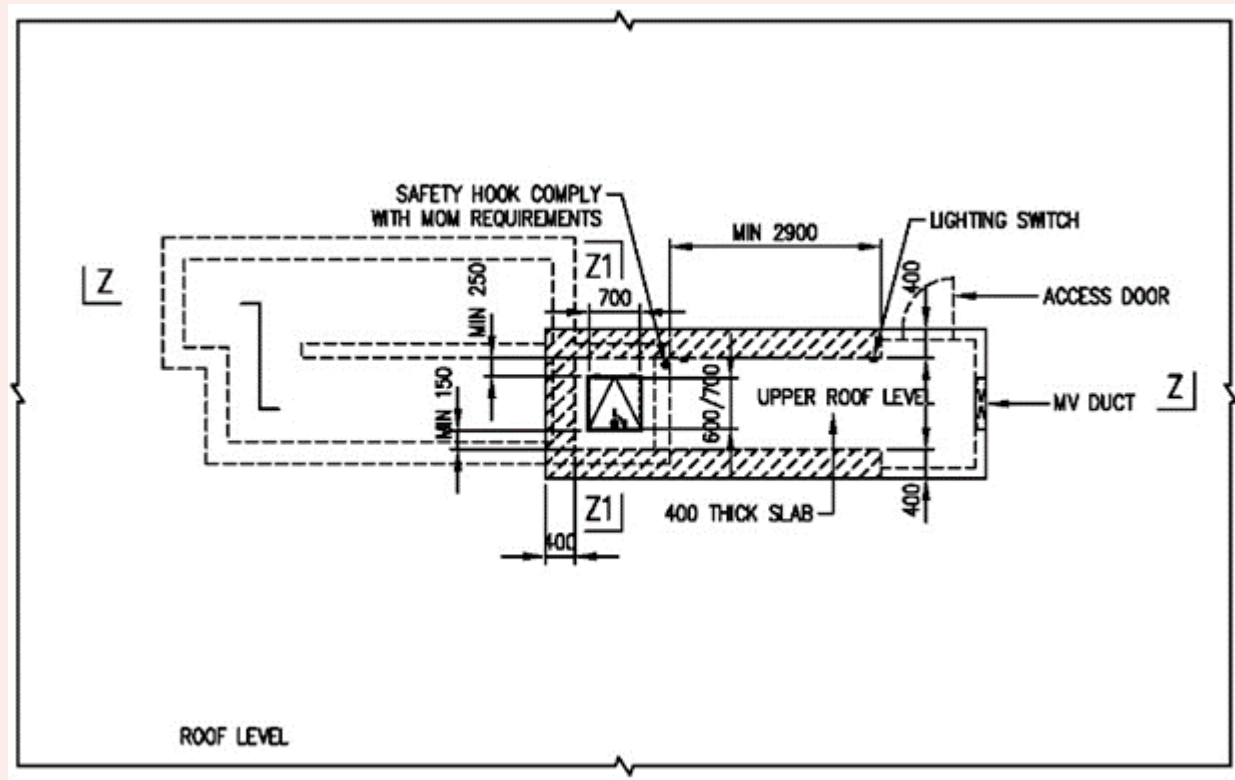


FIGURE 2.12.6(d): SECTION Z-Z OF S/C SS

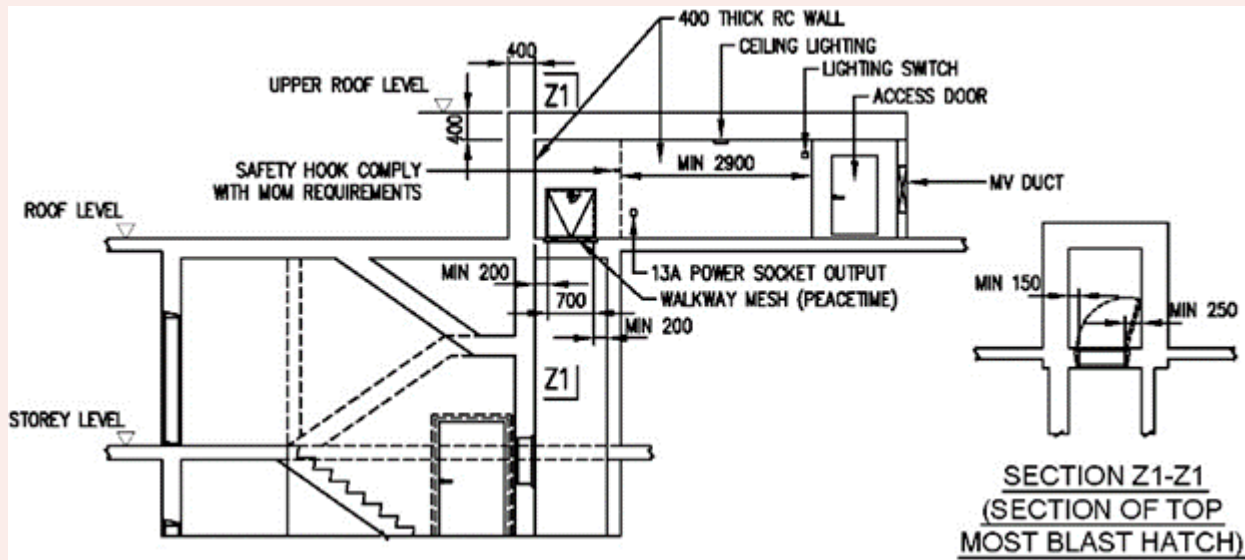

d. The net clear opening of the vertical and horizontal blast hatches shall be 600/700mm x 700mm as shown in FIGURE 2.12.7(a) and 2.12.7(b).

Figures & Tables

FIGURE 2.12.7(a): MINIMUM DIMENSION OF VERTICAL BLAST HATCH


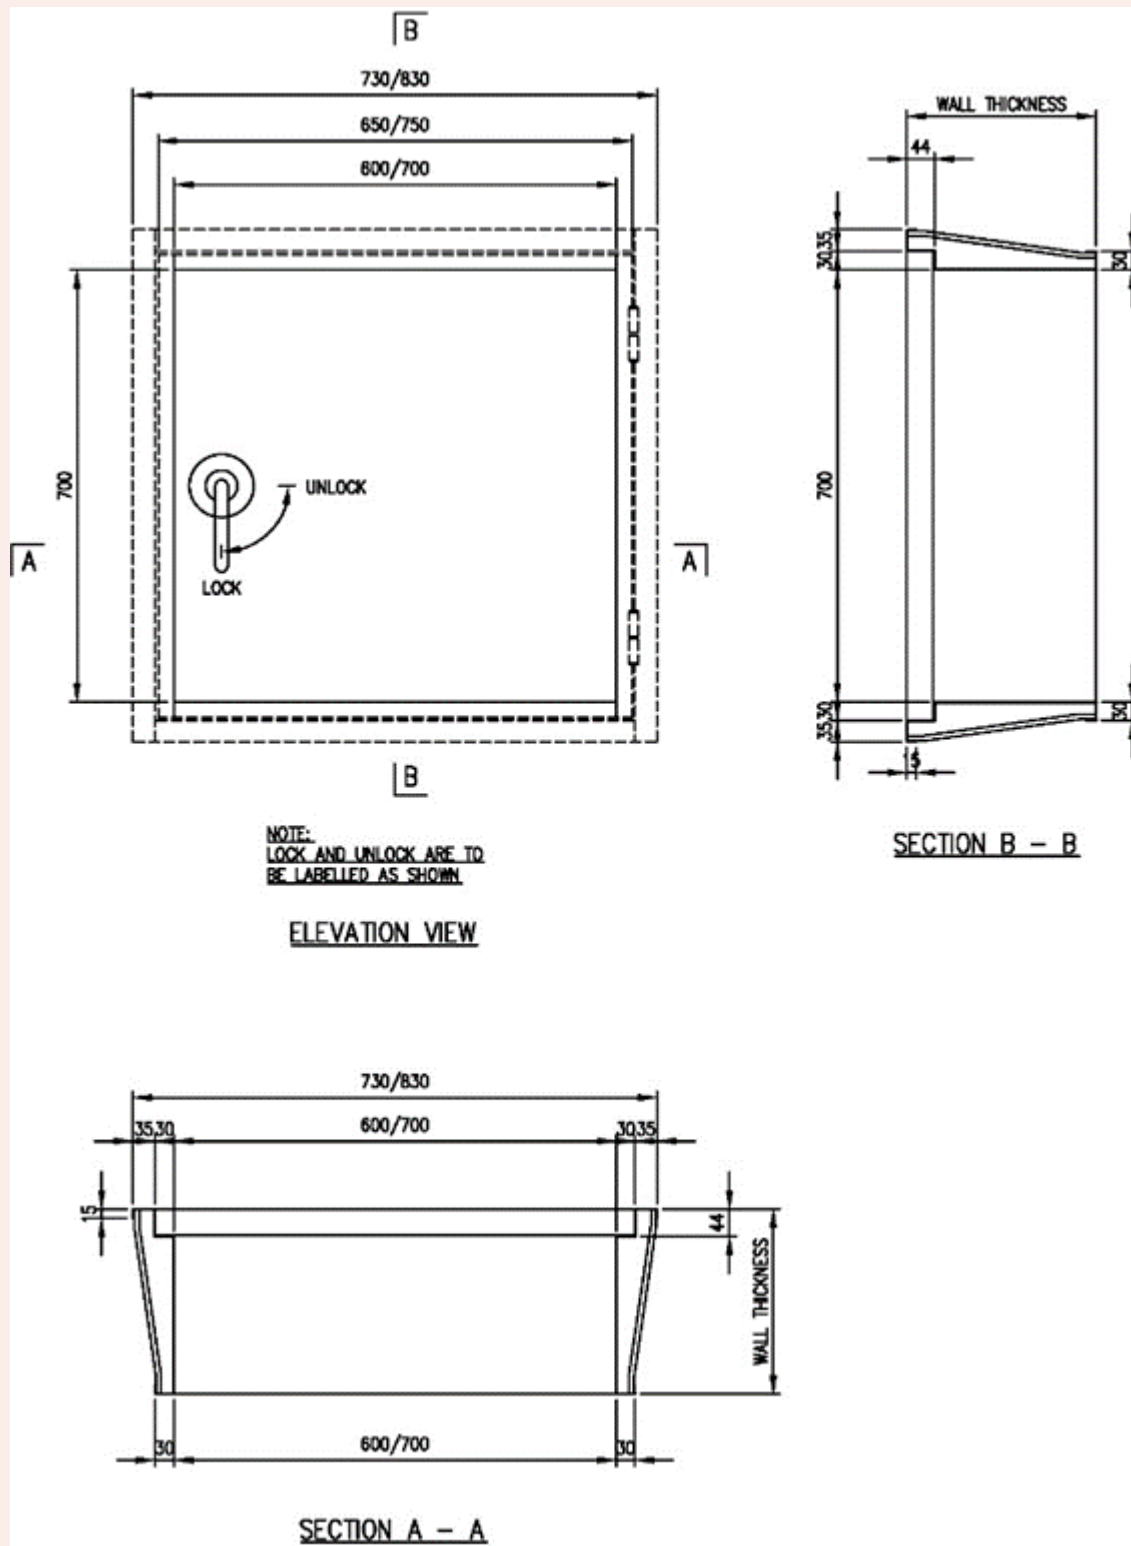


FIGURE 2.12.7(b): MINIMUM DIMENSION OF HORIZONTAL BLAST HATCH

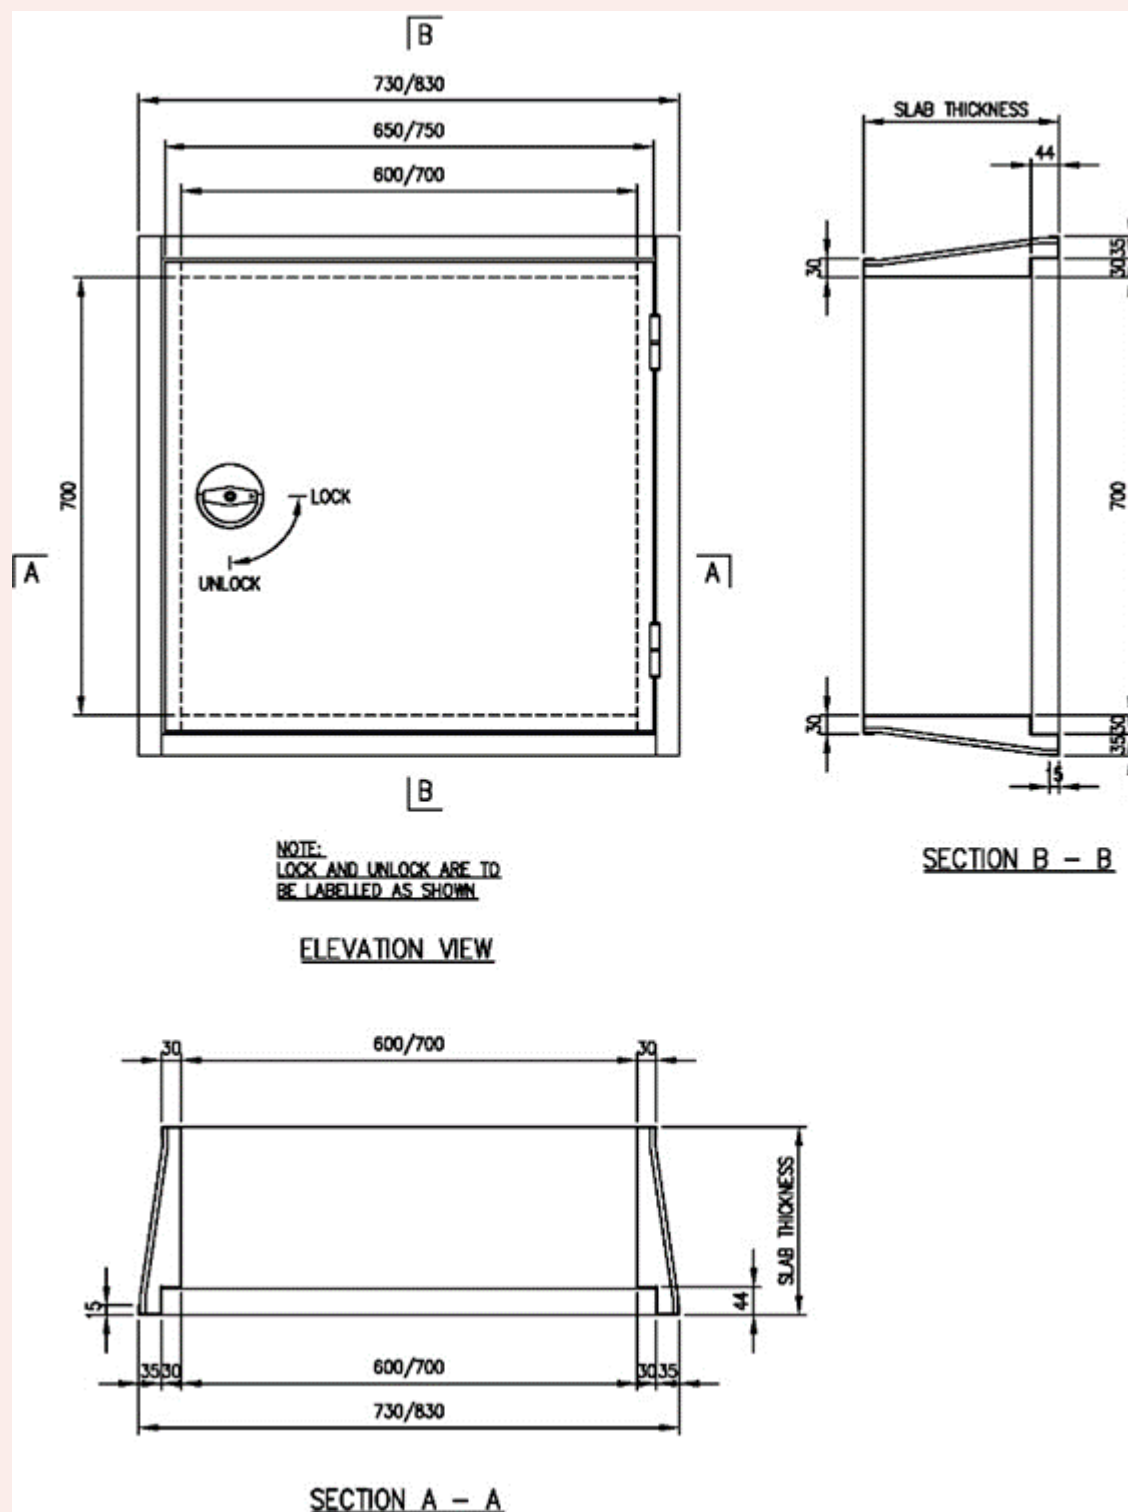

e. Unlocking” or “Locking” label or sticker to indicate the unlocking or locking position at the locking device shall be provided for all blast hatches. Refer to FIGURE 2.12.7(a) and 2.12.7(b).

Figures & Tables

FIGURE 2.12.7(a): MINIMUM DIMENSION OF VERTICAL BLAST HATCH


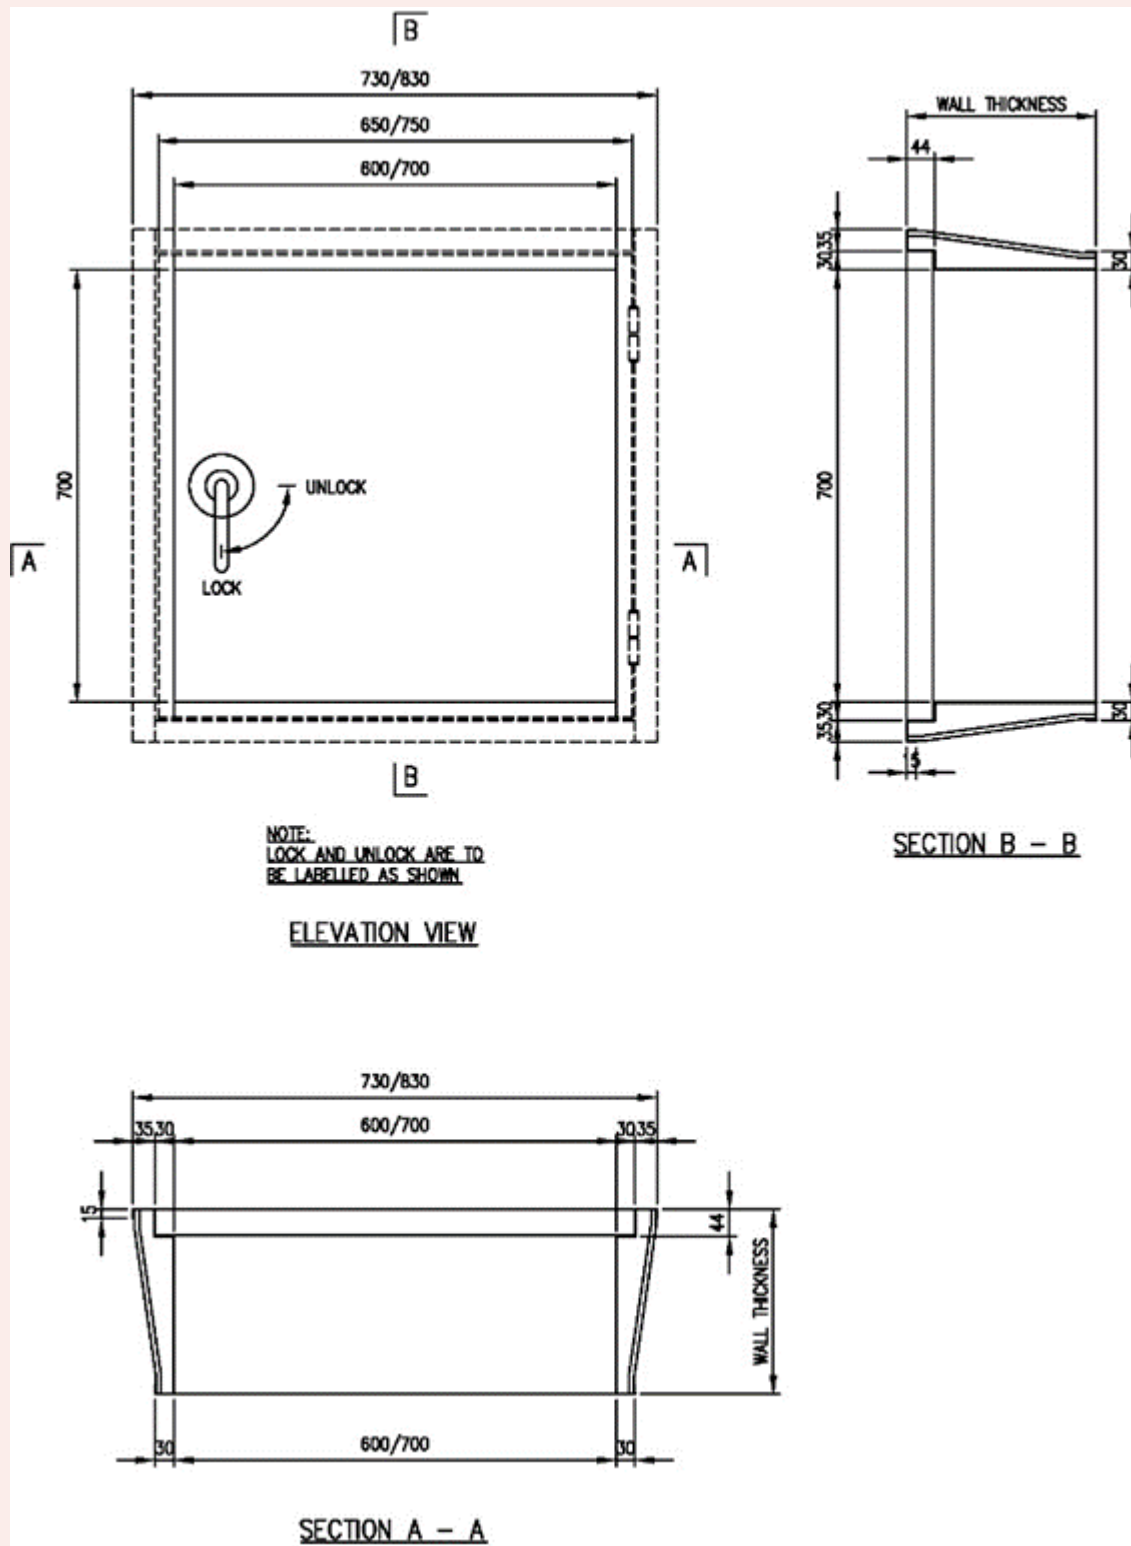


FIGURE 2.12.7(b): MINIMUM DIMENSION OF HORIZONTAL BLAST HATCH

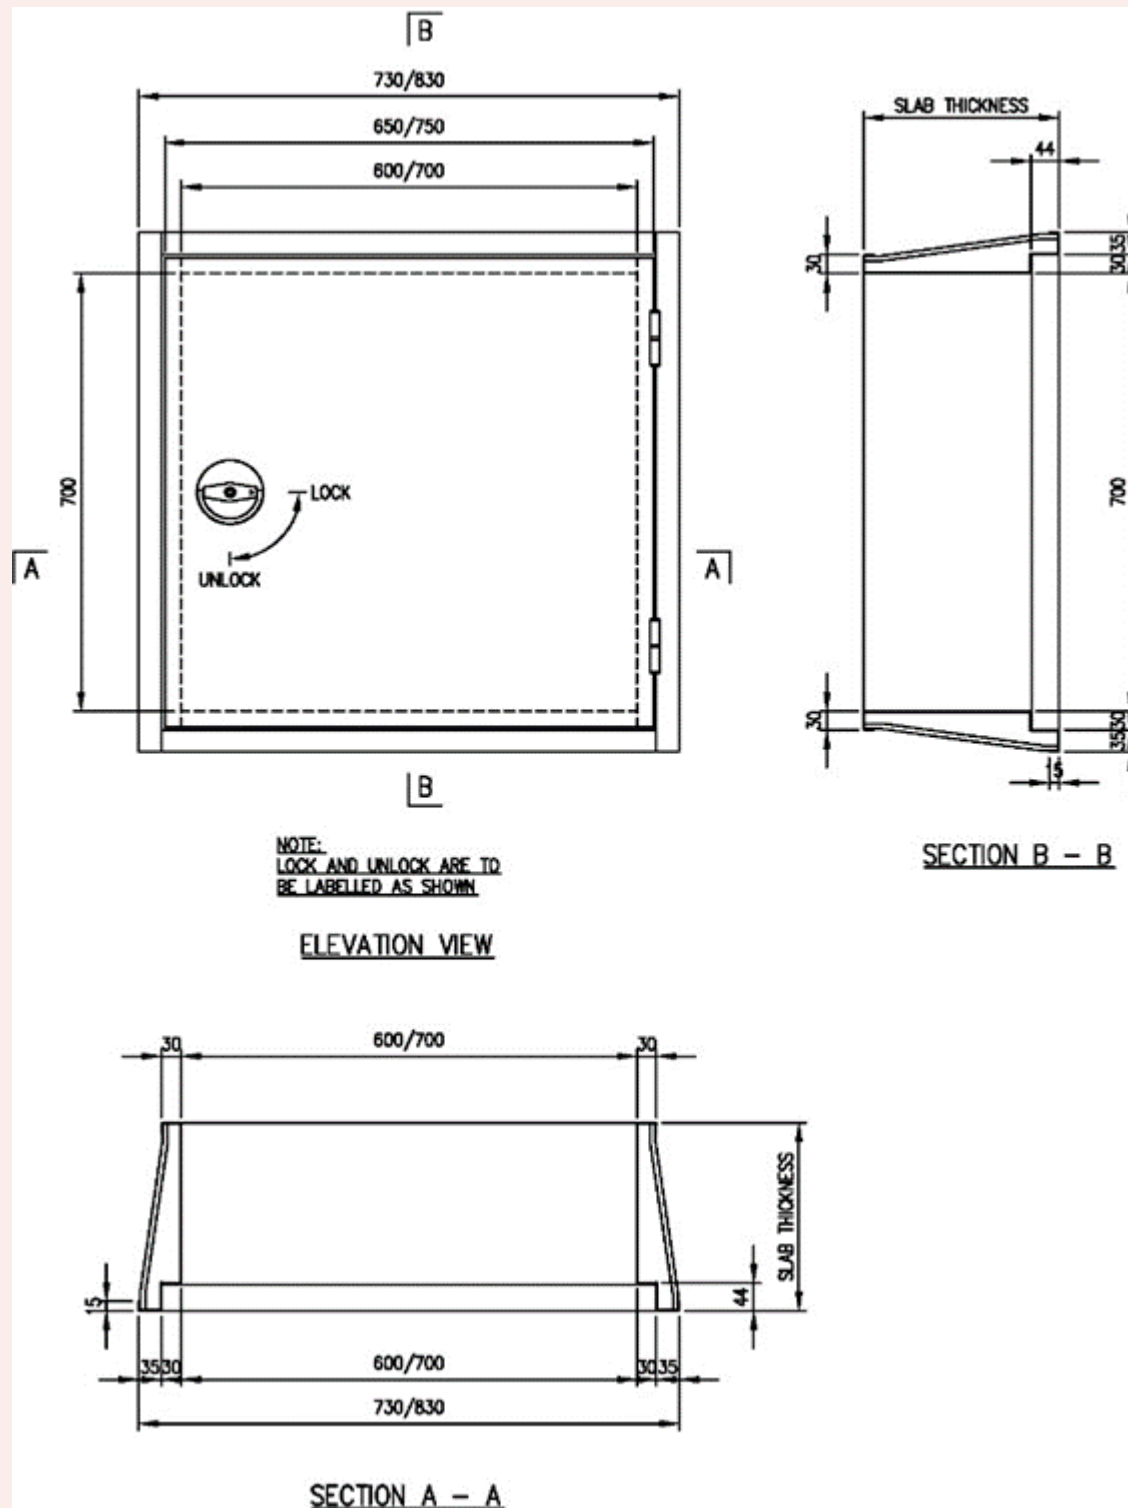


2.12.8 Provision of cut-off Sprinkler outside S/C SS and Scissor S/C SS

Where cut-off sprinkler is required to be provided in the fire-protected space for the compliance to fire safety, the cut-off sprinkler compartment shall be provided outside the S/C SS. Refer to FIGURE 2.12.8.

Figures & Tables

FIGURE 2.12.8: PROVISION OF CUT-OFF SPRINKLER IN S/C SS

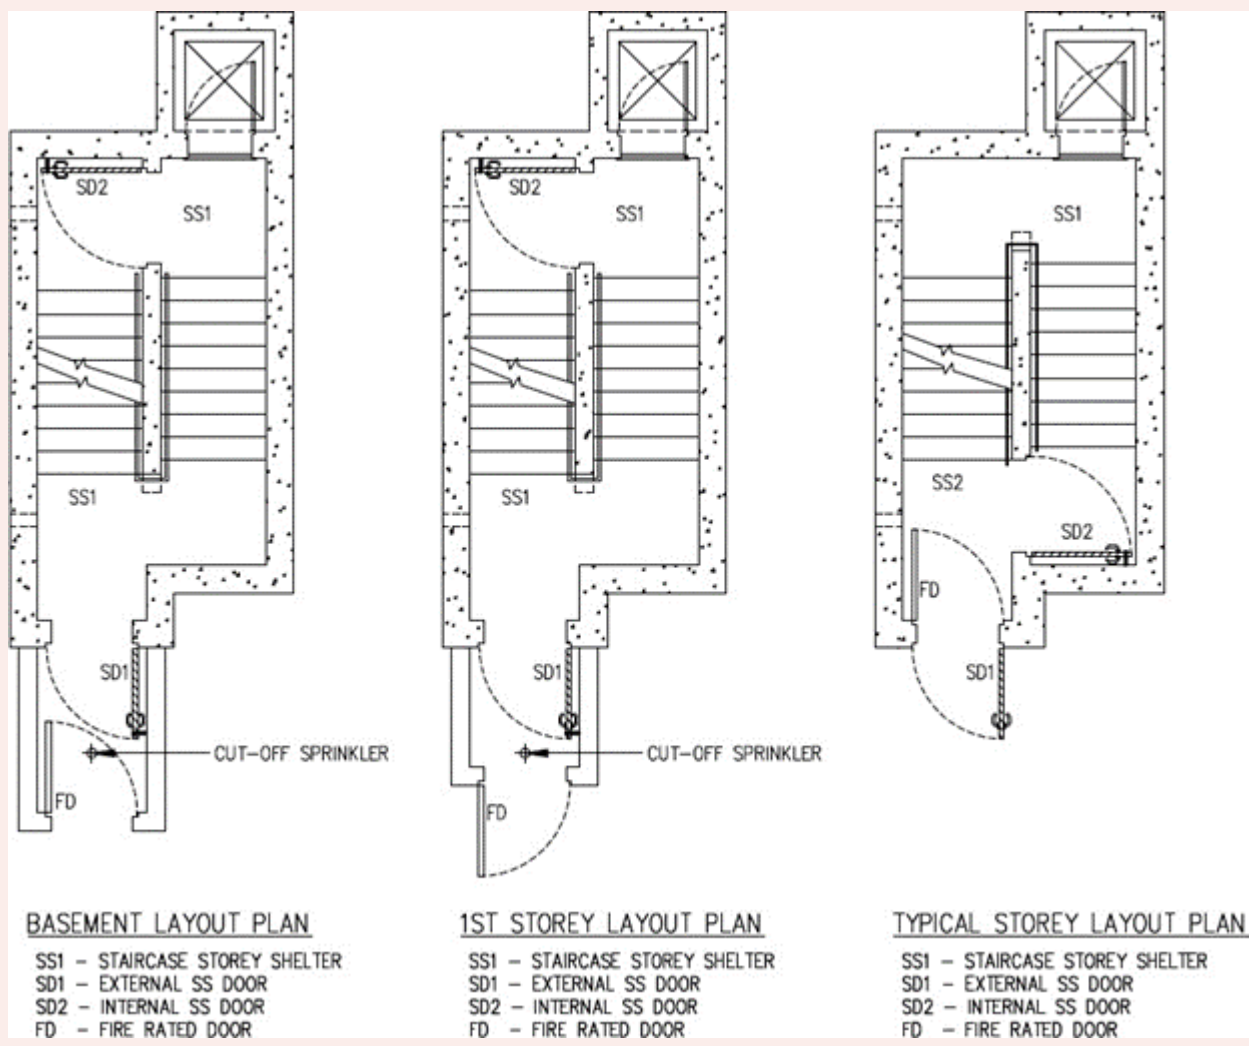

Amendment History - Chapter 2 - Architectural Requirements

Clause No.	Amendment Date	Effective Date	Clause Status	Clause Before Amendment	Circular Date
------------	----------------	----------------	---------------	-------------------------	---------------

CLAUSE 3.1 GENERAL

The structural design of the SS tower shall take into account both the vertical and lateral loads, where applicable. The SS tower shall be designed for maximum degrees of redundancy in the structural system against weapon effects.

CLAUSE 3.2 MATERIALS

3.2.1 Concrete

The minimum grade of concrete for all SS/NS structures shall be C32/40. Concrete used in SS/NS structures (including hollow core and joints), as well as concrete used for structures within shelter setback distance, should be of normal concrete density (2400kg/m3) and consists of 20mm nominal maximum size coarse aggregate. The use of pre-stressed concrete for SS wall/slab and NS wall/slab in the SS, S/C SS or scissor S/C SS tower is not permitted.

3.2.2 Steel Reinforcement

The steel reinforcement in SS/NS wall and slab shall be welded steel fabric mesh for steel bar diameter of up to 16mm and hot rolled steel bars. The minimum yield stress of main reinforcement bars and shear links in the structural elements forming the SS, S/C SS or scissor S/C SS or NS shall be minimum 500 N/mm².

CLAUSE 3.3 ANALYSIS

3.3.1 General


The vertical continuity of SS and NS walls, where applicable, to the foundation shall comply with [Clause 2.4.2](#). In the case of S/C SS or scissor S/C SS tower, the SS and NS wall shall be continuous to foundation, except where there are fire discharge openings at fire discharge levels. The fire discharge openings shall be located such that all corners of the S/C SS walls are continuous to foundation.


3.3.2 Beam Supported on SS wall

The end of the external beam that is supported on SS wall(s) shall be designed and detailed as simply support.

3.3.3 Shielded NS Walls (2 opposite NS wall [not applicable for S/C SS tower] or 4 NS walls)

No additional design checks on SS tower is required if its supporting wall(s) are shielded. These structural walls are deemed shielded if reinforced concrete slab or other equivalent structural forms provided above them is extended beyond their edges by as minimum length of $0.5H$, where H is the aggregate wall height of NS (See [FIGURE 3.3.3](#) and [3.3.4\(c\)](#)).

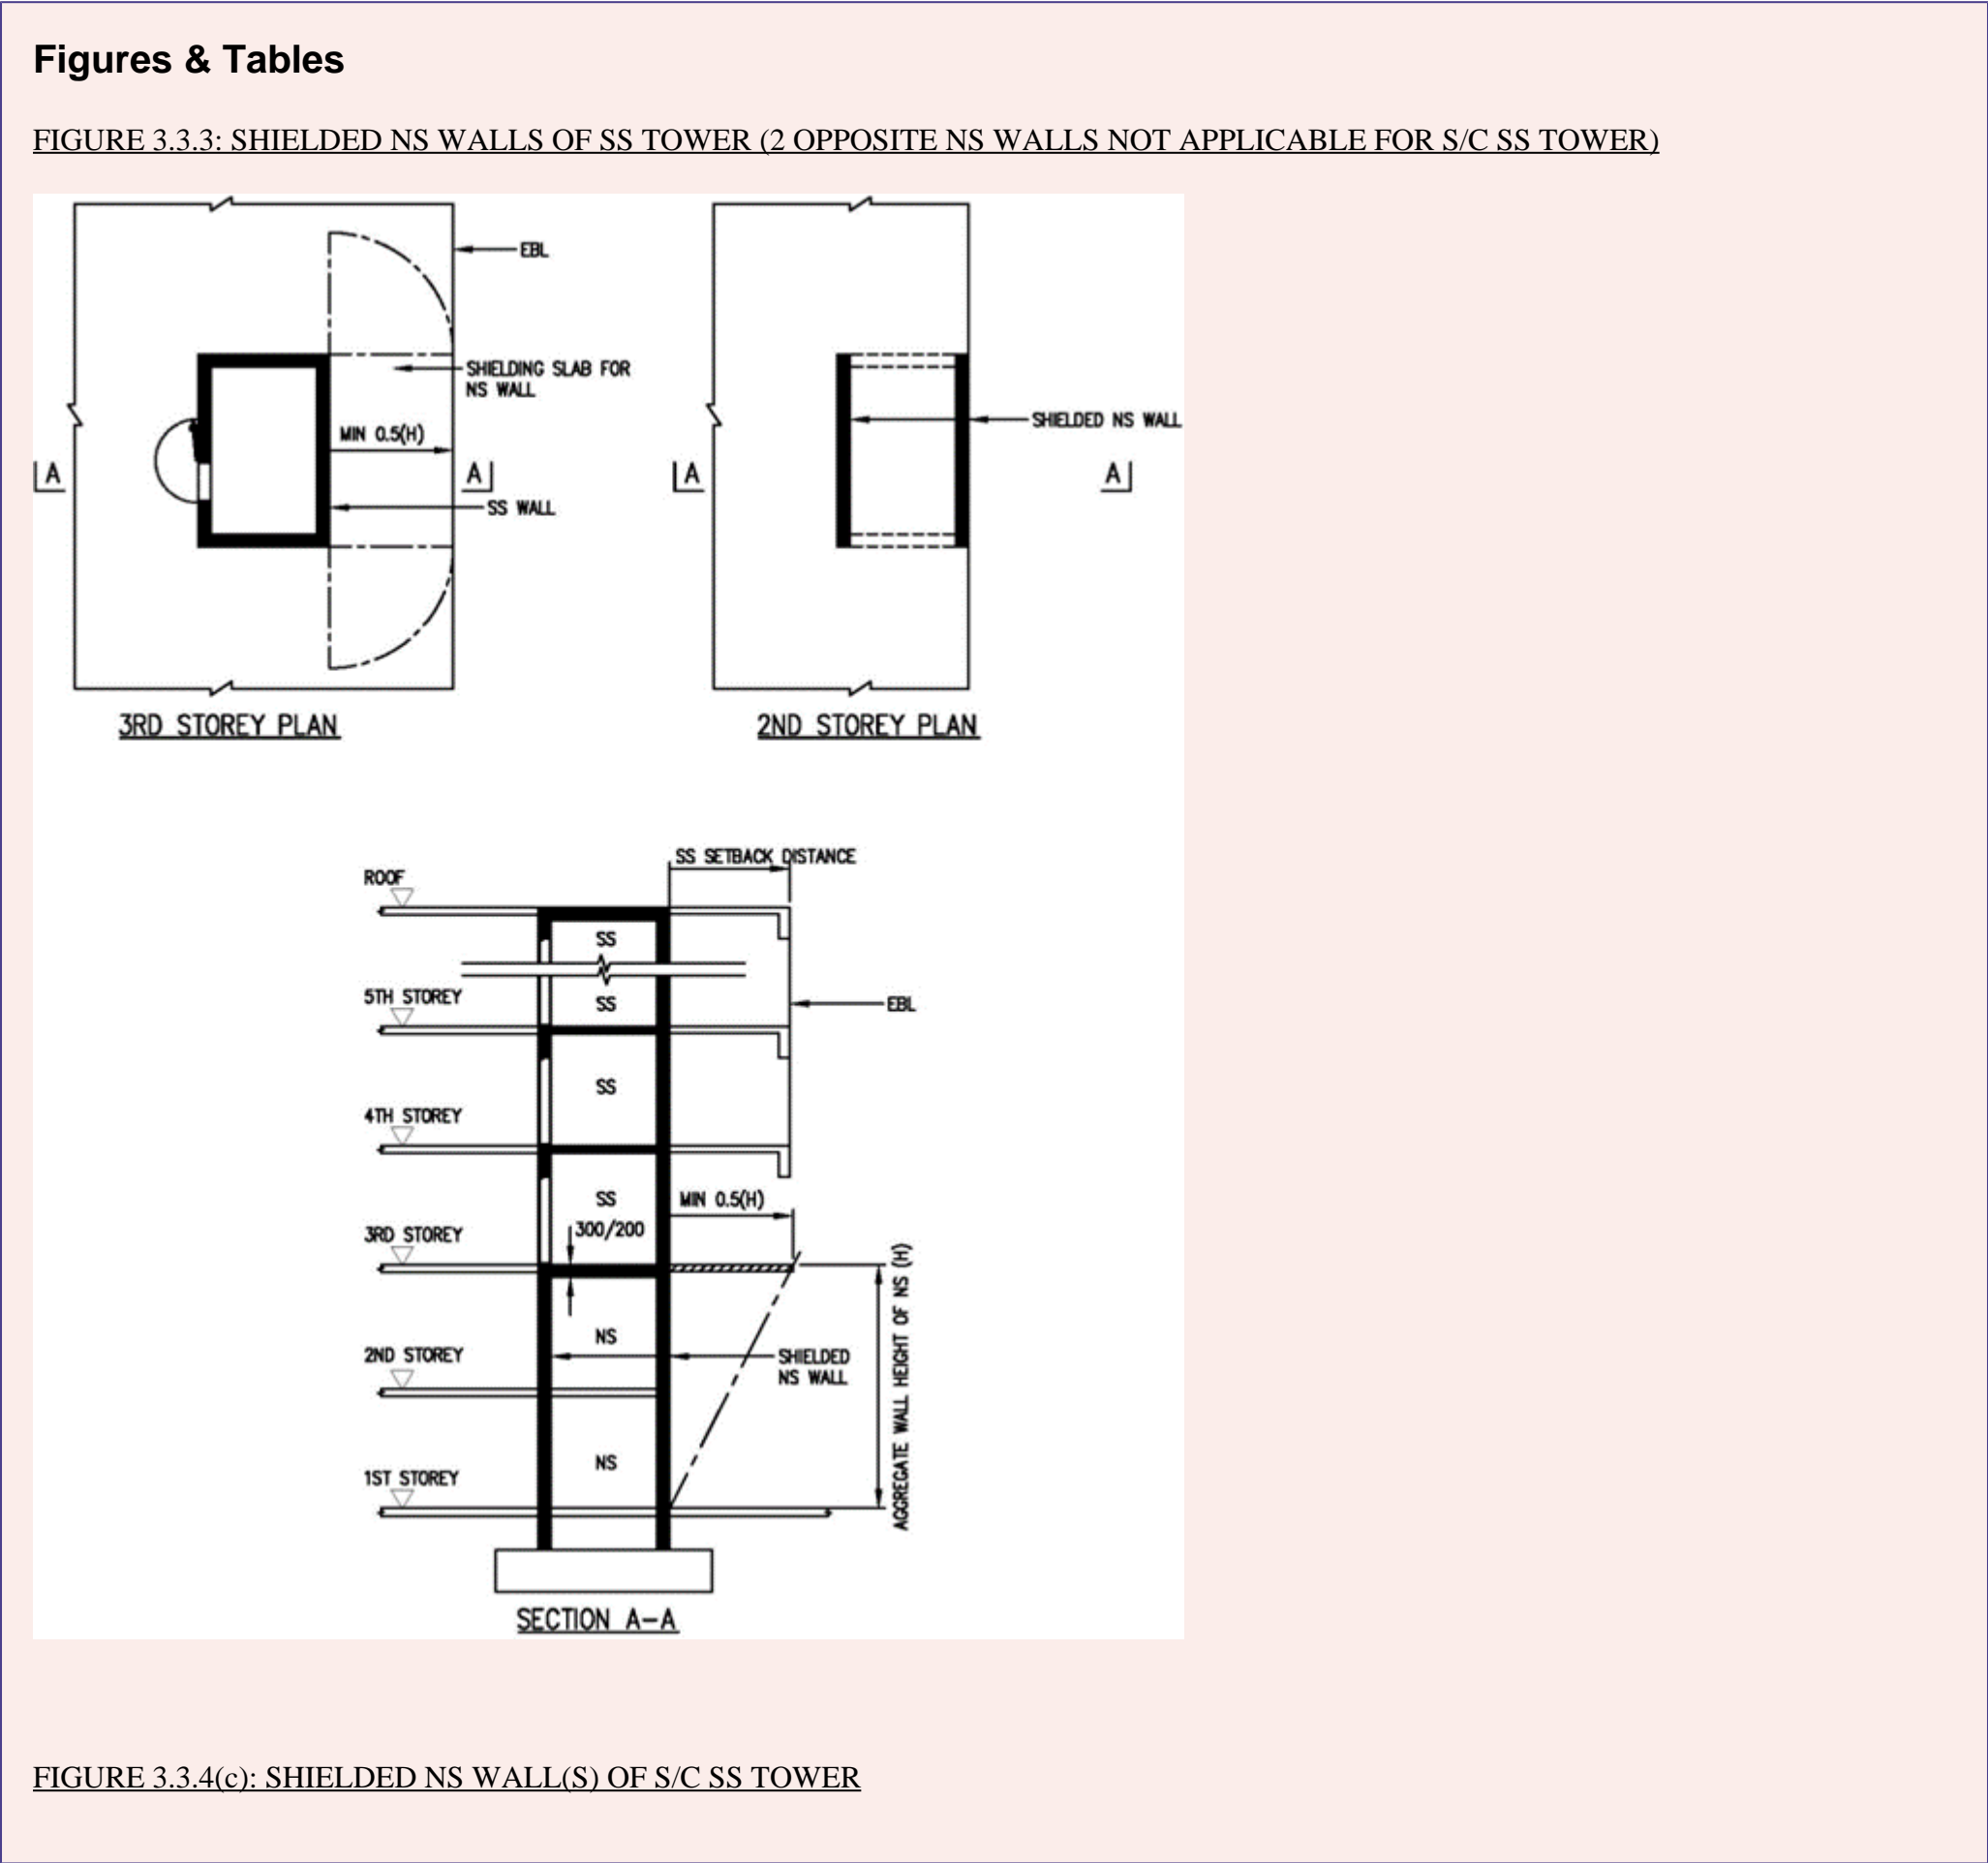

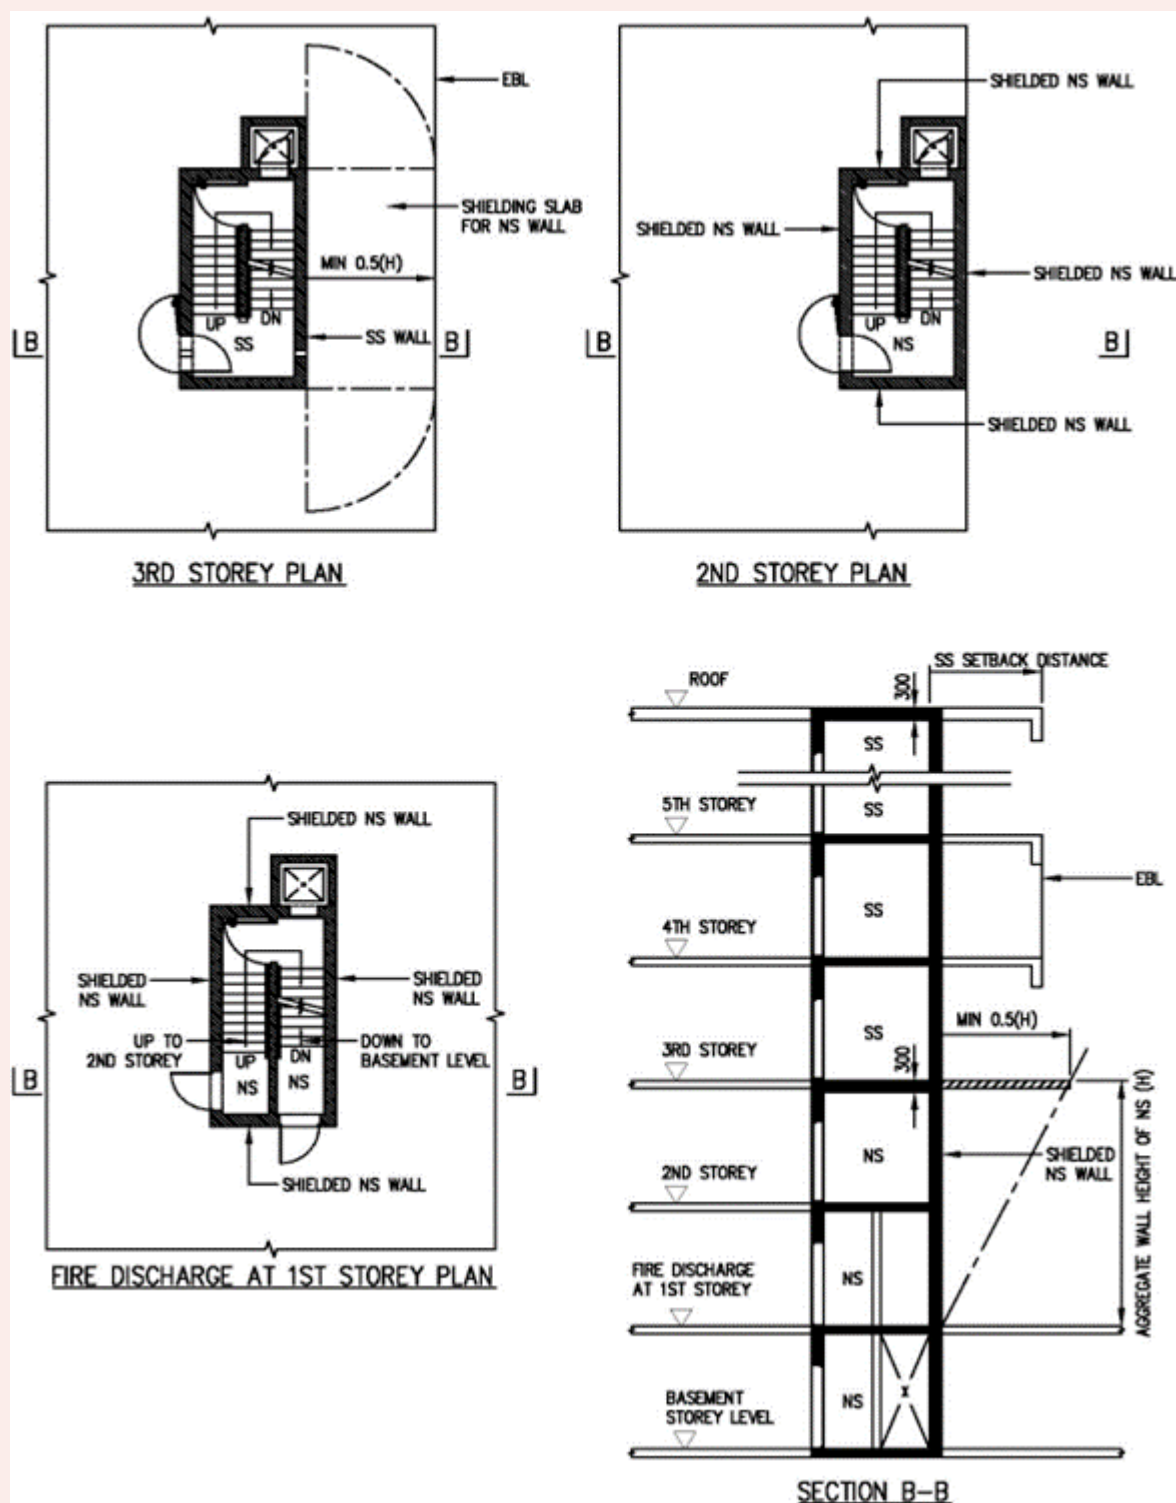

3.3.4 Unshielded NS Walls (2 opposite NS walls [not applicable for S/C SS tower] or 4 NS walls)

The following requirements are to be complied with if the design adopts:

a. Unshielded NS Walls

The minimum thickness of each NS wall shall be 300mm. The SS, S/C SS or scissor S/C SS tower shall be designed against the most severe effects as the result of the removal of a portion of the NS wall equivalent to an opening of 1500mm diameter on the NS wall at its most critical location (Refer to FIGURE 3.3.4(a), 3.3.4(b) and 3.3.4(d)).

Figures & Tables

FIGURE 3.3.4(a): UNSHIELDED NS WALL(S) OF SS TOWER

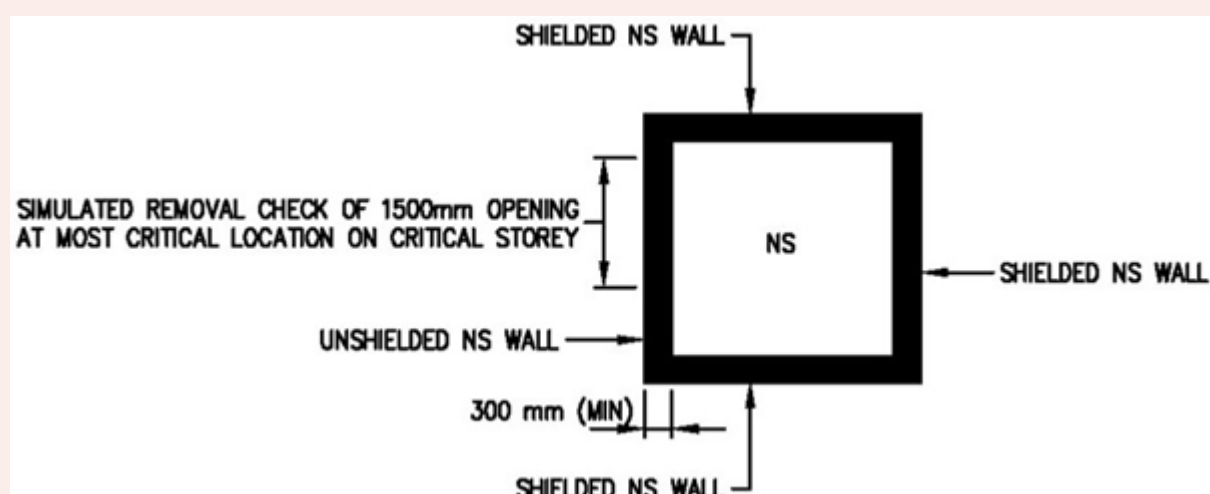


FIGURE 3.3.4(b): UNSHIELDED NS WALL(S) OF SS TOWER (2 OPPOSITE NS WALLS NOT APPLICABLE FOR S/C SS TOWER)


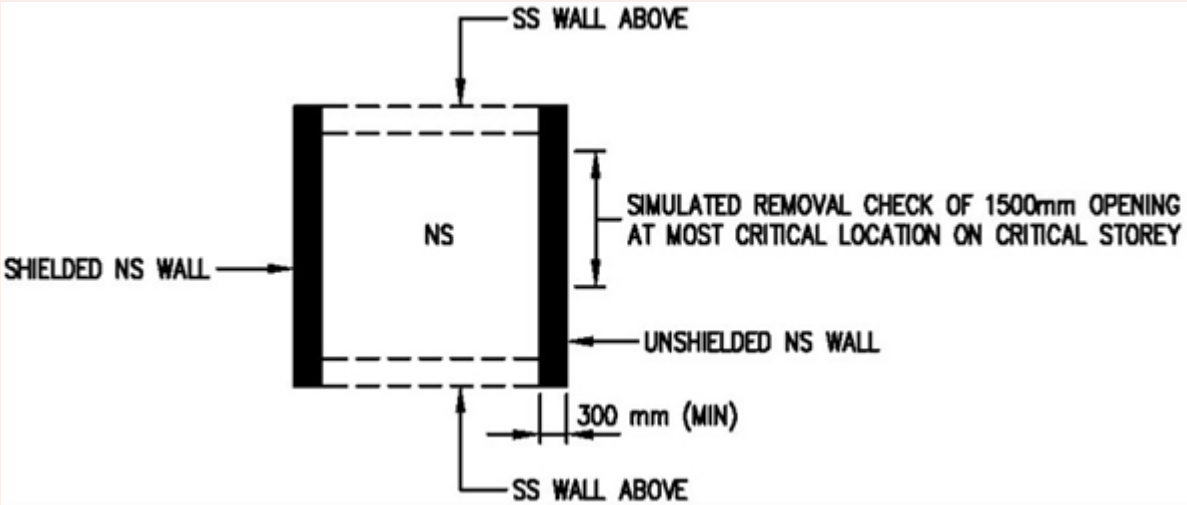


FIGURE 3.3.4(d): UNSHIELDED NS WALL OF S/C SS TOWER

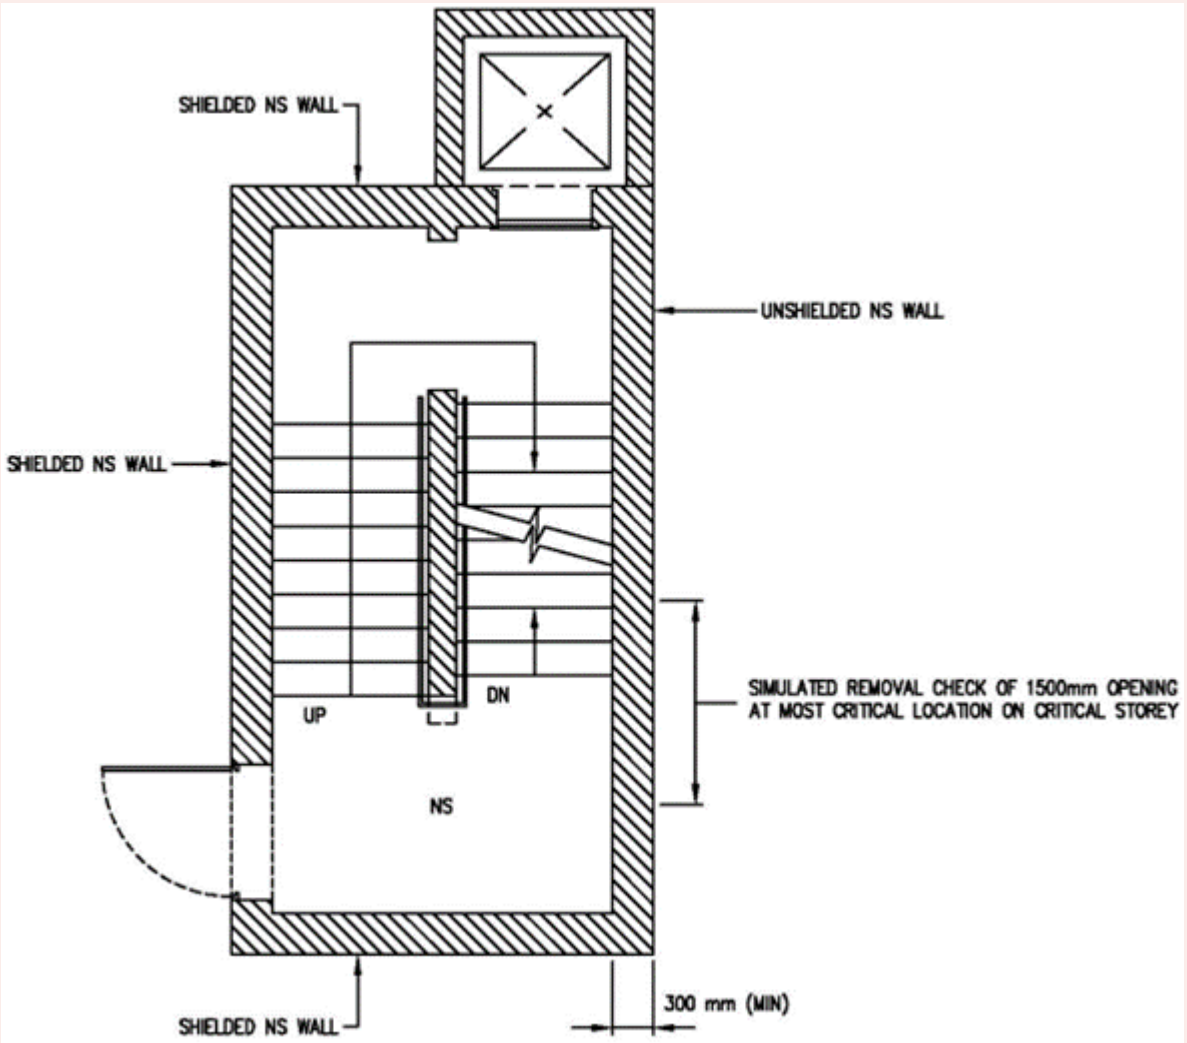

- b. The following are the criteria to be used when performing design checks for [Clause 3.3.4\(a\)](#):
- i. The design shall be based on the action combination and values of partial safety factor for actions in accordance with Table 3.3.4.

Figures & Tables

TABLE 3.3.4 : ACTION COMBINATION AND VALUES OF PARTIAL SAFETY FACTORS FOR ULTIMATE LIMIT STATE

TABLE 3.3.4 : ACTION COMBINATION AND VALUES OF PARTIAL SAFETY FACTORS FOR ULTIMATE LIMIT STATE

Action Combination	Permanent Action		Variable Action		Earth/Water Pressure Load, if applicable
	Favourable	Unfavourable	Imposed Load	Wind Load	
Permanent and Variable (Imposed Load, Wind Load), Earth/Water Pressure Load, if applicable	1.0	1.0	1.0	1.0	1.0

ii. The design strength for a given material is derived from the characteristic strength divided by the partial safety factor for strength of material, which shall be 1.2 for concrete and 1.0 for reinforcements.

CLAUSE 3.4 MEMBER DIMENSIONS AND REINFORCEMENT REQUIREMENTS

3.4.1 Member Dimensions

The minimum member size of SS and NS shall be as stipulated in Chapter 2 - Architectural Design.

3.4.2 Reinforcement Requirements

All diameters of reinforcement specified hereinafter shall refer to minimum fabric mesh or bar diameters. All spacing of reinforcement specified hereinafter shall refer to maximum spacing of reinforcement in both directions.

3.4.2.1 Wall Reinforcements of SS and NS

- a. Minimum Reinforcement in SS or NS walls - refer to TABLE 3.4.2.1.

Figures & Tables		
TABLE 3.4.2.1 : MINIMUM REINFORCEMENTS OF SS OR NS WALLS		
SS/NS Clear Height (Mm)	Reinforcement at both internal and external face of wall (both directions)	Shear Links (Both Directions)
2400 < Ht ≤ 3400	H13 - 100 c/c	H8 - 600 c/c
3400 < Ht ≤ 3900	H16 - 100 c/c	H8 600 c/c

- b. Reinforcements at both faces of the internal common wall shall be H10-100 c/c in both faces. The shear links shall be H8-600 c/c in both directions.

- c. Shielding wall in front of SS door:

Reinforcements at both faces of the wall shall be minimum H10-200 c/c. The shear link with L-bend at two ends shall be H8 at 600 c/c in both directions.

3.4.2.2 Reinforcements of SS and NS slabs

- a. Intermediate SS/NS slabs and slabs/waists of staircase SS/NS:

Top and bottom layer of slab reinforcements shall be H10-100 c/c in both directions. The shear links shall be H8-600 c/c in both directions.

- b. Ceiling slab of top-most SS:

- Reinforcements at both external face and internal face of the slab shall be H13- 100 c/c (both directions)..
- The shear links shall be H8-600 c/c in both directions.

- c. Floor slab of bottom-most SS or NS and floor slab of NS located above a SS:

- Slab reinforcements at both external face and internal face shall be H13-100 c/c (both directions).
- The shear links shall be H8-600 c/c in both directions.

- d. Ceiling slab outside the SS tower which is immediately above SS door:

The minimum ceiling slab shall be constructed of 150mm thick reinforced concrete. The reinforcement shall consist of two layers of reinforcement (top and bottom) at H10-100 c/c in both directions. These top and bottom layers of reinforcement bars shall be continuous or anchored to the slab of SS with tension anchorage length.

- e. Floor slab outside SS tower:

The reinforcements of every floor slab immediately outside SS tower walls shall be structurally connected to the SS tower.

- f. SS slab which is integrated with pile-cap/footing:

For SS slab integrated with the pile-cap or footing of 500mm thick or more, shear links is not required. The maximum spacing of main reinforcement shall be 200mm c/c.

CLAUSE 3.5 DETAILING OF SS TOWER

3.5.1 General

The SS tower is to be detailed to allow for the installation of services and fixtures in SS and to resist spalling of the internal face of SS walls, soffit of ceiling slabs and/or finishes on SS floor slab.

3.5.2 Lap and Anchorage Length

- a. Full lap and anchorage length of reinforcements in SS and NS walls and slabs shall be provided. The lap length shall take into account good or poor bond condition, steel bar diameter, shape of steel bar, concrete cover, steel strength and location where reinforcement bar laps and confinement of transverse bars.
- b. Minimum tension lap and anchorage length of reinforcement bars for minimum concrete grade C32/40 with good bond condition shall be as shown in TABLE 3.5.2. Longer tension lap and anchorage length shall be provided if they are required to meet poor bond condition and/or the structural load and safety requirements.

Figures & Tables		
TABLE 3.5.2 : MINIMUM TENSION LAP AND ANCHORAGE LENGTH		
TABLE 3.5.2 : MINIMUM TENSION LAP AND ANCHORAGE LENGTH		
Type	Reinforcement Bar Diameter Ø (mm)	
	10 ≤ Ø ≤ 16	16 ≤ Ø ≤ 32
Lap Length	47Ø	52Ø
Anchorage Length	37Ø	37Ø

- c. Welding of reinforcement to attain full anchorage length and tension lap length is not permitted.
- d. Bundled bars are not permitted.

3.5.3 Concrete Cover

The minimum and maximum concrete cover to the main reinforcements shall be 25mm and 40mm respectively.

3.5.4 Cast-In-Situ Elements for SS and S/C SS

Cast-In-Situ for SS elements shall comply with the dimensions and detailed requirements as shown in the following figures:

3.5.4 Cast-In-Situ Elements for SS and S/C SS	
FIGURE 3.5.4(a)	Plan of SS wall
FIGURE 3.5.4(b)	Sectional details of SS slabs/walls
FIGURE 3.5.4(c)	Sectional details of SS slabs/walls
FIGURE 3.5.4(d)(i)	Details of SS wall reinforcement bars near SS door
FIGURE 3.5.4(d)(ii)	Details of S/C SS wall reinforcement bars near S/C SS door
FIGURE 3.5.4(e)	Typical details of embedded conduit in SS wall
FIGURE 3.5.4(f)	Typical details of trimmer bars for ventilation sleeve
FIGURE 3.5.4(g)	Typical details of reinforcement bars at wall recess
FIGURE 3.5.4(h)	Details of shear links in SS slabs/walls
FIGURE 3.5.4(i)	Details of SS slab reinforcement near rescue hatch
FIGURE 3.5.4(j)	Reinforcement plan details for S/C SS
FIGURE 3.5.4(k)	Sectional details of SS slabs/walls for S/C SS
FIGURE 3.5.4(l)	Sectional details of SS slabs/walls for S/C SS
FIGURE 3.5.4(m)	Sectional details of SS slabs/walls for S/C SS

Figures & Tables	
FIGURE 3.5.4(a): PLAN OF SS WALL	

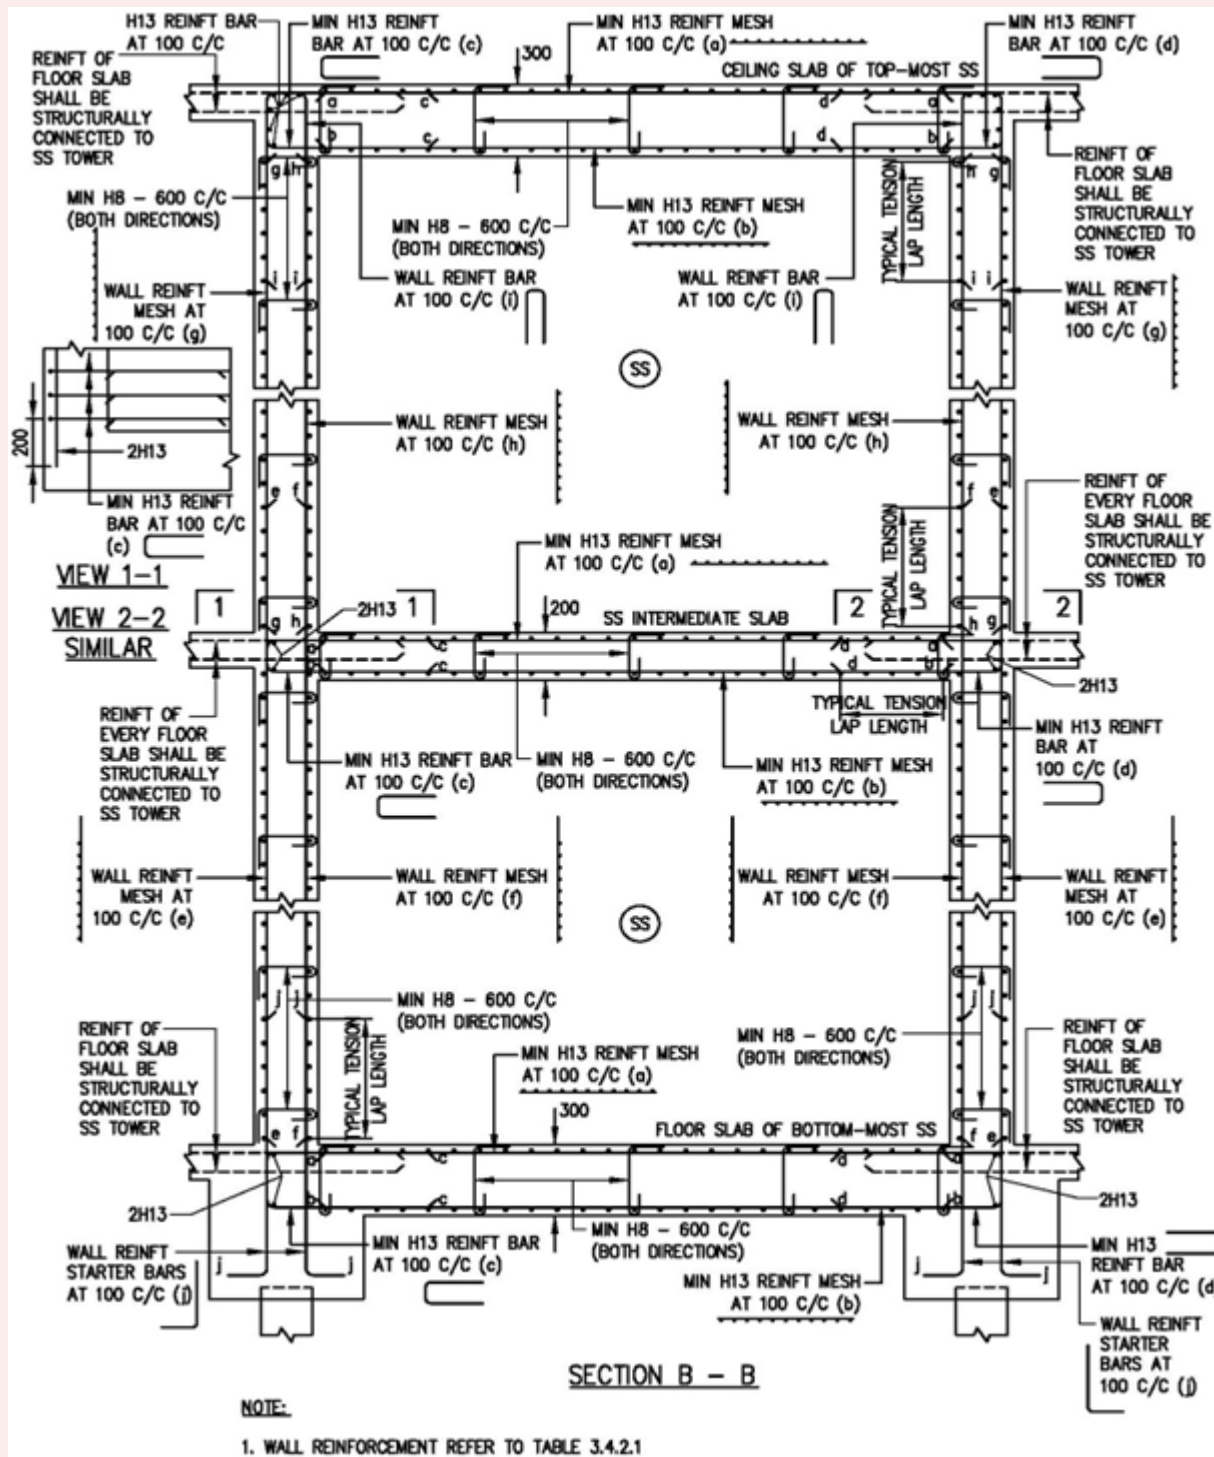


FIGURE 3.5.4(d)(i): DETAILS OF SS WALL REINFORCEMENT BARS NEAR SS DOOR

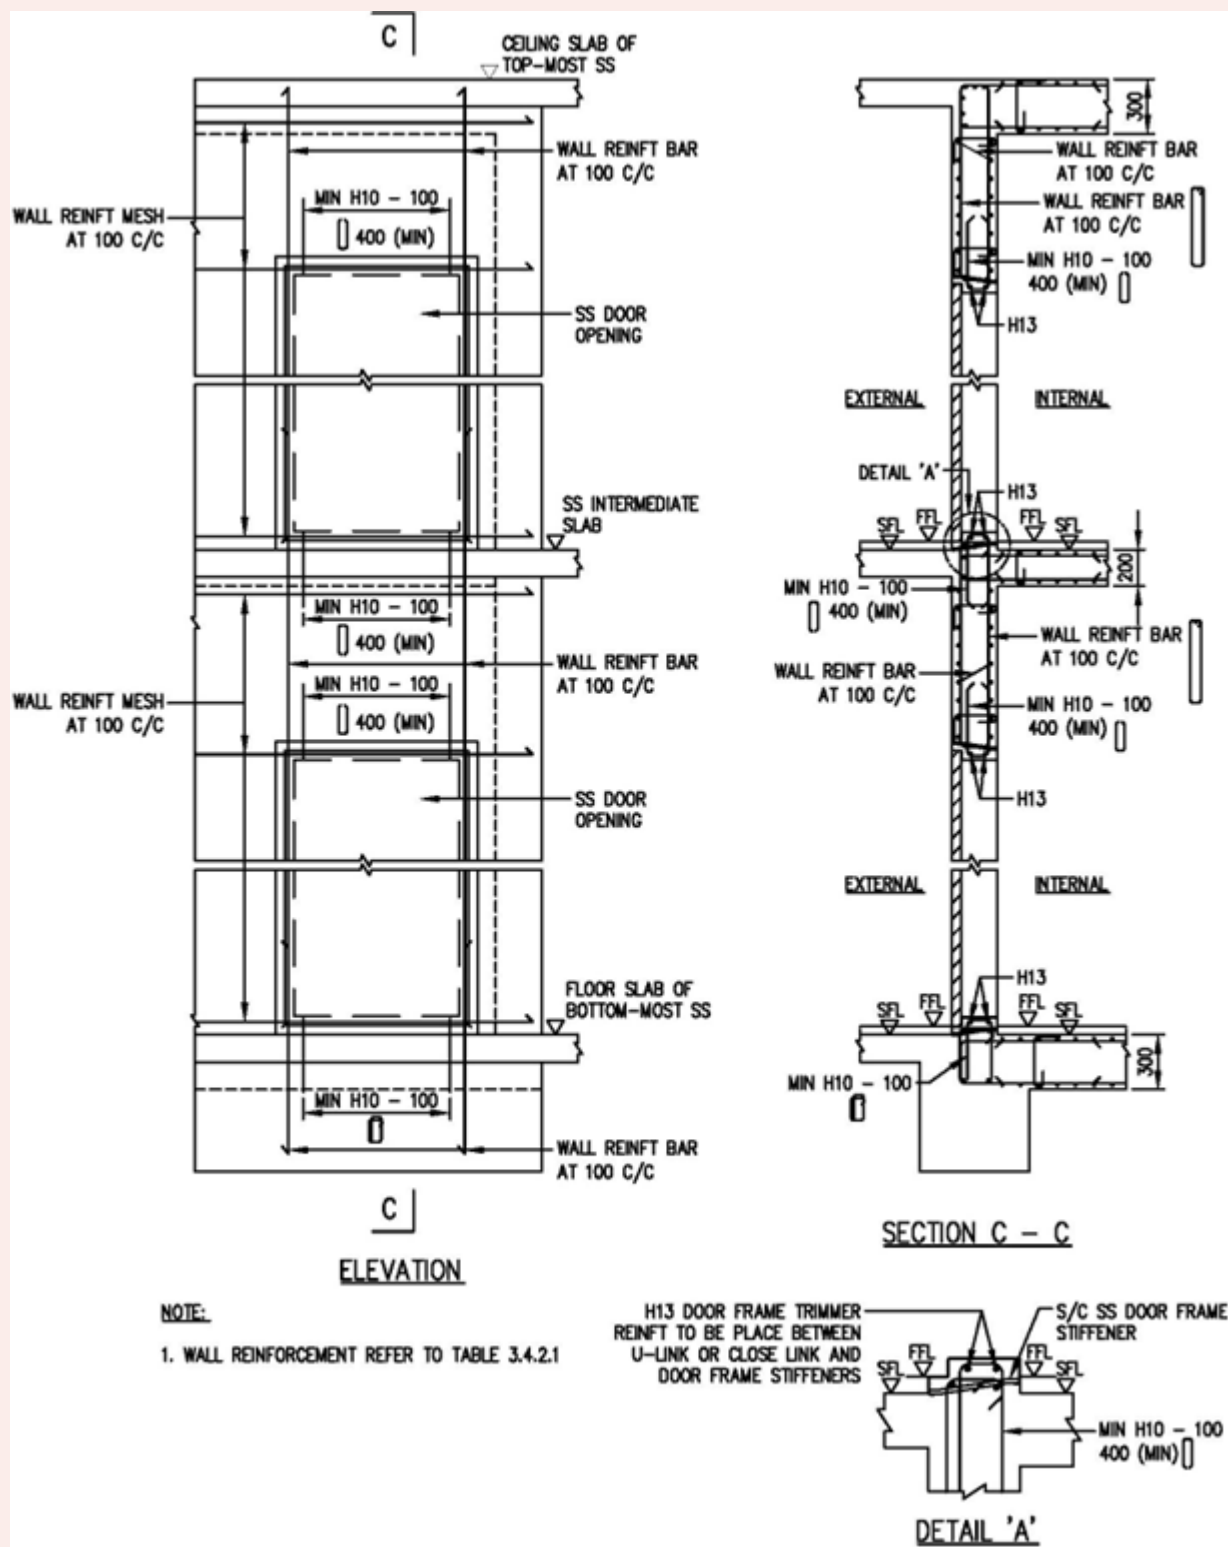


FIGURE 3.5.4(d)(ii): DETAILS OF SS WALL REINFORCEMENT BARS NEAR SS DOOR

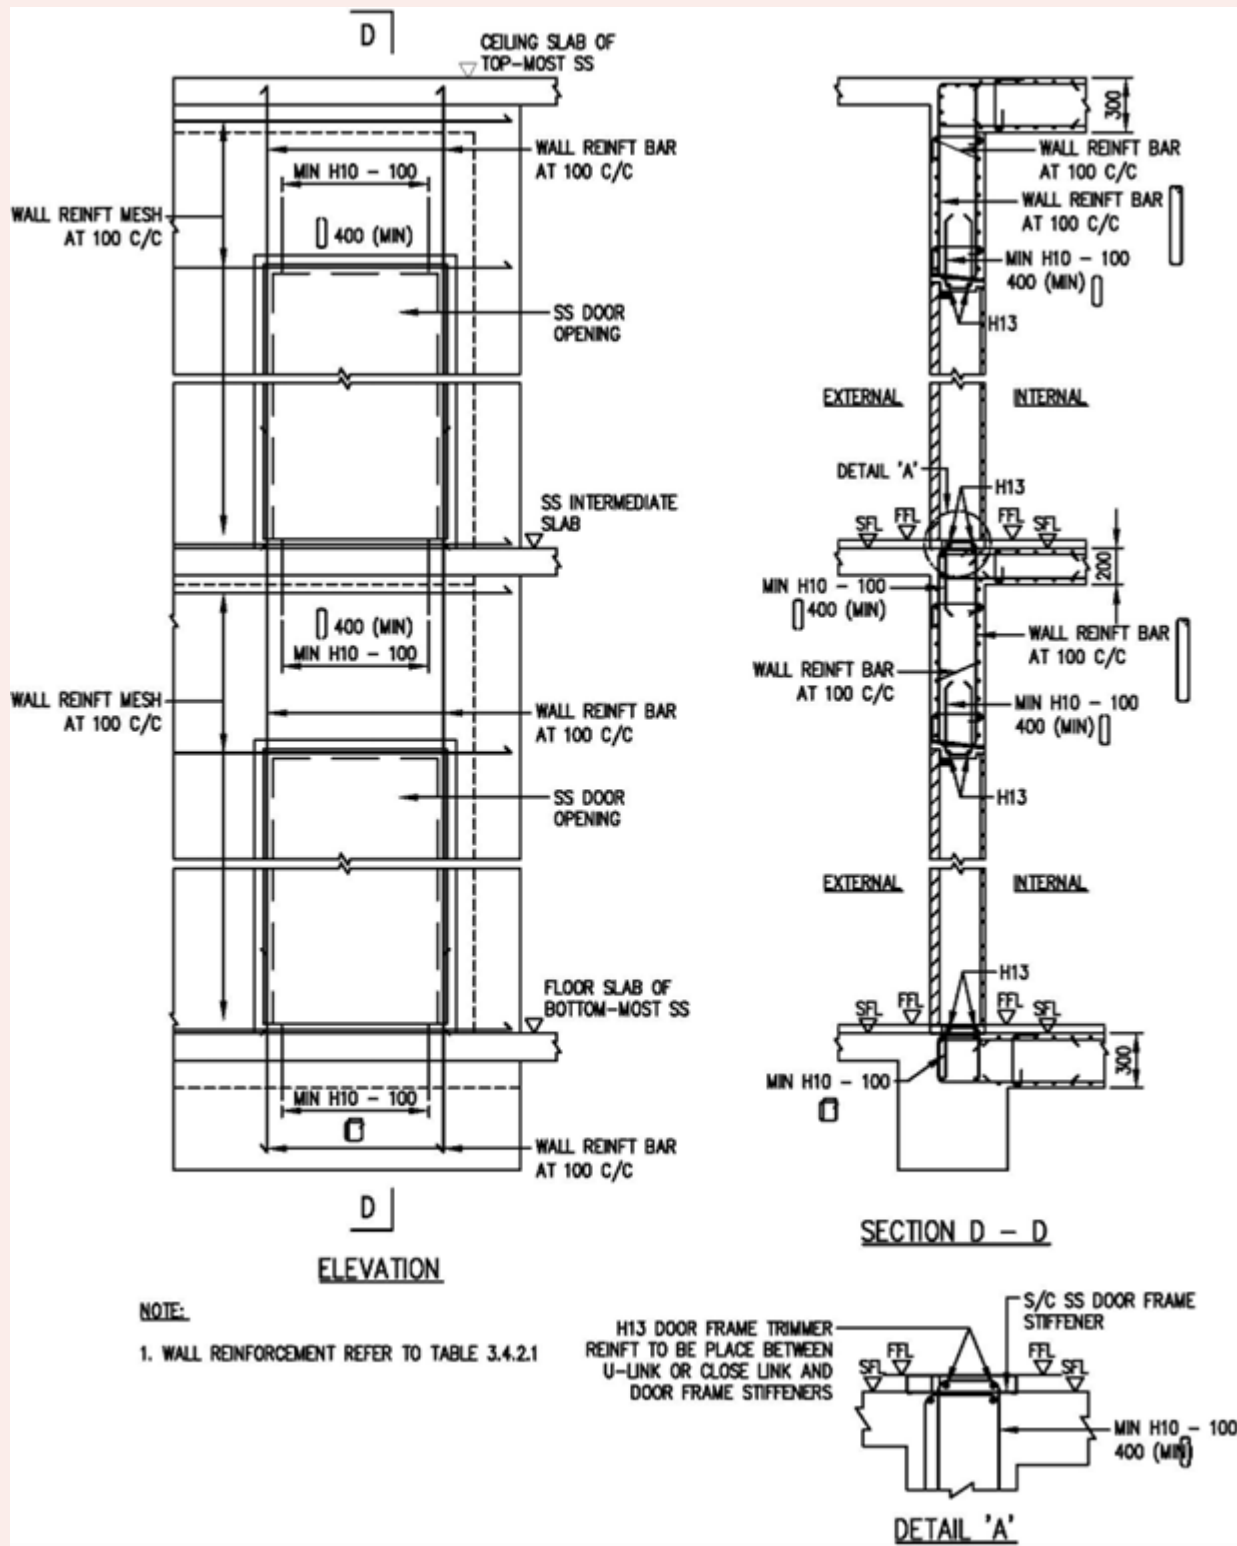


FIGURE 3.5.4(e): TYPICAL DETAILS OF EMBEDDED CONDUIT IN SS WALL

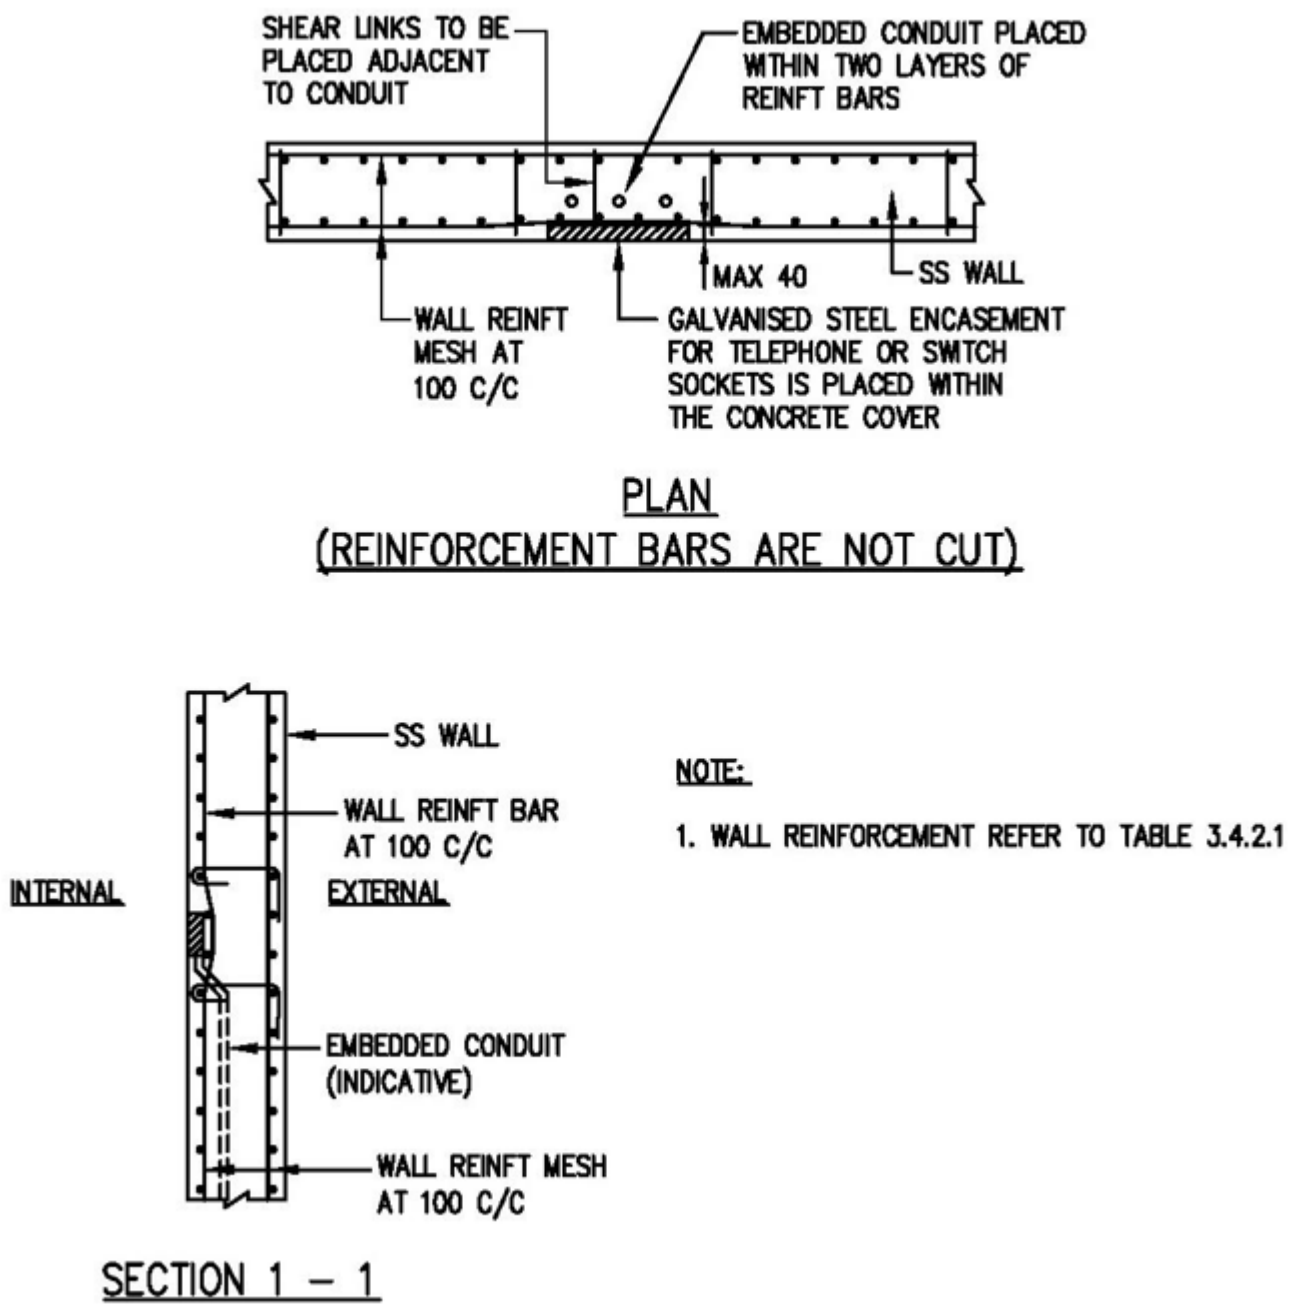


FIGURE 3.5.4(f): TYPICAL DETAILS OF TRIMMER BARS FOR VENTILATION SLEEVE

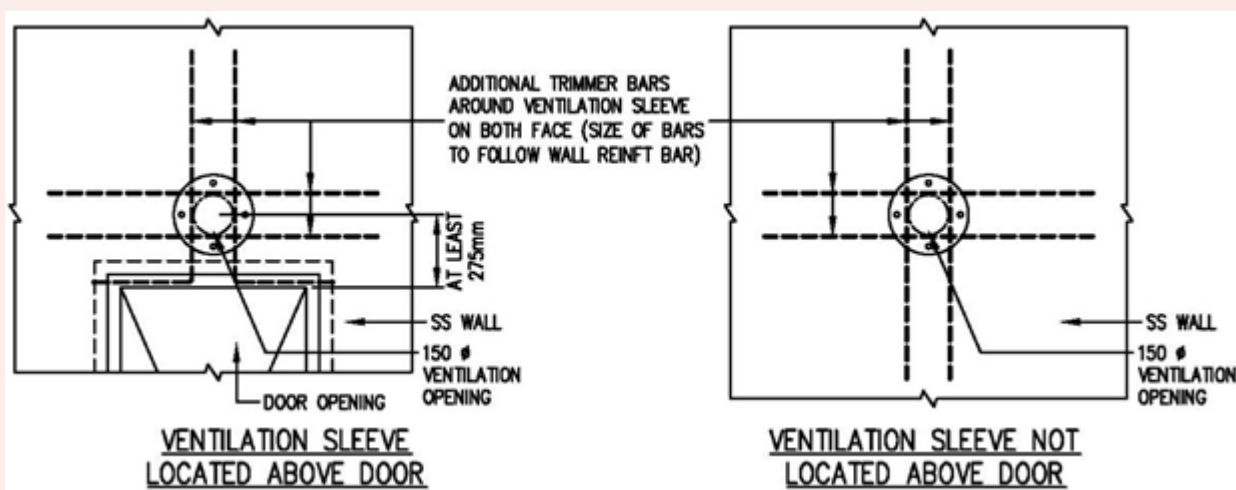


FIGURE 3.5.4(g): TYPICAL DETAILS OF REINFORCEMENT BARS AT WALL RECESS

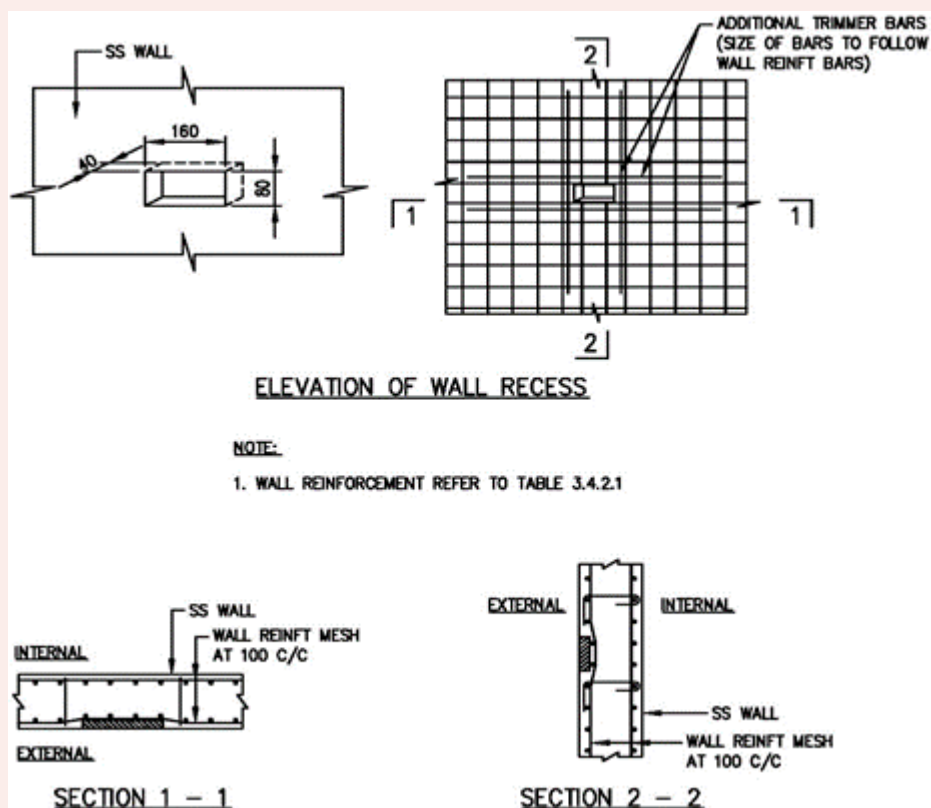


FIGURE 3.5.4(h): DETAILS OF SHEAR LINKS IN SS SLABS/ WALLS

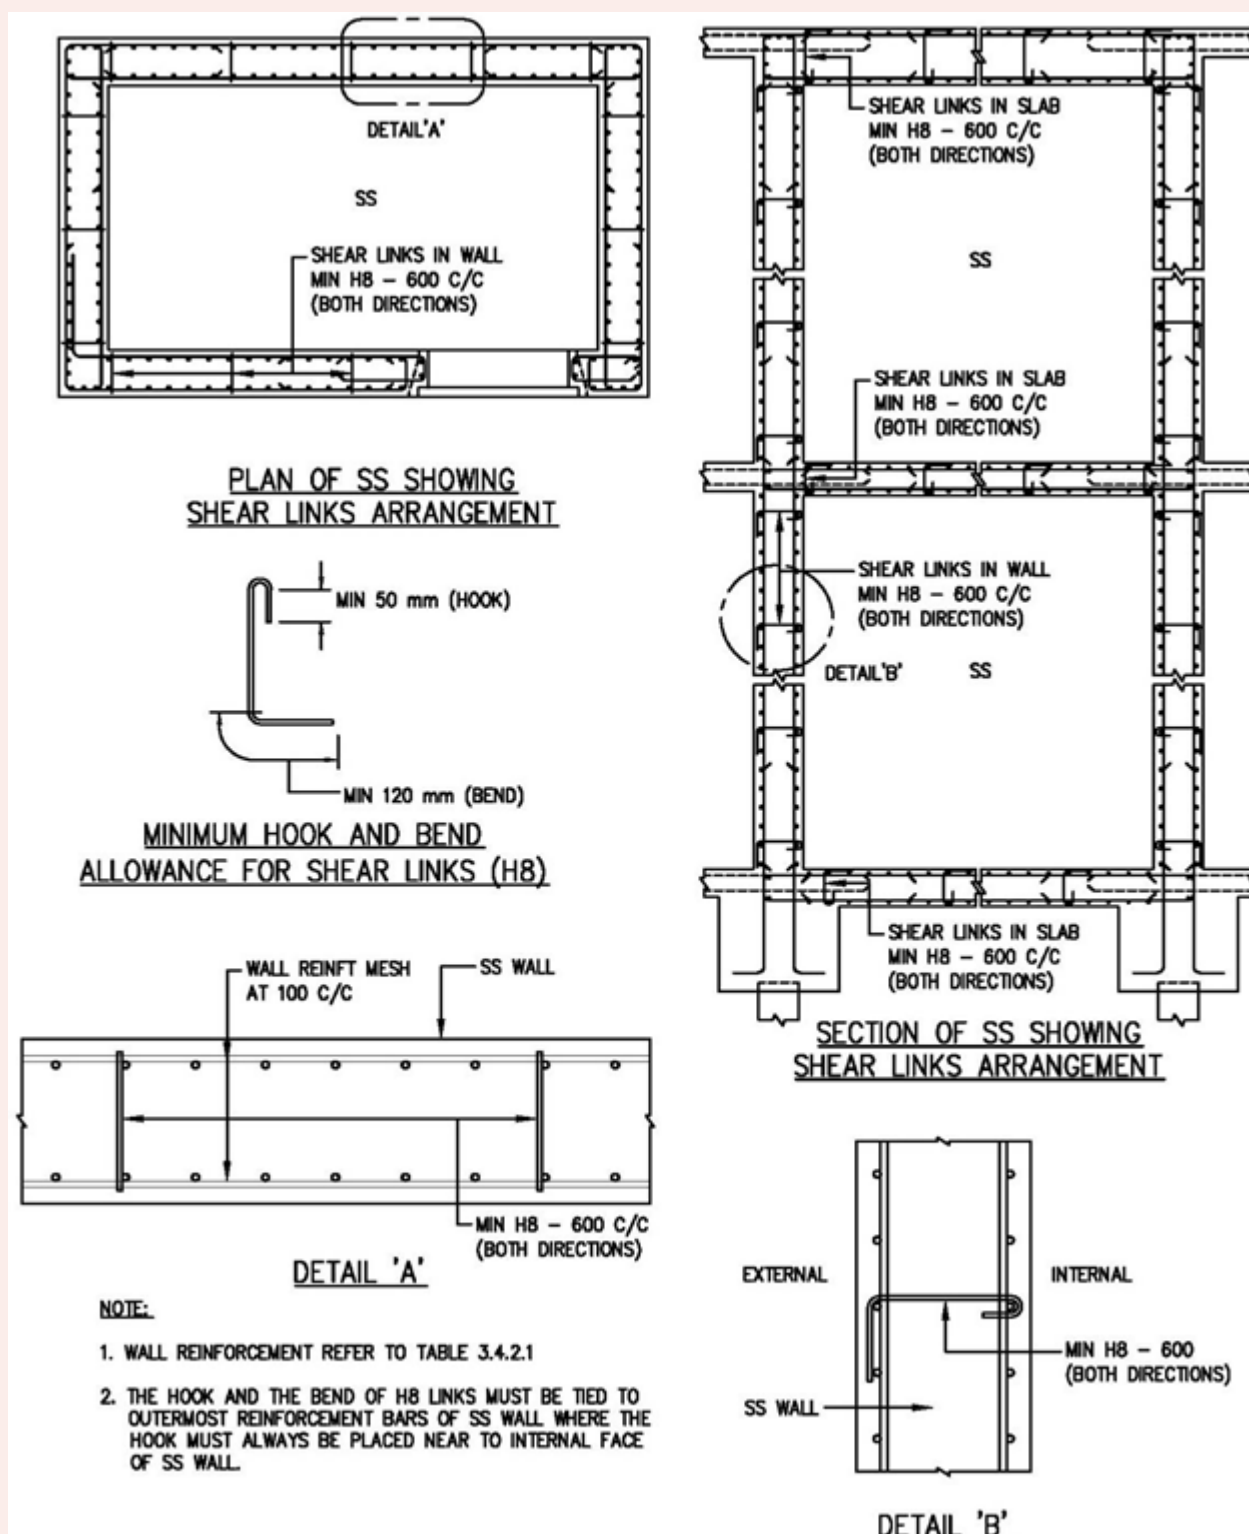


FIGURE 3.5.4(i): DETAILS OF SS SLAB REINFORCEMENT NEAR RESCUE HATCH

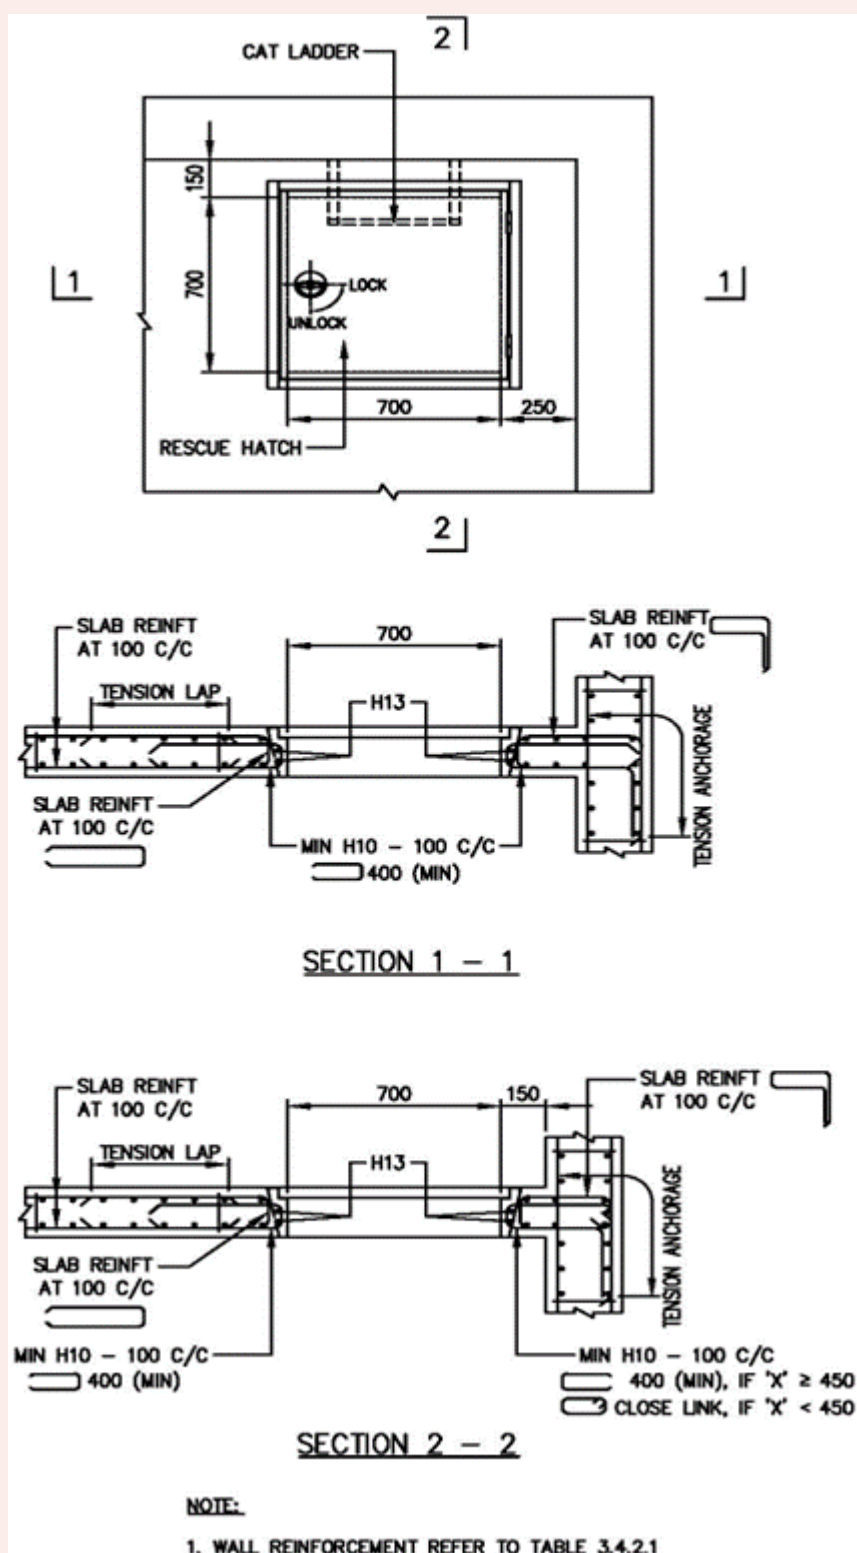


FIGURE 3.5.4(j): REINFORCEMENT PLAN DETAILS FOR S/C SS


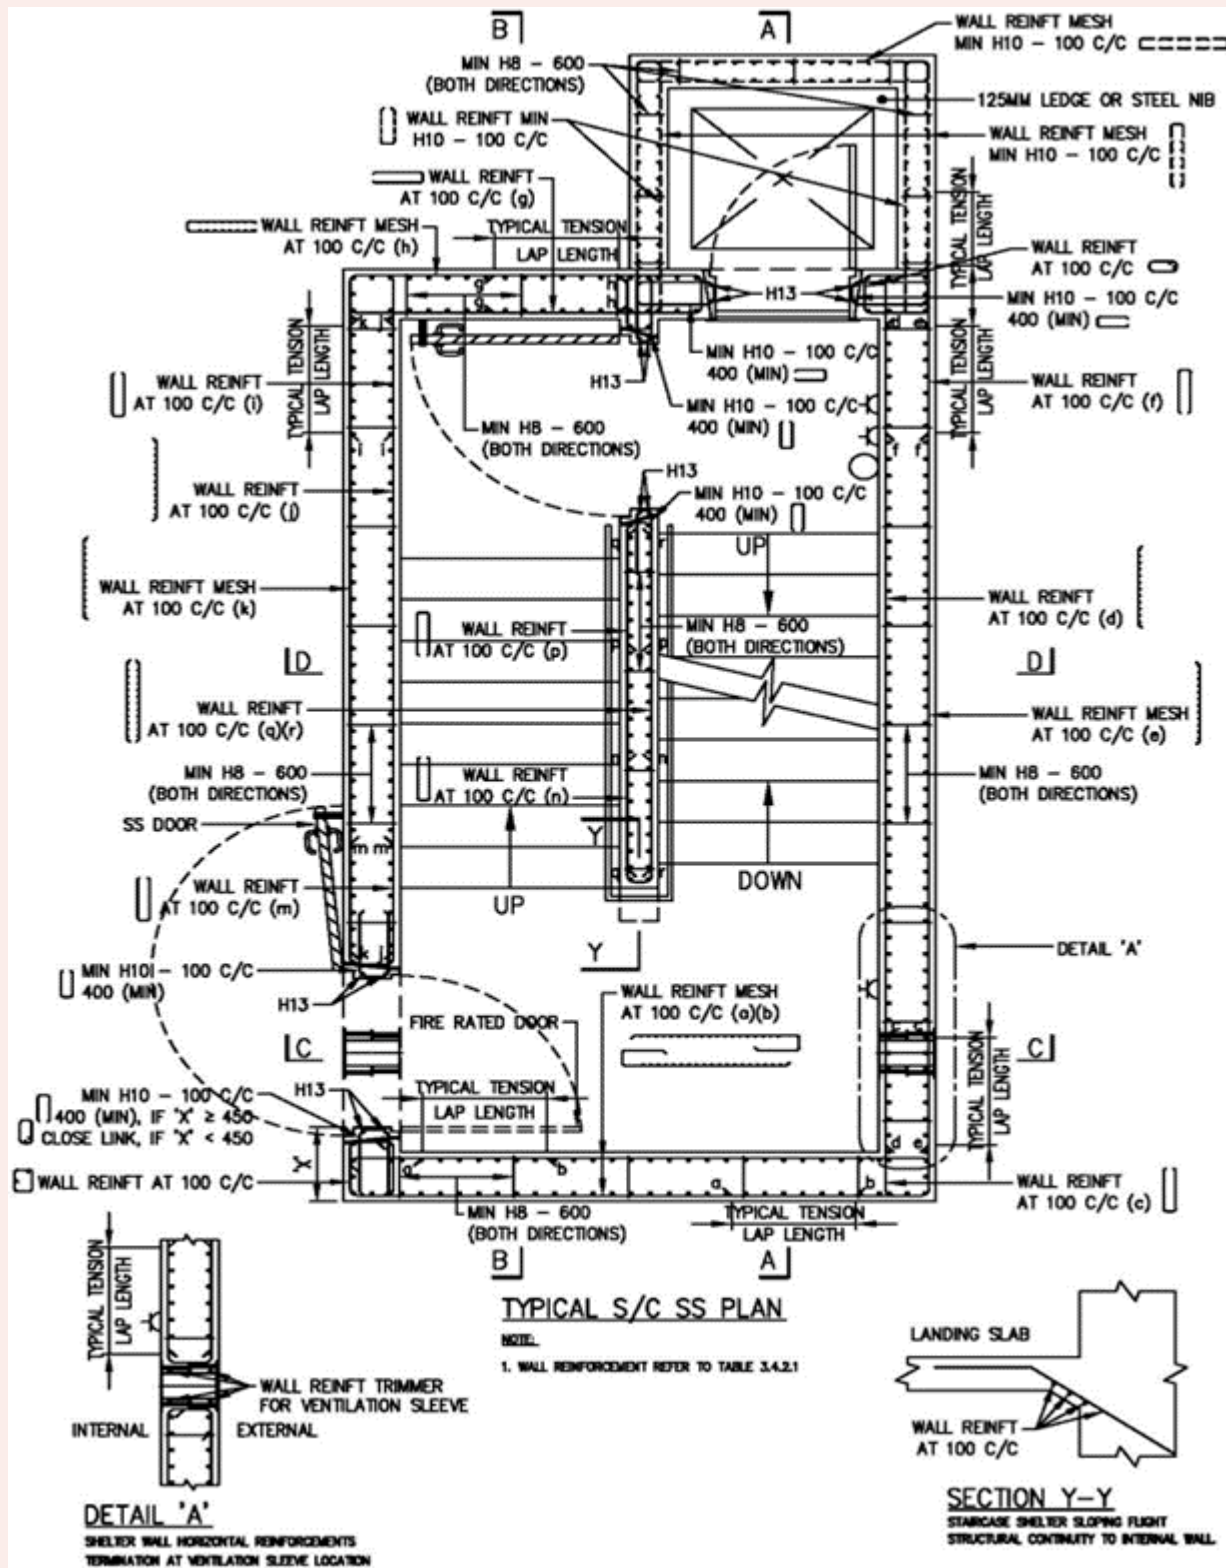


FIGURE 3.5.4(k): SECTIONAL DETAILS OF SS SLABS/ WALLS FOR S/C SS

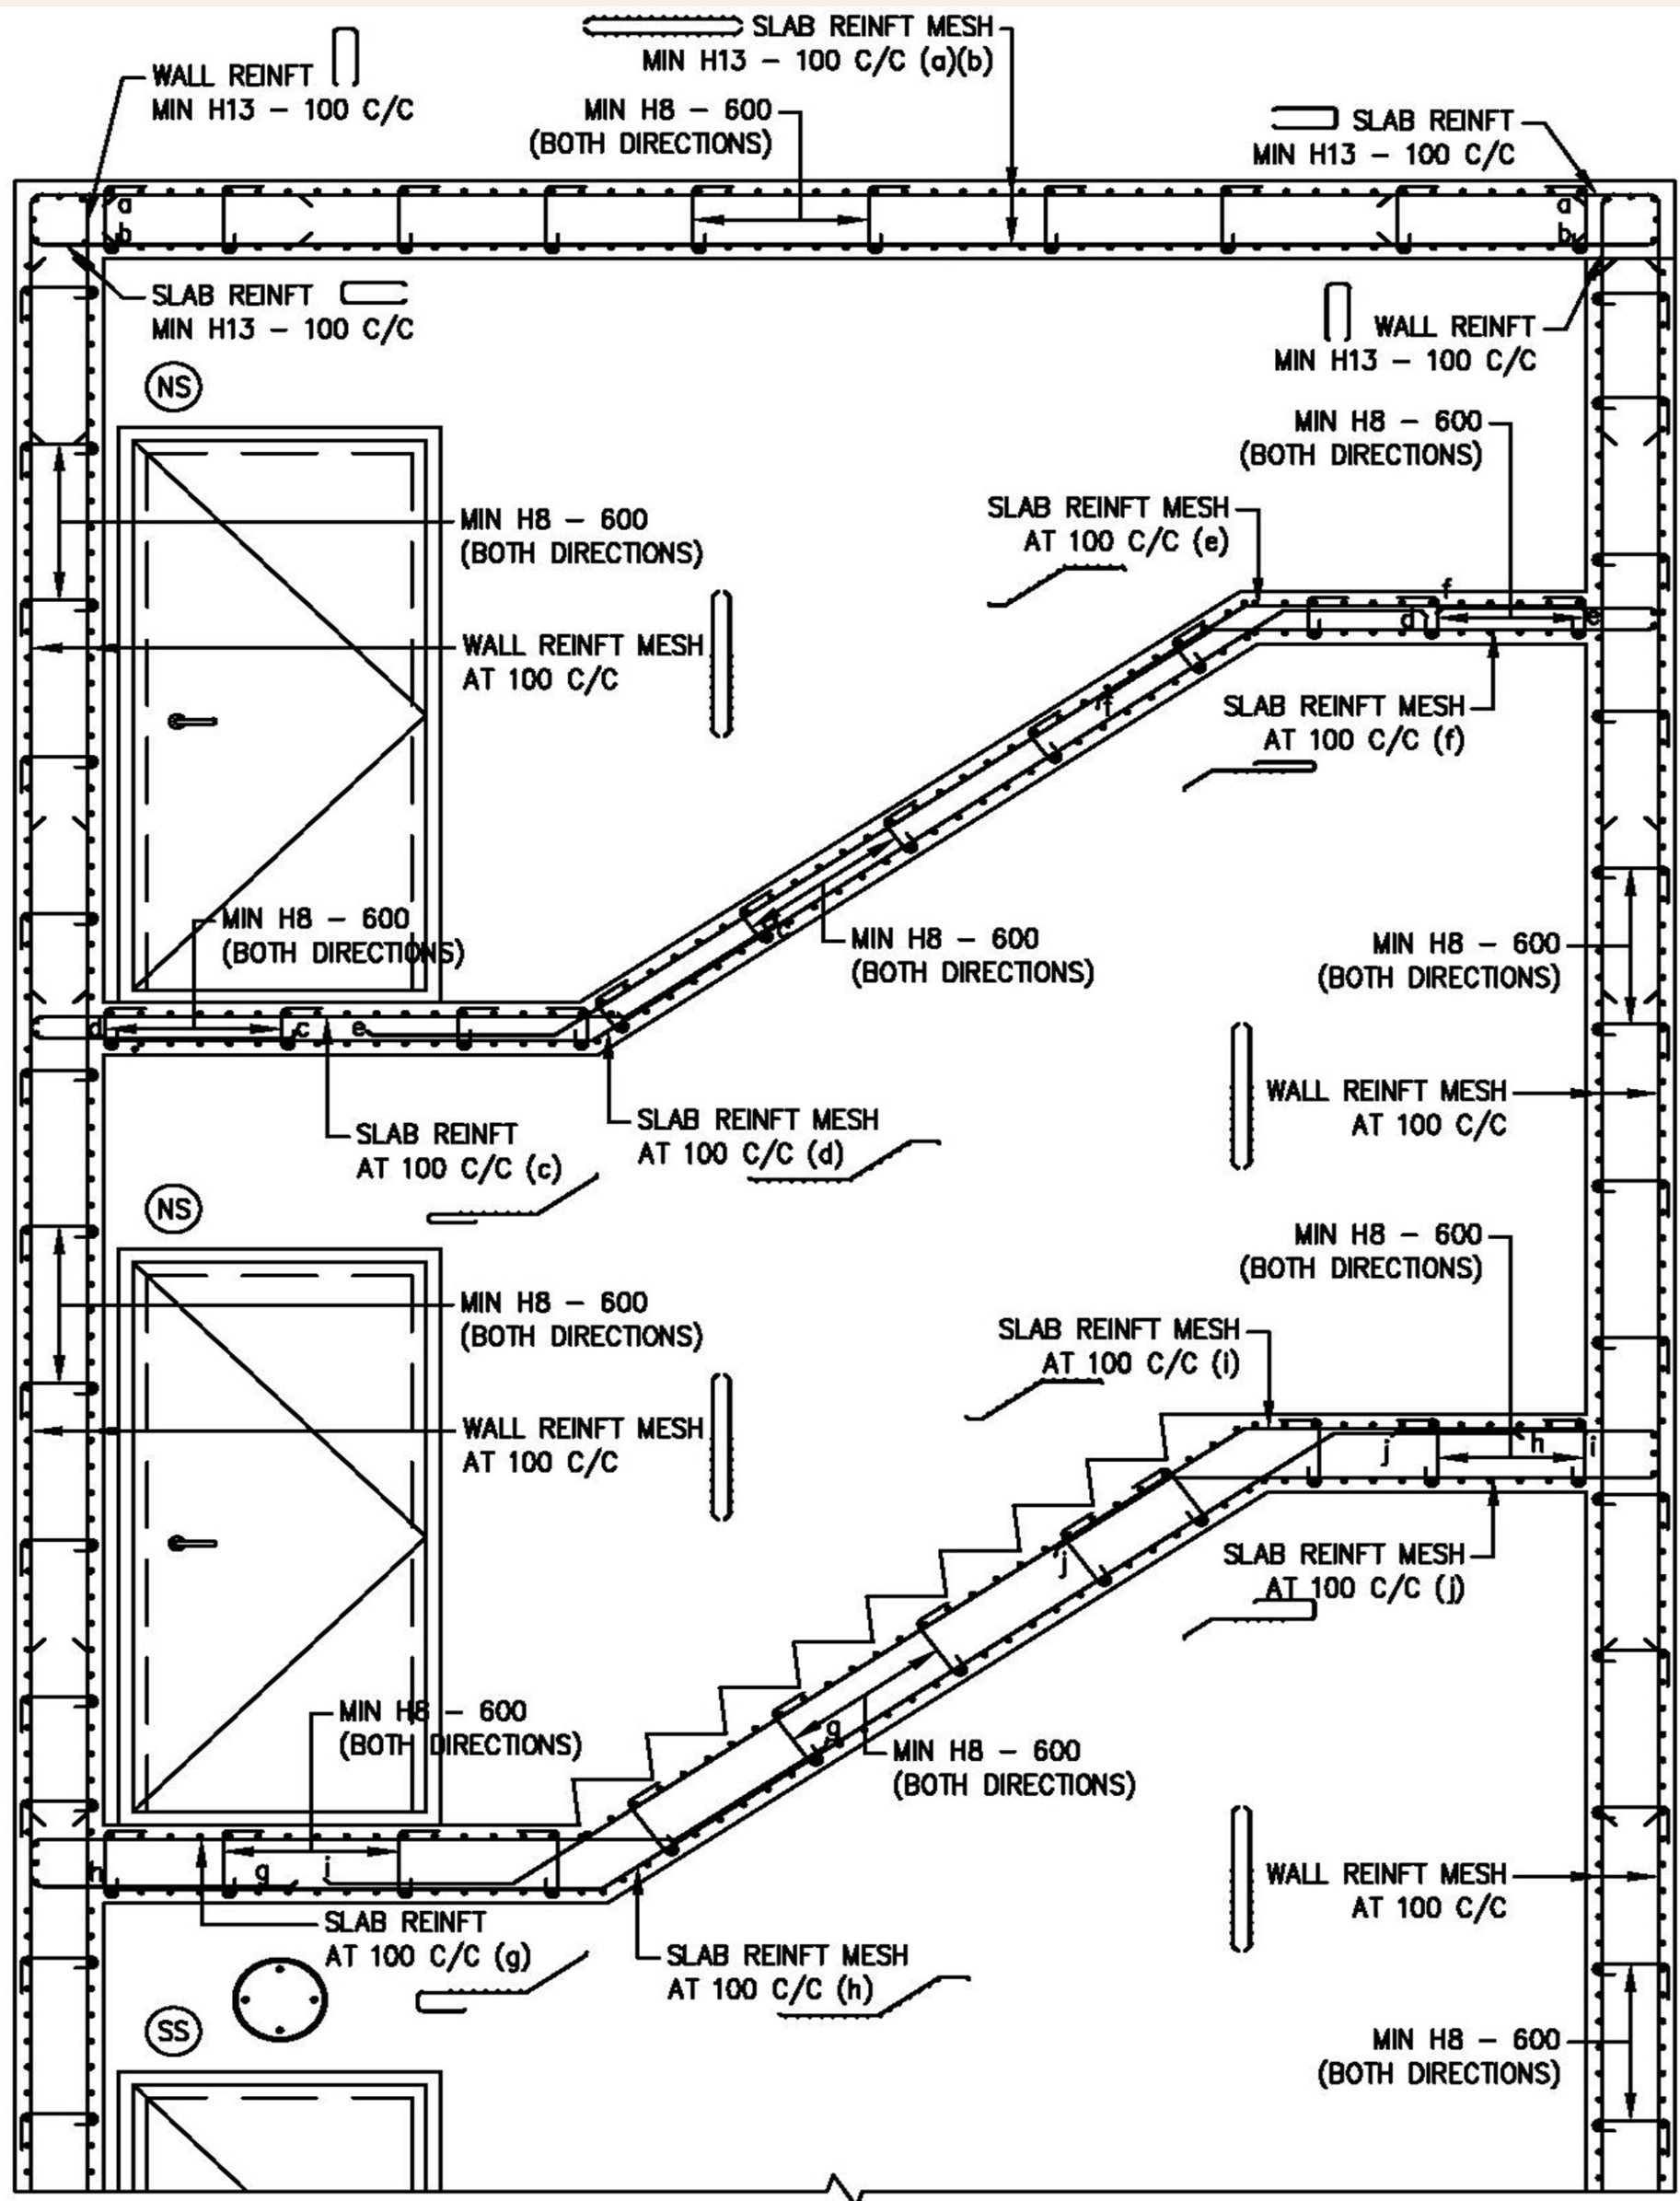


NOTE:

1. WALL REINFORCEMENT REFER TO TABLE 3.4.2.1

SECTION B - B

FIGURE 3.5.4(m): SECTIONAL DETAILS OF SS SLABS/ WALLS FOR S/C SS

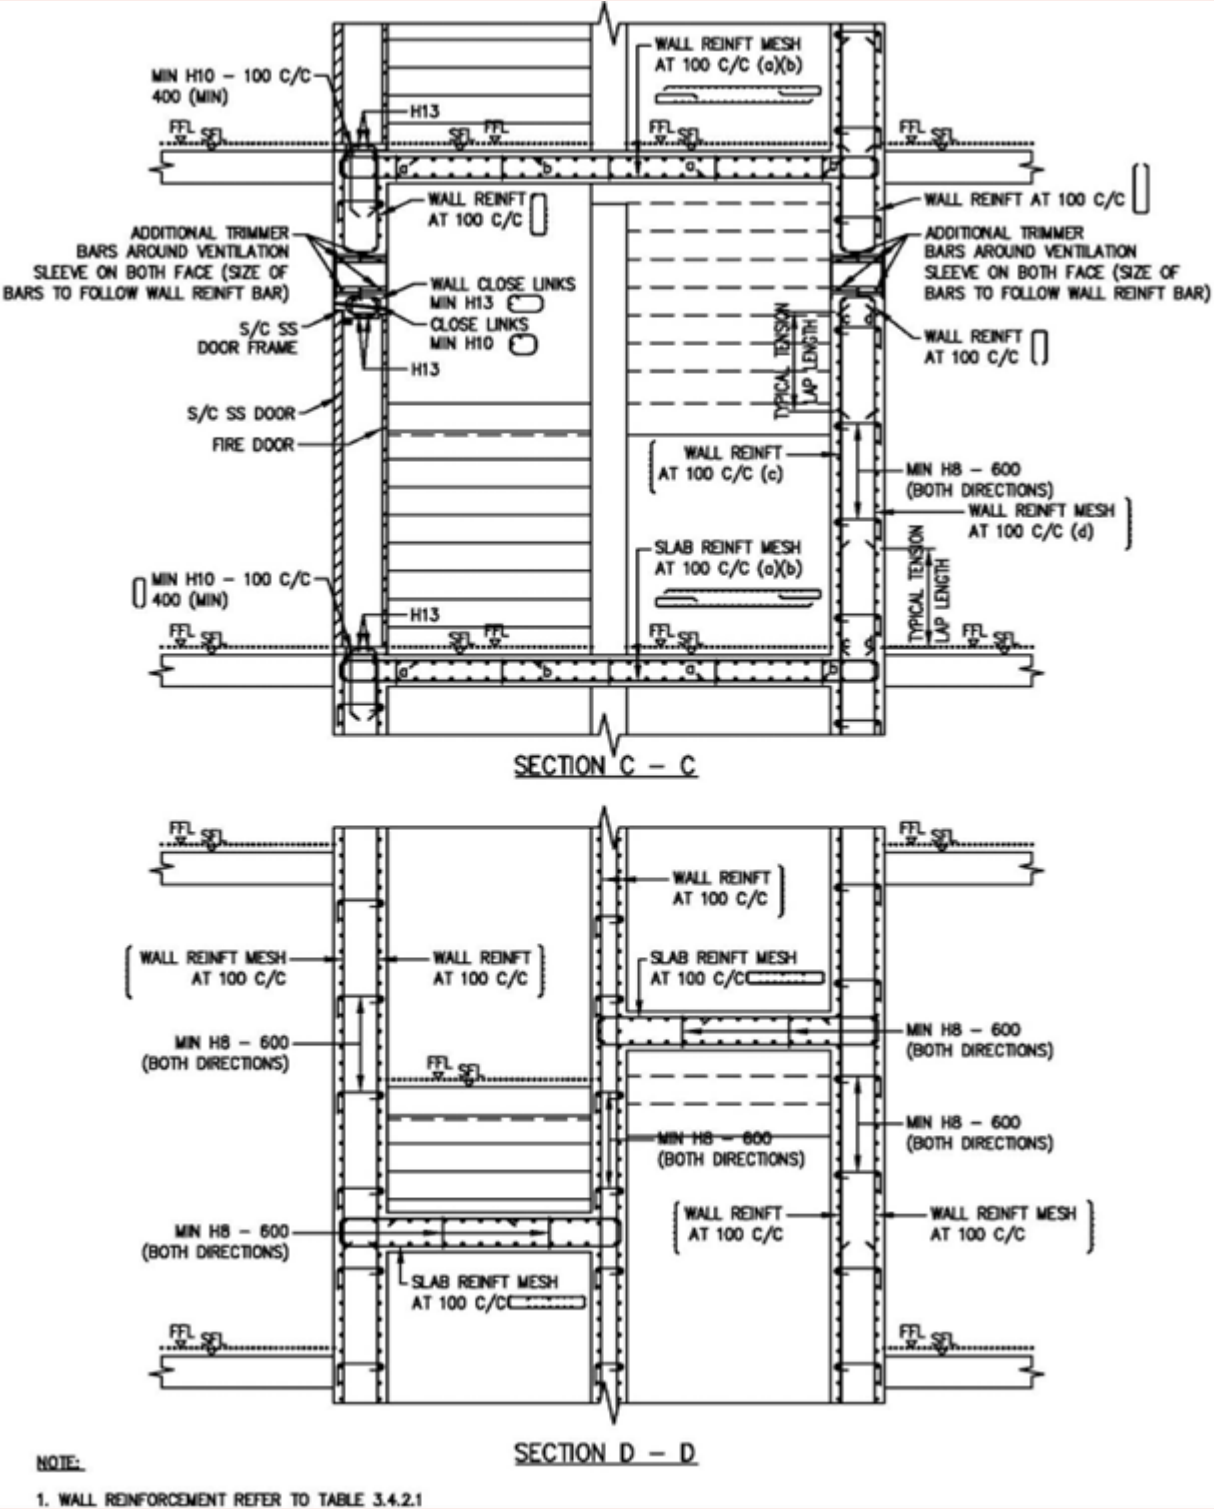


3.5.5 Precast Elements for SS and S/C SS

Pre-cast SS elements shall comply with the dimensions and detailed requirements as shown in the following figure:

3.5.5 Precast Elements for SS and S/C SS	
FIGURE 3.5.5(a)	Plan of SS walls with precast SS door frame panel (Type 1)
FIGURE 3.5.5(b)	Details and sections of precast SS door frame panel with ventilation sleeve above it (Type 1)
FIGURE 3.5.5(c)	Sections of precast SS door frame panel with ventilation sleeve above it (Type 1)
FIGURE 3.5.5(d)	Details and sections of precast SS door frame panel with ventilation sleeve along its side (Type 1)
FIGURE 3.5.5(e)	Details and sections of precast SS door frame panel with ventilation sleeve along its side (Type 1)
FIGURE 3.5.5(f)	Plan of SS walls with precast SS door frame panel ((Type 2)
FIGURE 3.5.5(g)	Details and sections of precast SS door frame panel with ventilation sleeve above it (Type 2)
FIGURE 3.5.5(h)	Sections of precast SS door frame panel with ventilation sleeve above it (Type 2)
FIGURE 3.5.5(i)	Details and sections of precast SS door frame panel with ventilation sleeve along its side (Type 2)
FIGURE 3.5.5(j)	Sections of precast SS door frame panel with ventilation sleeve along its side (Type 2)
FIGURE 3.5.5(k)	Plan of SS walls with precast SS door frame panel (Type 3)
FIGURE 3.5.5(l)	Details of precast SS door frame panel (Type 3)
FIGURE 3.5.5(m)	Sections of precast SS door frame panel (Type 3)
FIGURE 3.5.5(n)	Sections of precast SS door frame panel (Type 3)
FIGURE 3.5.5(o)(i)	Typical details and sections of reinforcement at ventilation sleeve location
FIGURE 3.5.5(o)(ii)	Typical details and sections of reinforcement at ventilation sleeve location
FIGURE 3.5.5(p)	Plans and details of SS slabs for S/C SS precast flight

Figures & Tables

FIGURE 3.5.5(a): PLAN OF SS WALLS WITH PRECAST SS DOOR FRAME PANEL (TYPE 1)

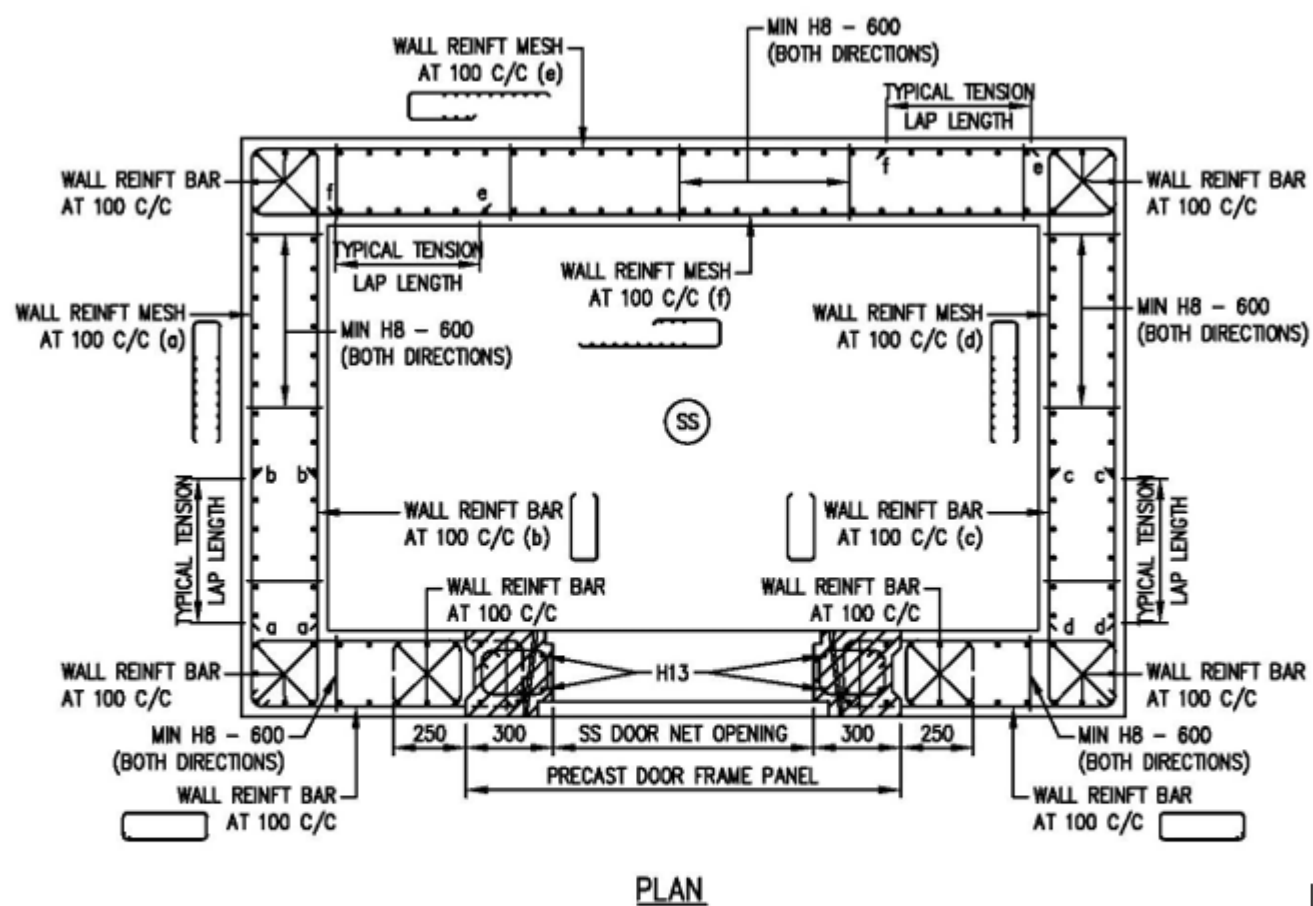

NOTE:

1. WALL REINFORCEMENT REFER TO TABLE 3.4.2.1
2. WALL REINFORCEMENTS AT VENTILATION SLEEVE LOCATION REFER TO FIGURE 3.5.5(o)(i) & (ii)

FIGURE 3.5.5(b): DETAILS AND SECTIONS OF PRECAST SS DOOR FRAME PANEL WITH VENTILATION SLEEVE ABOVE IT (TYPE 1)



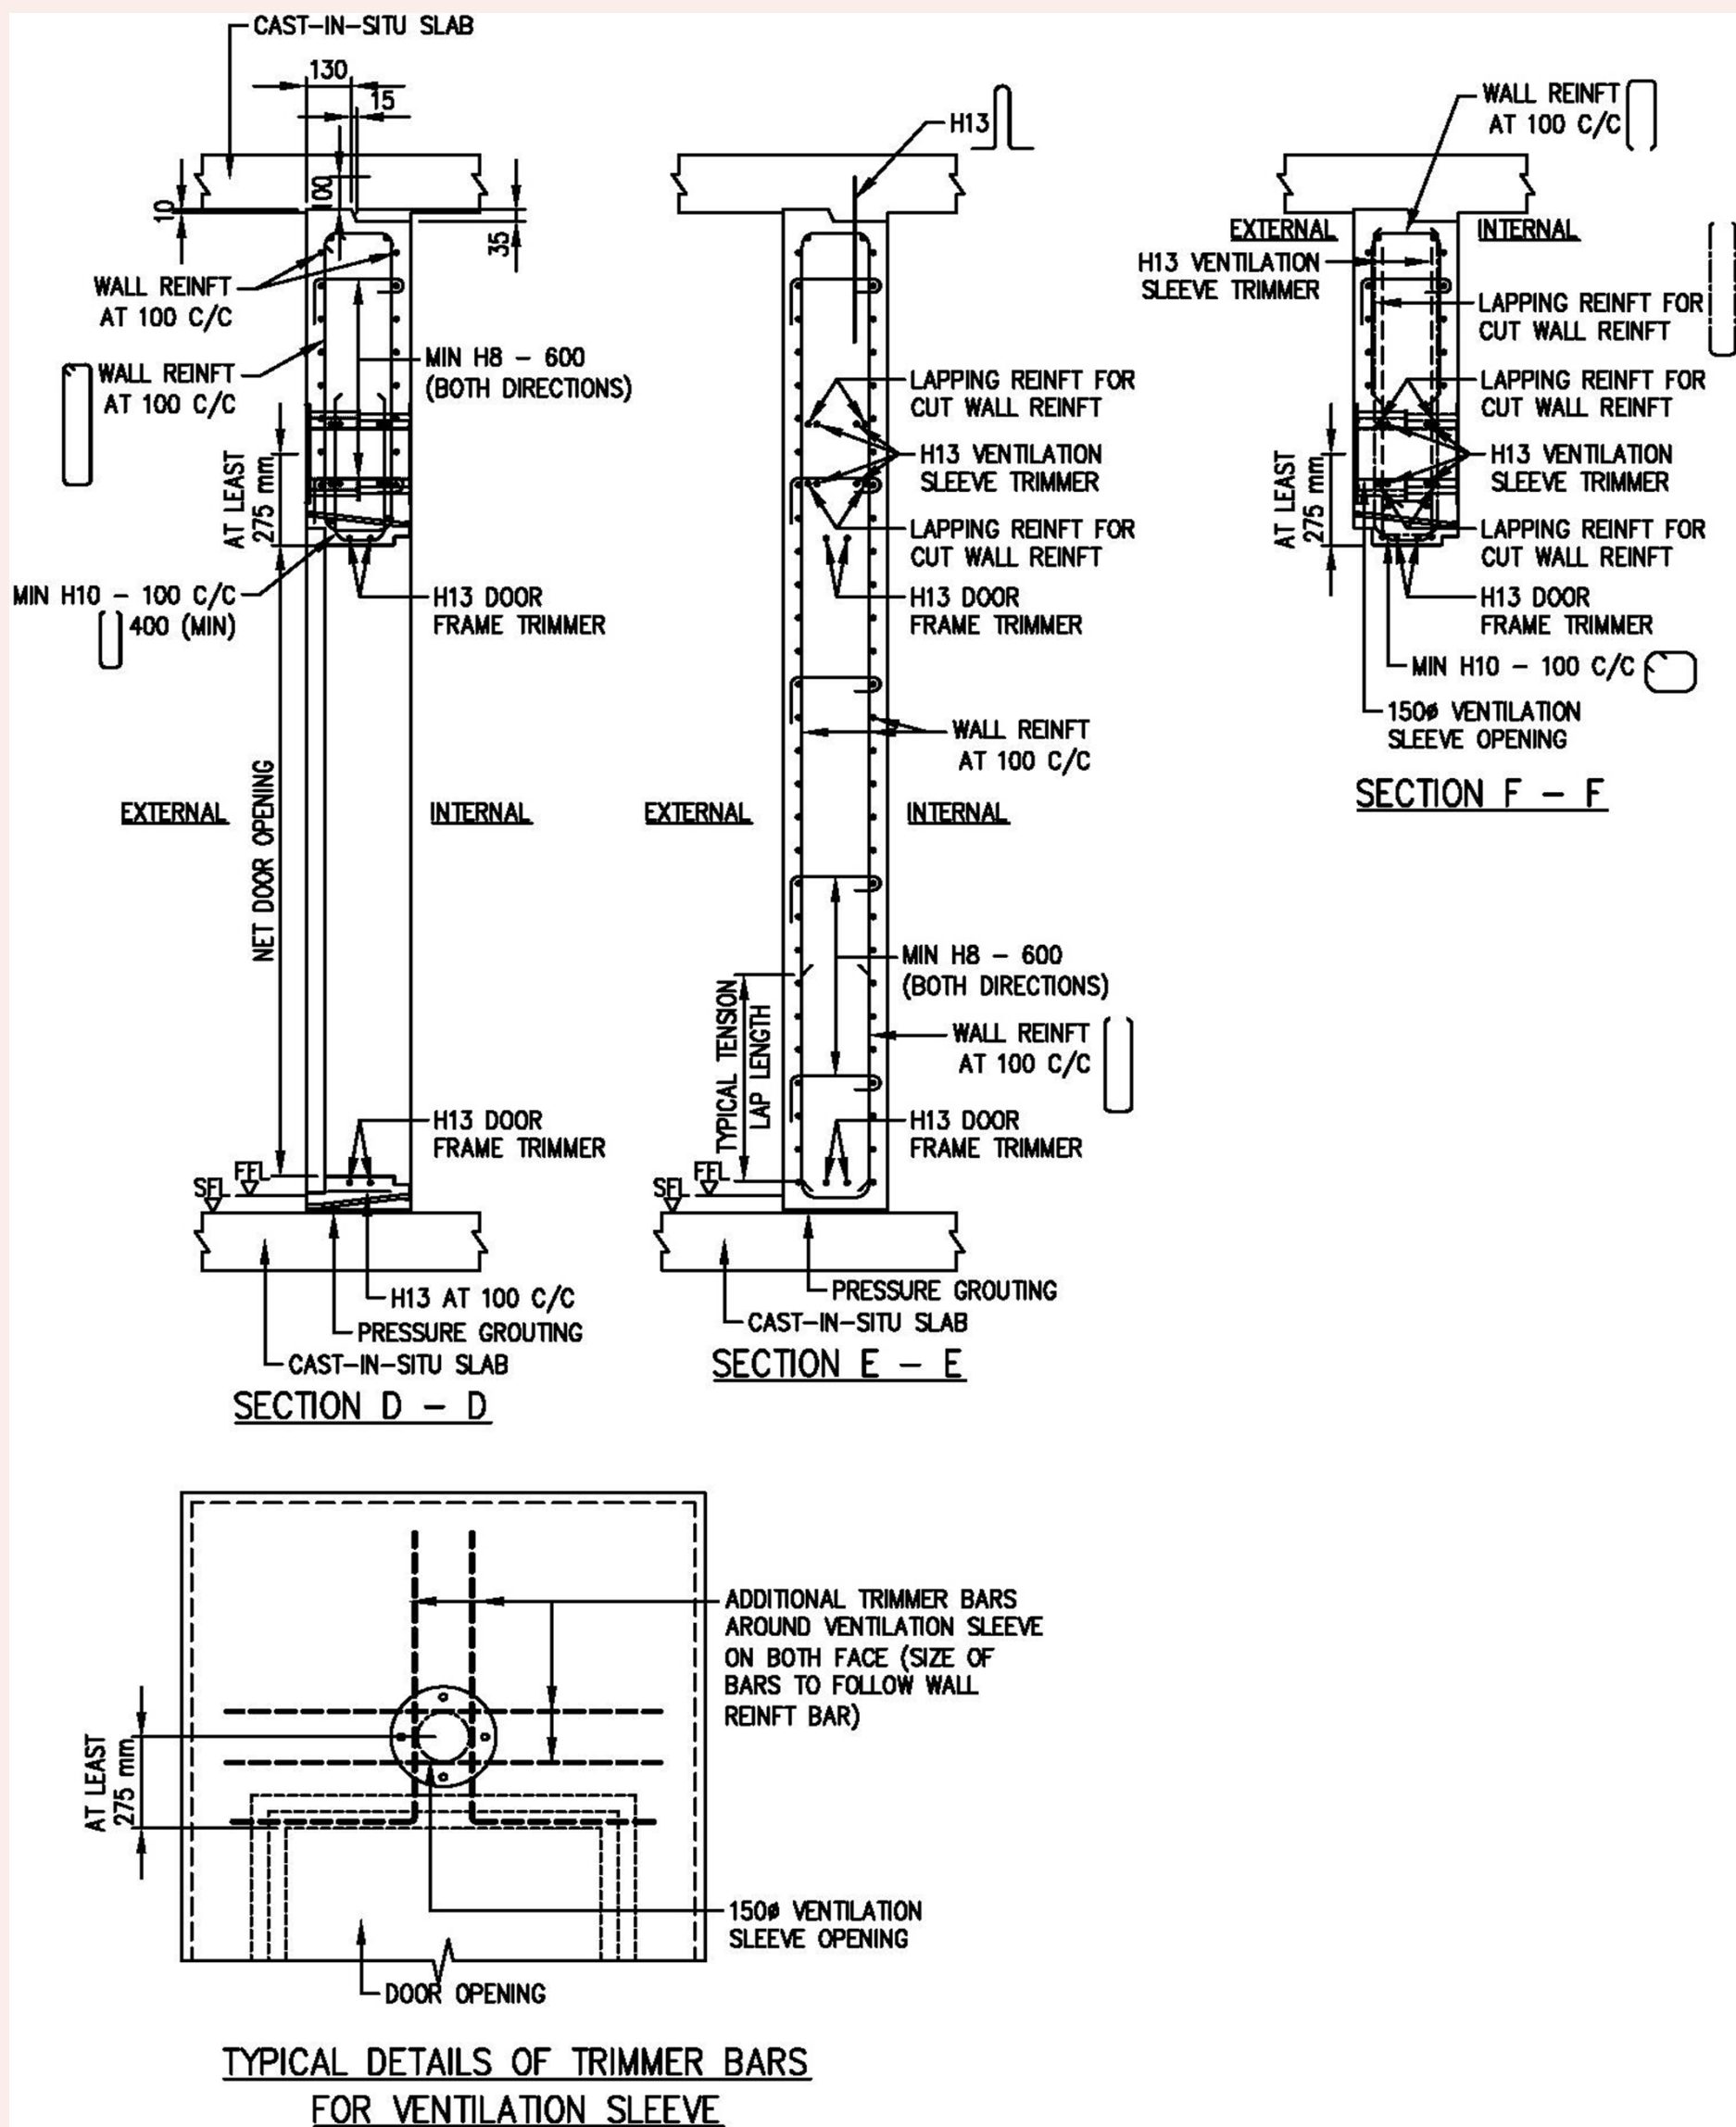


FIGURE 3.5.5(d): DETAILS AND SECTIONS OF PRECAST SS DOOR FRAME WITH VENTILATION SLEEVE ALONG ITS SIDE (TYPE 1)


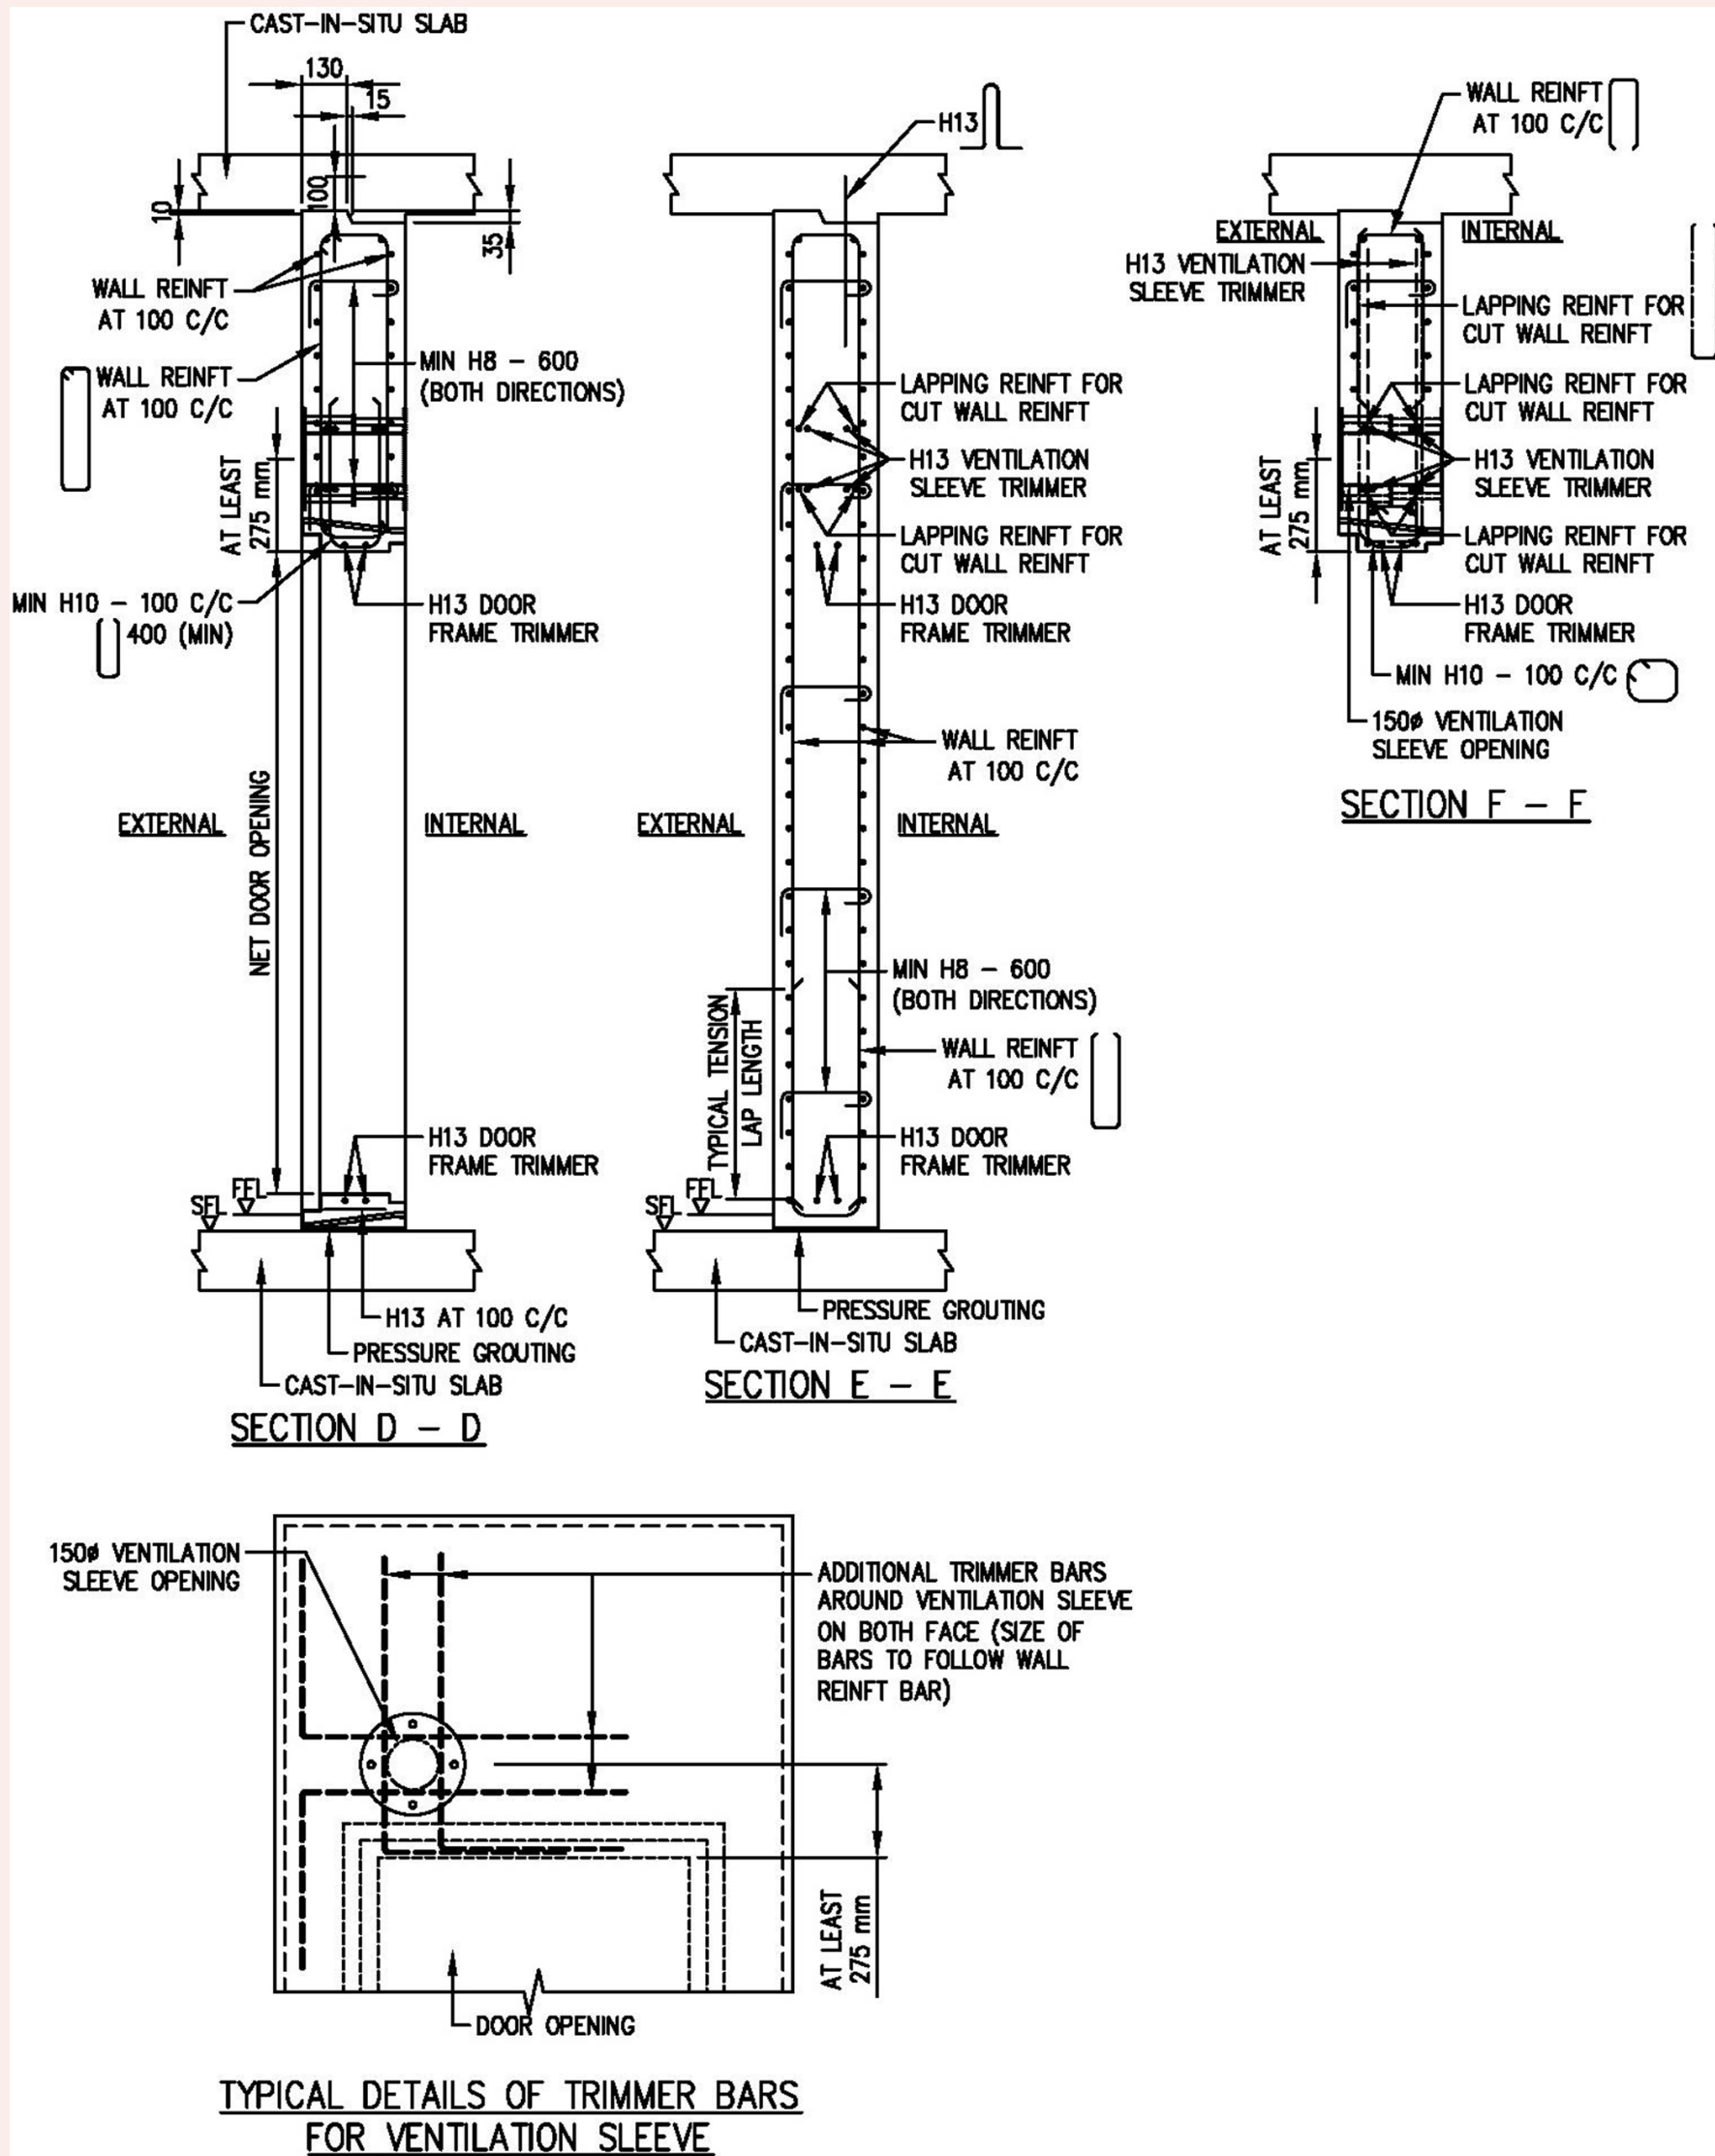


FIGURE 3.5.5(f): PLAN OF SS WALLS WITH PRECAST SS DOOR FRAME PANEL (TYPE 2)

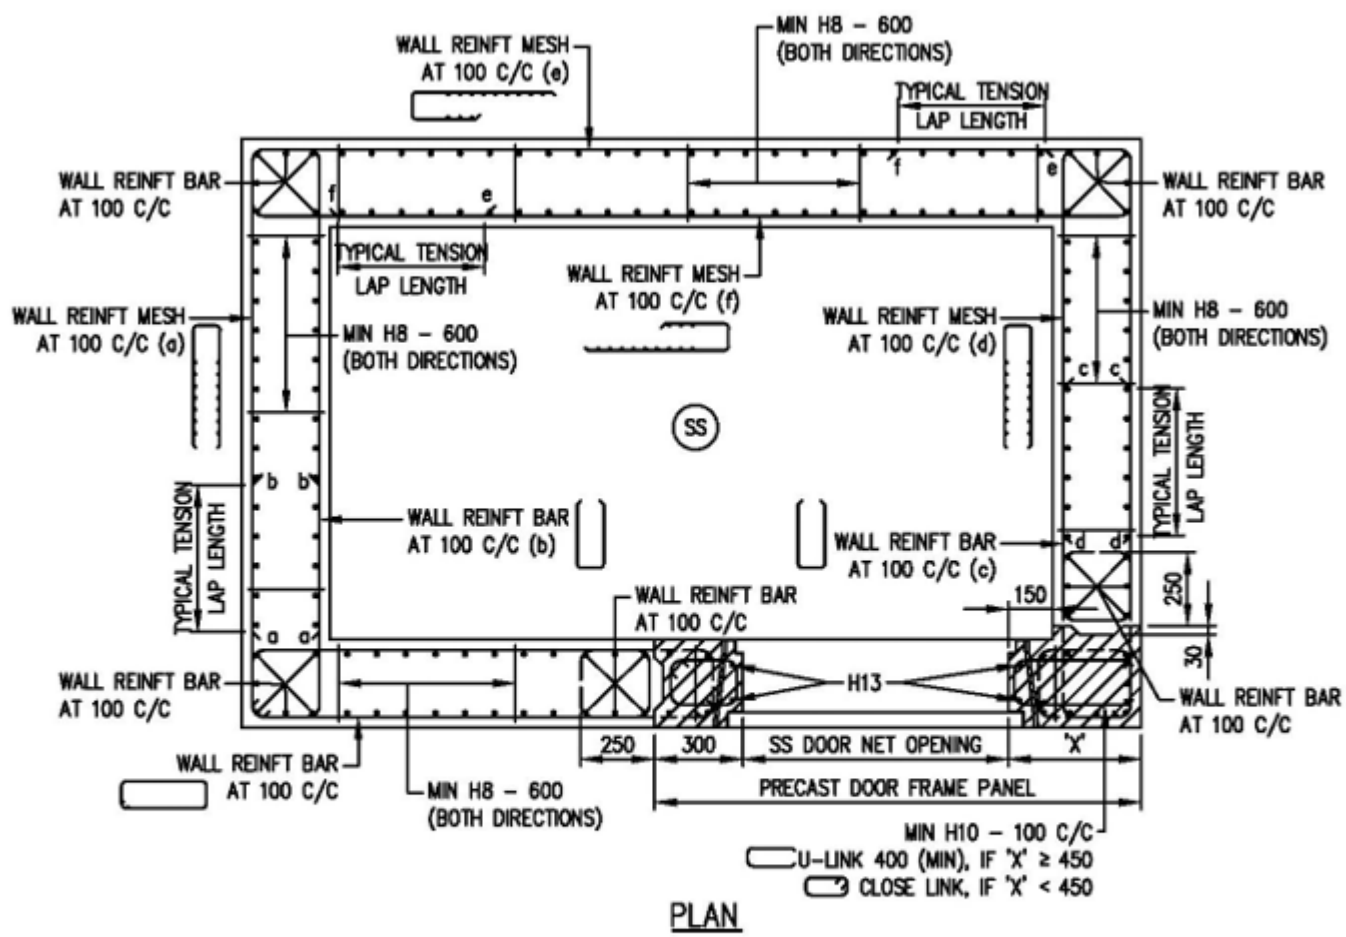

NOTE:

1. WALL REINFORCEMENT REFER TO TABLE 3.4.2.1
2. WALL REINFORCEMENTS AT VENTILATION SLEEVE LOCATION REFER TO FIGURE 3.5.5(o)(i) & (ii)

FIGURE 3.5.5(g): PLAN OF SS WALLS WITH PRECAST SS DOOR FRAME PANEL (TYPE 2)



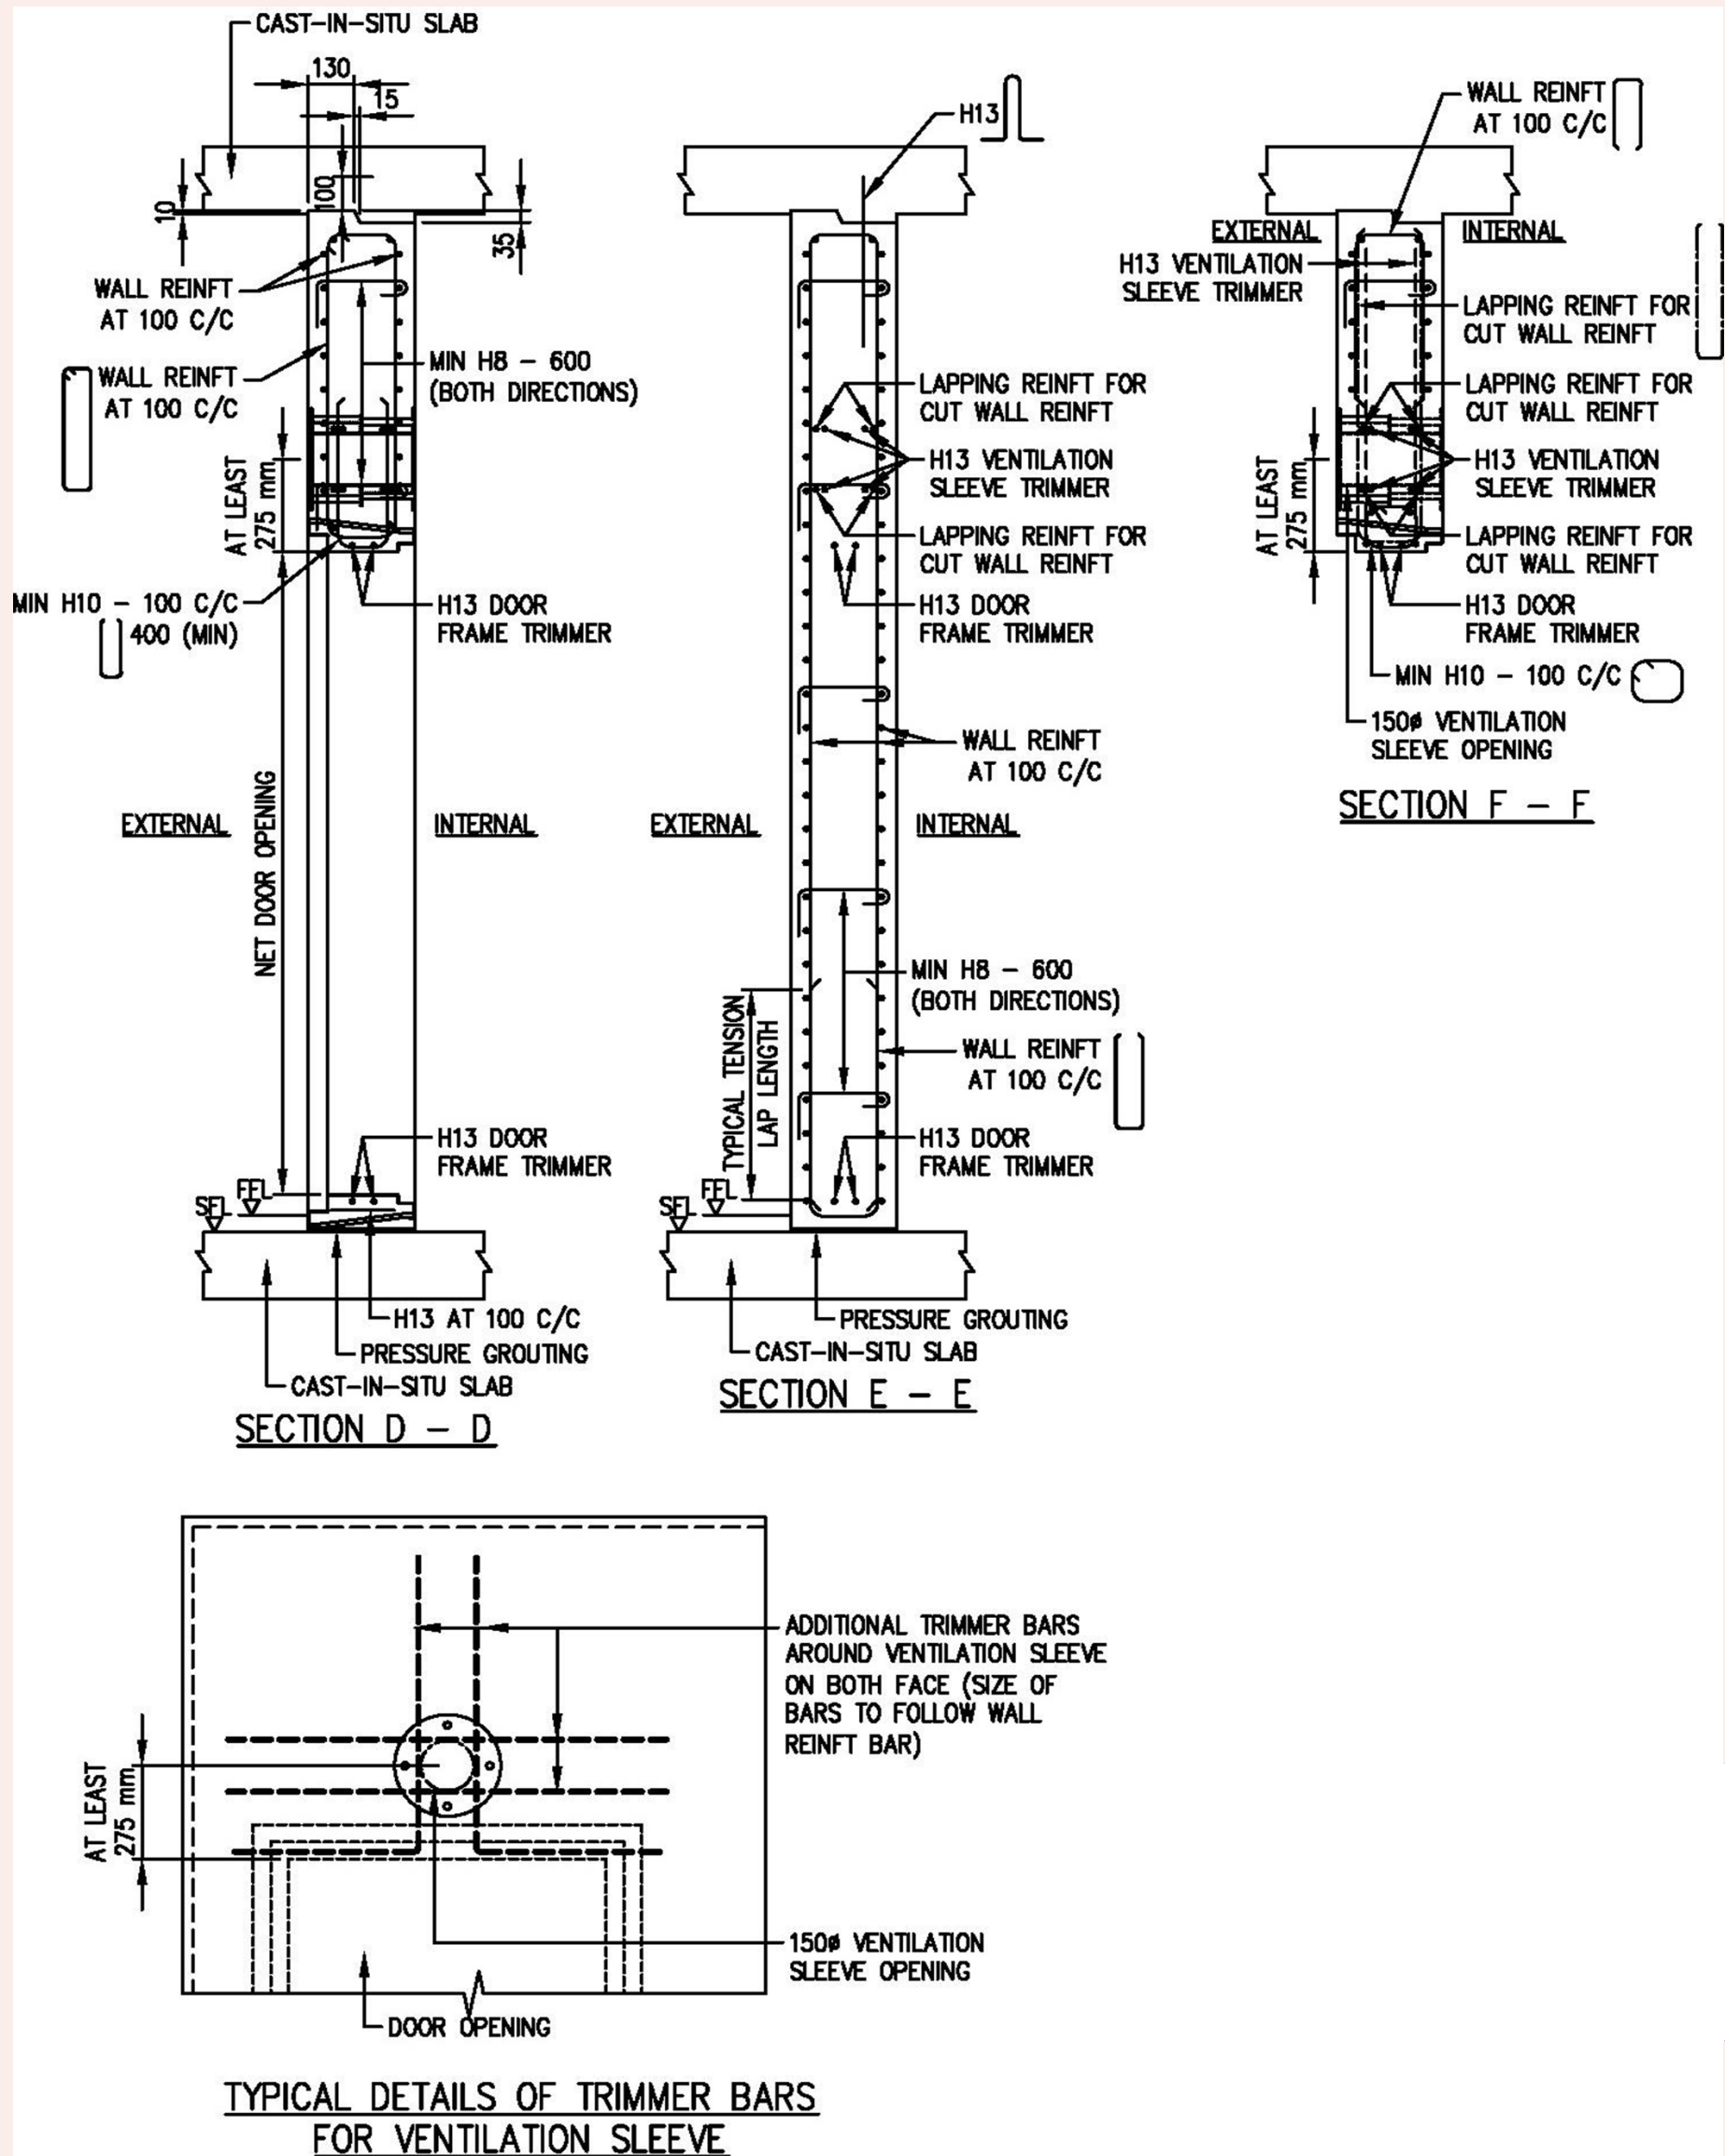


FIGURE 3.5.5(i): DETAILS AND SECTIONS OF PRECAST SS DOOR FRAME PANEL WITH VENTILATION SLEEVE ALONG ITS SIDE (TYPE 2)




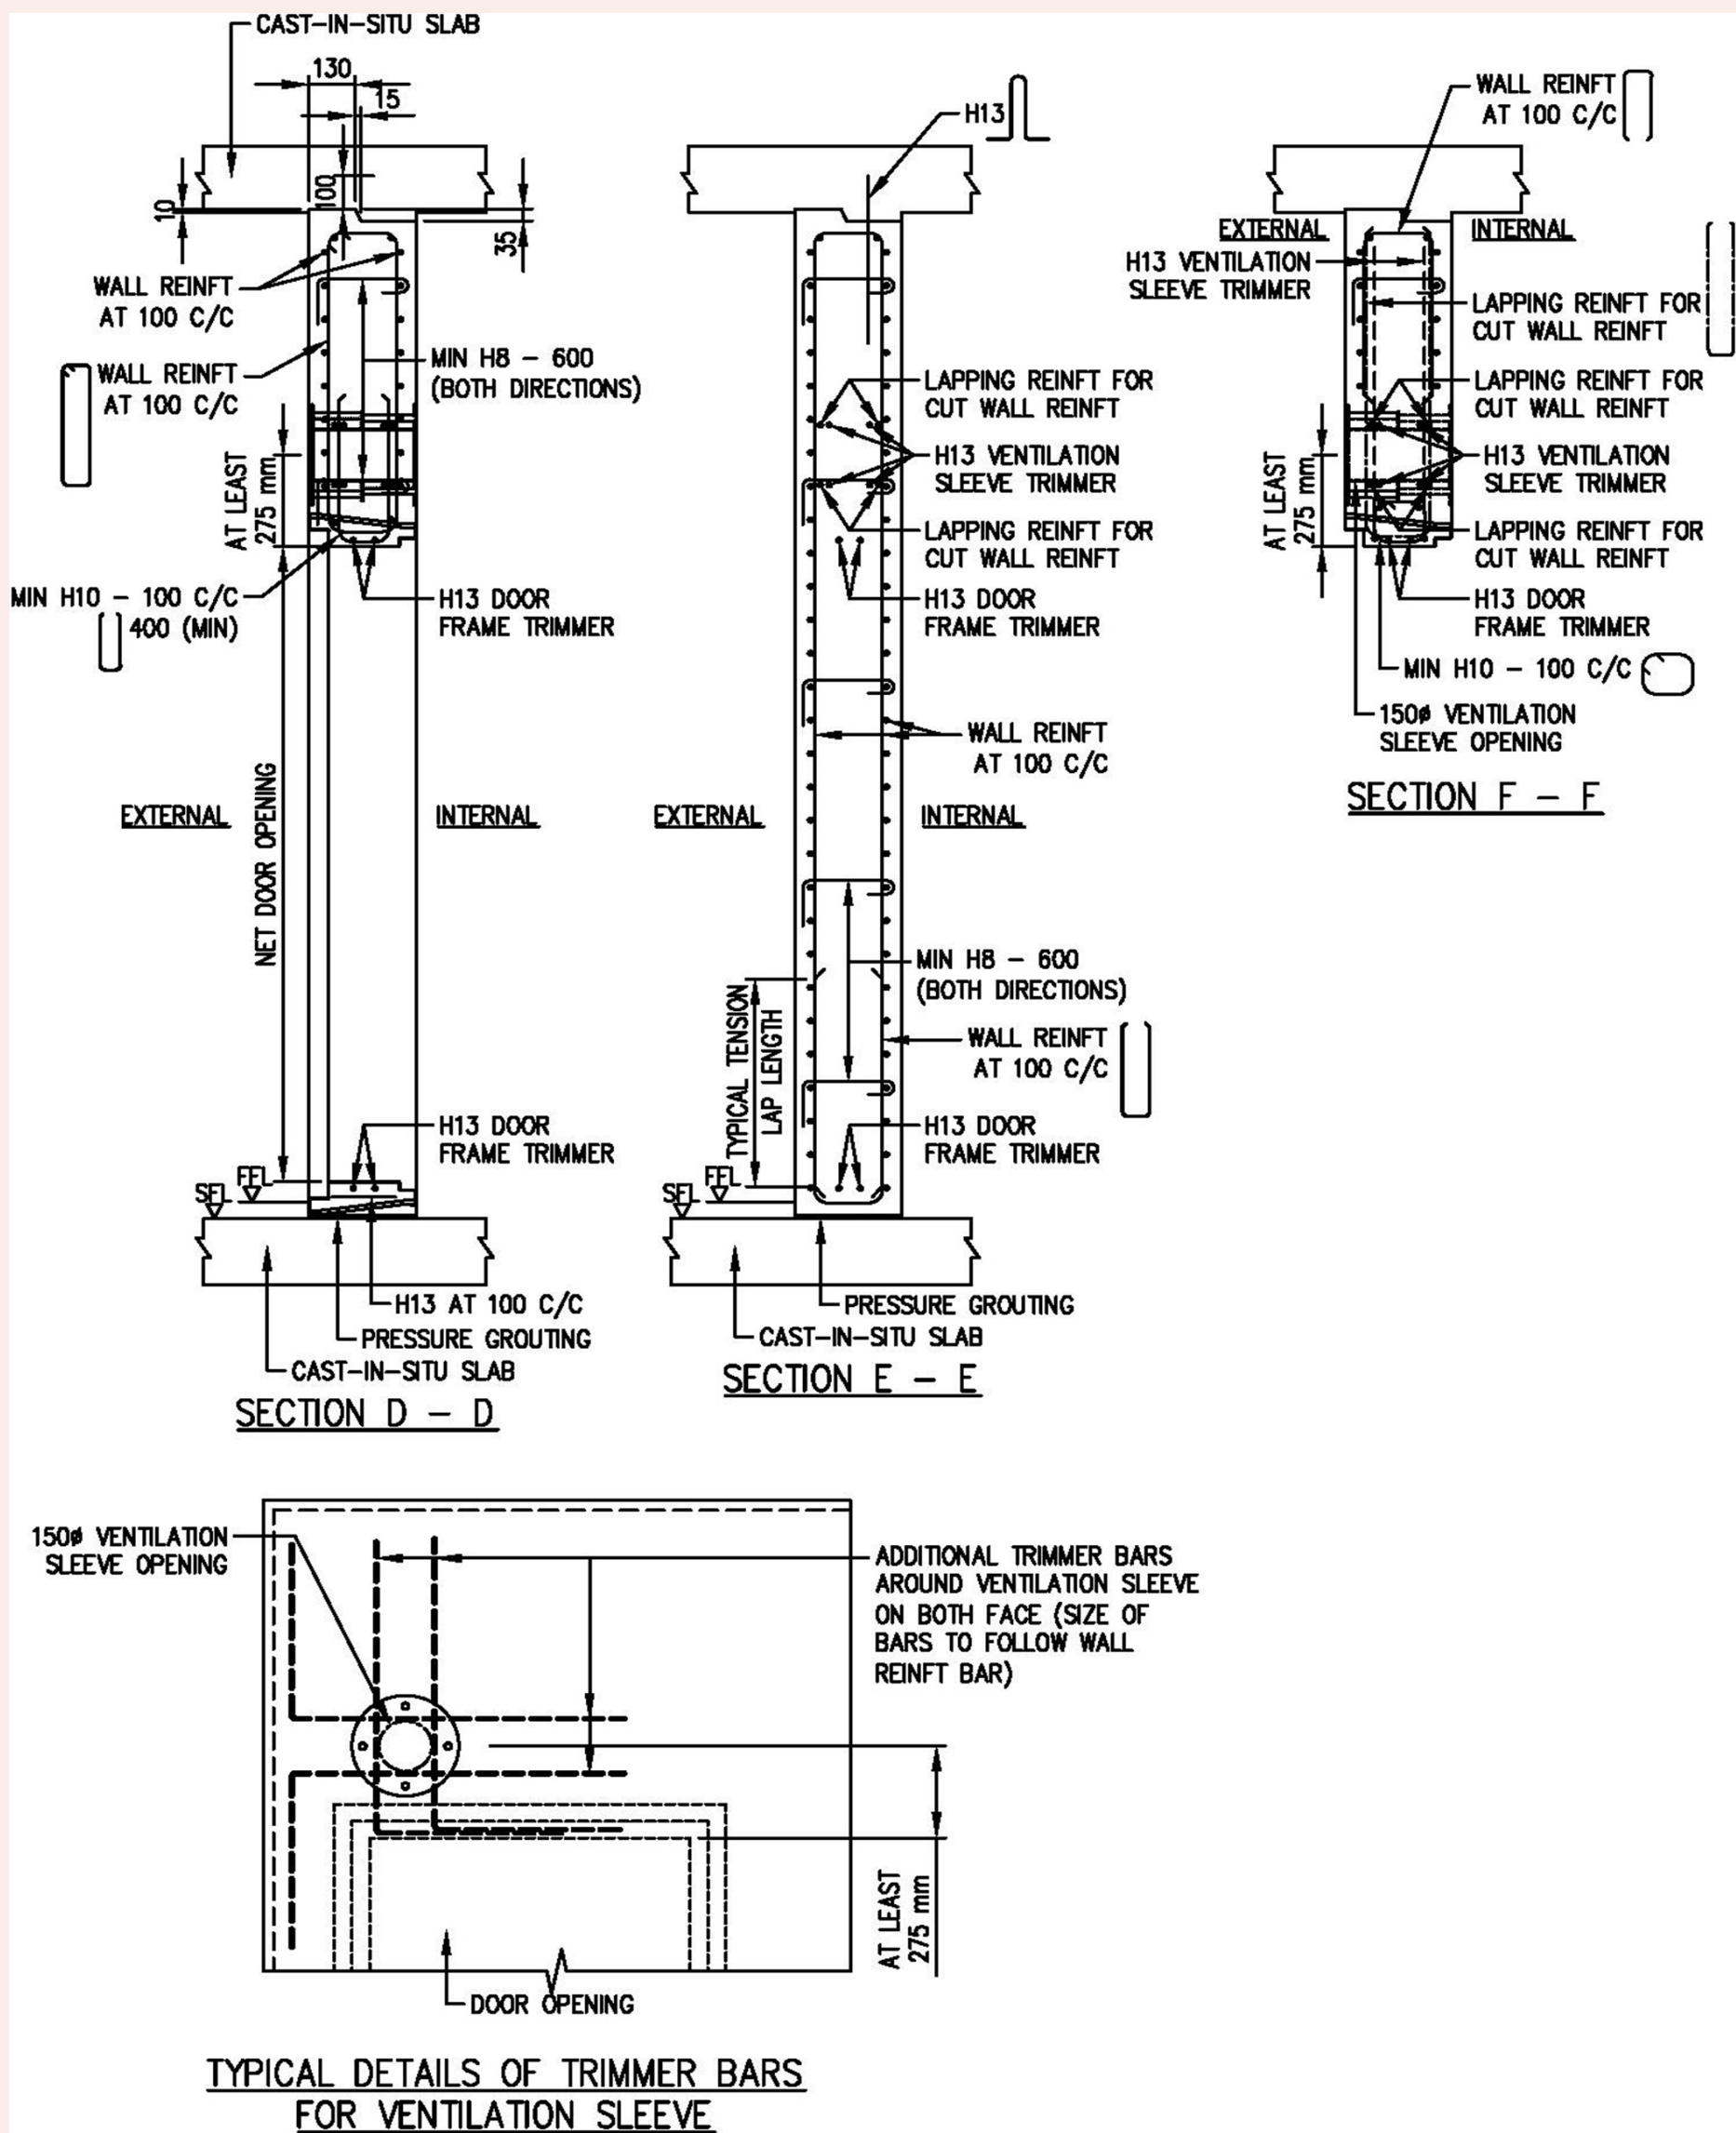


FIGURE 3.5.5(k) PLAN OF SS WALLS WITH PRECAST SS DOOR FRAME PANEL (TYPE 3)

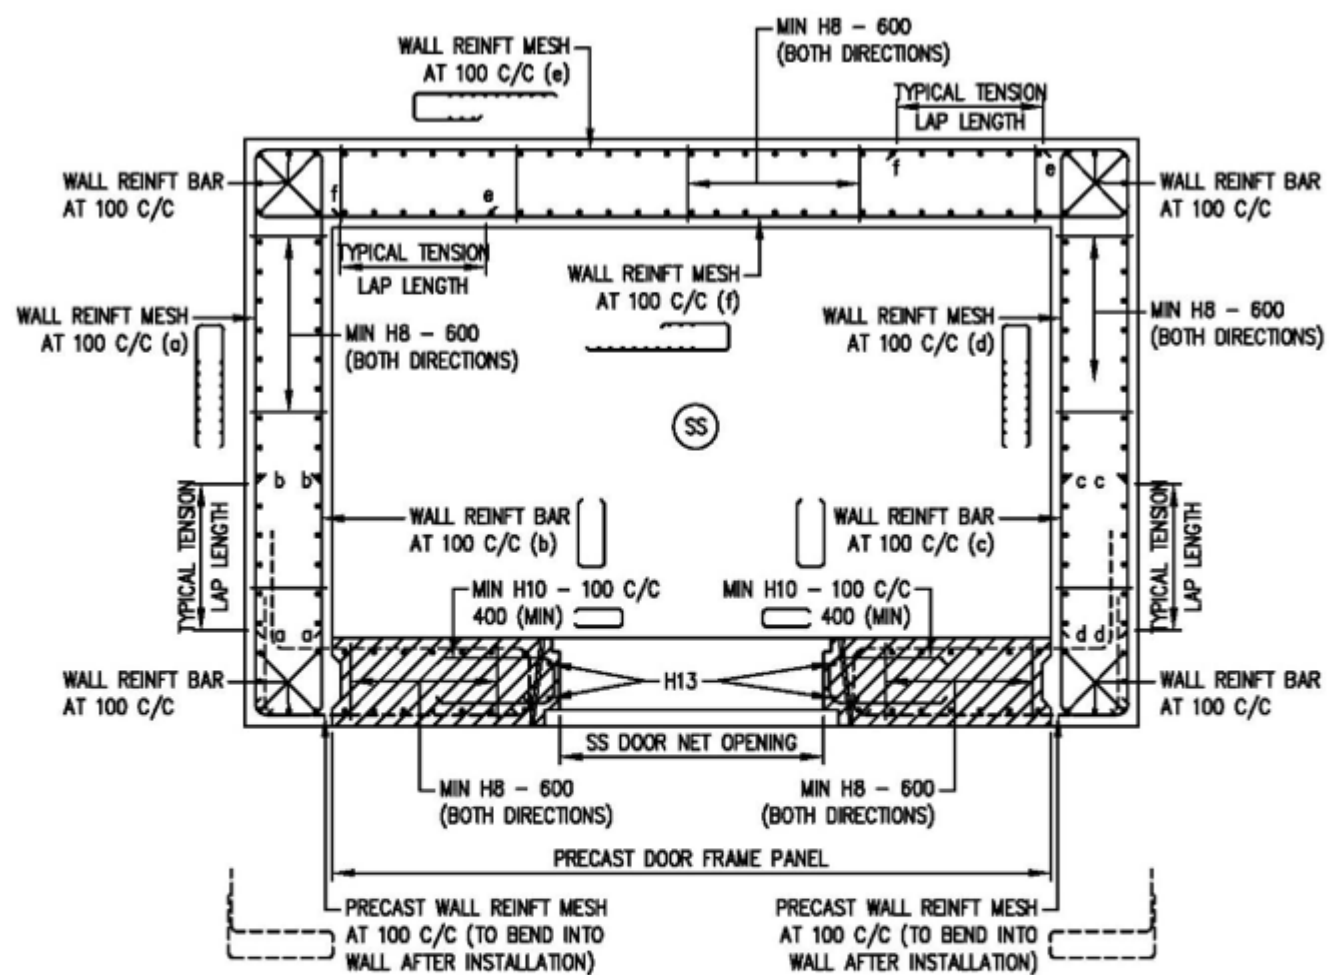


PLAN

NOTE:

1. WALL REINFORCEMENT REFER TO TABLE 3.4.2.1
2. WALL REINFORCEMENTS AT VENTILATION SLEEVE LOCATION REFER TO FIGURE 3.5.5(o)(i) & (ii)


FIGURE 3.5.5(i): DETAILS OF PRECAST SS DOOR FRAME PANEL (TYPE 3)

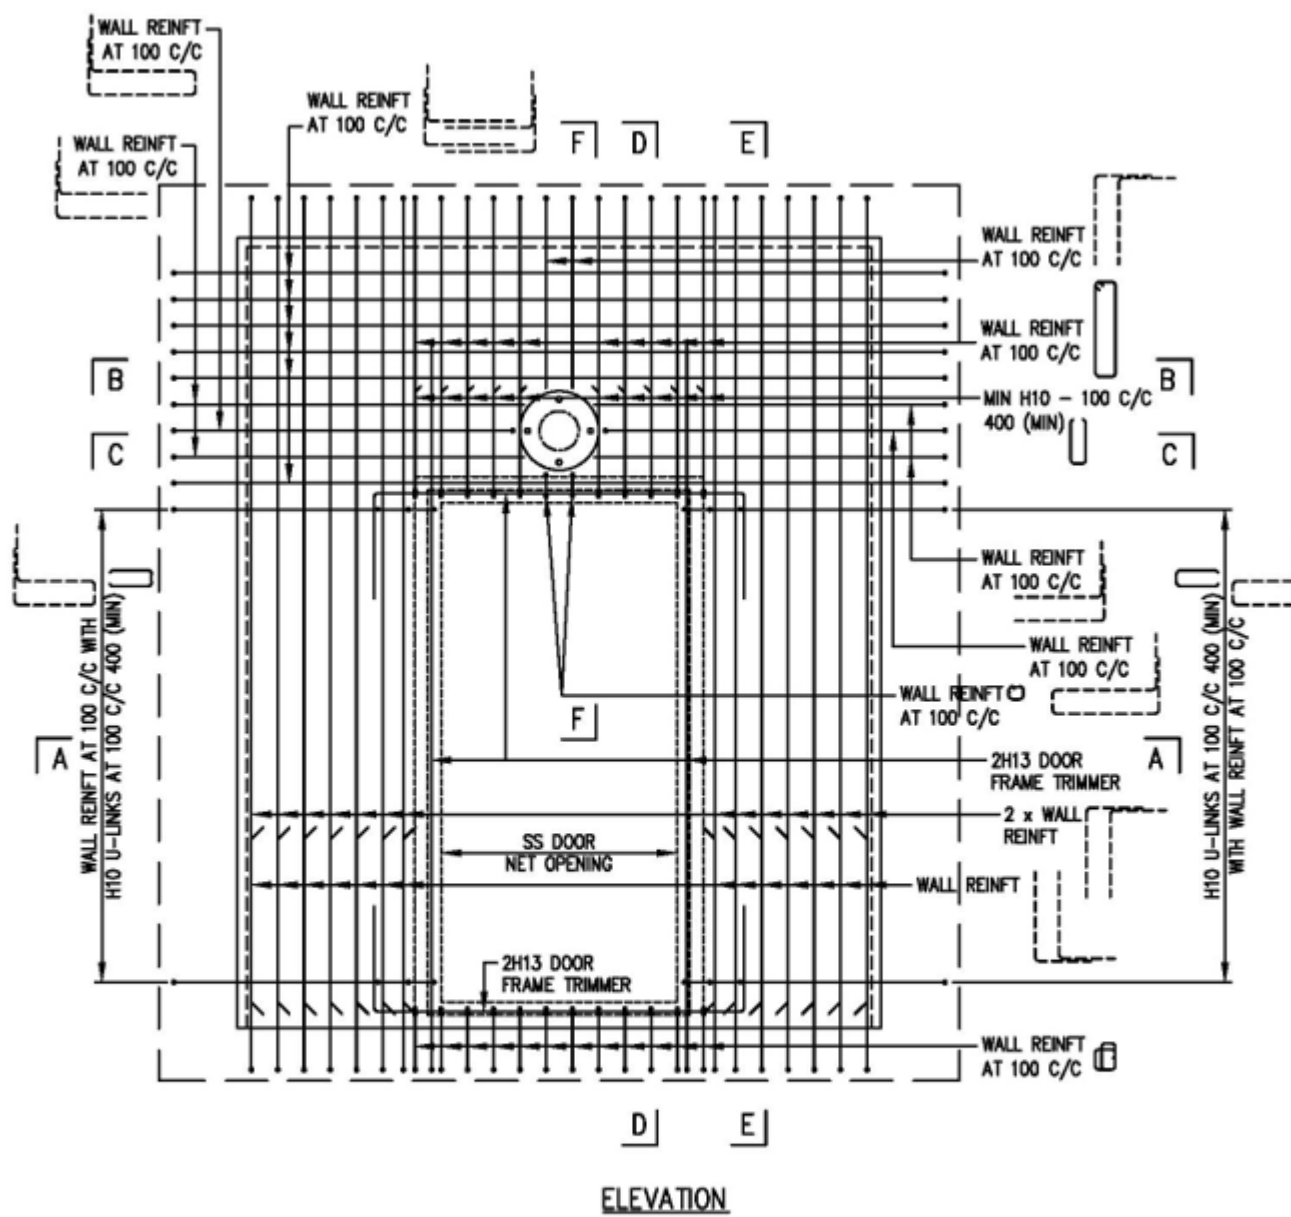


NOTE:

1. WALL REINFORCEMENT REFER TO TABLE 3.4.2.1
2. WALL REINFORCEMENTS AT VENTILATION SLEEVE LOCATION REFER TO FIGURE 3.5.5(o)(i) & (ii)


FIGURE 3.5.5(m): SECTIONS OF PRECAST SS DOOR FRAME PANEL (TYPE 3)

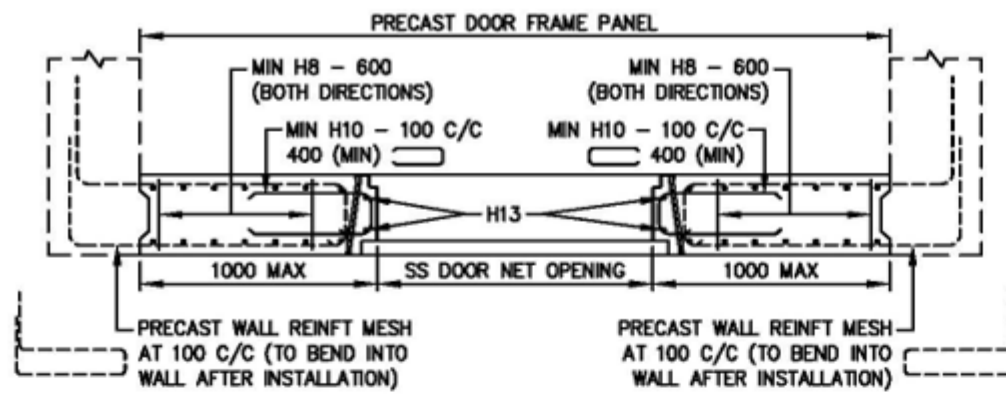

SECTION A - A

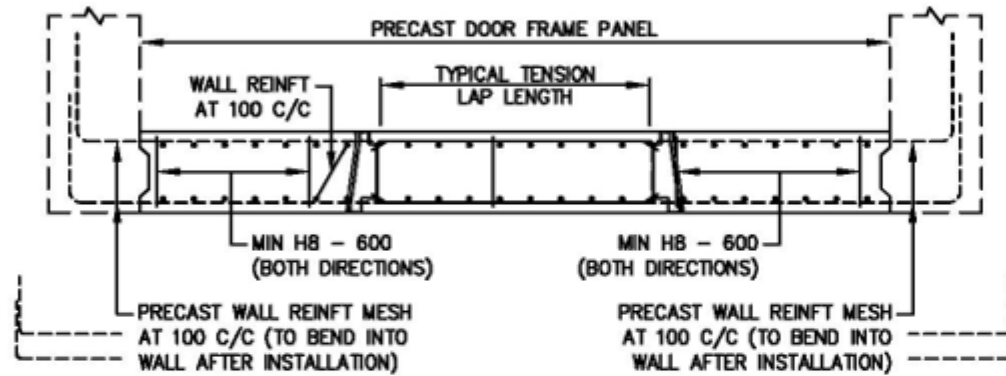

SECTION B - B

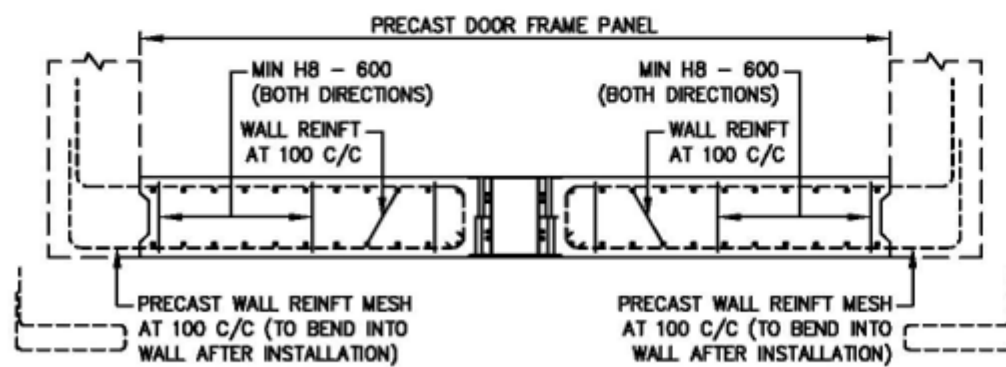

SECTION C - C

NOTE:

1. WALL REINFORCEMENT REFER TO TABLE 3.4.2.1
2. WALL REINFORCEMENTS AT VENTILATION SLEEVE LOCATION REFER TO FIGURE 3.5.5(o)(i) & (ii)

FIGURE 3.5.5(n): SECTIONS OF PRECAST SS DOOR FRAME PANEL (TYPE 3)

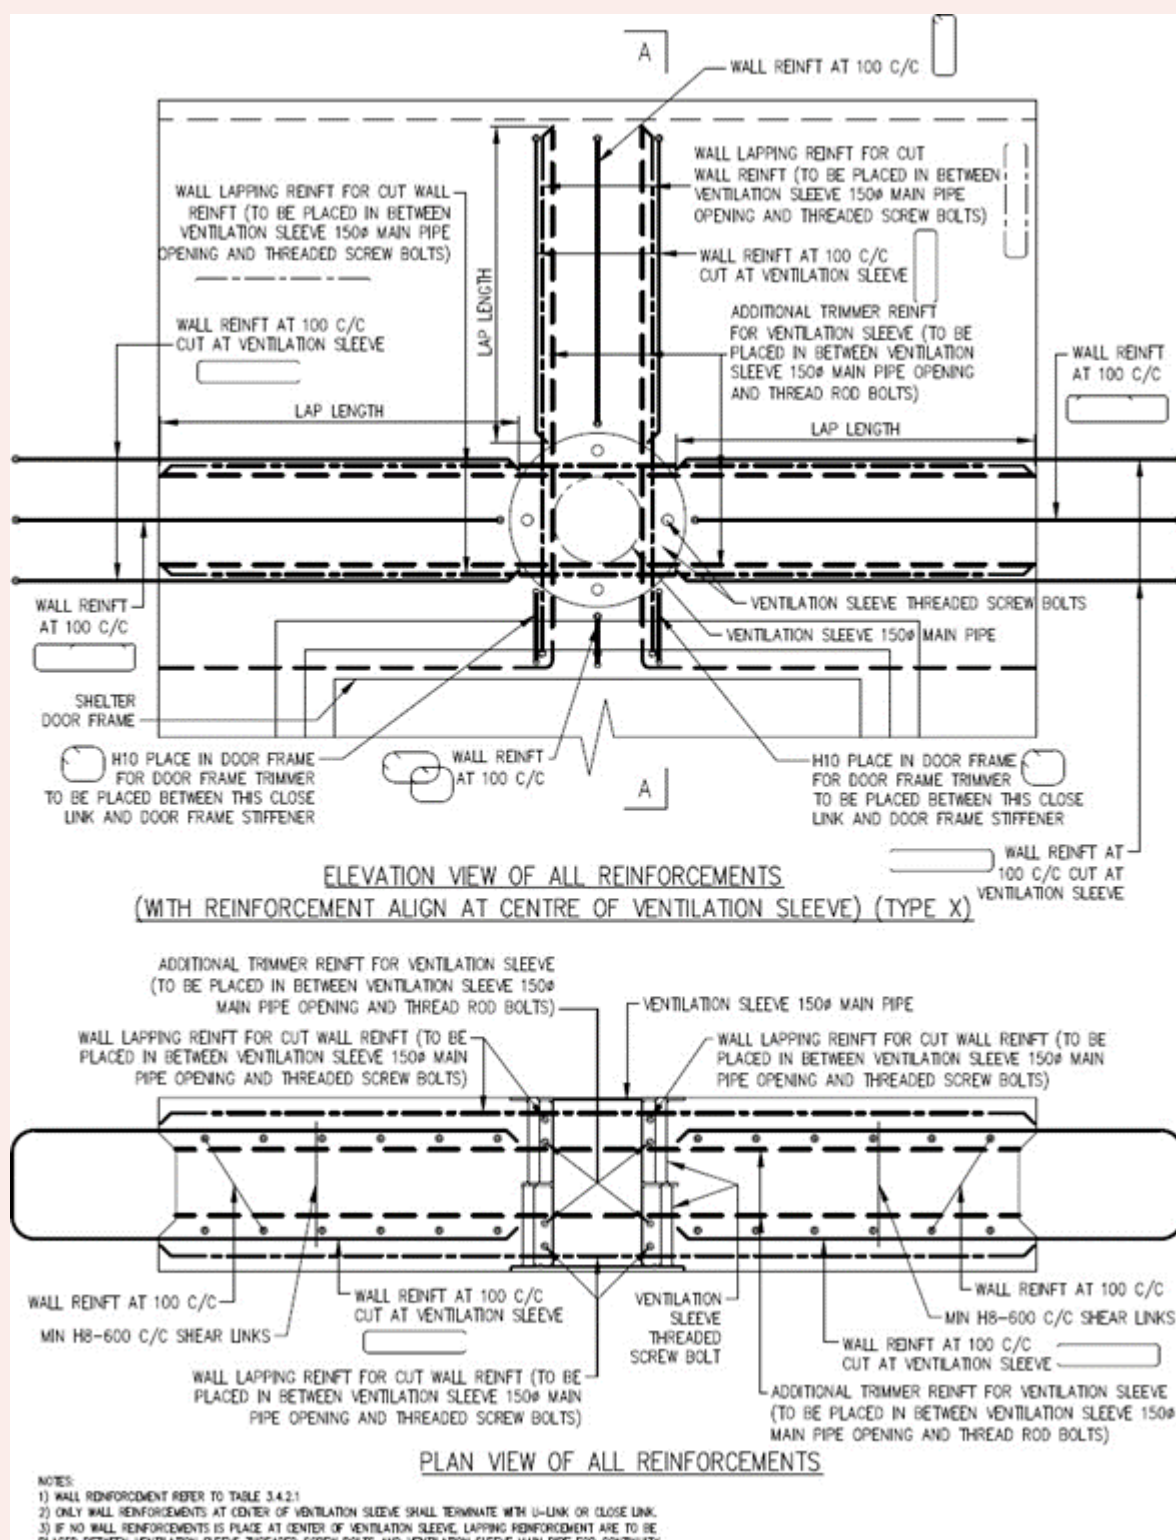


FIGURE 3.5.5(o)(ii): TYPICAL DETAILS AND SECTIONS OF REINFORCEMENTS AT VENTILATION SLEEVE LOCATION


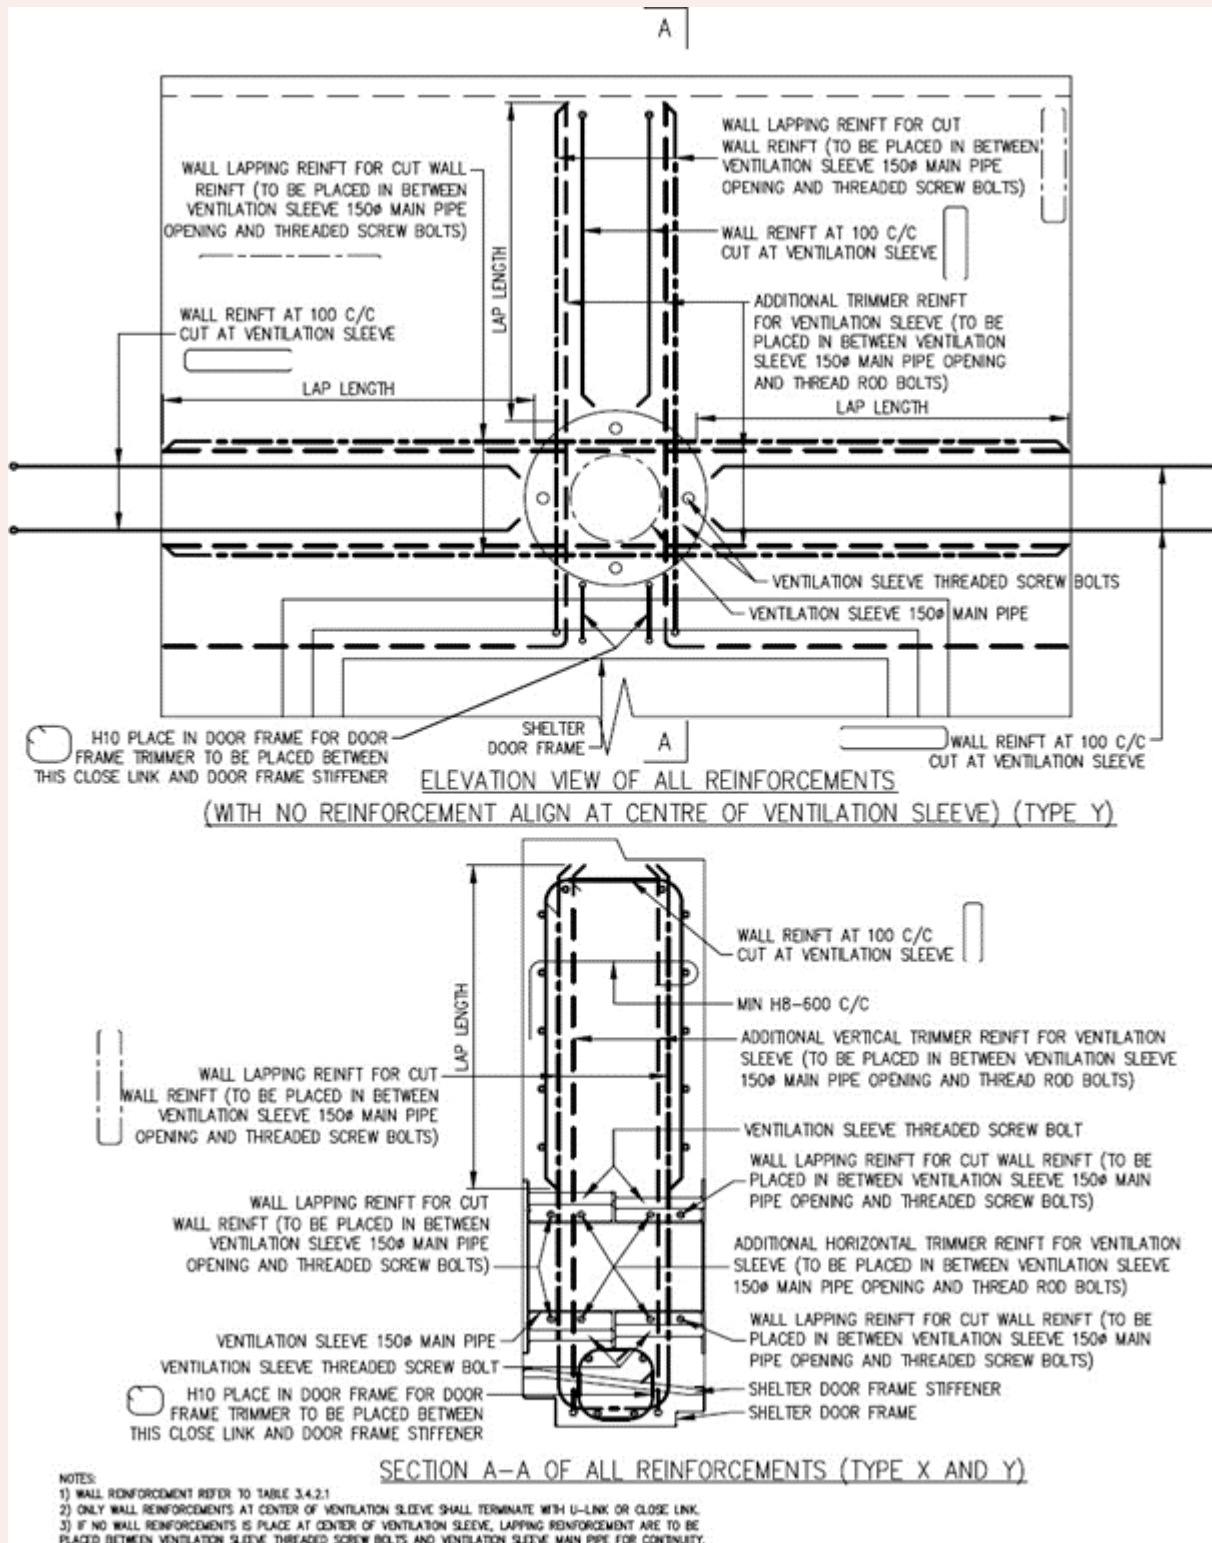


FIGURE 3.5.5(p): PLANS AND DETAILS OF SS SLABS FOR S/C SS PRECAST FLIGHT

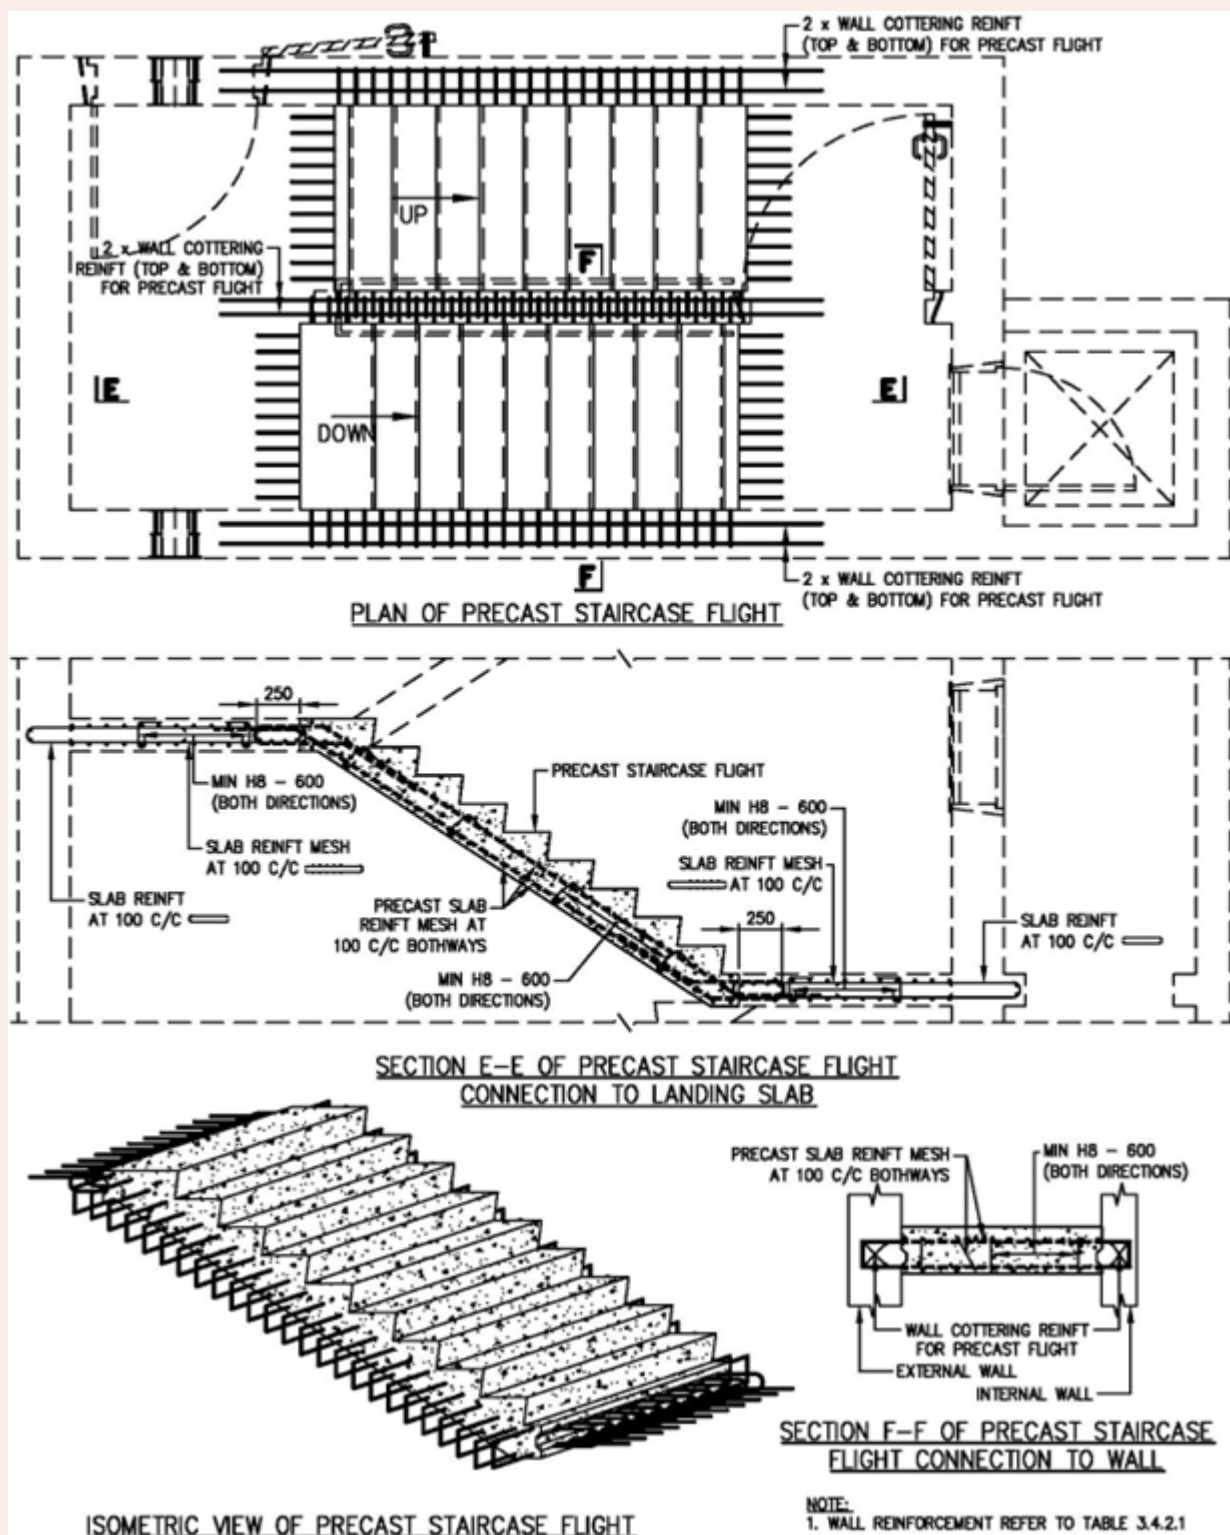

3.5.6 Precast Hollow Core S/C SS

3.5.6.1 Dimensions of Precast Hollow Core S/C SS

- Precast hollow core staircase storey shelter shall be designed to meet the shelter area and volume requirements. The internal length and width of the precast S/C SS walls shall be modular with an increment of 100mm or 50mm respectively. Precast S/C SS comprises 3 parts as shown in FIGURE 3.5.6.1(a) and 3.5.6.1(b). Precast S/C SS, including the dimensions and spacing of modular hollow cores [See TABLE A & TABLE B of FIGURE 3.5.6.1(a)], ventilation sleeves, blast door, blast hatch and electrical fixtures are shown in FIGURE 3.5.6.1(a) to 3.5.6.1(c).

Figures & Tables

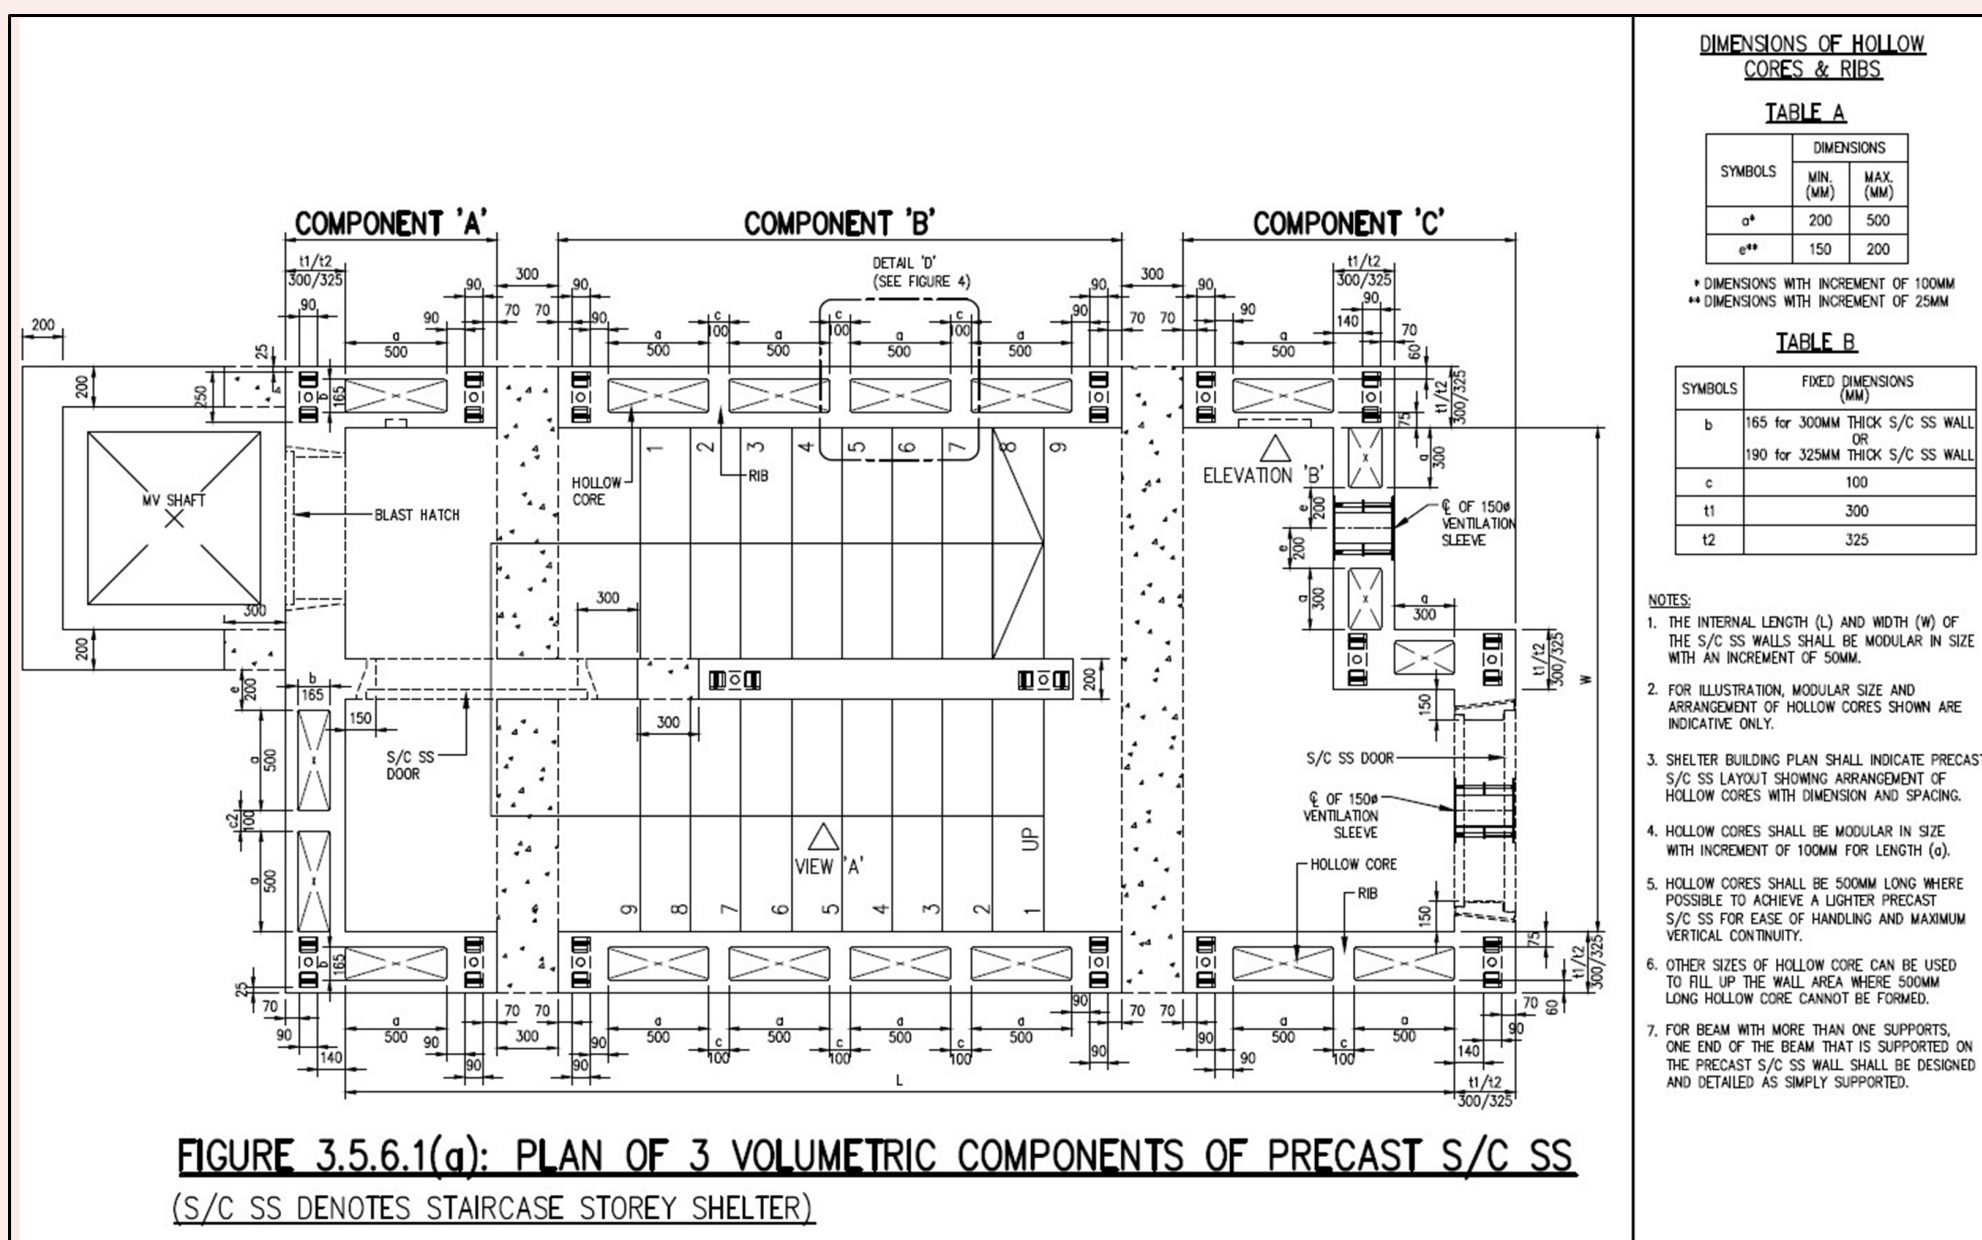


FIGURE 3.5.6.1(a): PLAN OF 3 VOLUMETRIC COMPONENTS OF PRECAST S/C SS
(S/C SS DENOTES STAIRCASE STOREY SHELTER)

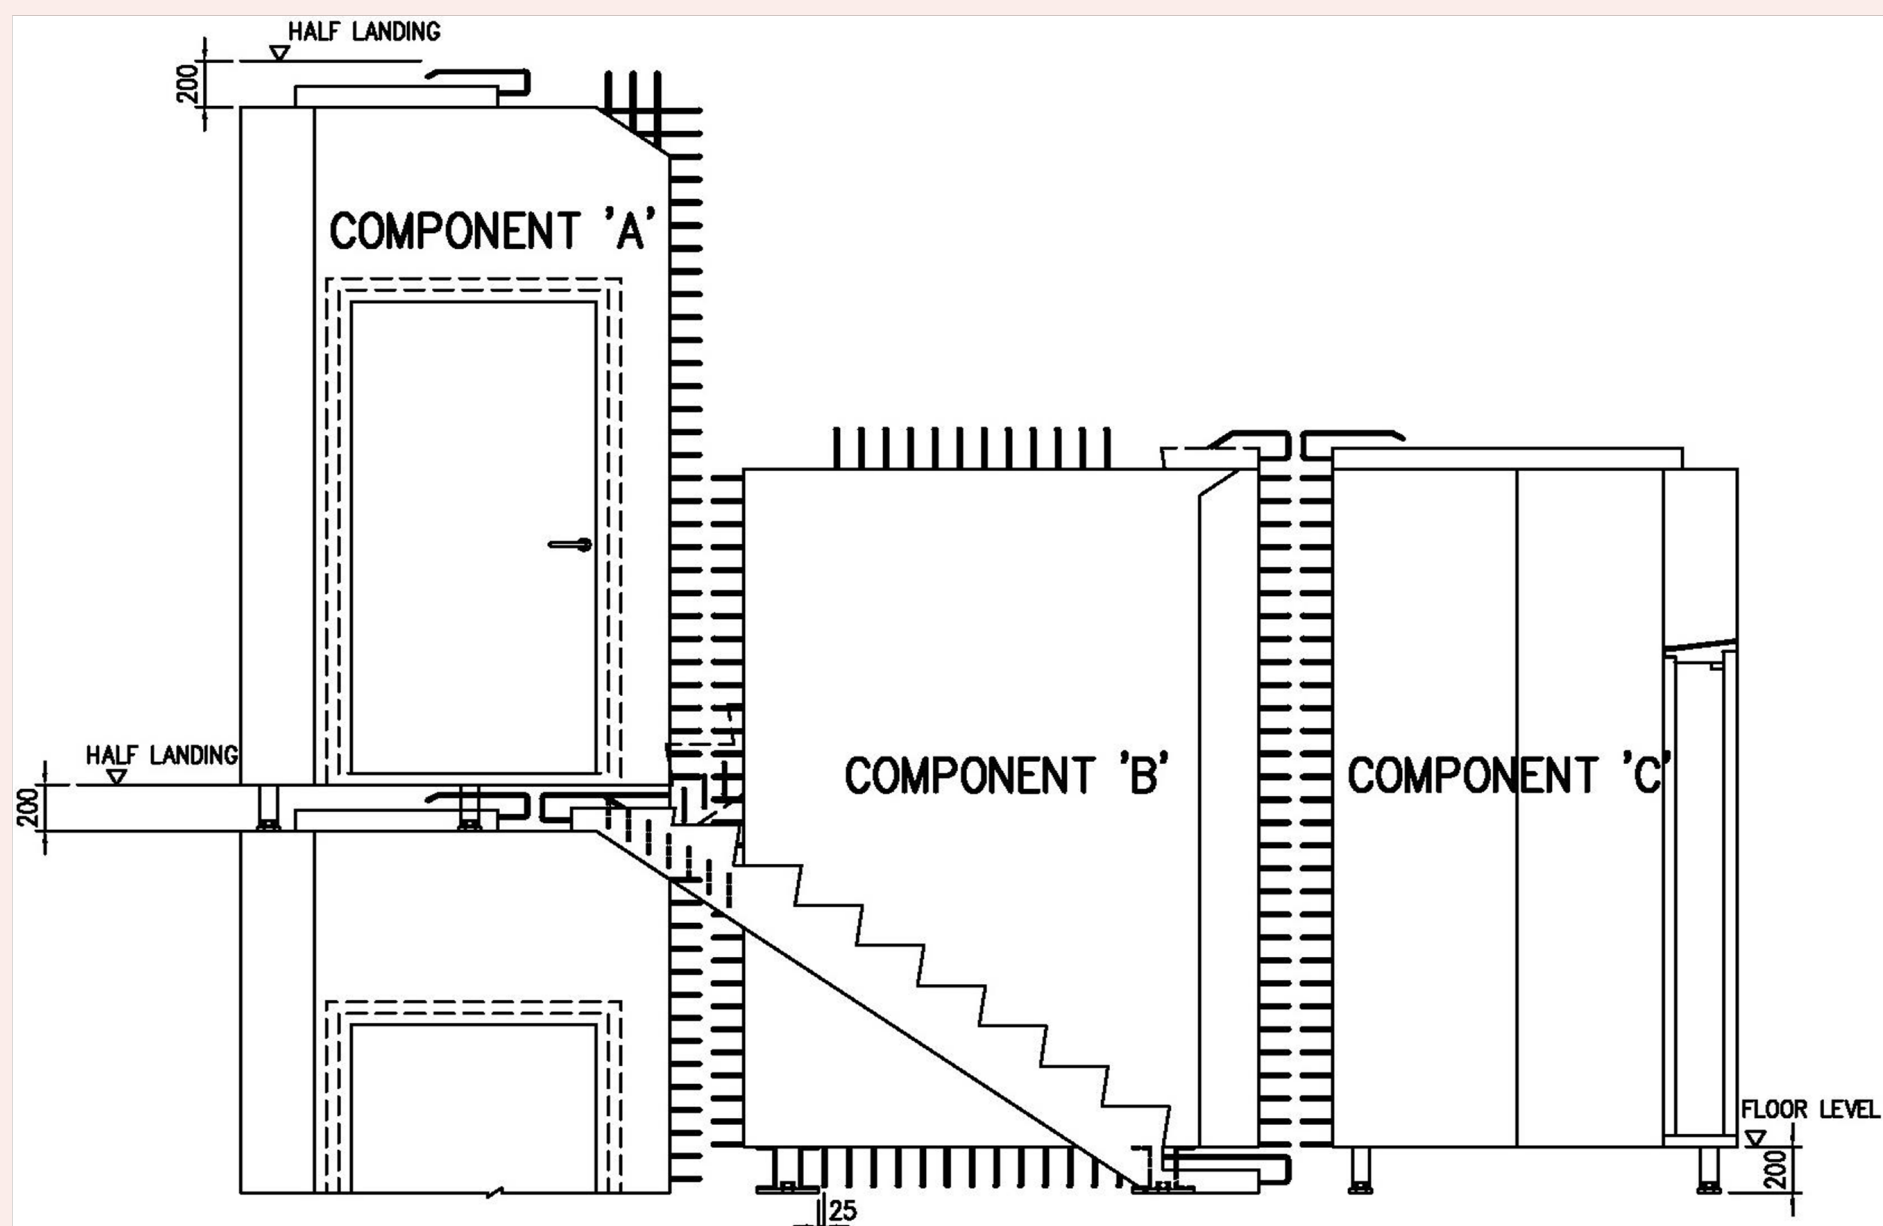


FIGURE 3.5.6.1(b): INTERNAL ELEVATION VIEW 'A' OF 3 VOLUMETRIC COMPONENTS OF PRECAST S/C SS

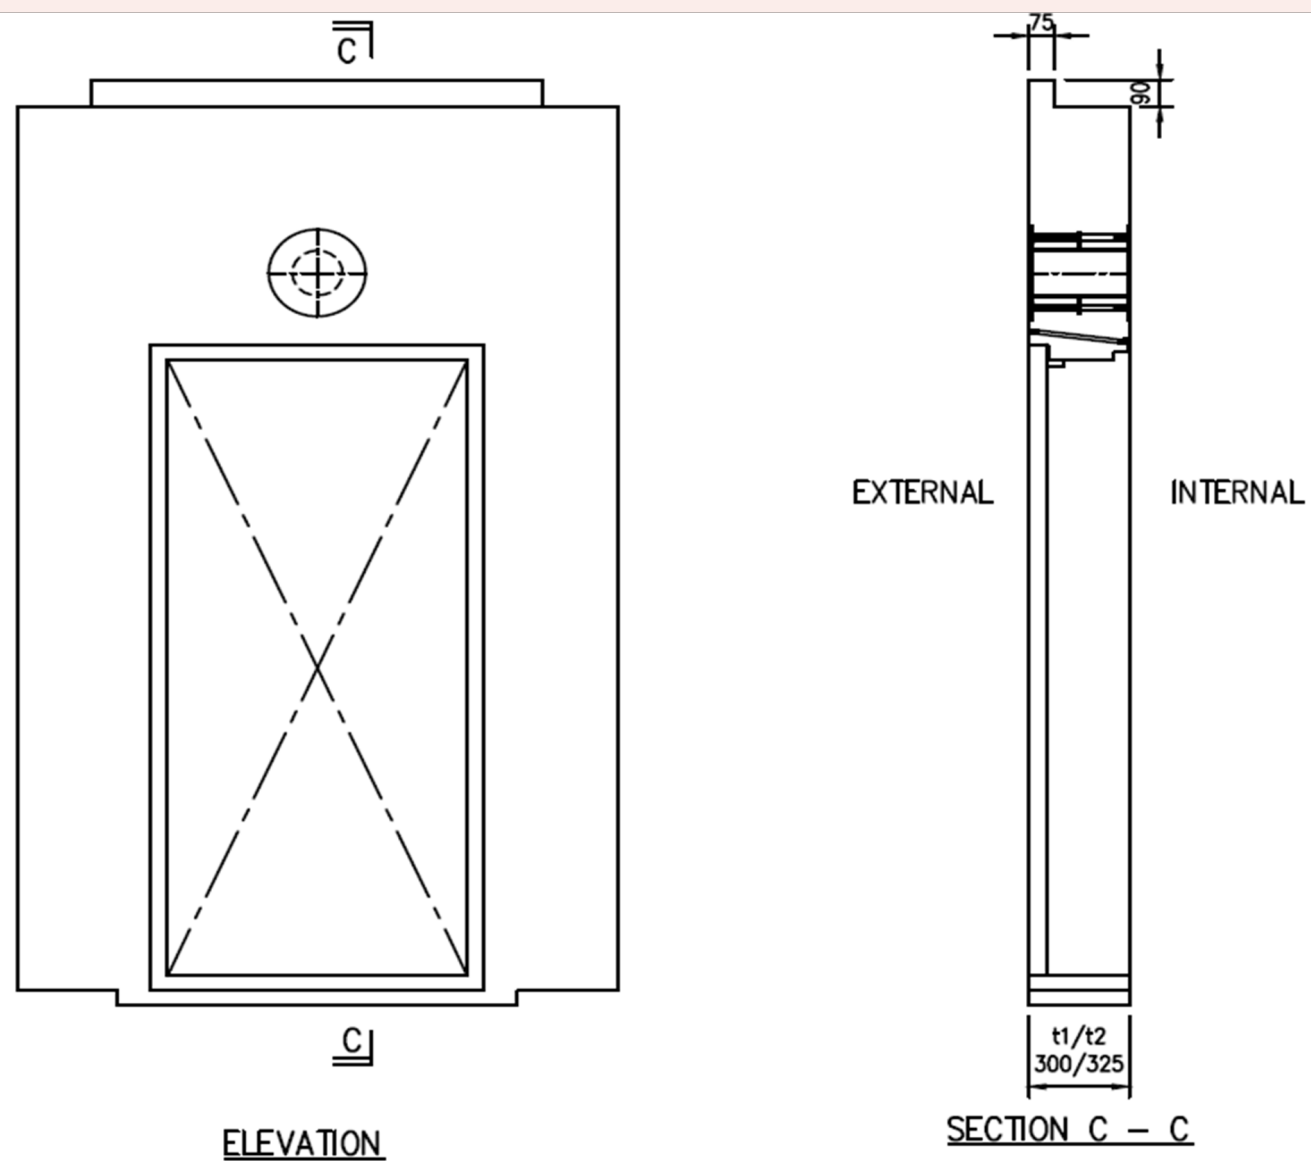


FIGURE 3.5.6.1(c): BLAST DOOR AND VENTILATION SLEEVE

i. FIGURE 3.5.6.1(a): Plan of 3 Volumetric Components of Precast S/CSS.

Figures & Tables

FIGURE 3.5.6.1(a): Plan of 3 Volumetric Components of Precast S/CSS.

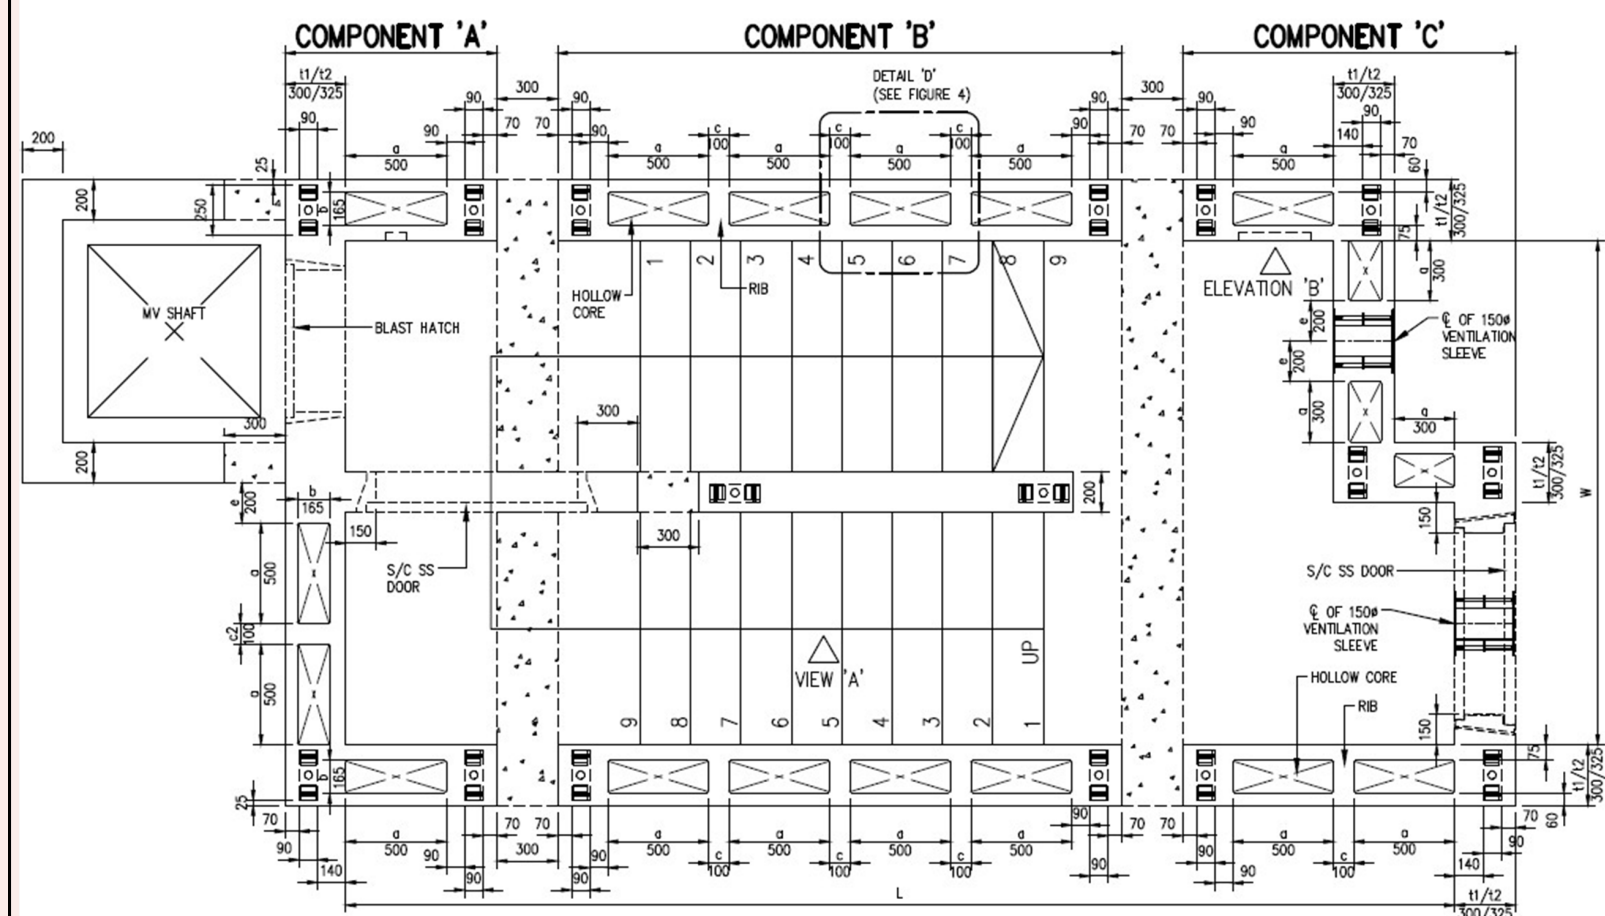


FIGURE 3.5.6.1(a): PLAN OF 3 VOLUMETRIC COMPONENTS OF PRECAST S/C SS
(S/C SS DENOTES STAIRCASE STOREY SHELTER)

DIMENSIONS OF HOLLOW CORES & RIBS

TABLE A

SYMBOLS	DIMENSIONS	
	MIN. (MM)	MAX. (MM)
a*	200	500
e**	150	200

* DIMENSIONS WITH INCREMENT OF 100MM
** DIMENSIONS WITH INCREMENT OF 25MM

TABLE B


SYMBOLS	FIXED DIMENSIONS (MM)
b	165 for 300MM THICK S/C SS WALL OR 190 for 325MM THICK S/C SS WALL
c	100
t1	300
t2	325

NOTES:

1. THE INTERNAL LENGTH (L) AND WIDTH (W) OF THE S/C SS WALLS SHALL BE MODULAR IN SIZE WITH AN INCREMENT OF 50MM.
2. FOR ILLUSTRATION, MODULAR SIZE AND ARRANGEMENT OF HOLLOW CORES SHOWN ARE INDICATIVE ONLY.
3. SHELTER BUILDING PLAN SHALL INDICATE PRECAST S/C SS LAYOUT SHOWING ARRANGEMENT OF HOLLOW CORES WITH DIMENSION AND SPACING.
4. HOLLOW CORES SHALL BE MODULAR IN SIZE WITH INCREMENT OF 100MM FOR LENGTH (a).
5. HOLLOW CORES SHALL BE 500MM LONG WHERE POSSIBLE TO ACHIEVE A LIGHTER PRECAST S/C SS FOR EASE OF HANDLING AND MAXIMUM VERTICAL CONTINUITY.
6. OTHER SIZES OF HOLLOW CORE CAN BE USED TO FILL UP THE WALL AREA WHERE 500MM LONG HOLLOW CORE CANNOT BE FORMED.
7. FOR BEAM WITH MORE THAN ONE SUPPORTS, ONE END OF THE BEAM THAT IS SUPPORTED ON THE PRECAST S/C SS WALL SHALL BE DESIGNED AND DETAILED AS SIMPLY SUPPORTED.

ii. FIGURE 3.5.6.1(b): Internal Elevation View 'A' of 3 Volumetric Components of Precast S/C SS.

Figures & Tables

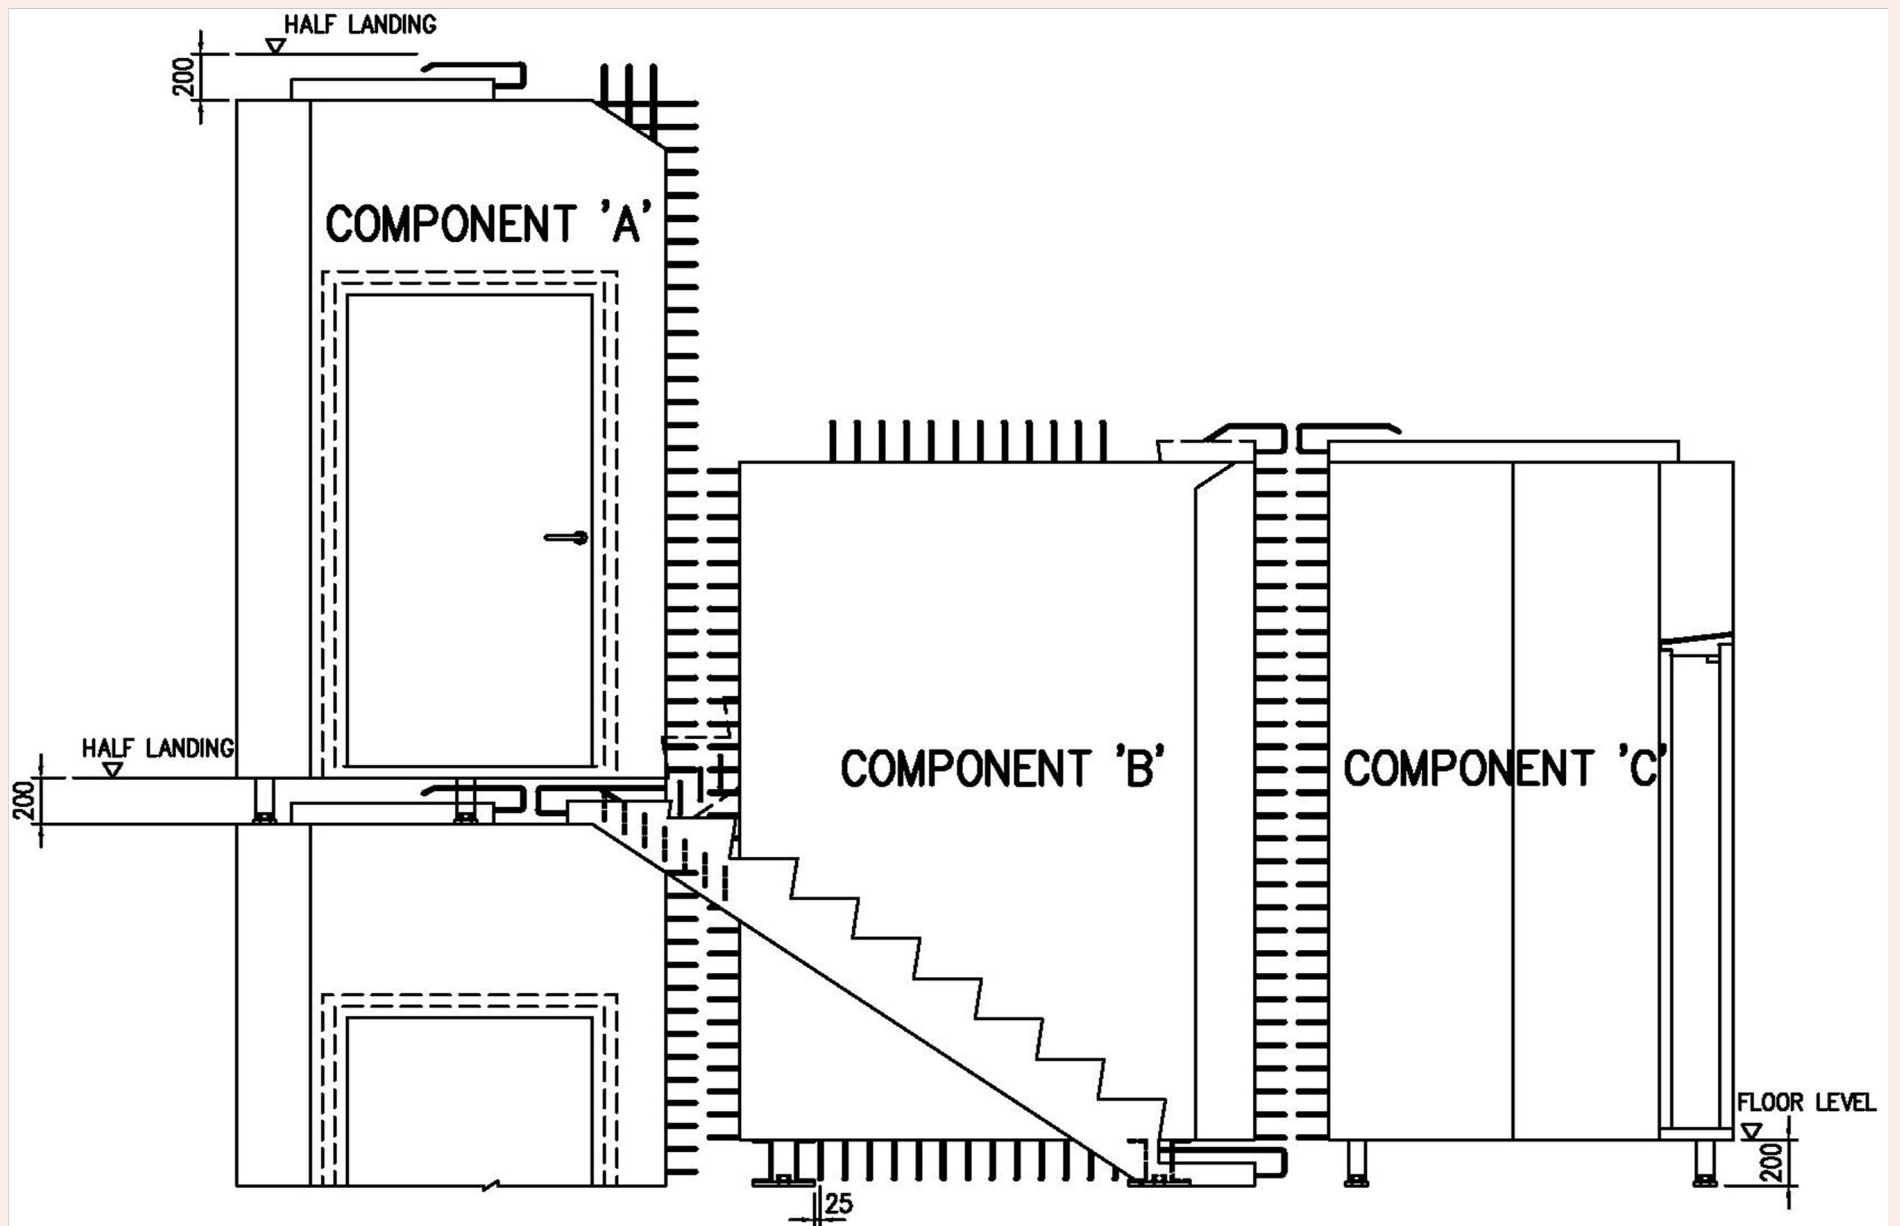

**FIGURE 3.5.6.1(b): INTERNAL ELEVATION VIEW 'A' OF 3
VOLUMETRIC COMPONENTS OF PRECAST S/C SS**

iii. FIGURE 3.5.6.1(c): Blast Door and Ventilation Sleeve.

Figures & Tables

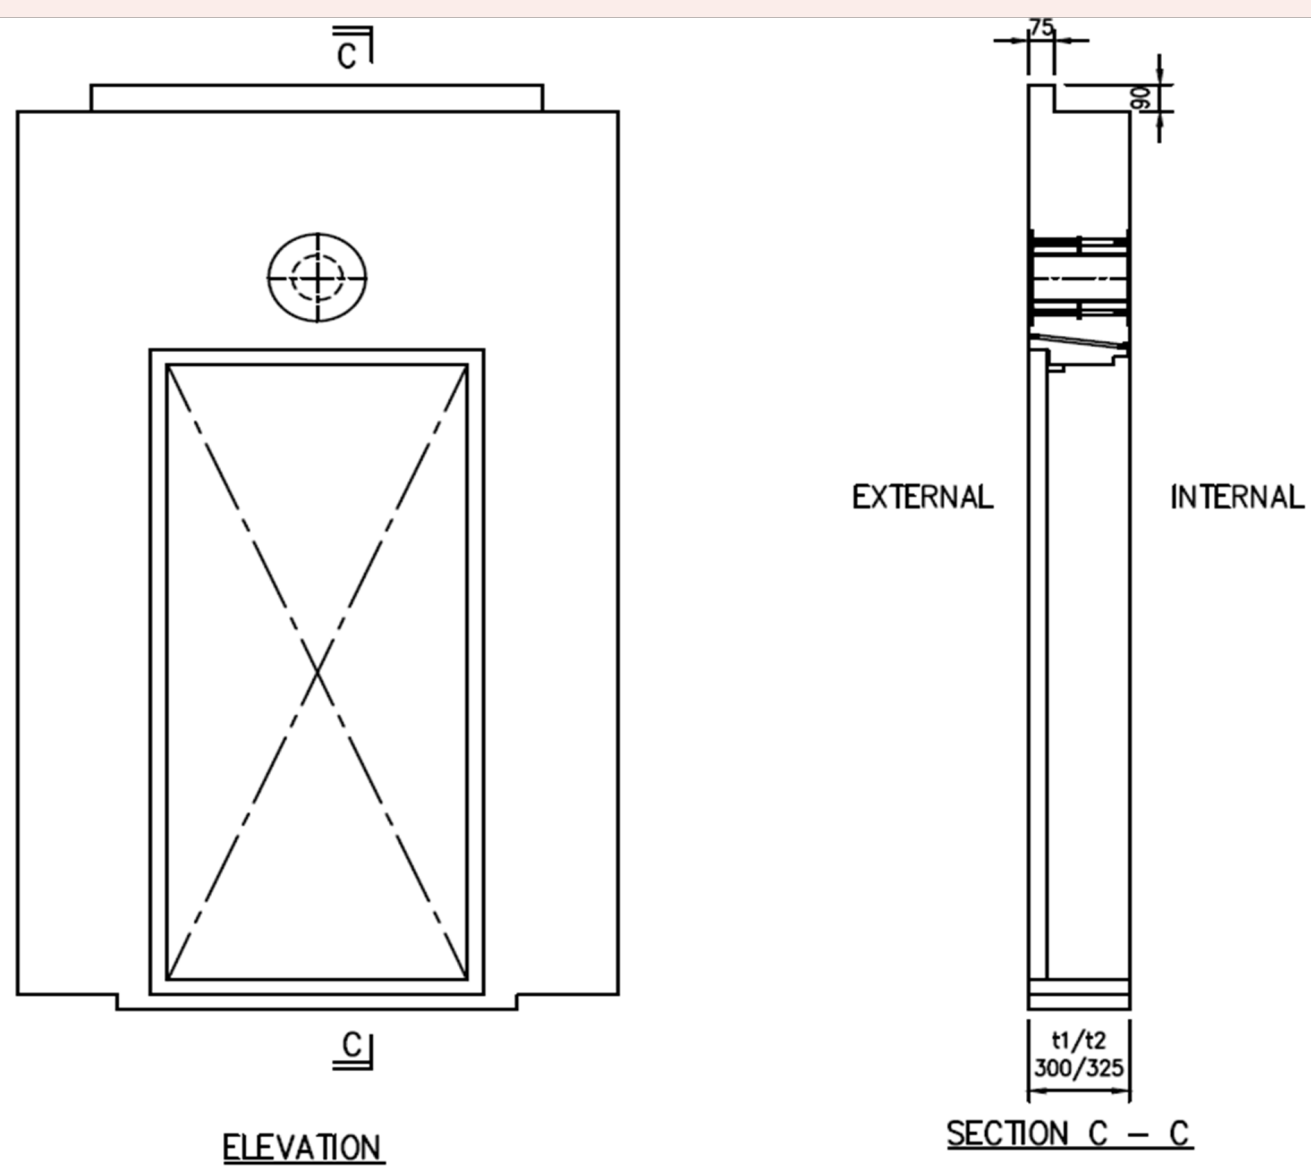


FIGURE 3.5.6.1(c): BLAST DOOR AND VENTILATION SLEEVE

b. To facilitate de-moulding of the precast S/C SS, the hollow cores shall be tapered all round along its height as shown in FIGURE 3.5.6.1(d).

Figures & Tables


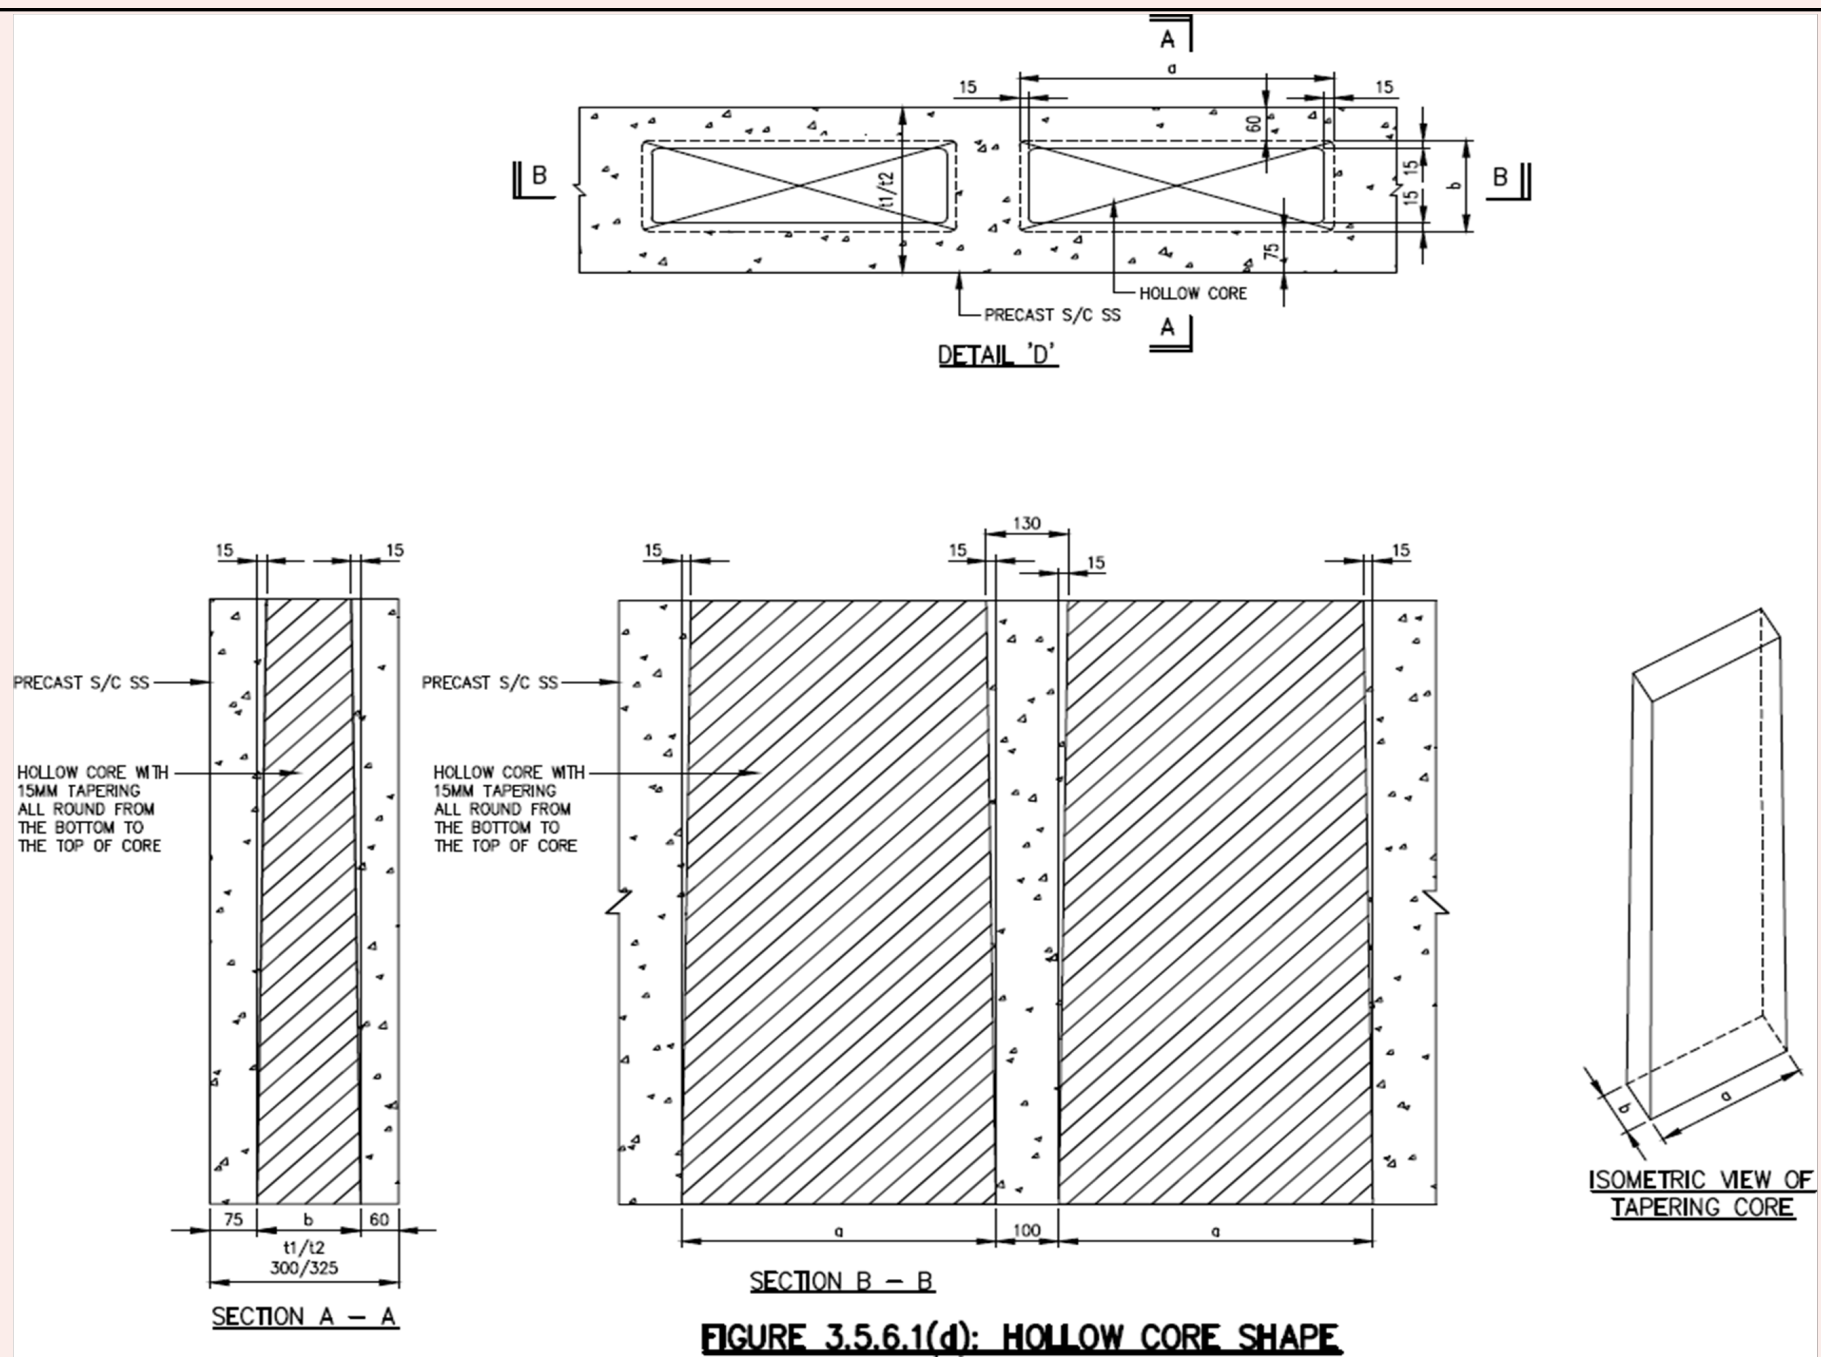


FIGURE 3.5.6.1(d): HOLLOW CORE SHAPE

i. FIGURE 3.5.6.1(d): Hollow Core Shape.

Figures & Tables

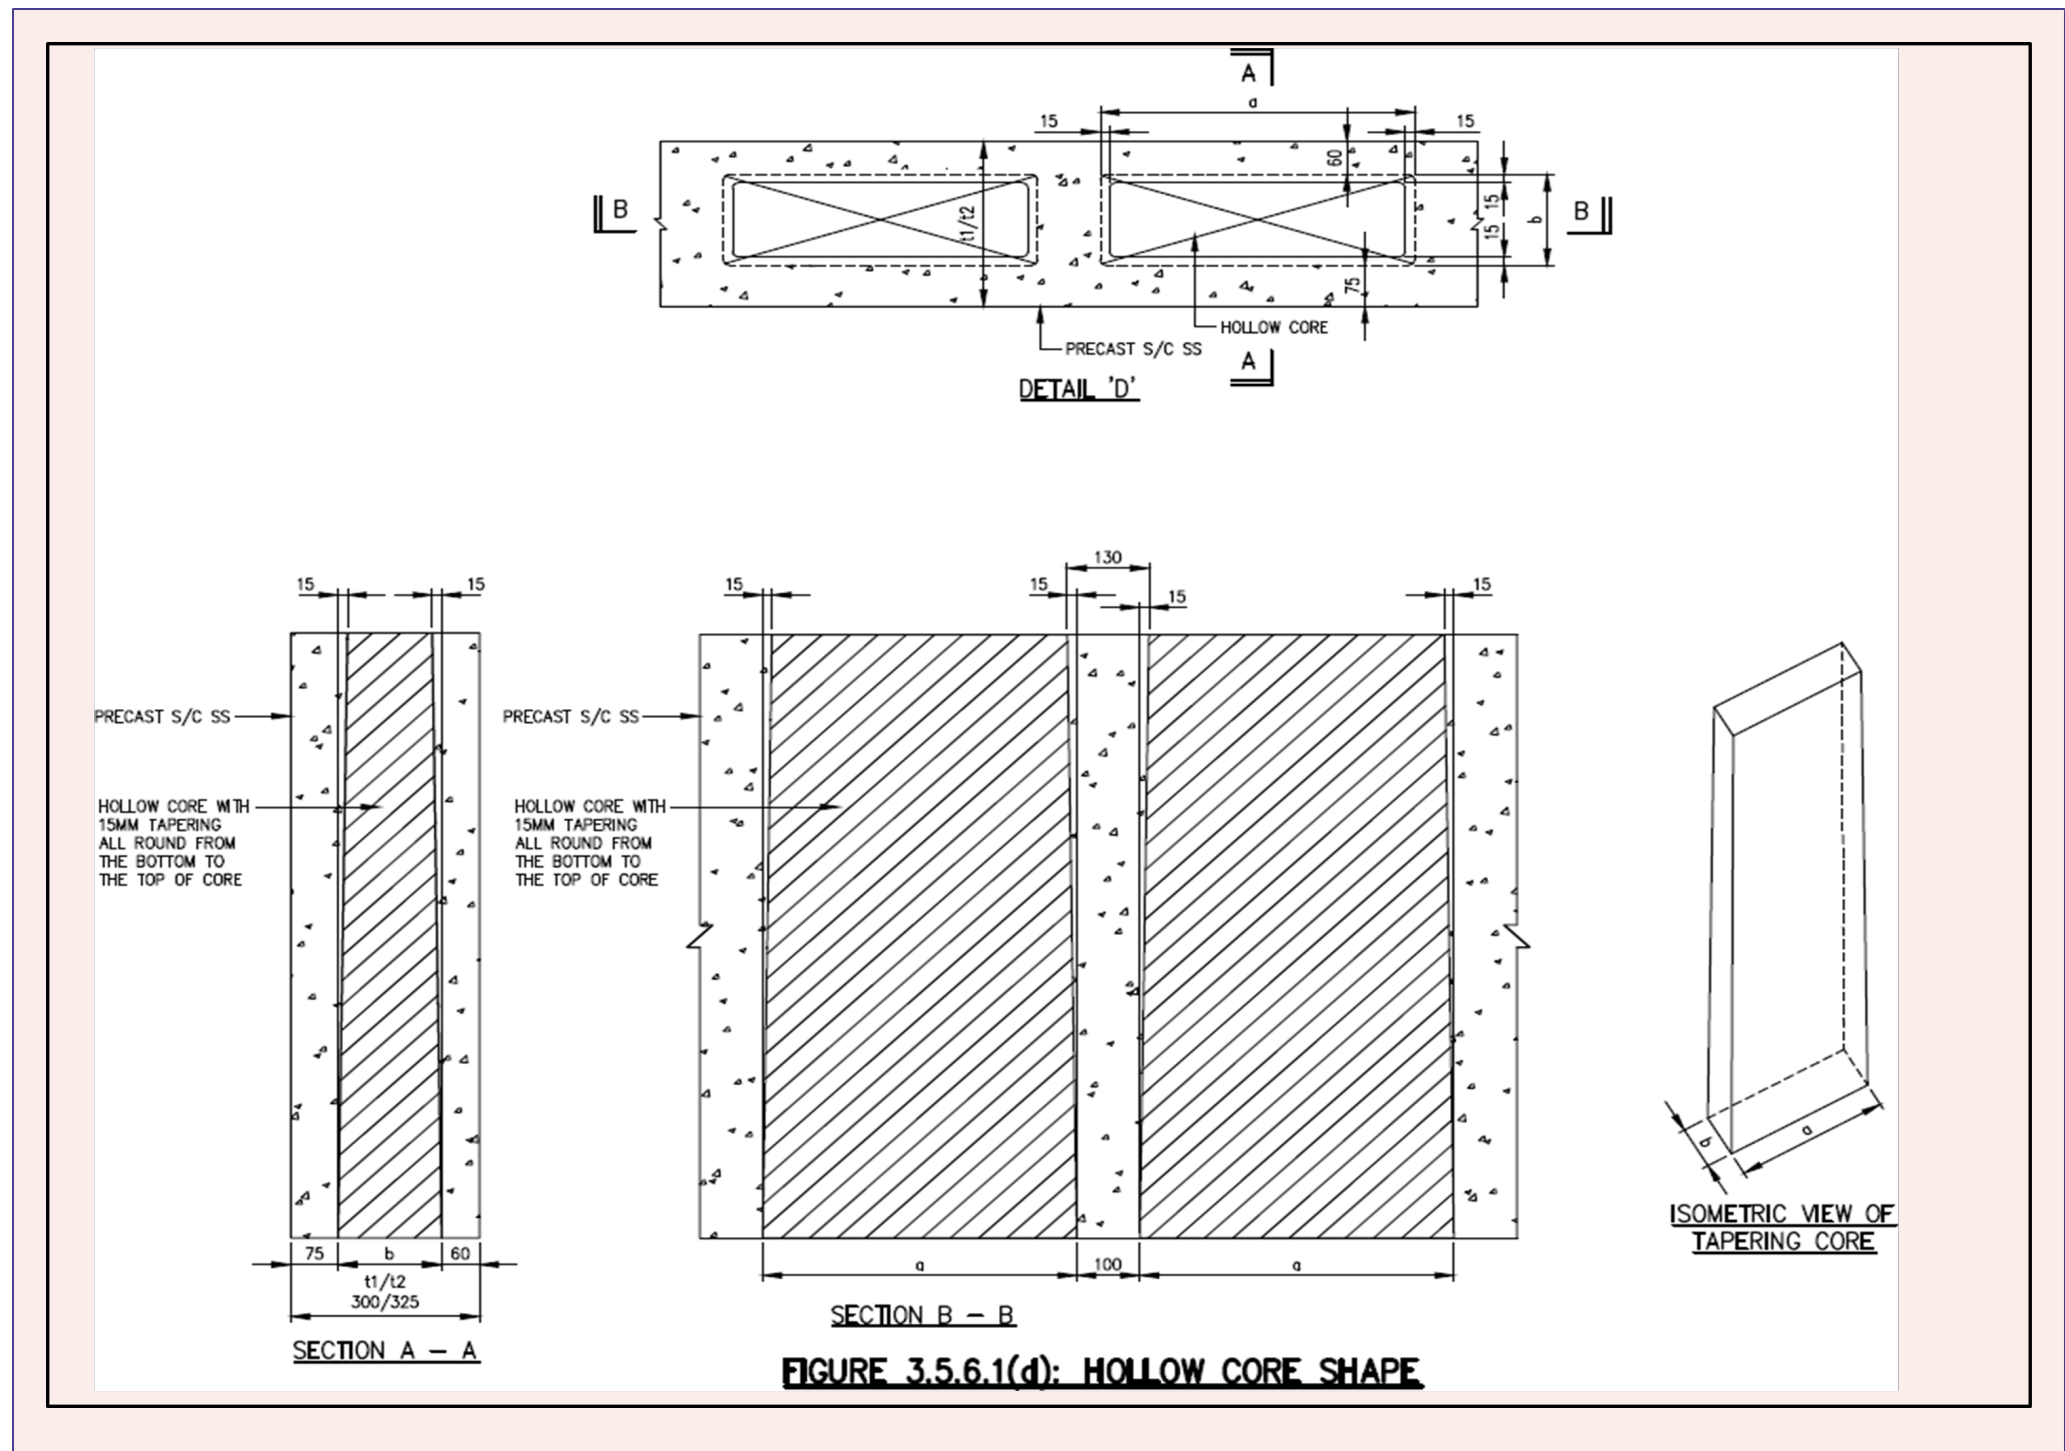

c. Where possible, hollow core of maximum 500mm long shall be adopted to achieve lighter precast SSS components for ease of handling and achievement of maximum vertical continuity.

3.5.6.2 Reinforcement Requirements

- a. The reinforcements of precast S/C SS shall be welded steel fabric mesh and hot rolled steel bars. Reinforcements specified for precast slab components, walls and hollow cores of the precast SSS refer to minimum bar diameters and maximum spacing in both directions.
- b. In the precast S/C SS walls, reinforcements shall be welded steel fabric mesh of minimum H13 at 100mm c/c spacing or minimum H16 at 100mm c/c spacing depending on the clear height of staircase storey shelter as specified in [Clause 3.4.2.1](#) and [TABLE 3.4.2.1](#).

Figures & Tables		
TABLE 3.4.2.1 : MINIMUM REINFORCEMENTS OF SS OR NS WALLS		
TABLE 3.4.2.1 : MINIMUM REINFORCEMENTS OF SS OR NS WALLS		
SS/NS Clear Height (mm)	Reinforcement at both internal and external face of wall (both directions)	Shear Links (both directions)
2400 < Ht ≤ 3400	H13 - 100 c/c	H8 - 600 c/c
3400 < Ht ≤ 3900	H16 - 100 c/c	H8 600 c/c

c. The details of reinforcements for precast S/C SS, the rib of precast S/C SS, connection between precast S/C SS components, S/C SS door frame, blast hatch, electrical fixtures, trimmer bars around ventilation sleeve openings, at door recess and hollow cores are shown in [FIGURE 3.5.6.2\(a\)\(i\)](#) to [3.5.6.2\(k\)](#):

3.5.6.2 Reinforcement Requirements	
FIGURE 3.5.6.2(a)(i)	Plan of Precast S/C SS (Component 'A')
FIGURE 3.5.6.2(a)(ii)	Plan of Precast S/C SS Wall with Reinforcement Details at Blast Hatch Opening (S/C SS Component 'A')
FIGURE 3.5.6.2(a)(iii)	Plan of Precast S/C SS Wall with Reinforcement Details above Blast Hatch Opening (S/C SS Component 'A')
FIGURE 3.5.6.2(a)(iv)	Section D-D (S/C SS Component 'A')

FIGURE 3.5.6.2(a)(v)	Section E-E (S/C SS Component 'A')
FIGURE 3.5.6.2(a)(vi)	Section F-F (S/C SS Component 'A')
FIGURE 3.5.6.2(a)(vii)	Section G-G (S/C SS Component 'A')
FIGURE 3.5.6.2(a)(viii)	Section H-H (S/C SS Component 'A')
FIGURE 3.5.6.2(b)(i)	Plan of Precast S/C SS (S/C SS Component 'B')
FIGURE 3.5.6.2(b)(ii)	Plan of Precast S/C SS Wall with Reinforcement Details (S/C SS Component 'B')
FIGURE 3.5.6.2(b)(iii)	Internal Elevation View 'B' (S/C SS Component 'B')
FIGURE 3.5.6.2(b)(iv)	Section K1-K1 (S/C SS Component 'B')
FIGURE 3.5.6.2(b)(v)	Section K2-K2 (S/C SS Component 'B')
FIGURE 3.5.6.2(b)(vi)	Section L-L (S/C SS Component 'B')
FIGURE 3.5.6.2(c)(i)	Plan of Precast S/C SS (Component 'C')
FIGURE 3.5.6.2(c)(ii)	Plan of Precast S/C SS Wall with Reinforcement Details (S/C SS Component 'C')
FIGURE 3.5.6.2(c)(iii)	Section S-S (S/C SS Component 'C')
FIGURE 3.5.6.2(c)(iv)	Section T-T (S/C SS Component 'C')
FIGURE 3.5.6.2(c)(v)	Section U-U at Ventilation Sleeve (S/C SS Component 'C')
FIGURE 3.5.6.2(c)(vi)	Section X-X at Ventilation Sleeve (S/C SS Component 'C')
FIGURE 3.5.6.2(c)(vii)	Section V-V (S/C SS Component 'C')
FIGURE 3.5.6.2(c)(viii)	Section W-W (S/C SS Component 'C')
FIGURE 3.5.6.2(d)	Reinforcement details of Rib
FIGURE 3.5.6.2(e)	Details of Reinforcements near Door Frame and at Electrical Fixtures on Internal Face of Precast SSS
FIGURE 3.5.6.2(f)	Details of Trimmer Bars for Ventilation Sleeve
FIGURE 3.5.6.2(g)	Details of Trimmer Bars for Wall Recess for Precast S/C SS Door Handle
FIGURE 3.5.6.2(h)	Electrical Fixtures on External Face of Precast S/C SS
FIGURE 3.5.6.2(i)	Reinforcements in Hollow Cores
FIGURE 3.5.6.2(j))	Reinforcements in Hollow Cores of Precast S/C SS
FIGURE 3.5.6.2(k)	Reinforcements Lapping in Hollow Cores

Figures & Tables

FIGURE 3.5.6.2(a)(i) && FIGURE 3.5.6.2(a)(ii)

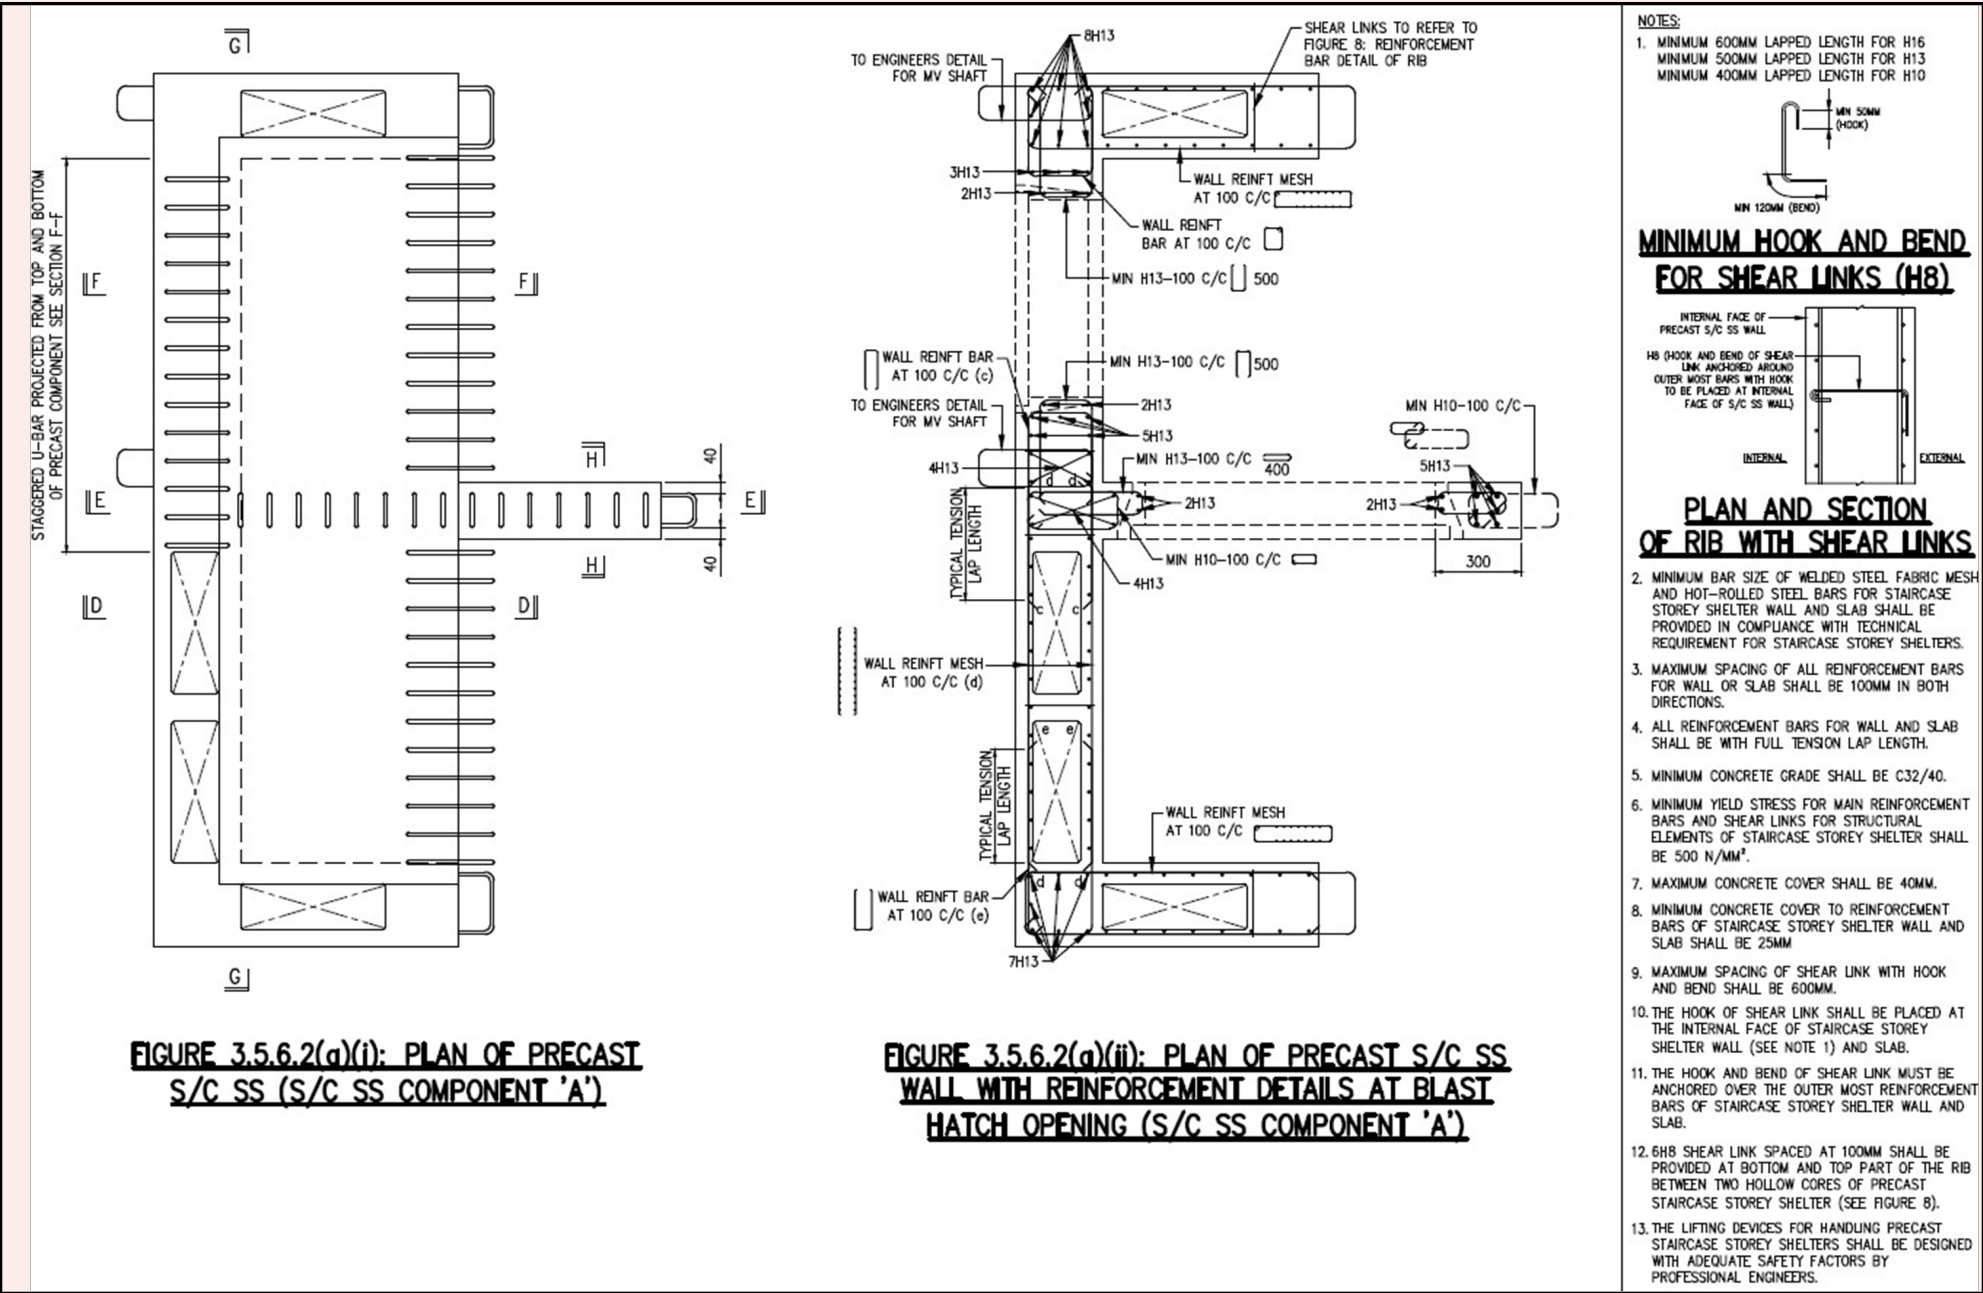


FIGURE 3.5.6.2(a)(iii), FIGURE 3.5.6.2(a)(iv) && FIGURE 3.5.6.2(a)(v)

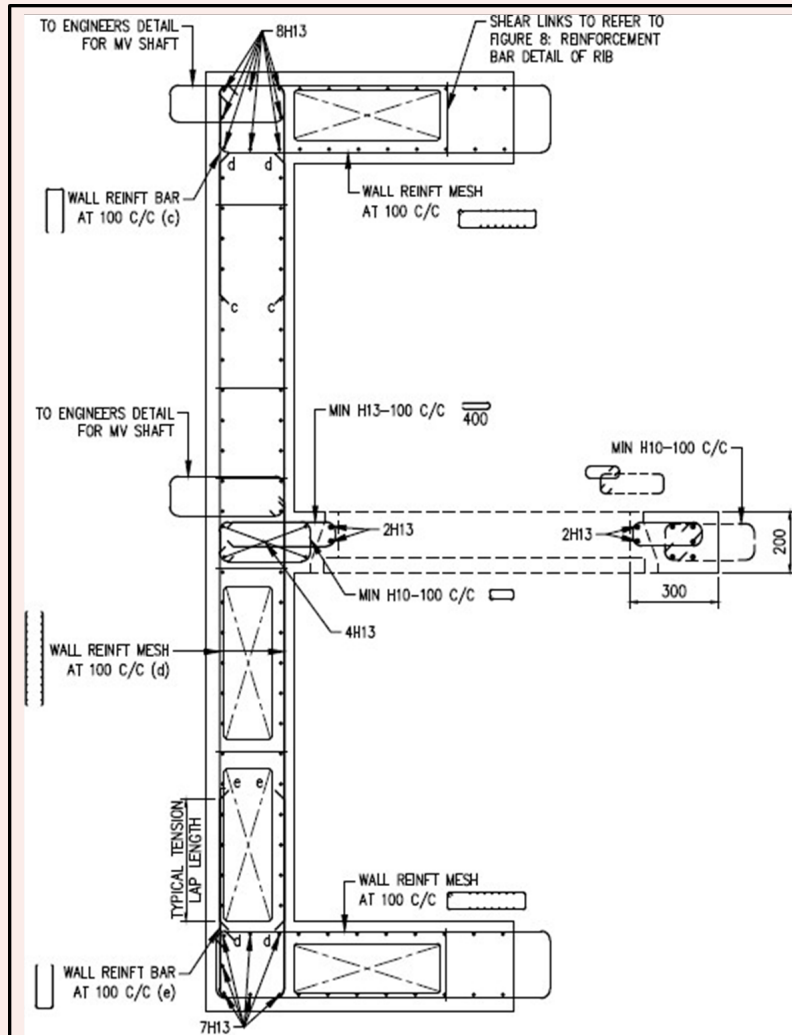


FIGURE 3.5.6.2(a)(iii): PLAN OF PRECAST S/C SS WALL WITH REINFORCEMENT DETAILS ABOVE BLAST HATCH OPENING (S/C SS COMPONENT 'A')

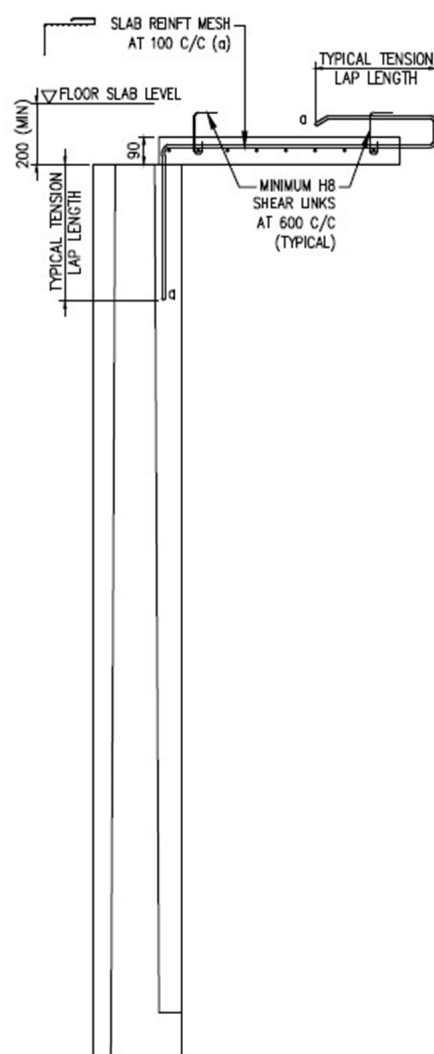


FIGURE 3.5.6.2(a)(iv): SECTION D-D (S/C SS COMPONENT 'A')

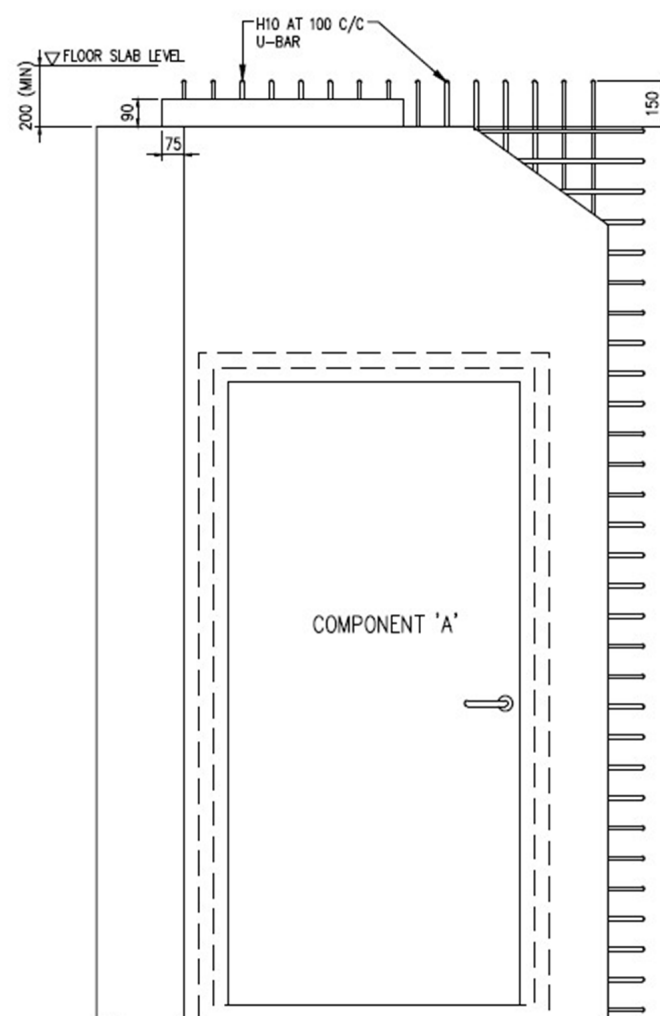


FIGURE 3.5.6.2(a)(v): SECTION E-E (S/C SS COMPONENT 'A')

FIGURE 3.5.6.2(a)(vi)

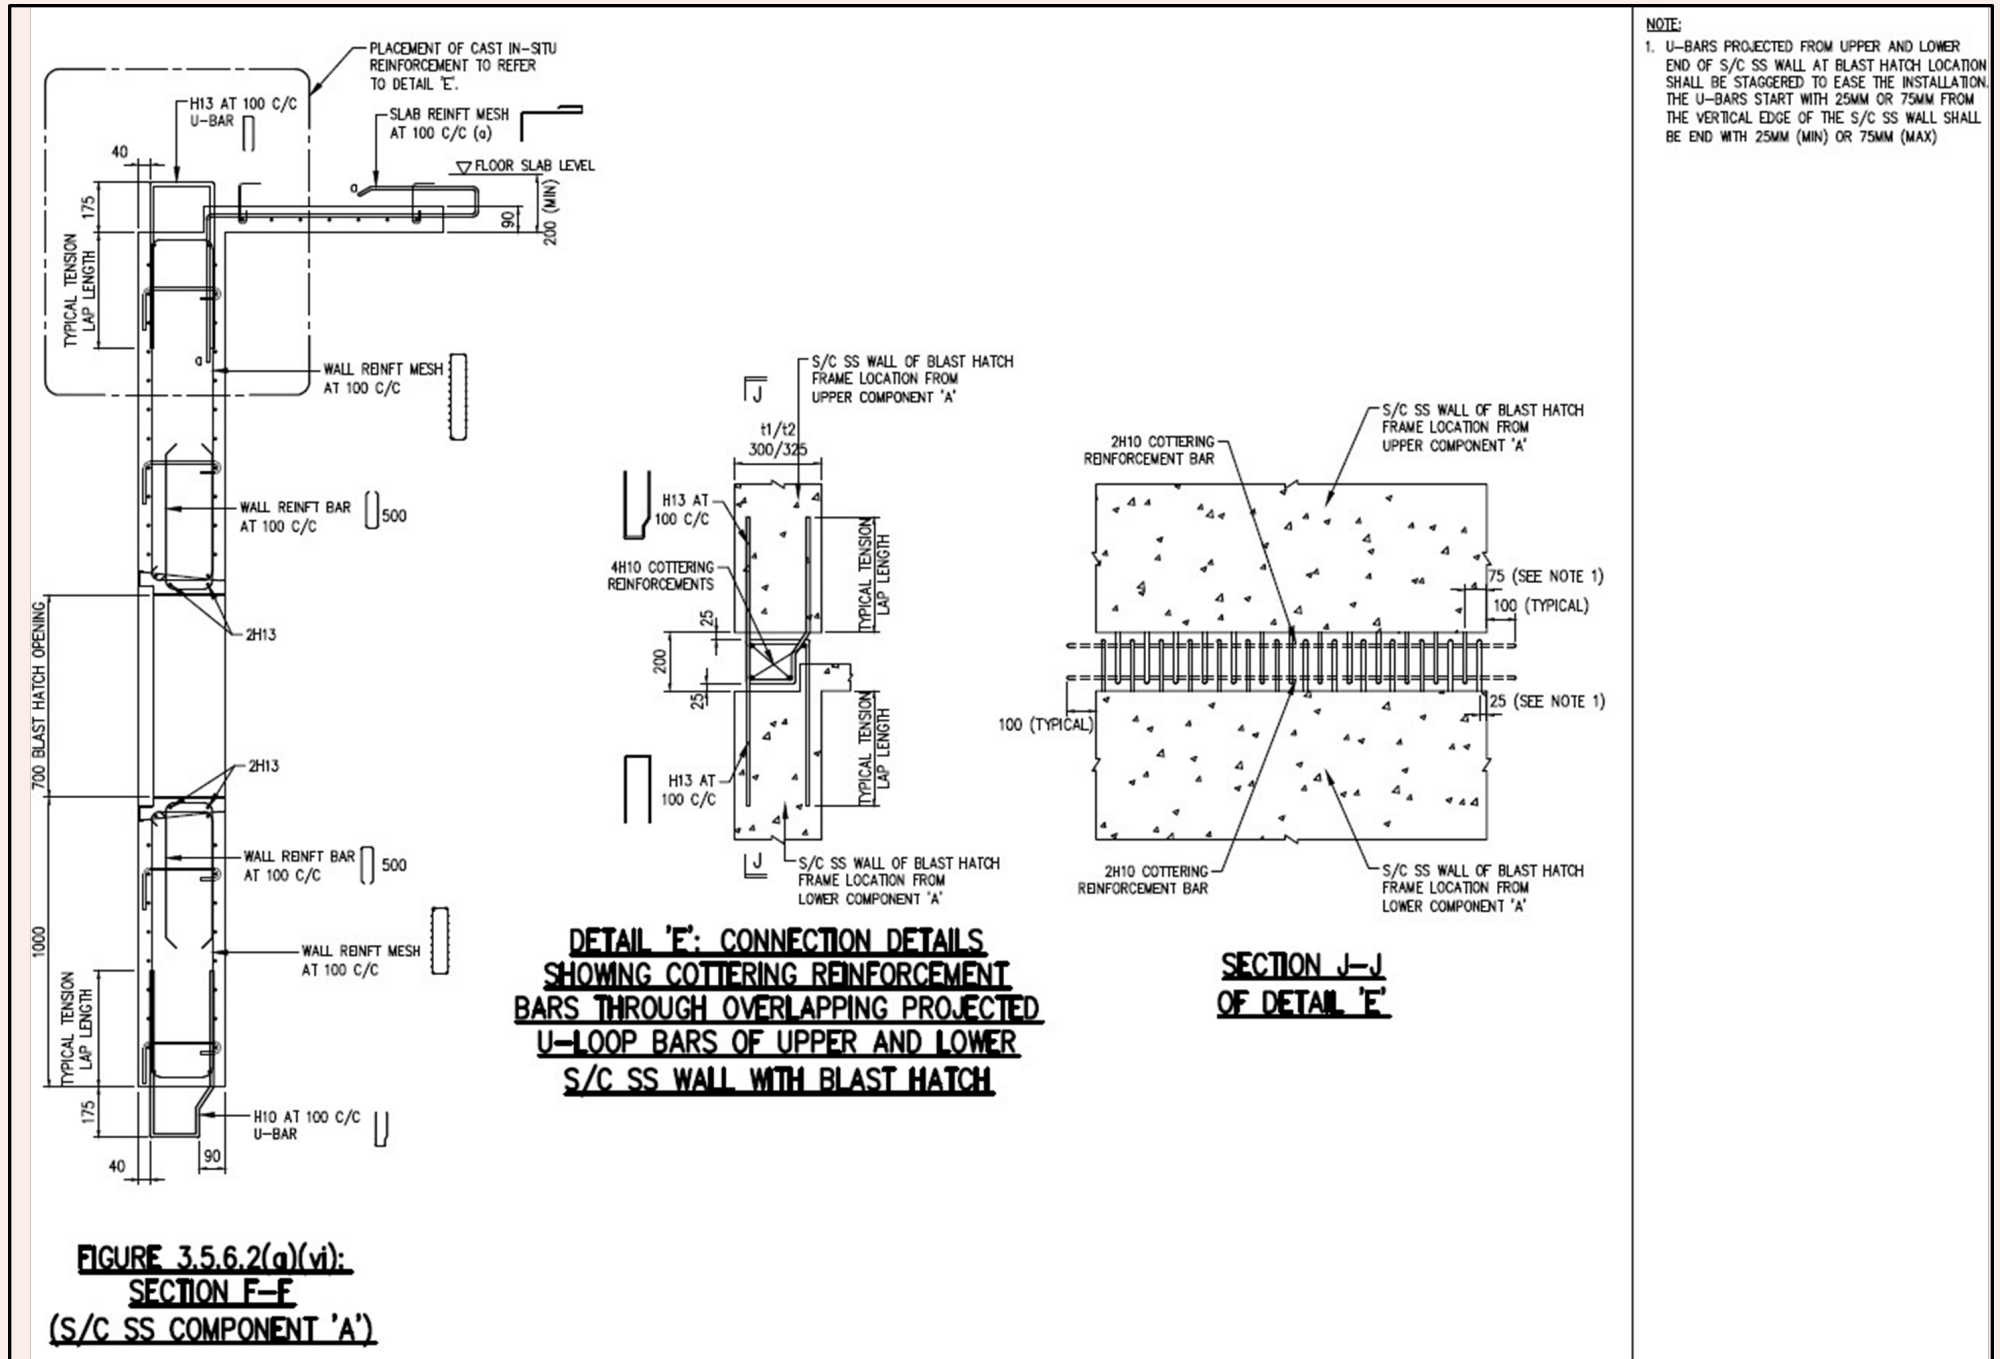


FIGURE 3.5.6.2(a)(vii) && FIGURE 3.5.6.2(a)(viii)

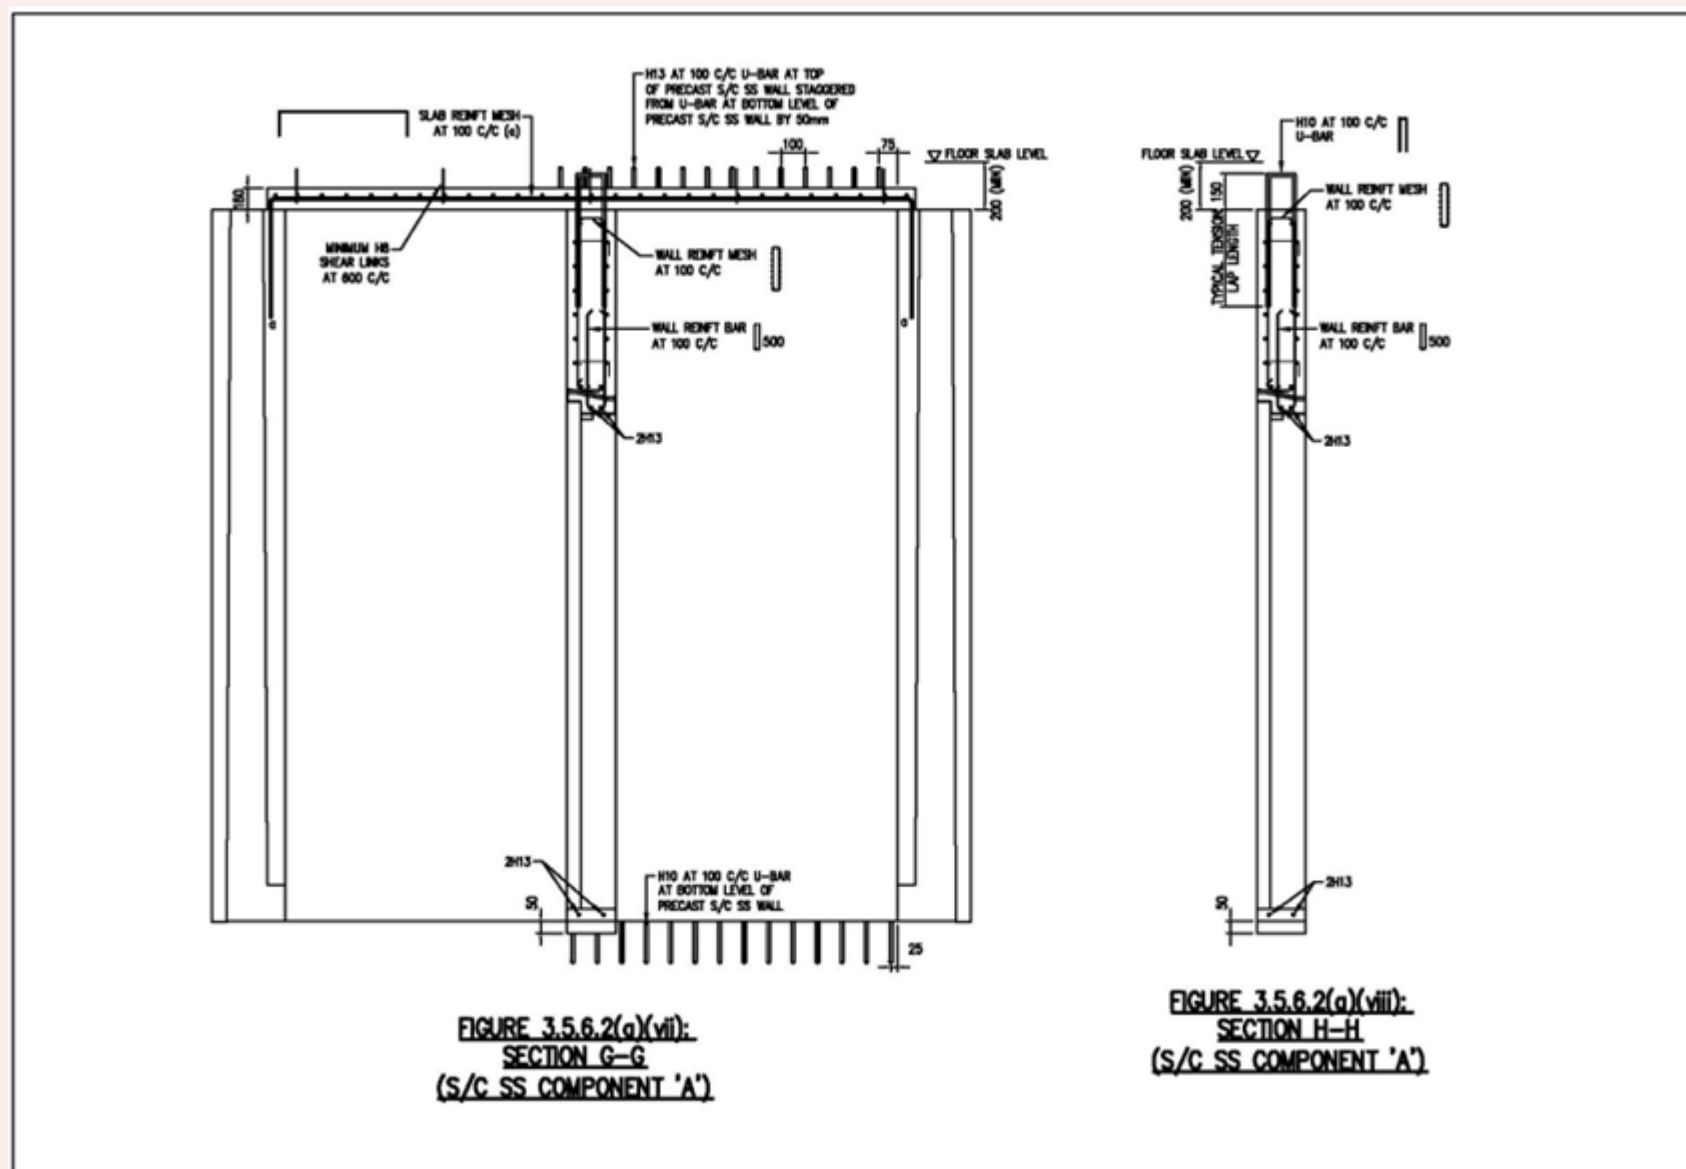


FIGURE 3.5.6.2(b)(i) && FIGURE 3.5.6.2(b)(ii)

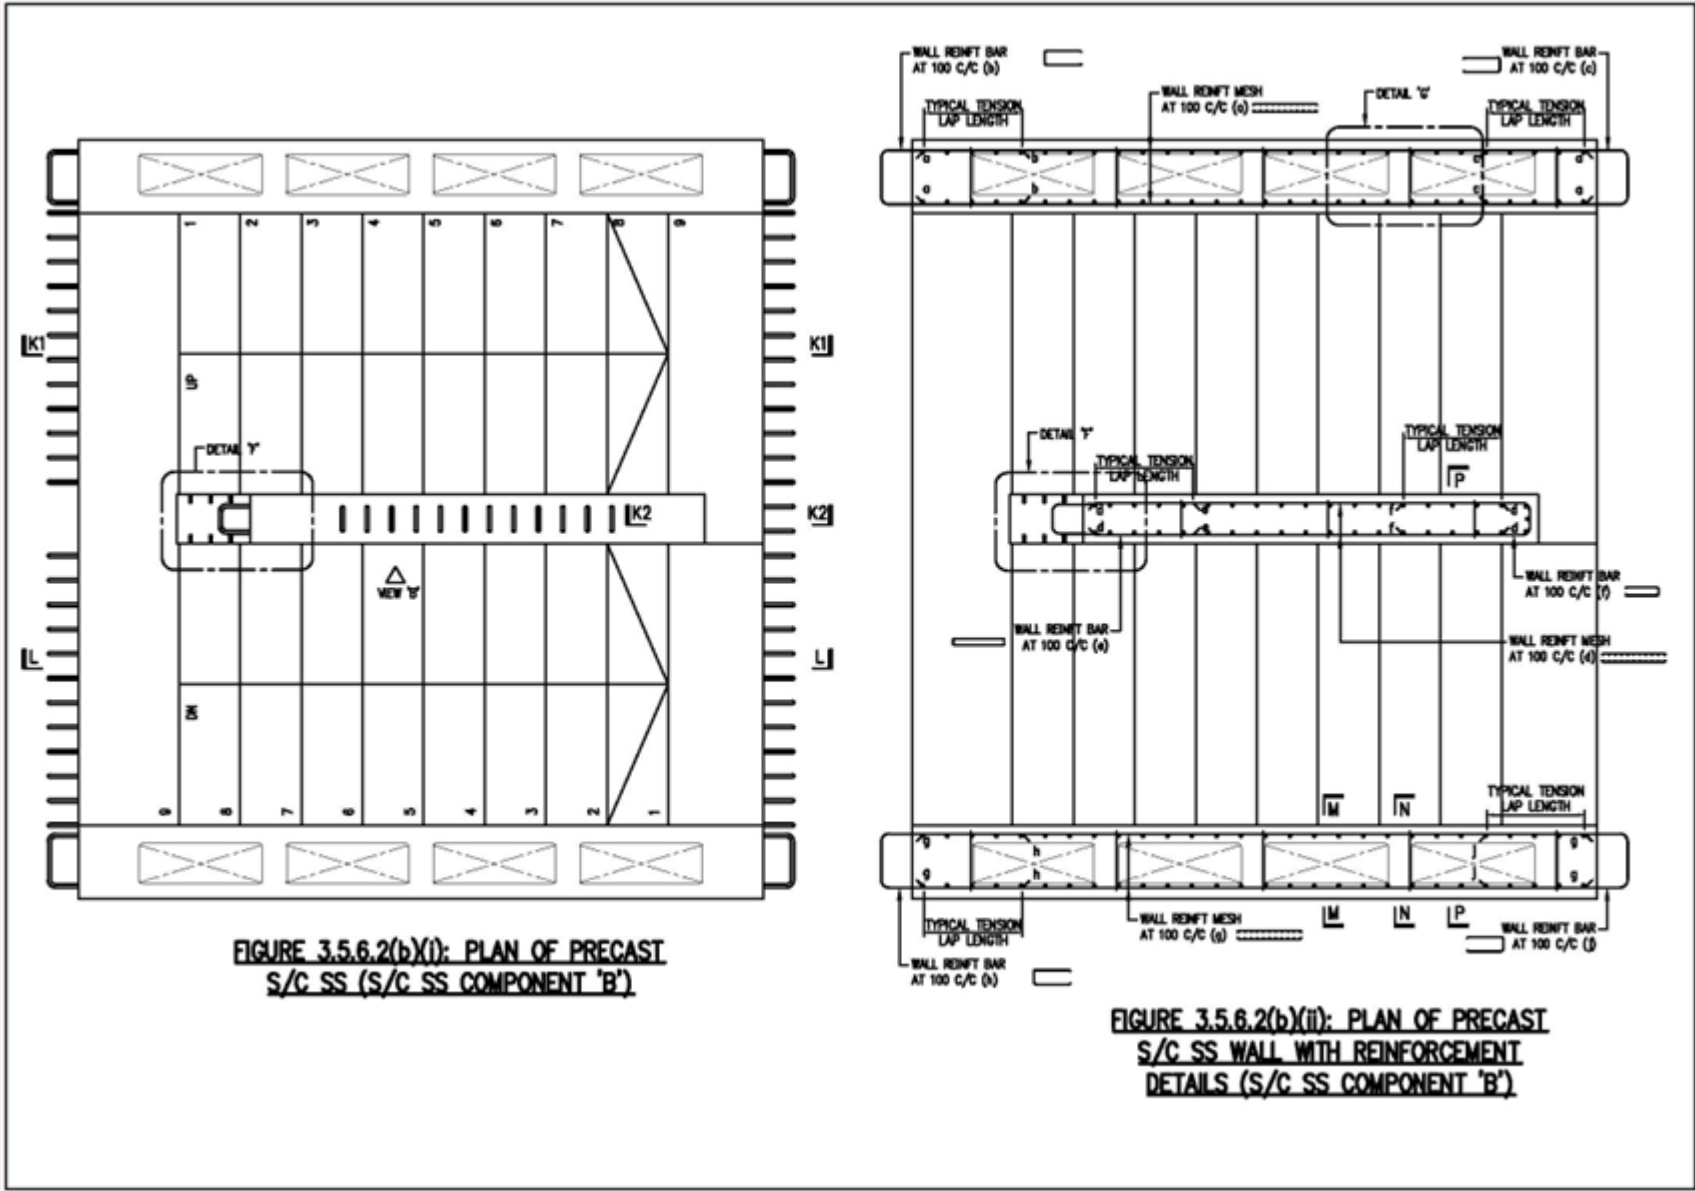

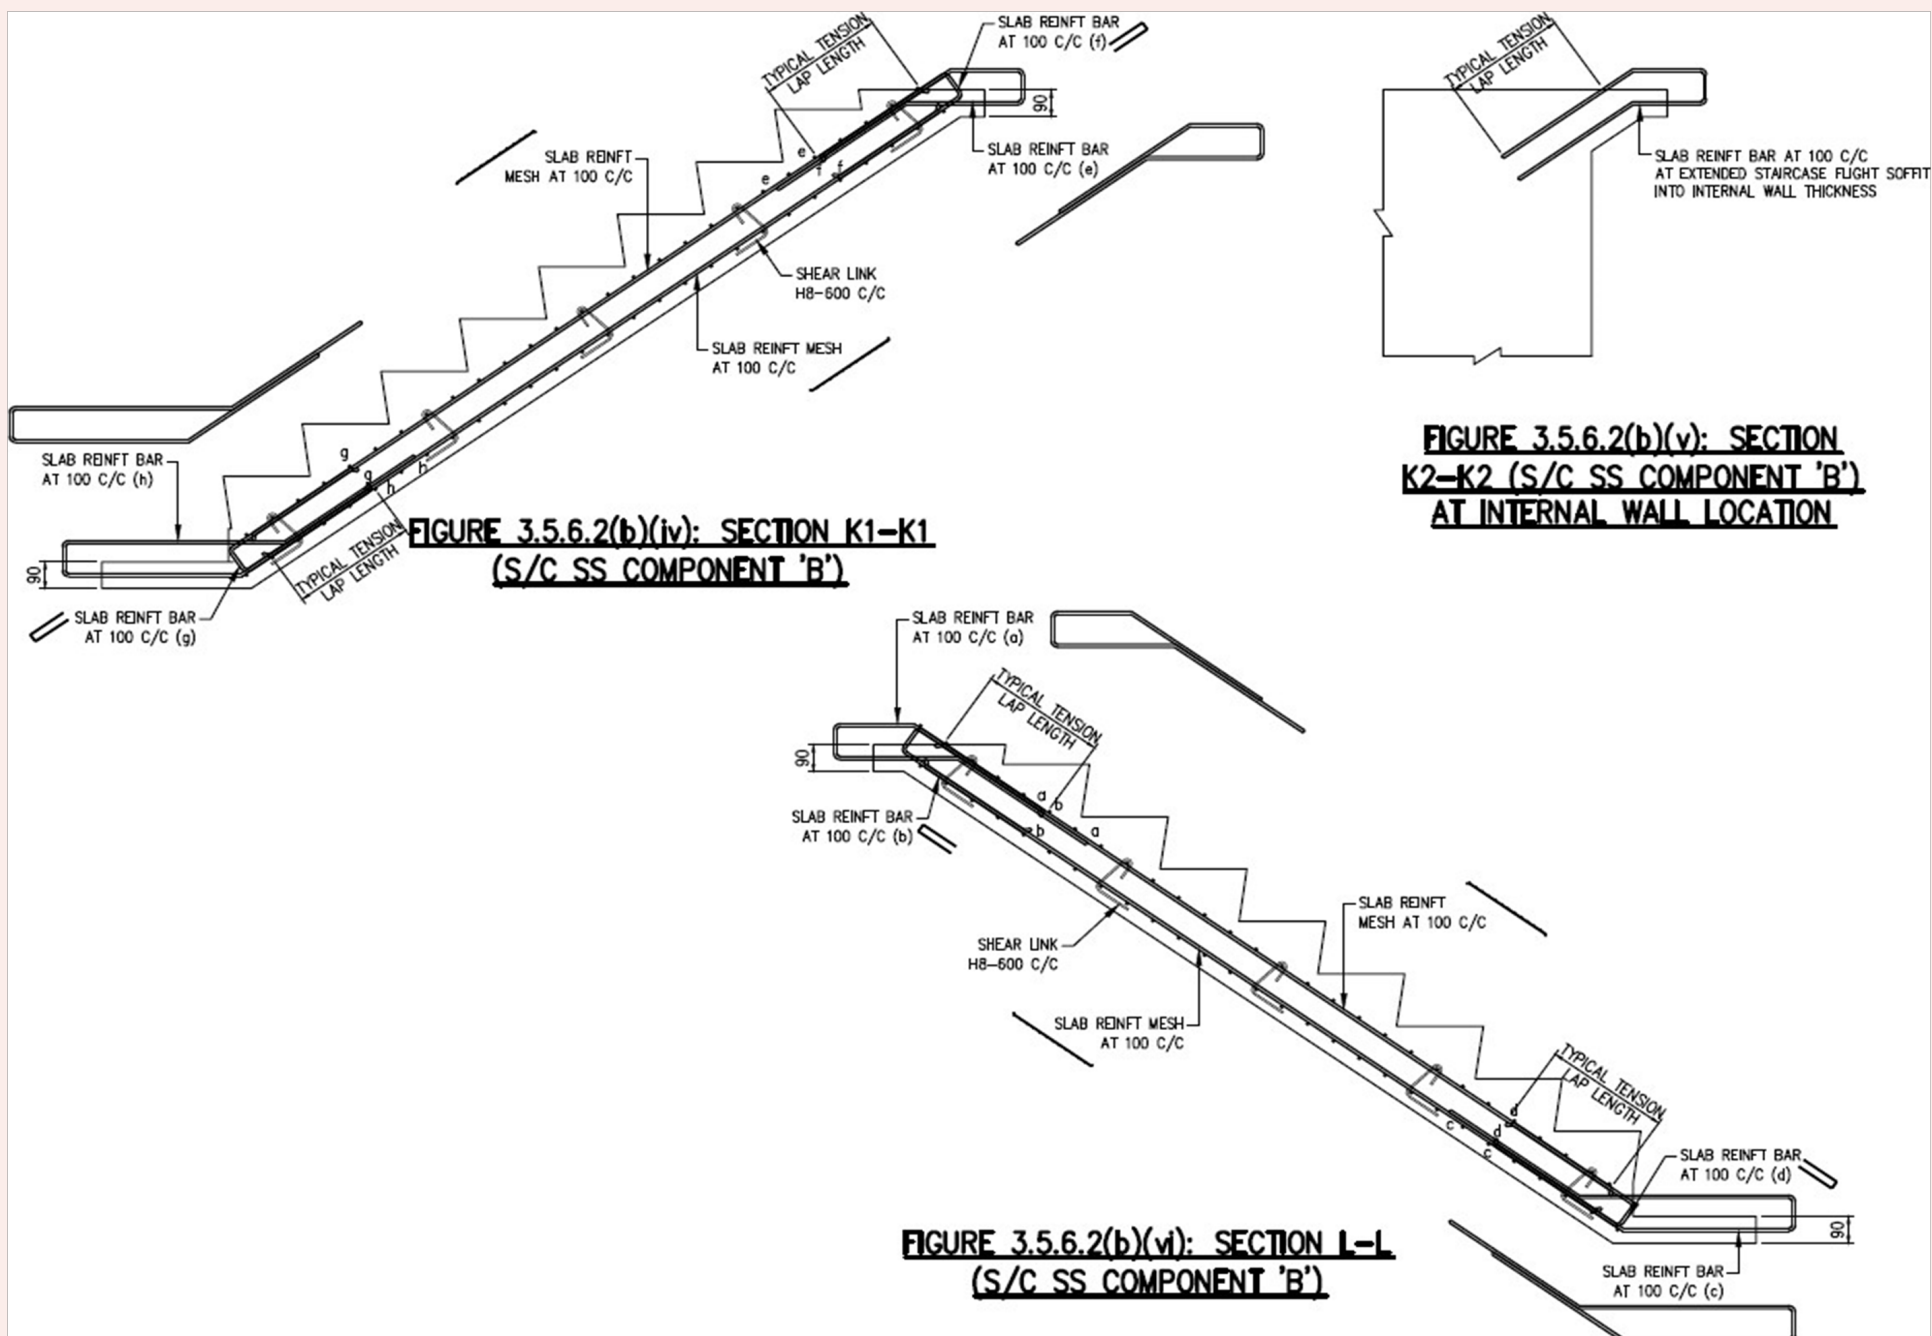


FIGURE 3.5.6.2(b)(iii)





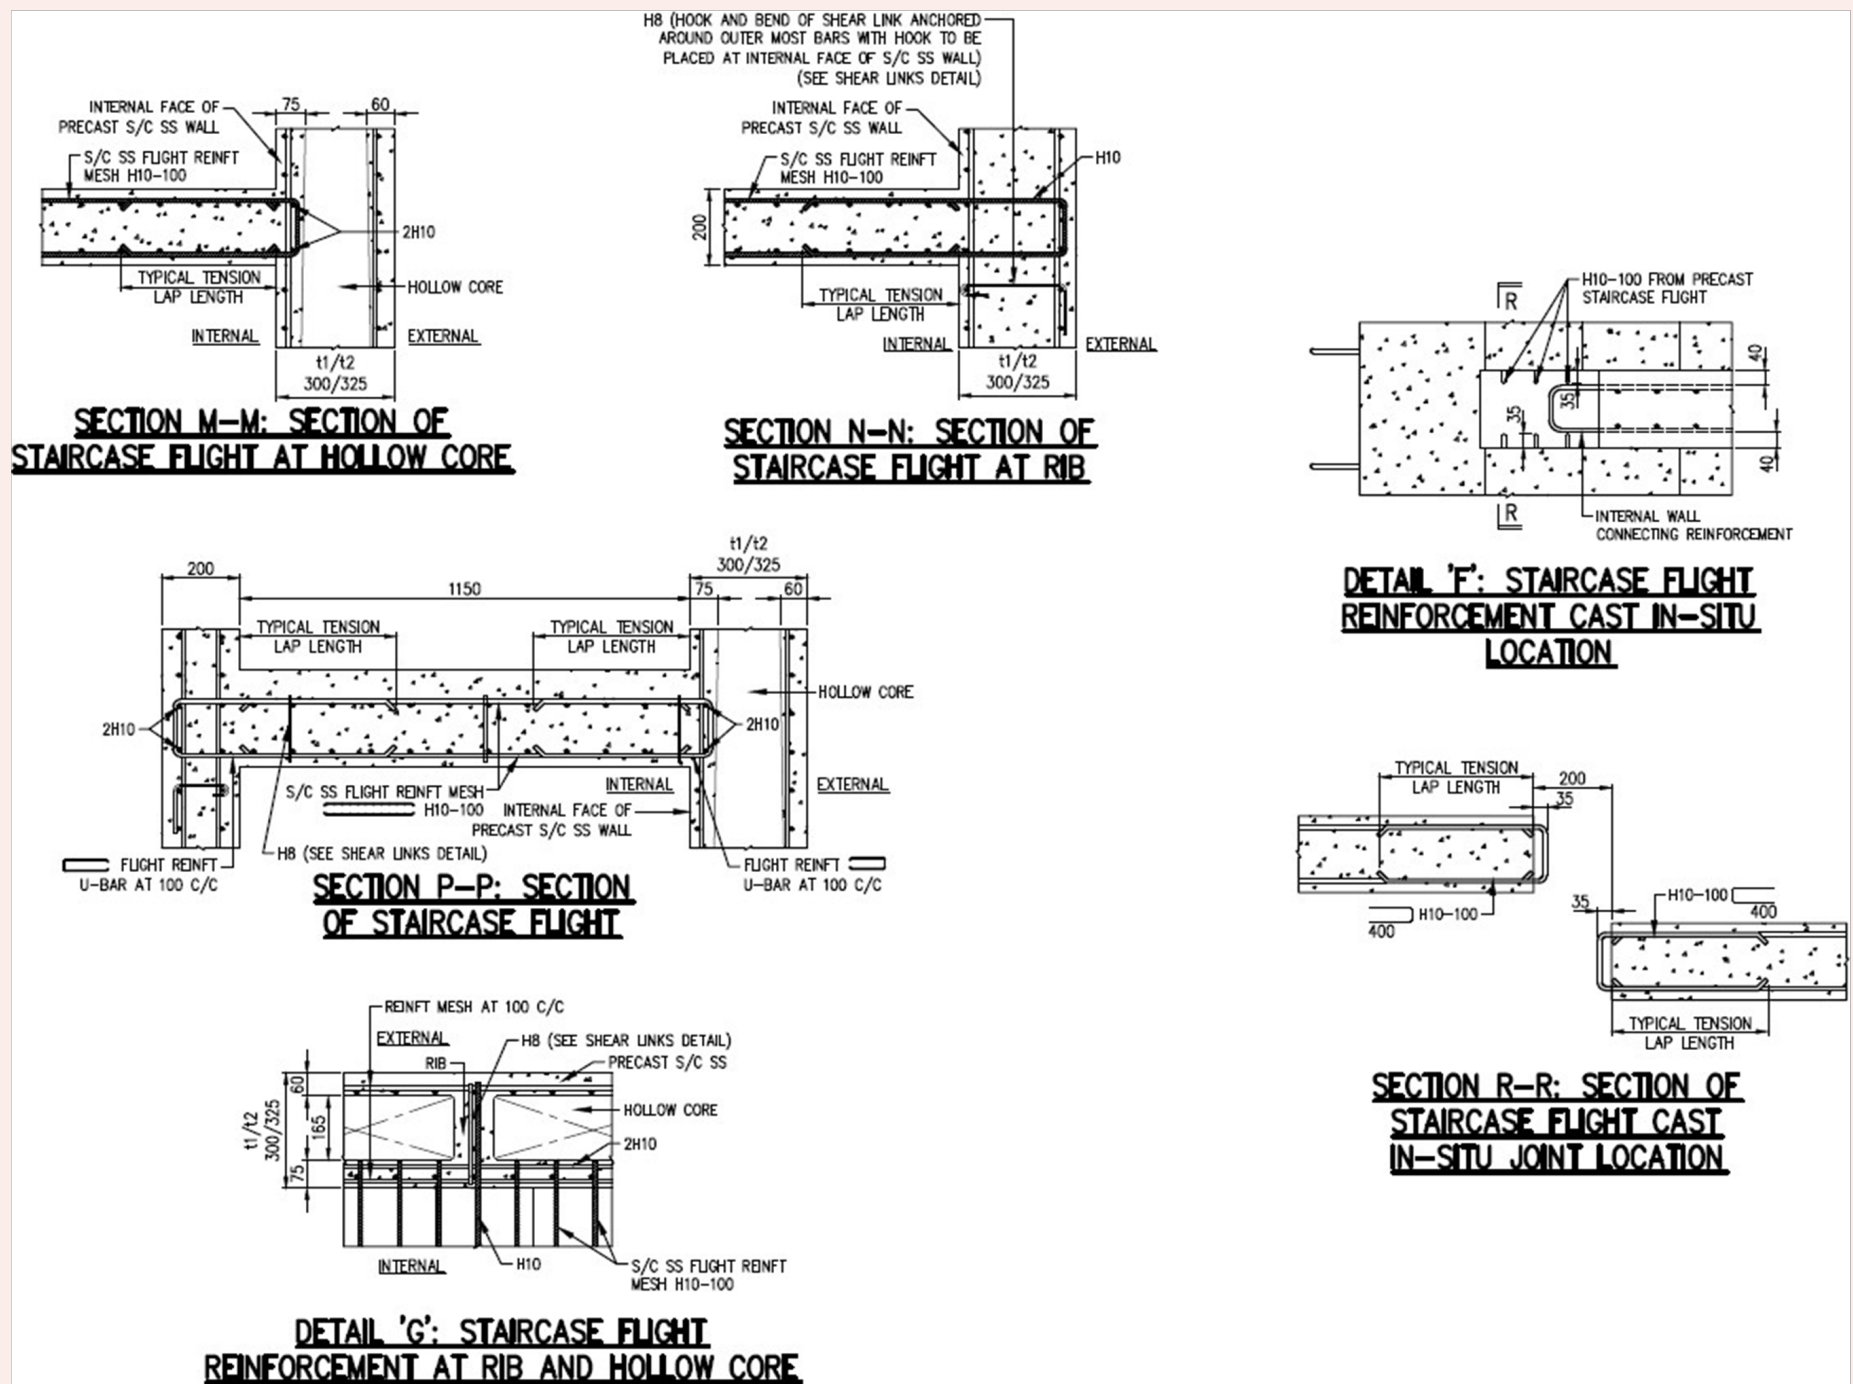


FIGURE 3.5.6.2(c)(i) & FIGURE 3.5.6.2(c)(ii)

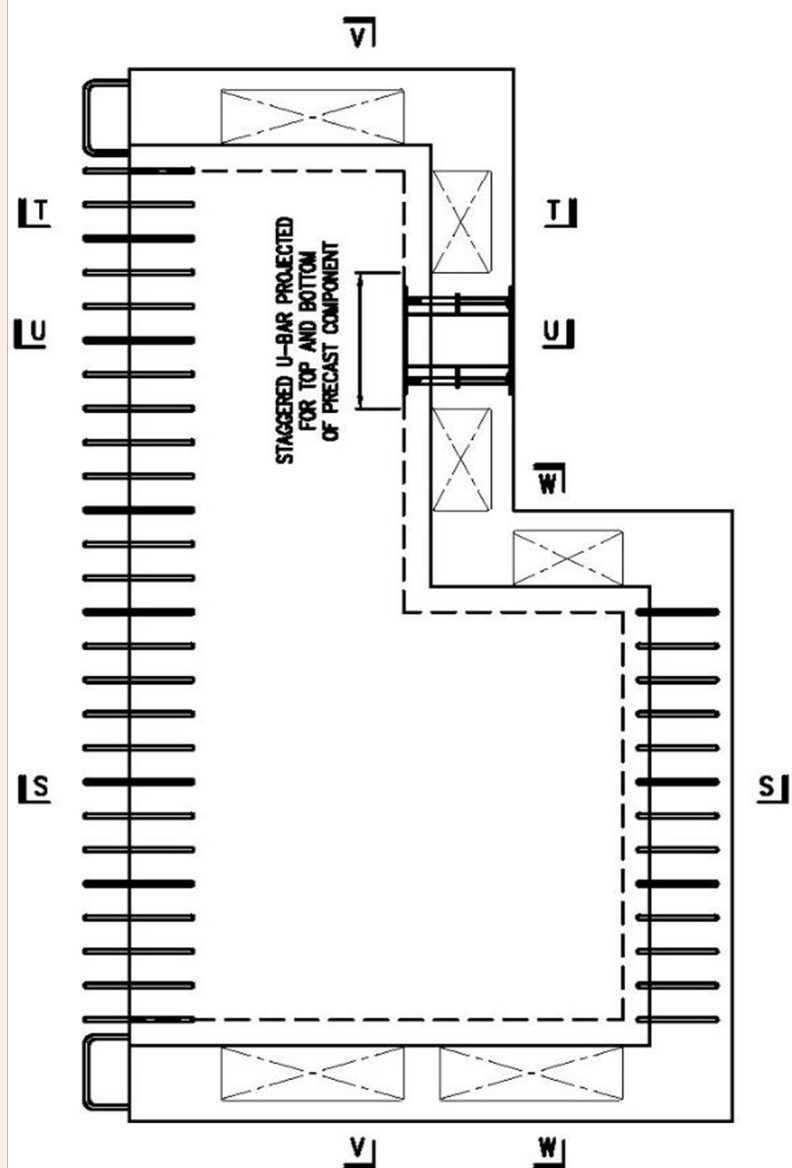


FIGURE 3.5.6.2(c)(i): PLAN OF PRECAST S/C SS (S/C SS COMPONENT 'C')



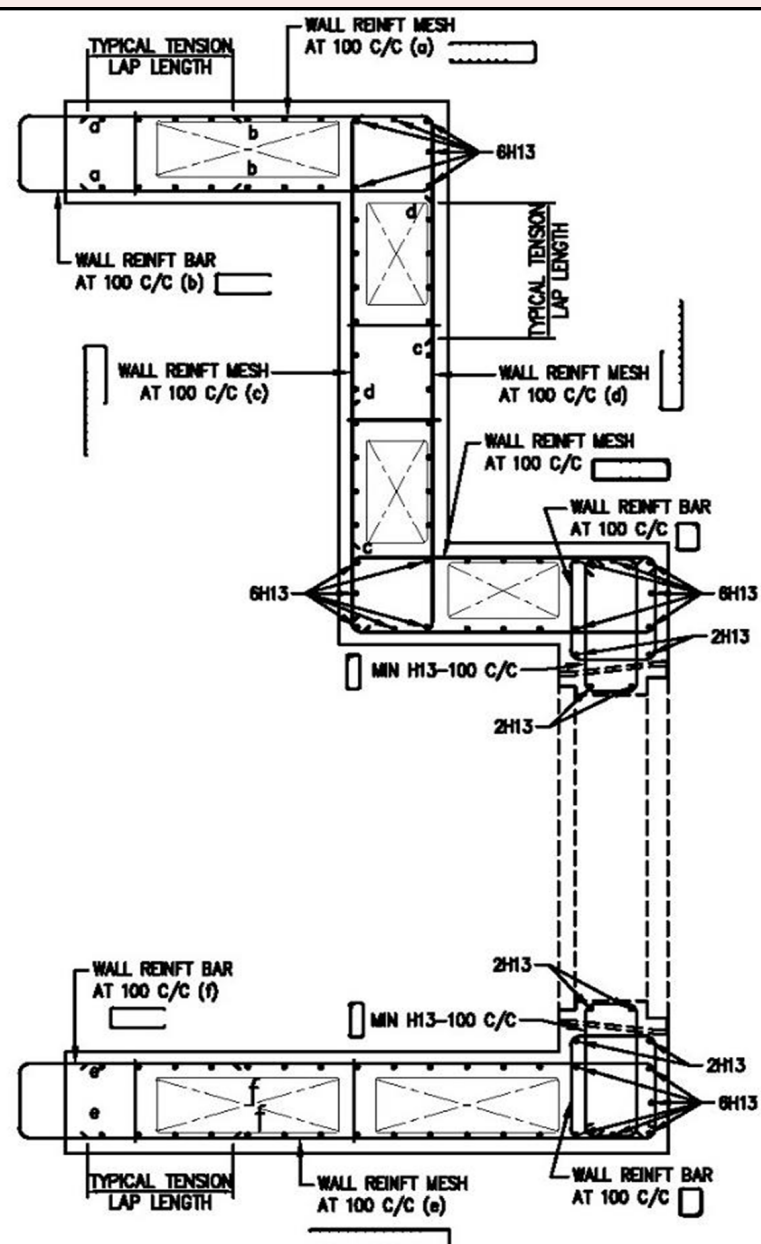


FIGURE 3.5.6.2(c)(ii): PLAN OF PRECAST S/C SS WALL WITH REINFORCEMENT DETAILS (S/C SS COMPONENT 'C')

FIGURE 3.5.6.2 (c)(iii) & FIGURE (c)(iv)

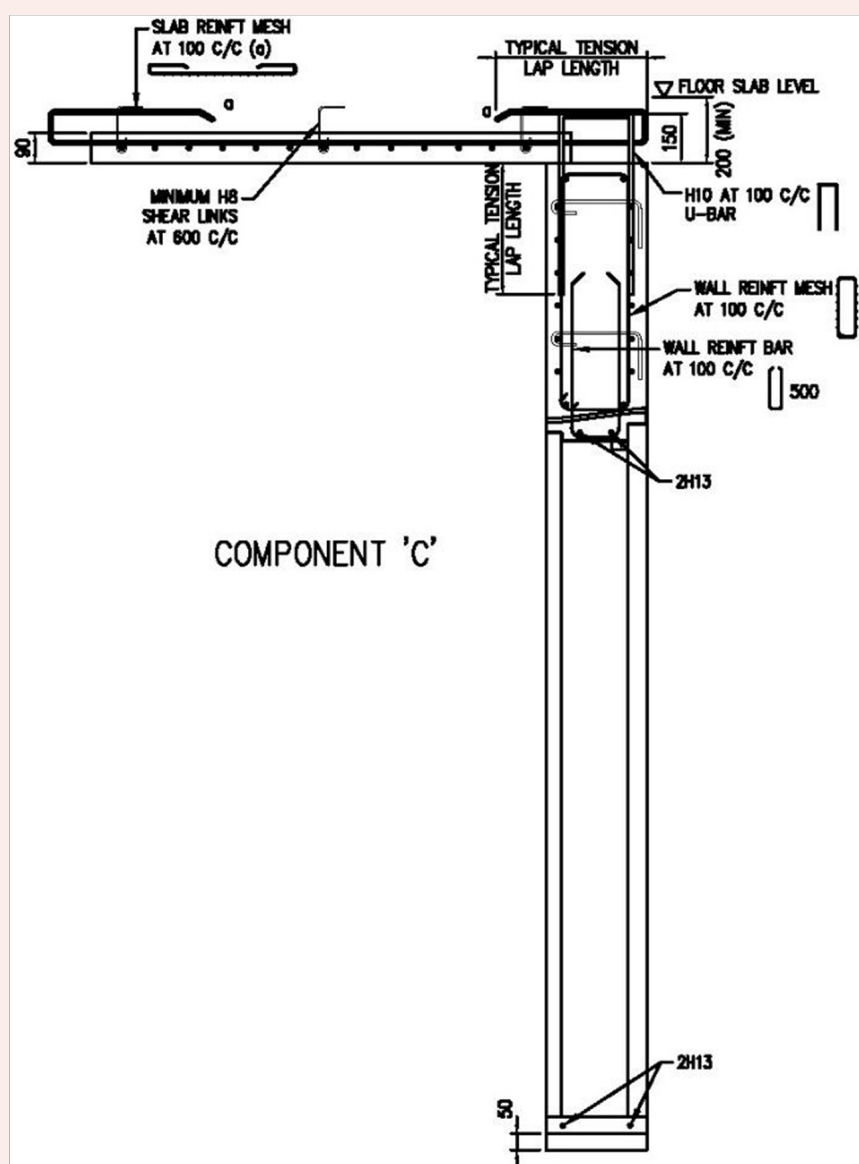


**FIGURE 3.5.6.2(c)(iii): SECTION S-S
(S/C SS COMPONENT 'C')**

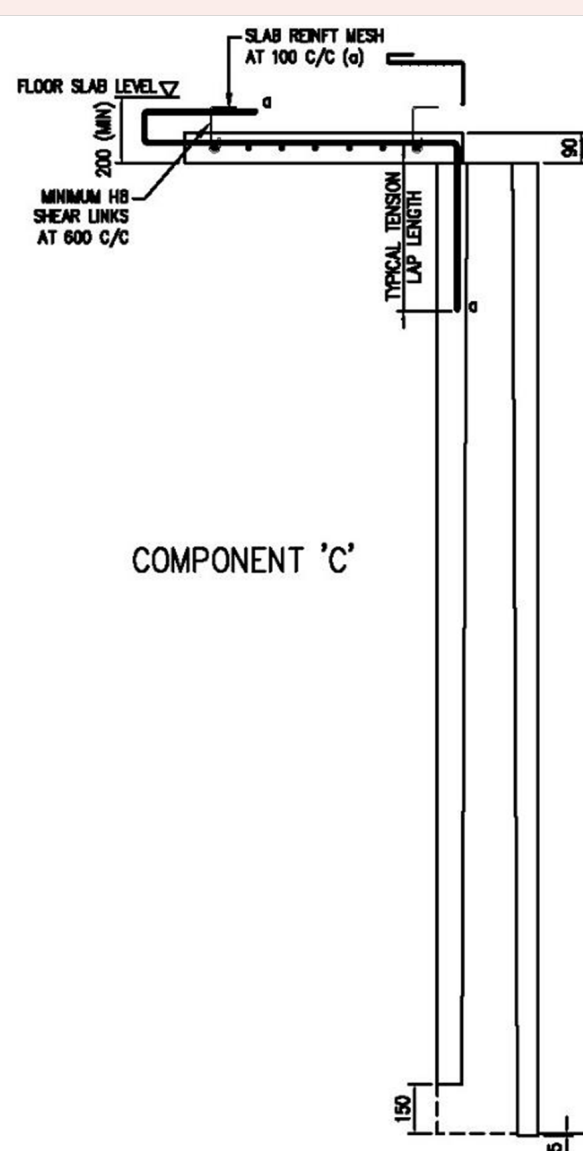


**FIGURE 3.5.6.2(c)(iv): SECTION T-T
(S/C SS COMPONENT 'C')**


FIGURE 3.5.6.2 (c)(v) & FIGURE (c)(vi)

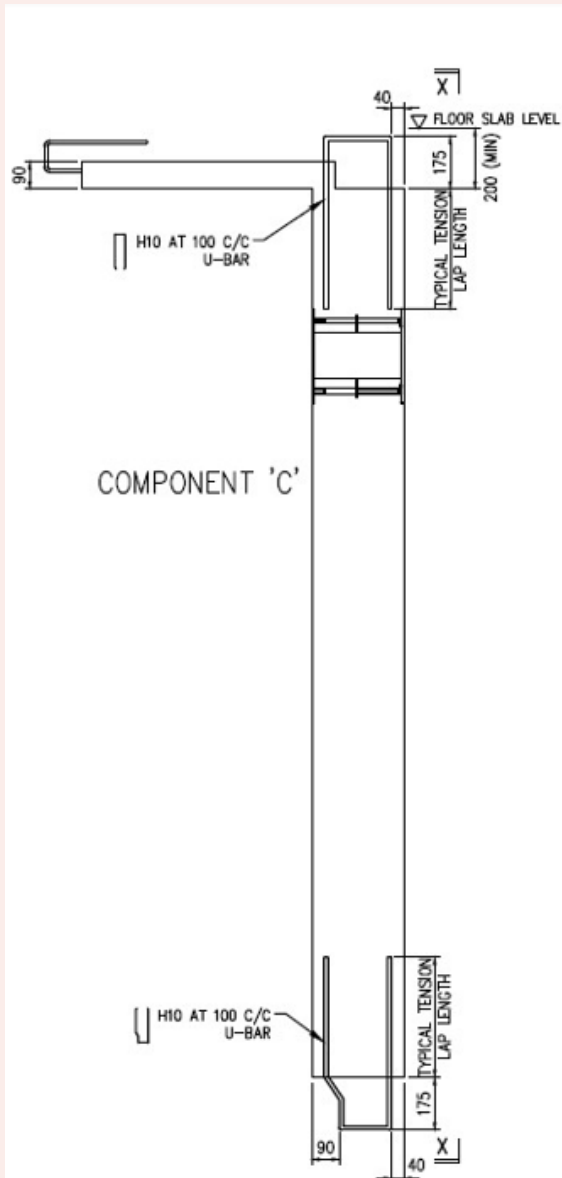


**FIGURE 3.5.6.2(c)(v): SECTION
U-U AT VENTILATION SLEEVE
(S/C SS COMPONENT 'C')**

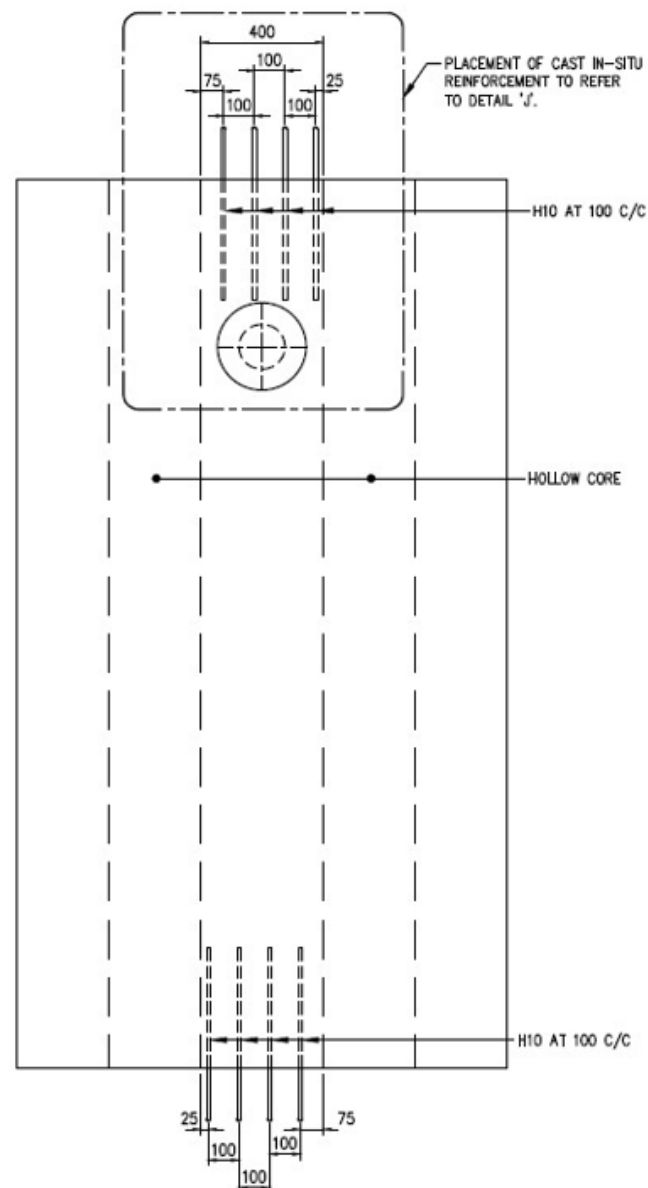

**FIGURE 3.5.6.2(c)(vi): SECTION
X-X AT VENTILATION SLEEVE
(S/C SS COMPONENT 'C')**

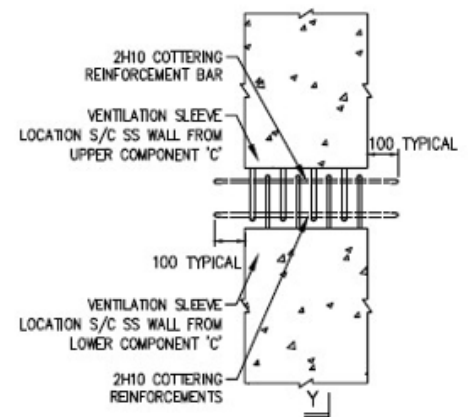

**DETAIL 'J': CONNECTION DETAIL SHOWING
COTTING REINFORCEMENT BARS
THROUGH OVERLAPPING PROJECTED
U-LOOP BARS OF UPPER AND LOWER
S/C SS WALL WITH VENTILATION SLEEVE**

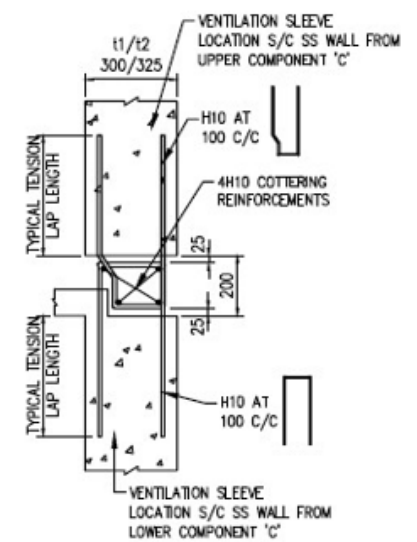

**SECTION Y-Y
OF DETAIL 'J'**

FIGURE 3.5.6.2 (c)(vii) & FIGURE (c)(viii)

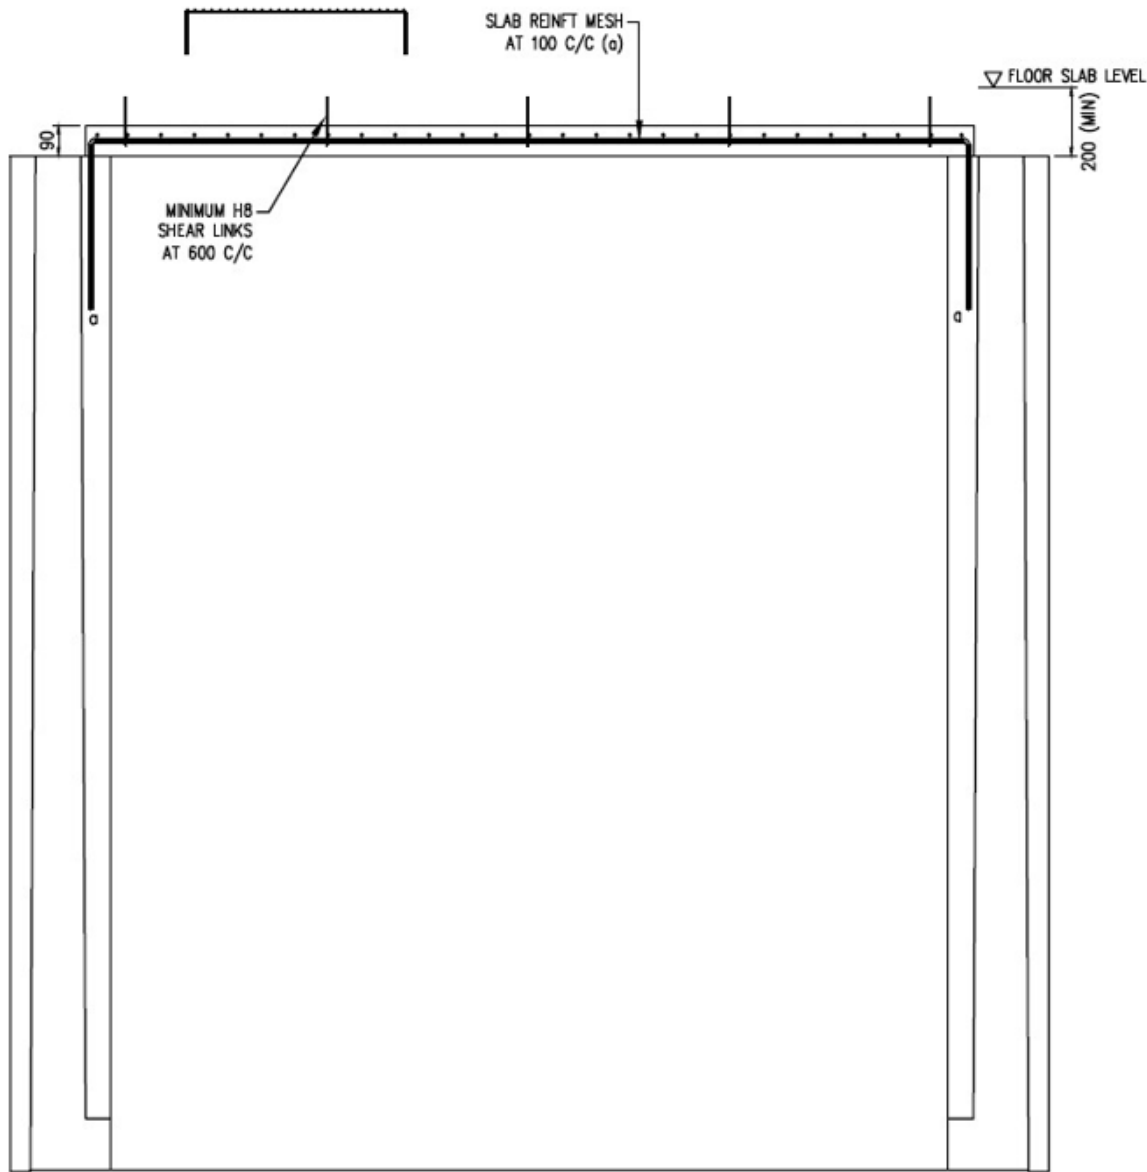


FIGURE 3.5.6.2(c)(vii): SECTION V-V (S/C SS COMPONENT 'C')

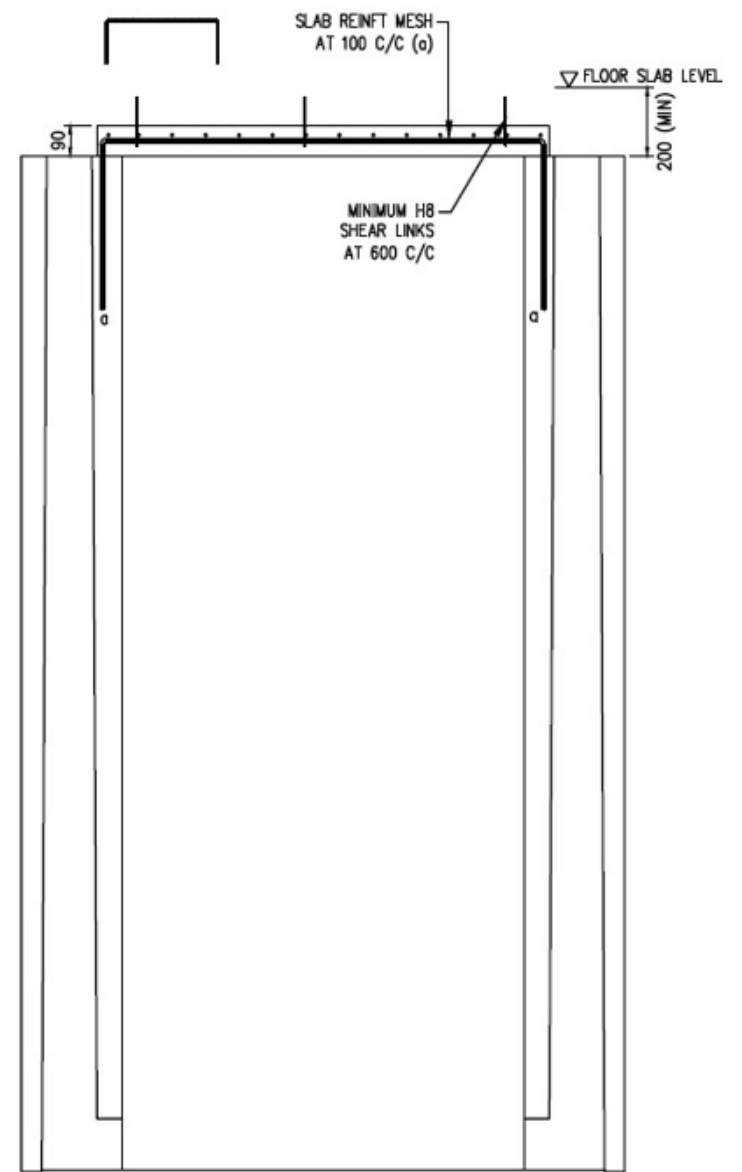


FIGURE 3.5.6.2(c)(viii): SECTION W-W (S/C SS COMPONENT 'C')

FIGURE 3.5.6.2(d)

-

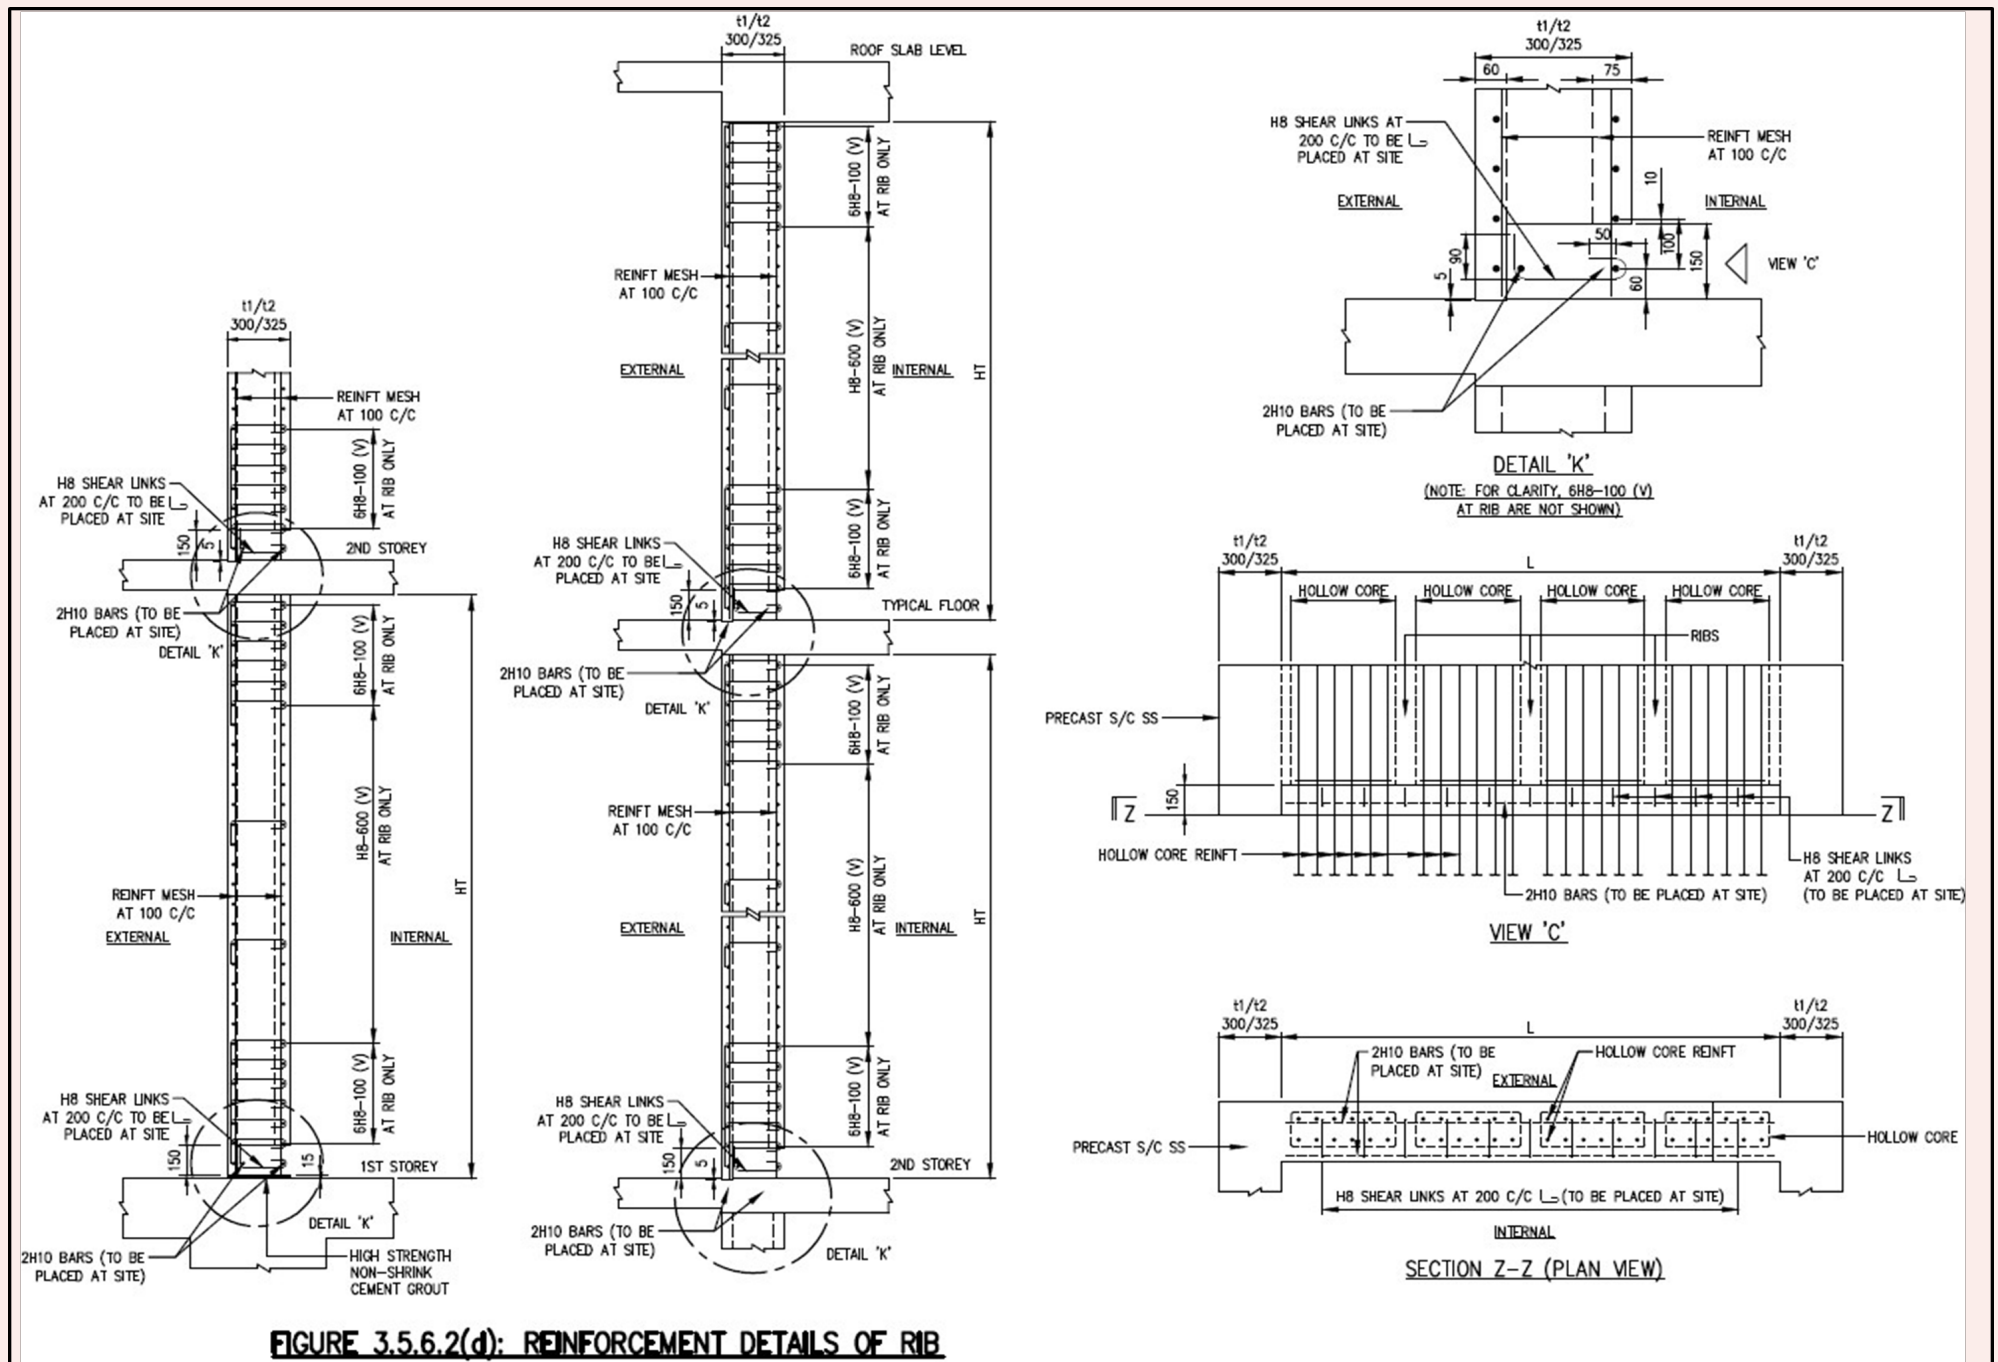


FIGURE 3.5.6.2(d): REINFORCEMENT DETAILS OF RIB

FIGURE 3.5.6.2(e)

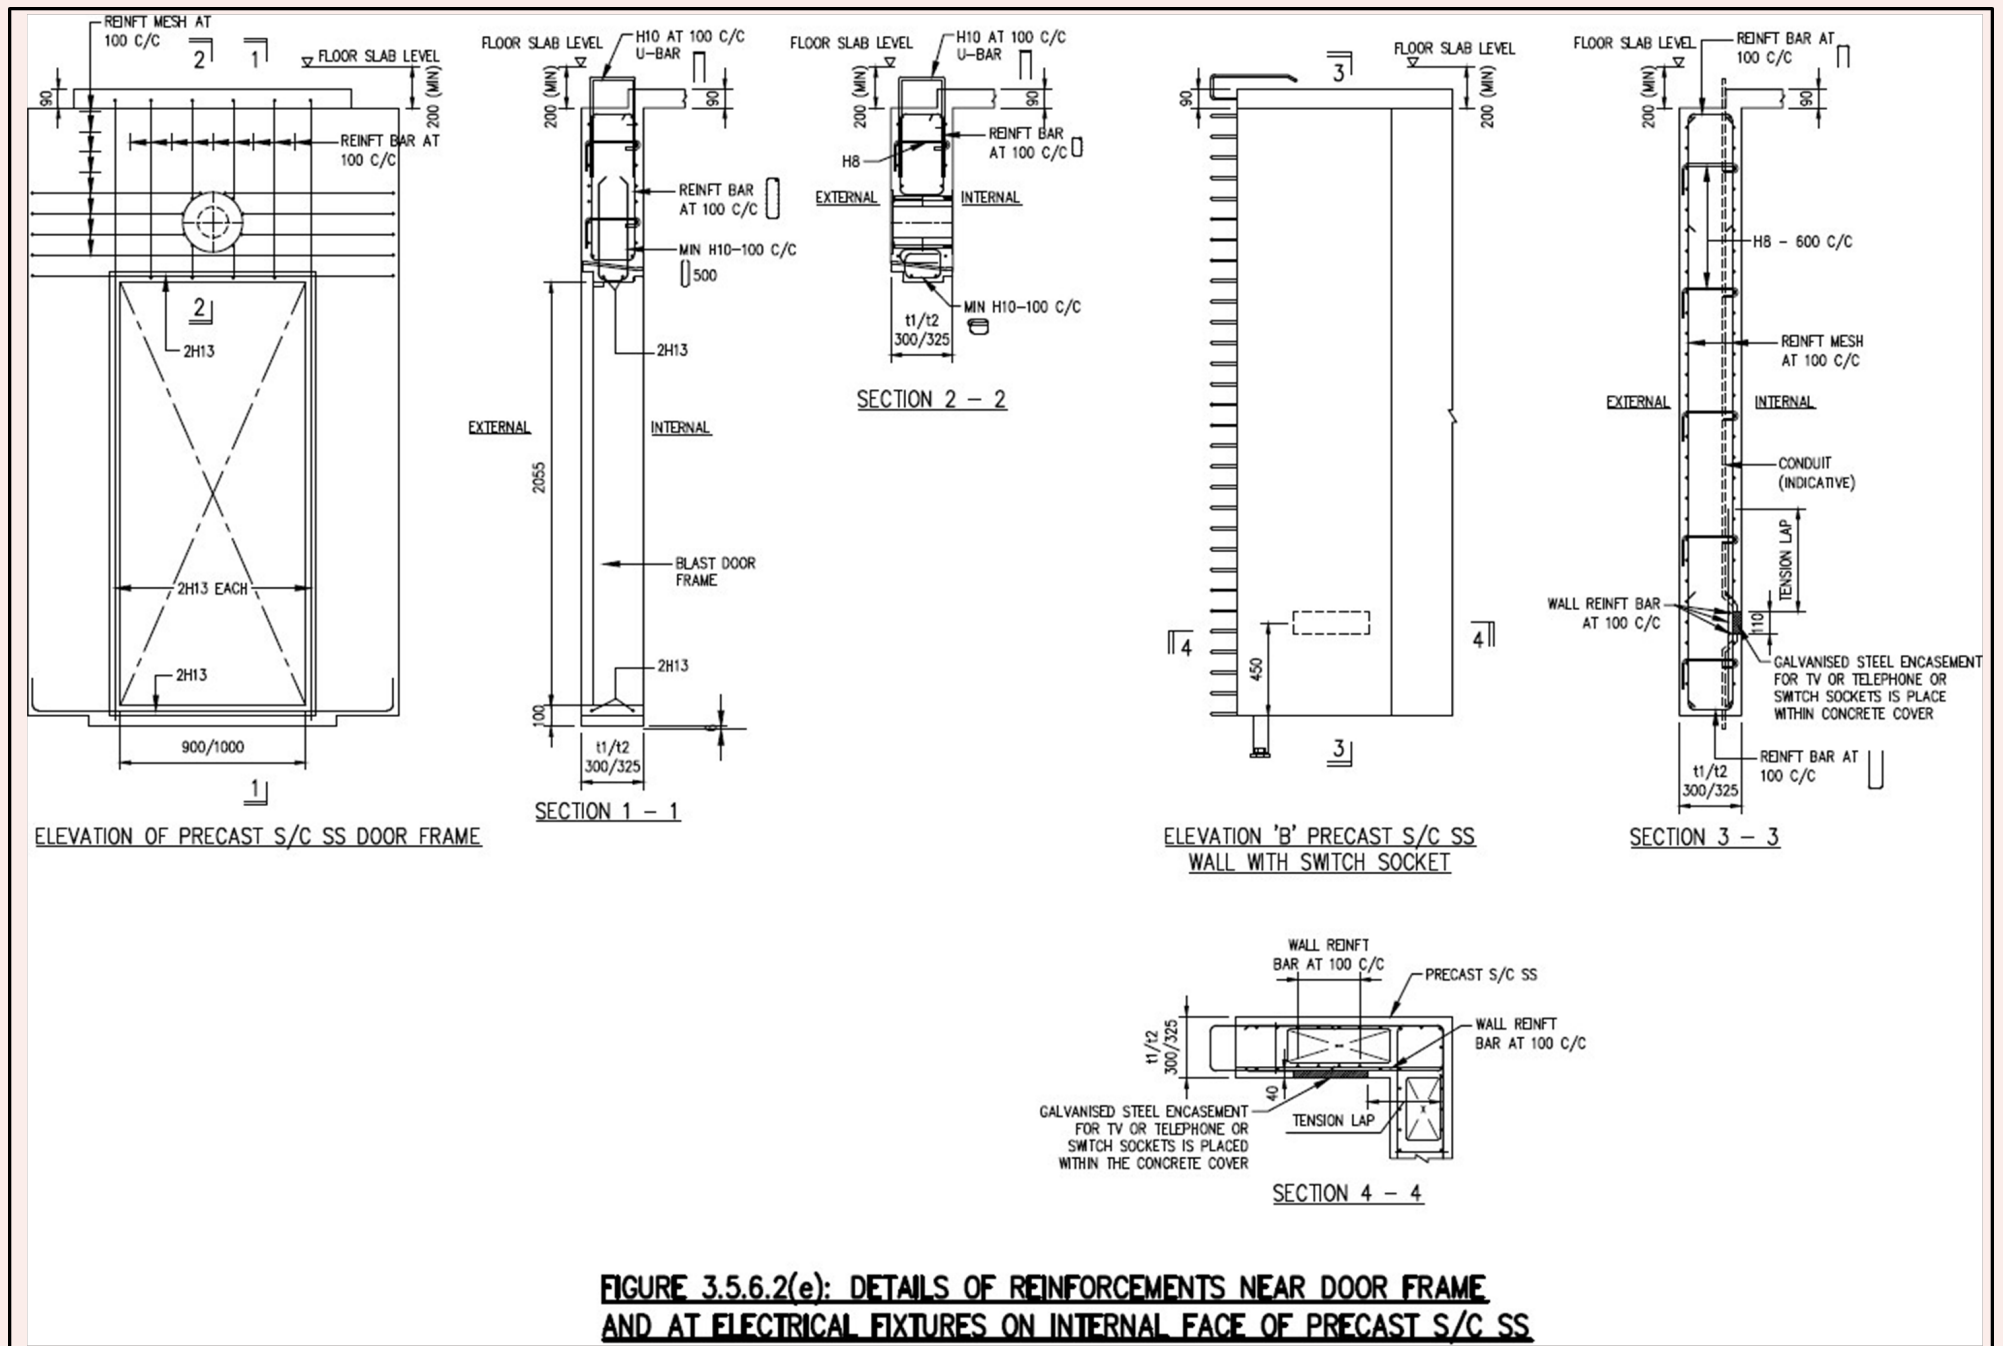


FIGURE 3.5.6.2(f), FIGURE 3.5.6.2(g) & FIGURE 3.5.6.2(h)

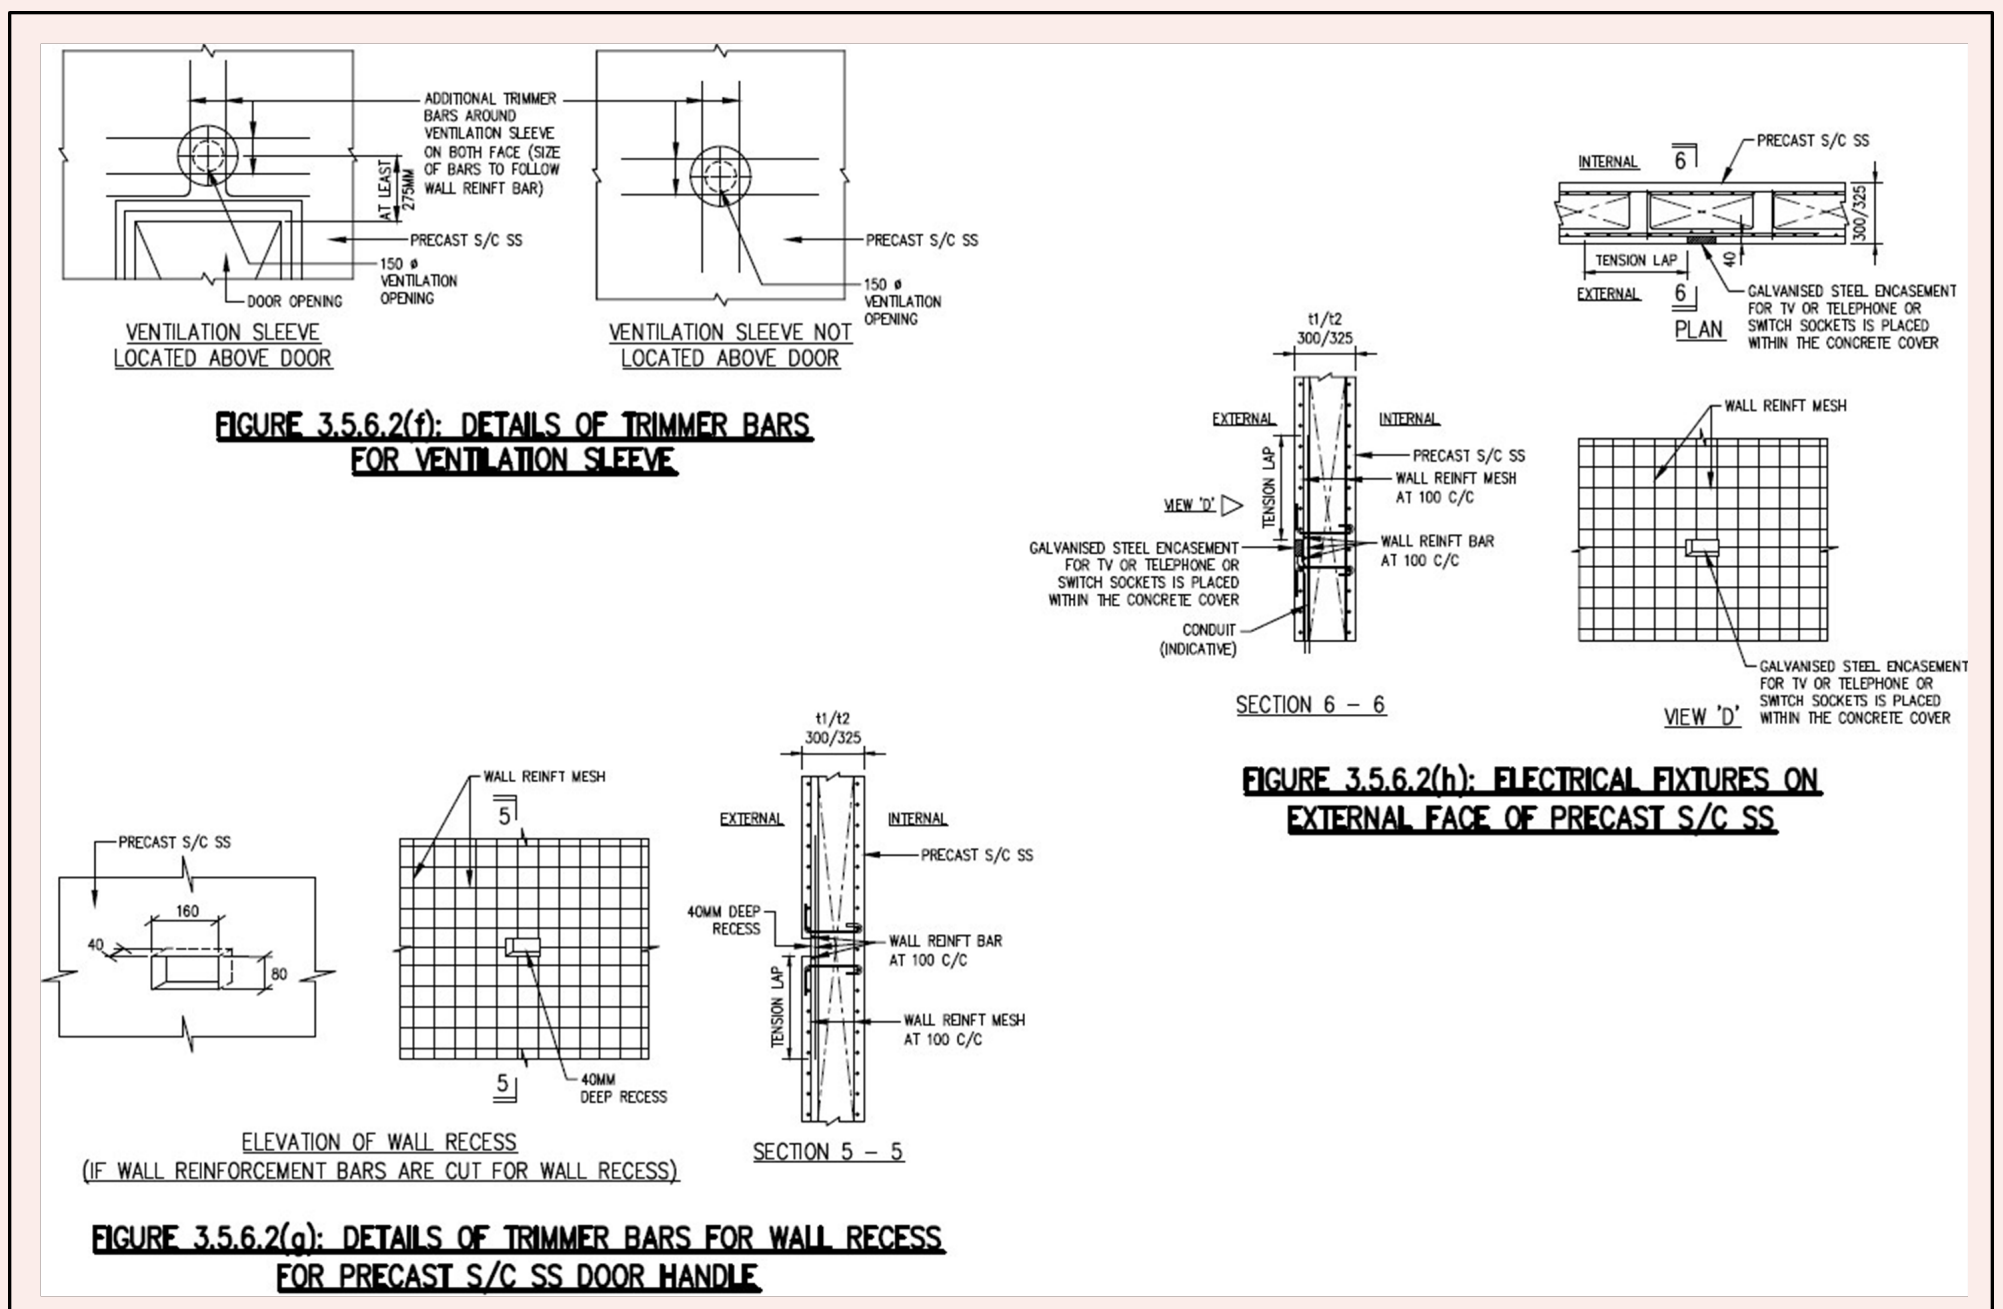


FIGURE 3.5.6.2(i) & FIGURE 3.5.6.2 (j)



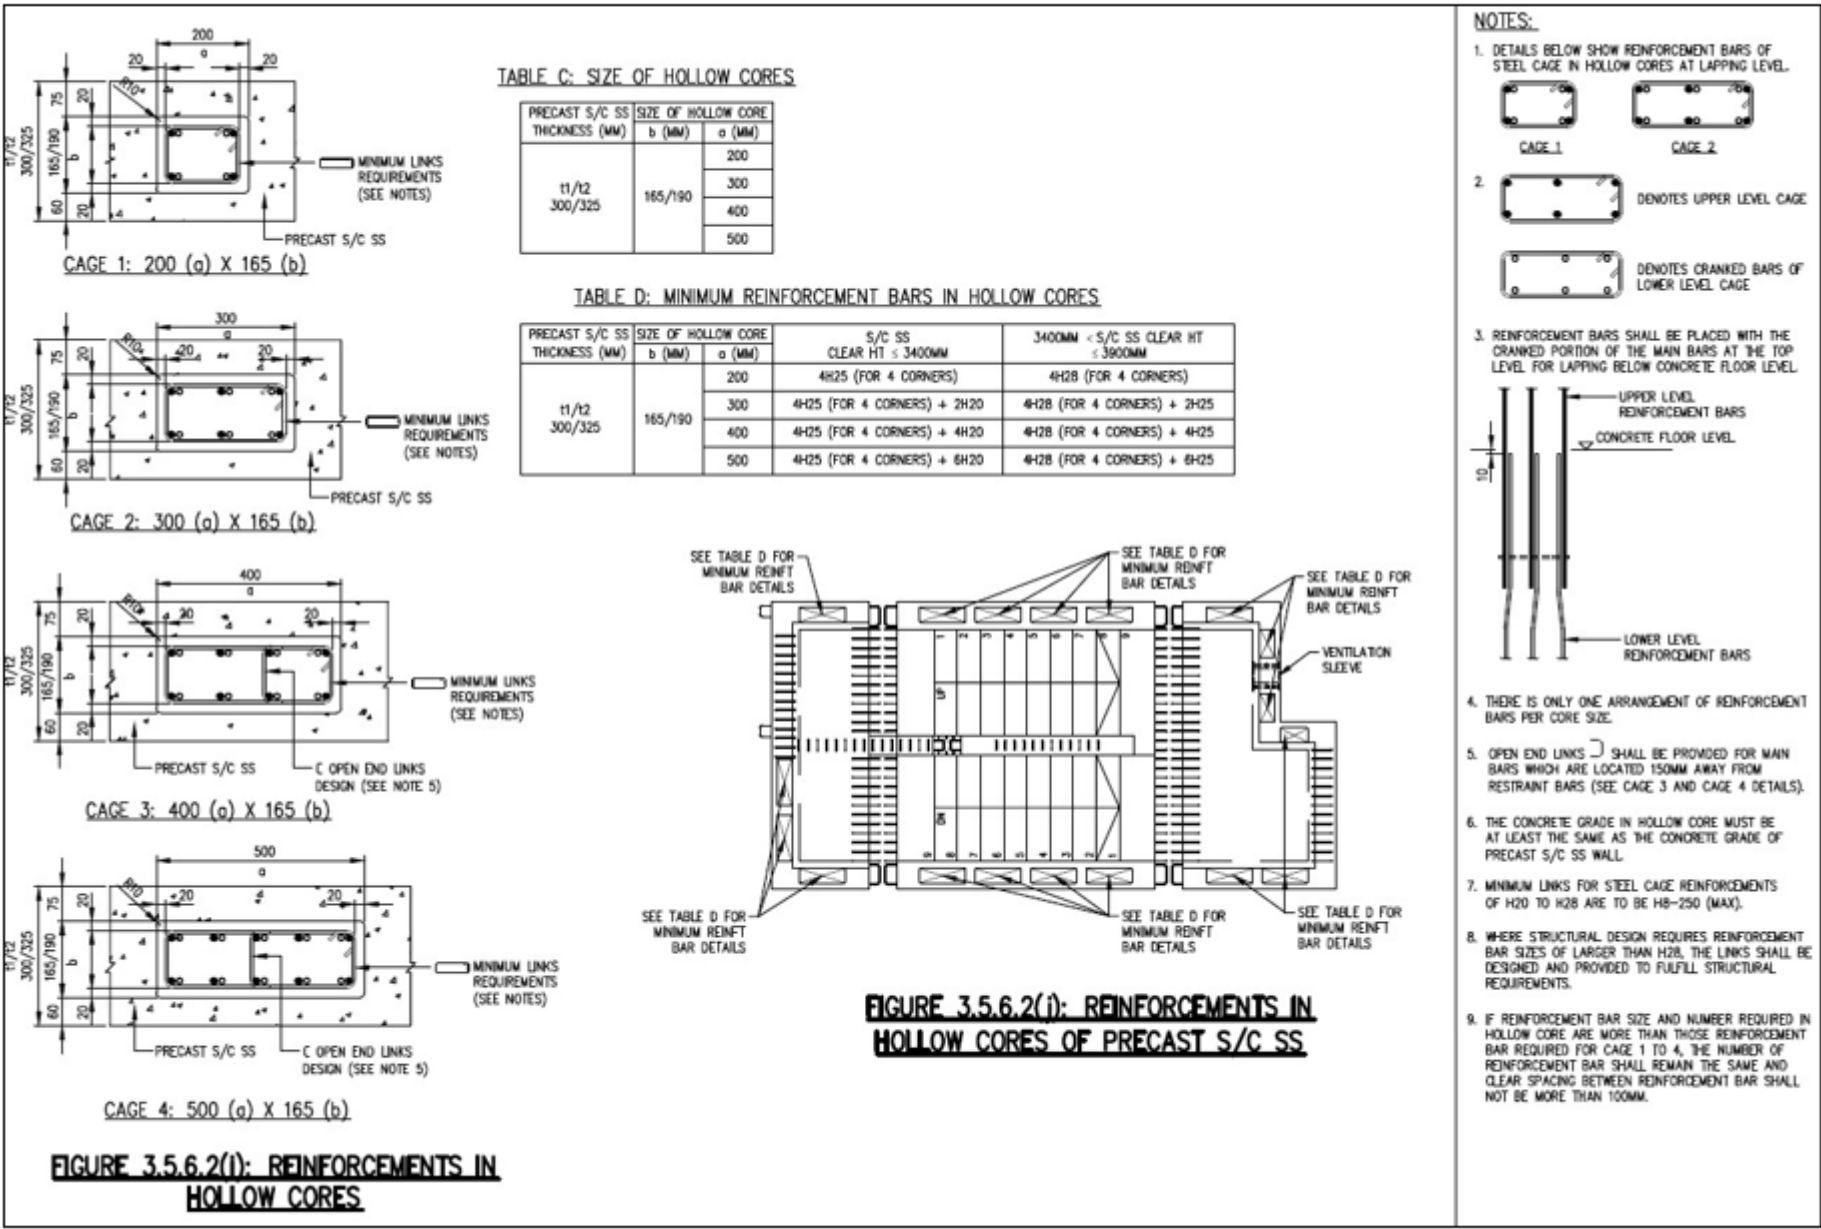


FIGURE 3.5.6.2(k)

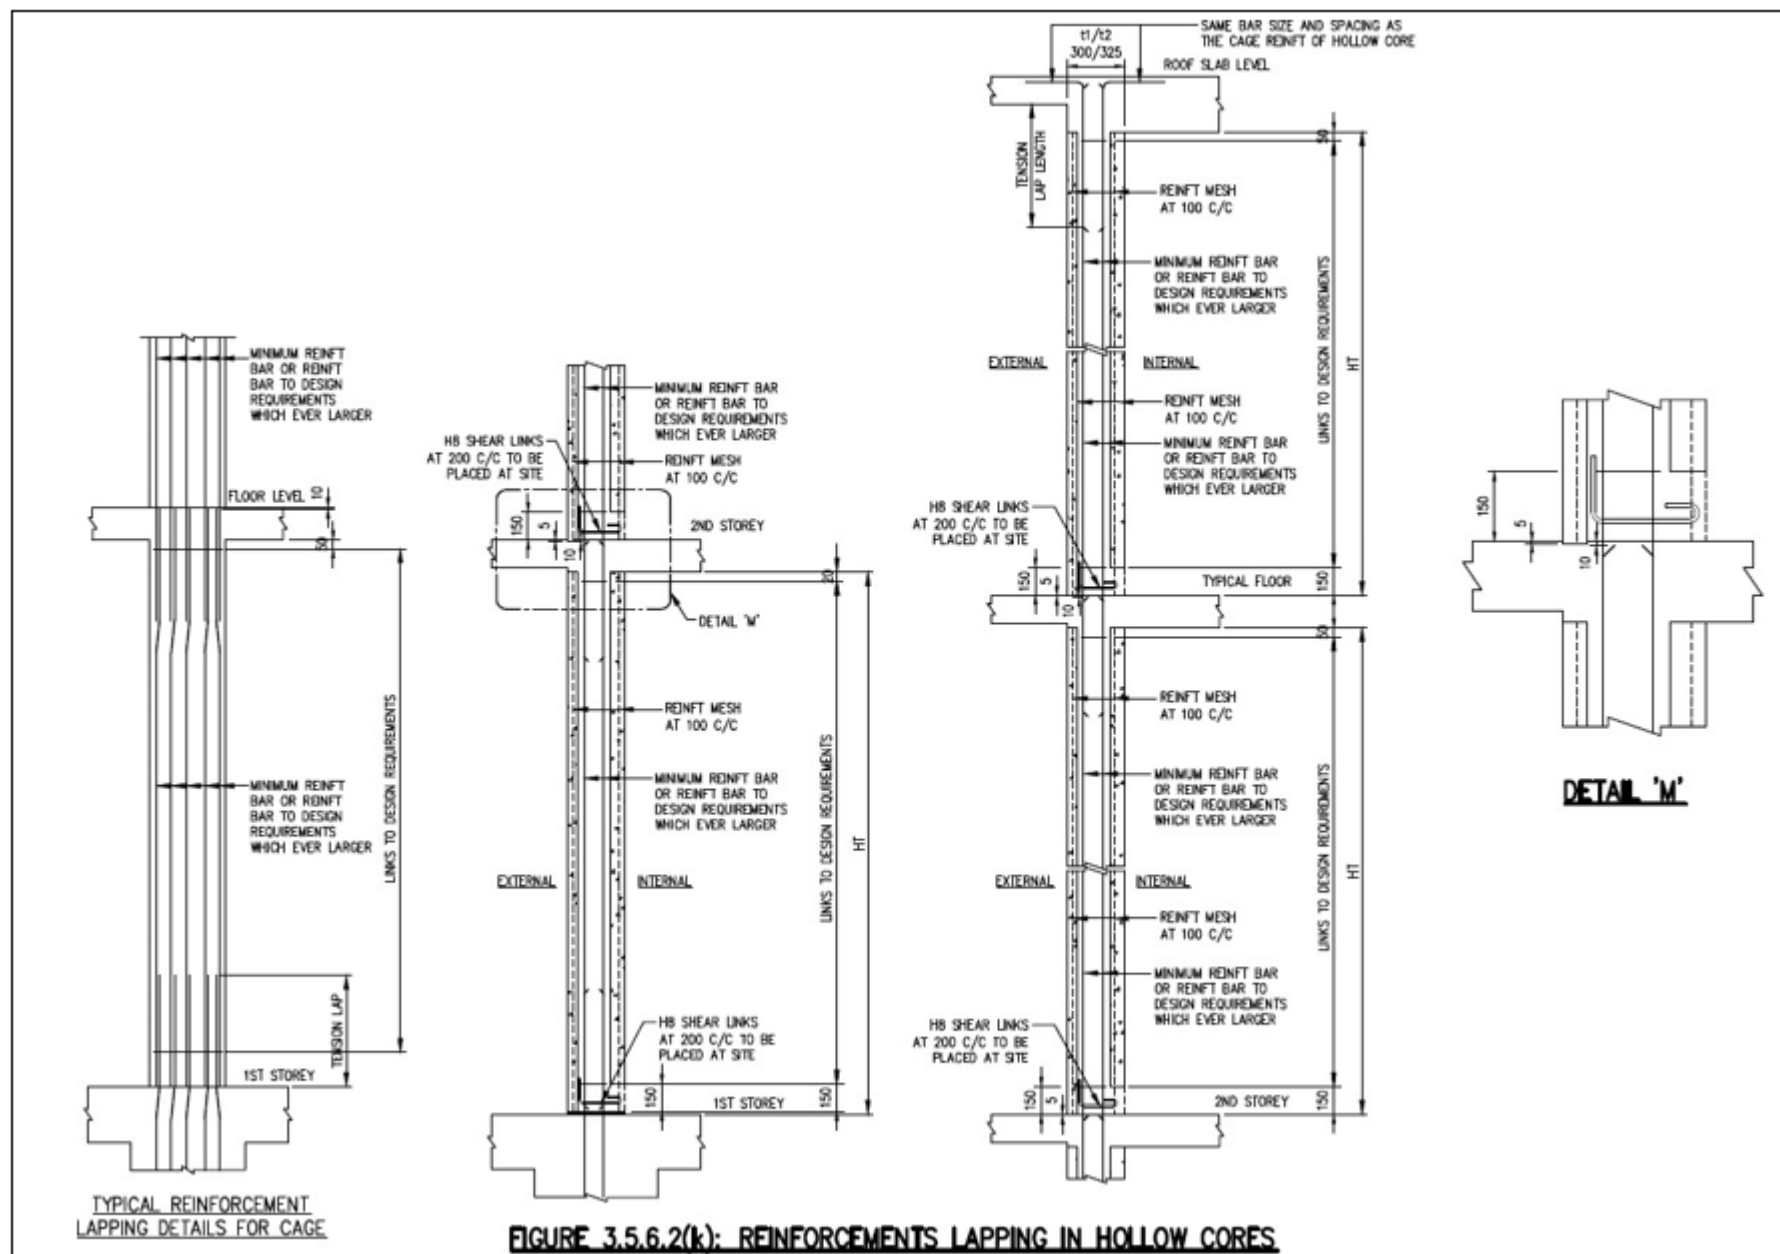

d. For the rib between two hollow cores of precast S/C SS, its top and bottom portion shall be provided with closer shear links of at least 6 numbers of H8 at maximum 100mm c/c spacing as shown in FIGURE 3.5.6.2(d). For area between these top and bottom portions, minimum shear links of at least H8 at maximum 600mm c/c spacing shall be provided as shown in FIGURE 3.5.6.2(d). The hook of the shear links must be anchored around the outermost reinforcements of the internal face of precast S/C SS wall.

Figures & Tables

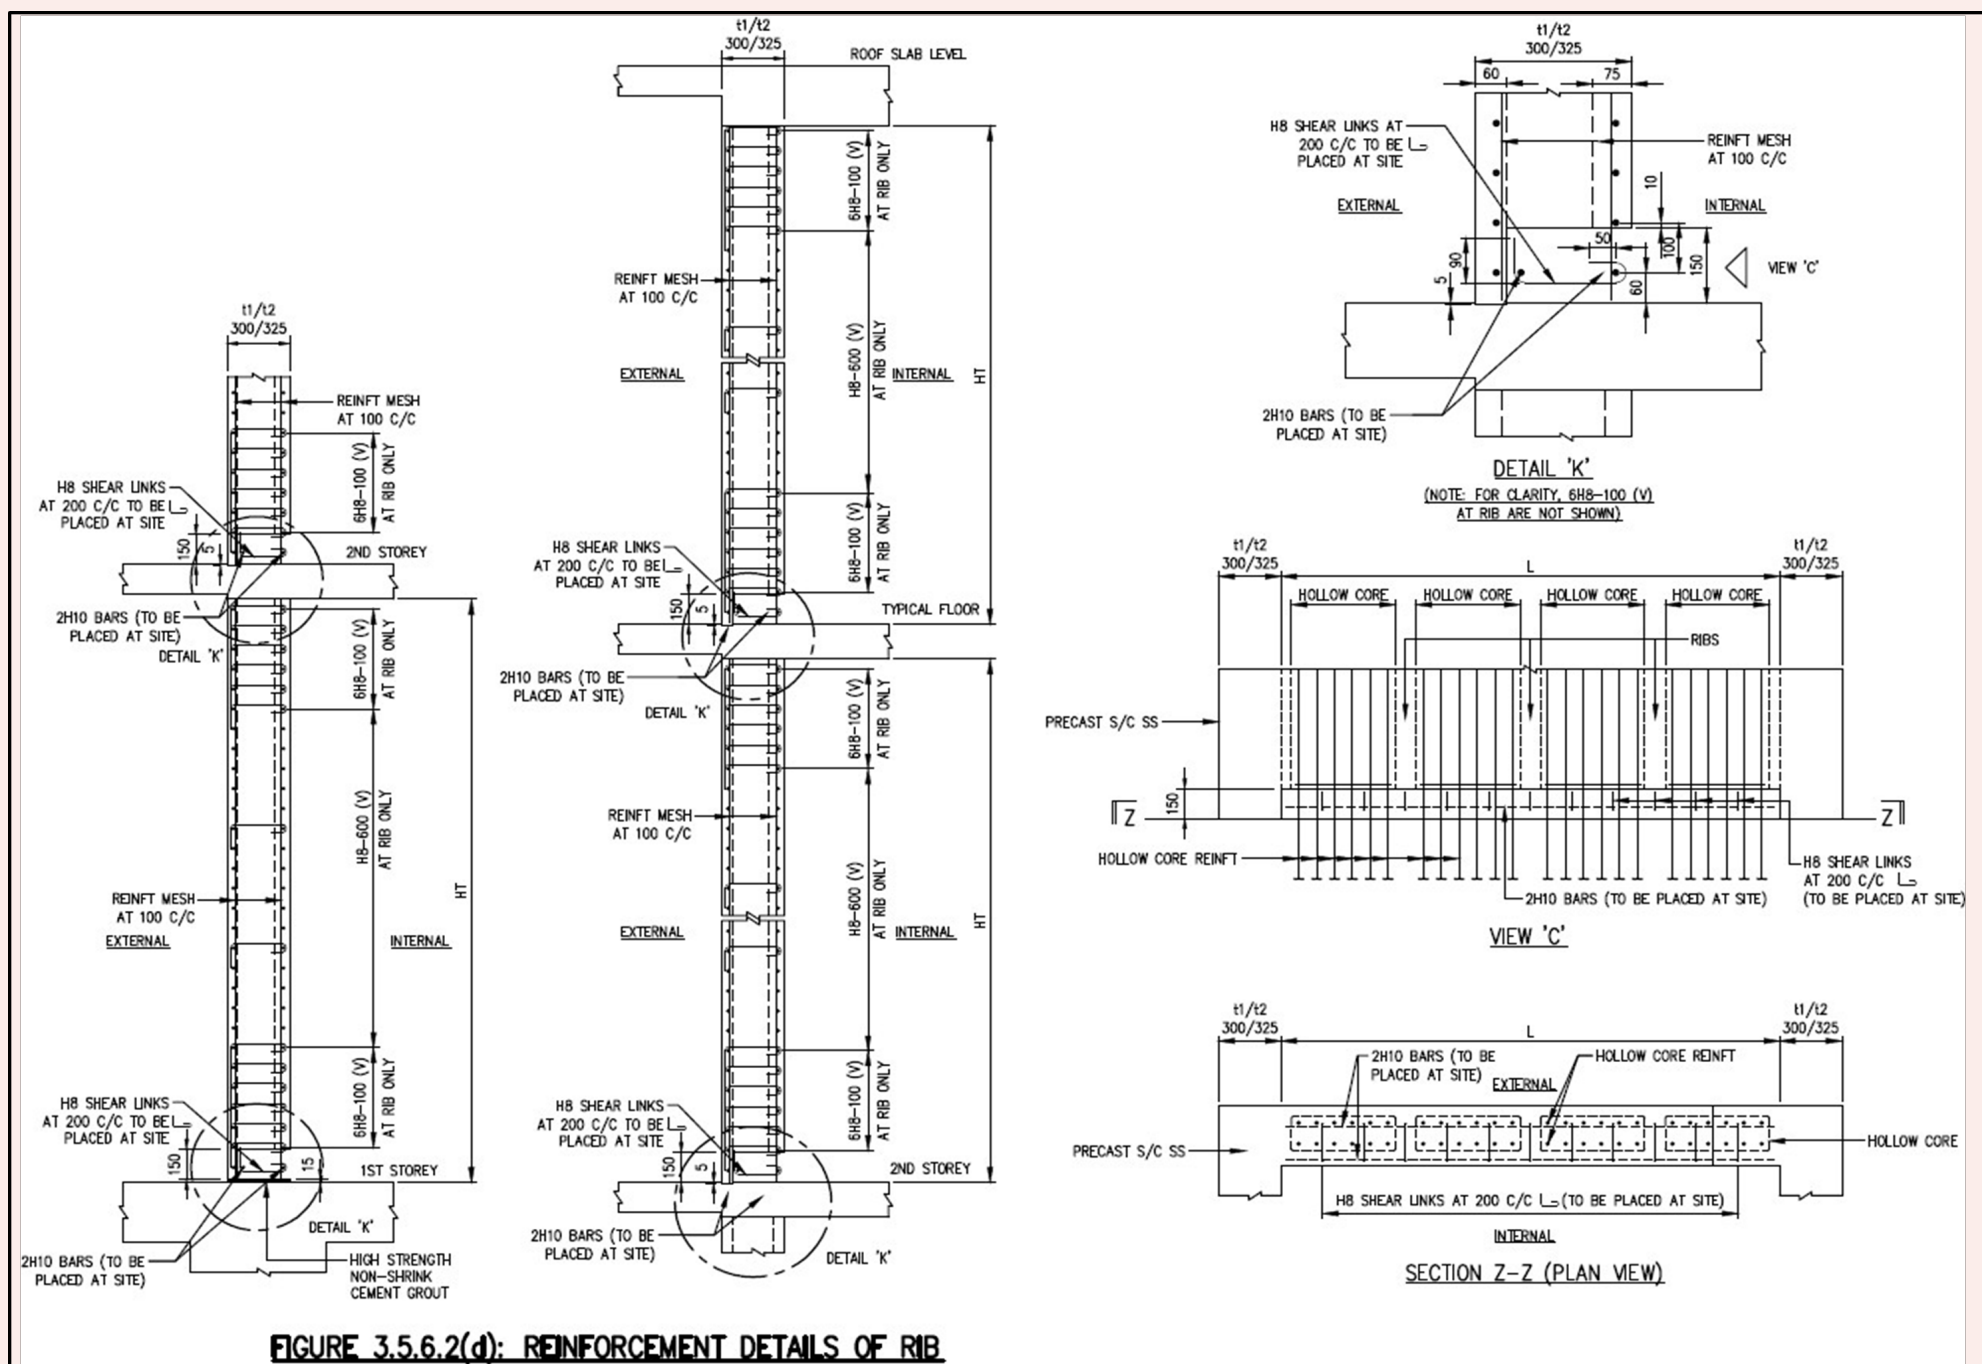

e. The reinforcements for the precast S/C SS door frame, ventilation sleeves, wall recess for electrical fixtures on internal face of precast S/C SS wall and wall recess for the external S/C SS door handle are shown in FIGURE 3.5.6.2(f) to 3.5.6.2(h).

Figures & Tables

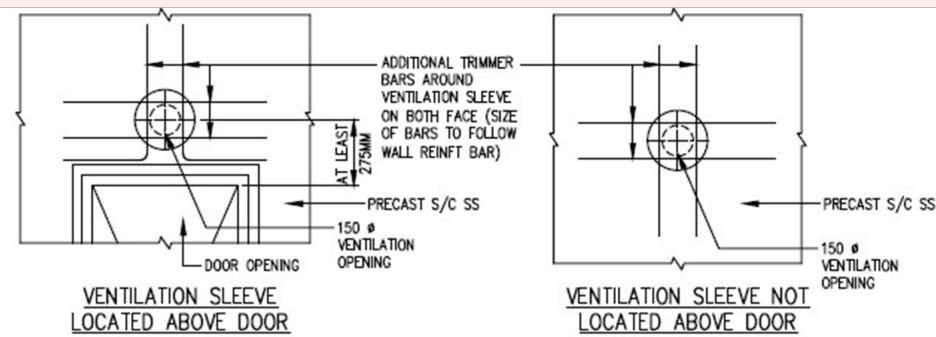


FIGURE 3.5.6.2(f): DETAILS OF TRIMMER BARS FOR VENTILATION SLEEVE

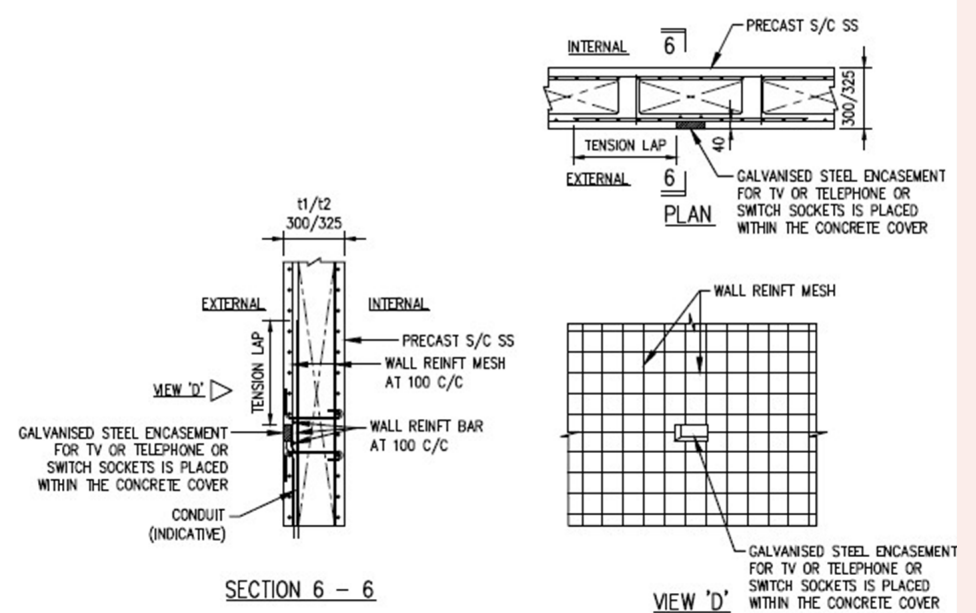


FIGURE 3.5.6.2(h): ELECTRICAL FIXTURES ON EXTERNAL FACE OF PRECAST S/C SS


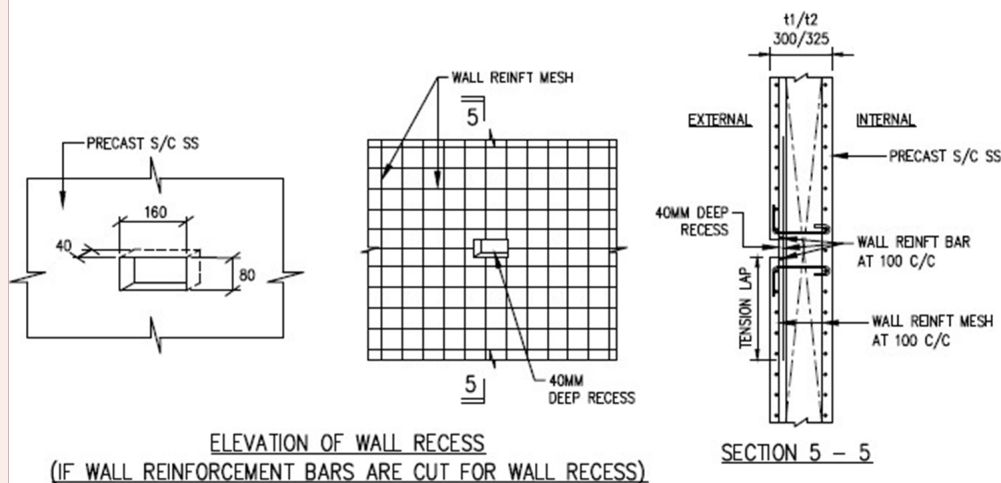


FIGURE 3.5.6.2(g): DETAILS OF TRIMMER BARS FOR WALL RECESS FOR PRECAST S/C SS DOOR HANDLE


f. The modular length of the hollow cores of precast S/C SS shall vary between minimum 200mm and maximum 500mm with increment of 100mm whereas the modular width of the hollow cores of precast S/C SS shall be 165mm and 190mm for S/C SS wall thickness of 300mm and 325mm respectively as shown in TABLE C of FIGURE 3.5.6.2(i). In these hollow cores, minimum reinforcements and links shall be provided and installed as shown in TABLE D of FIGURE 3.5.6.2(i) and 3.5.6.2(j). Higher reinforcements and links shall be provided if they are required to meet the structural safety and stability requirements.

Figures & Tables

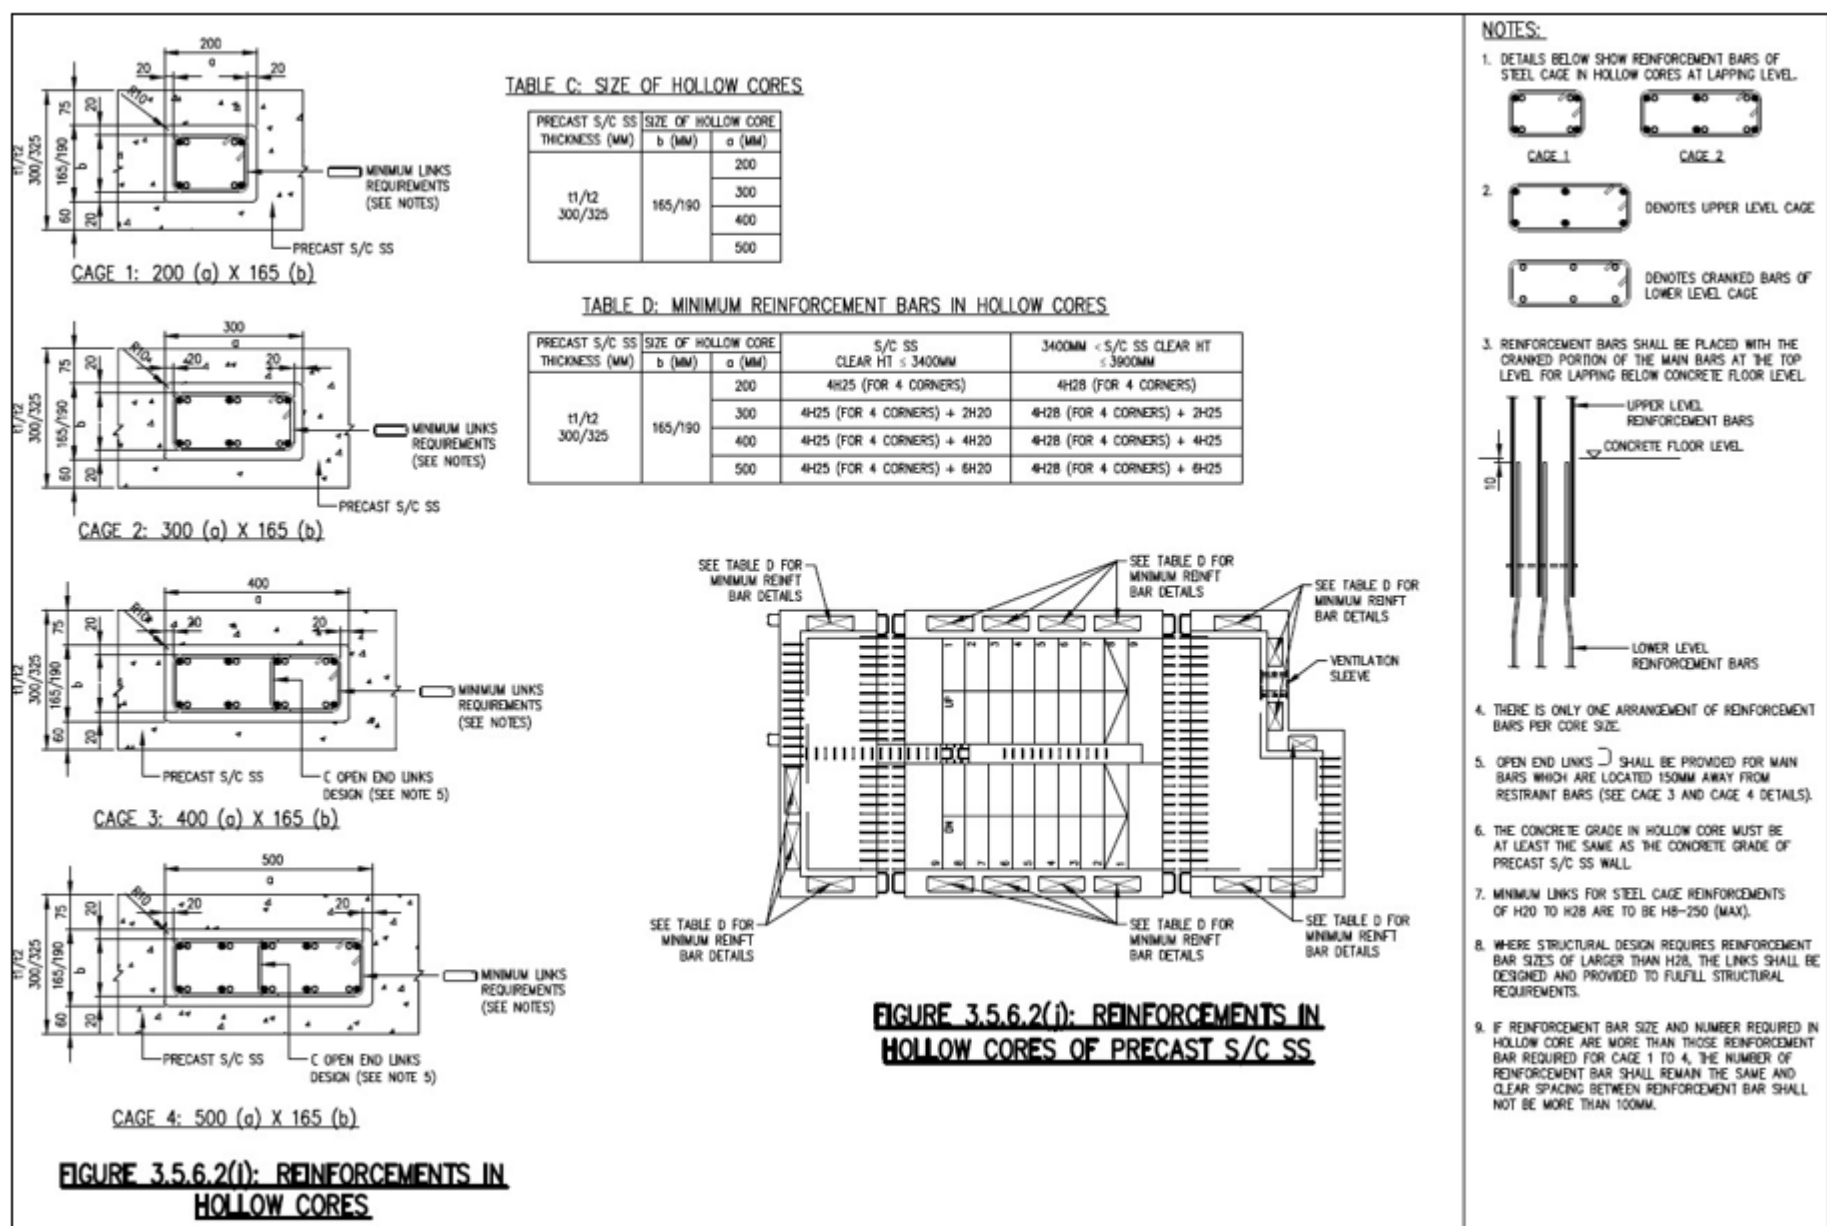

g. All reinforcement bars must be designed and detailed with full tension anchorage or lap length, complying with [Clause 3.5.2](#). The reinforcements for hollow cores of precast S/C SS wall shall be cranked at their upper part to facilitate placing of the reinforcements at lapping level as shown in [FIGURE 3.5.6.2\(k\)](#).

Figures & Tables

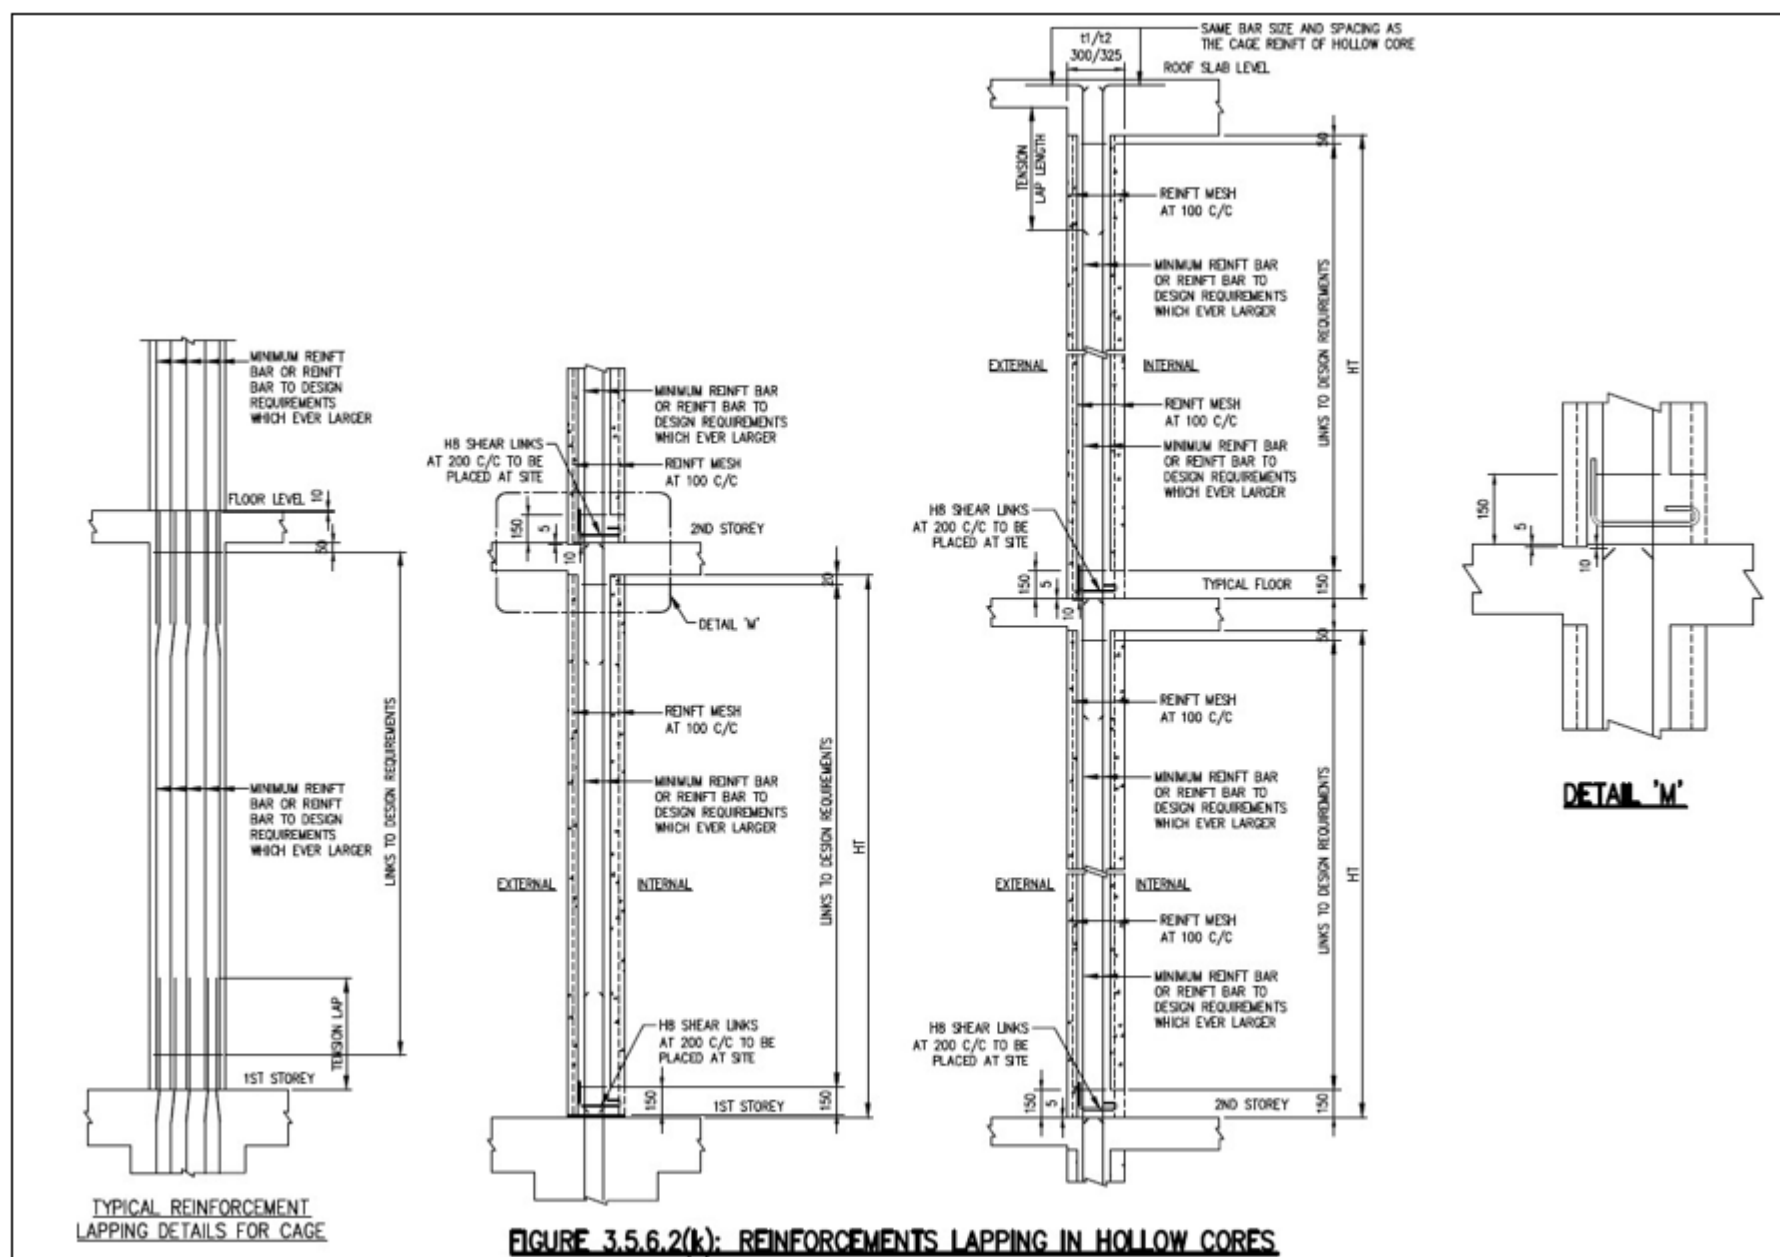

3.5.6.3 Connection between Precast Hollow Core Staircase Storey Shelters

- a. The connection between Precast S/C SS hollow cores are shown in FIGURE 3.5.6.3(a) to 3.5.6.3(c):

Figures & Tables

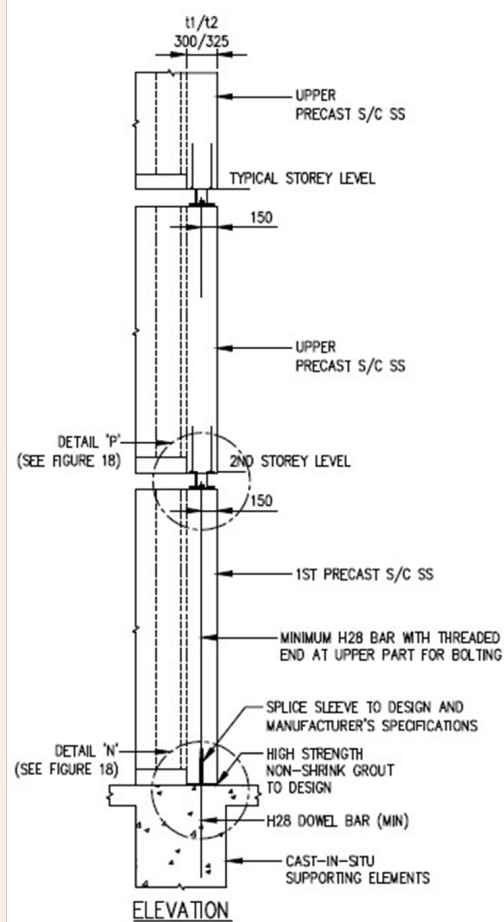


FIGURE 3.5.6.3(a): SPLICE SLEEVE CONNECTION DETAILS BETWEEN PRECAST S/C SS AND CAST IN-SITU ELEMENT AND BOLT CONNECTION DETAILS BETWEEN TWO PRECAST S/C SS



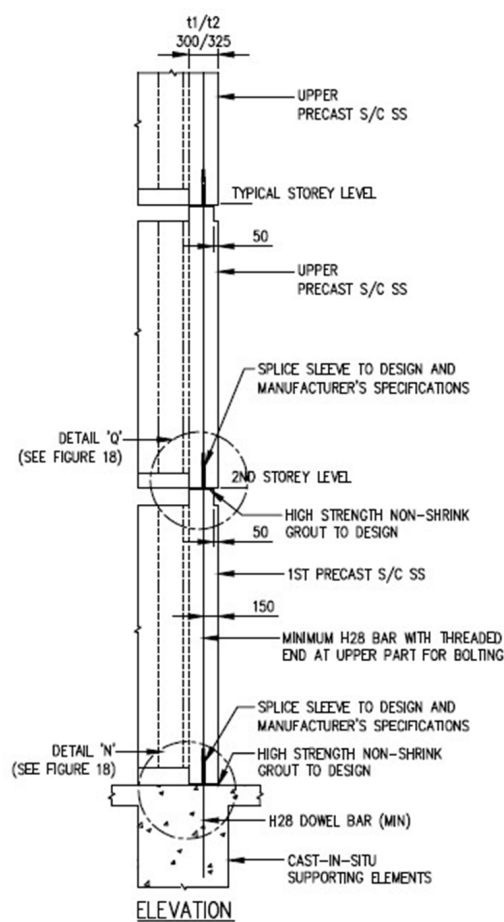


FIGURE 3.5.6.3(b): SPLICE SLEEVE CONNECTION DETAILS FOR PRECAST S/C SS TOWER

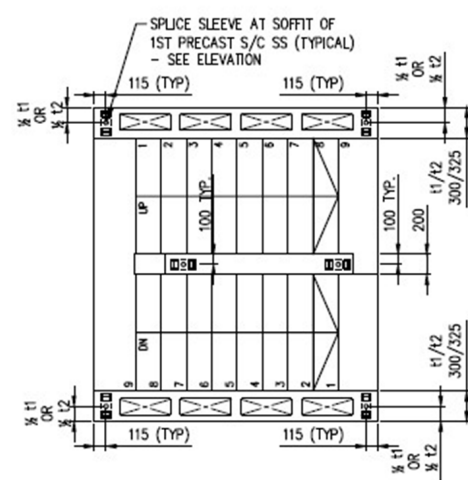

REFERENCE PLAN FOR 1ST STOREY COMPONENT 'B' PRECAST S/C SS

(SIZE AND ARRANGEMENT OF CORES SHOWN IS INDICATIVE ONLY)

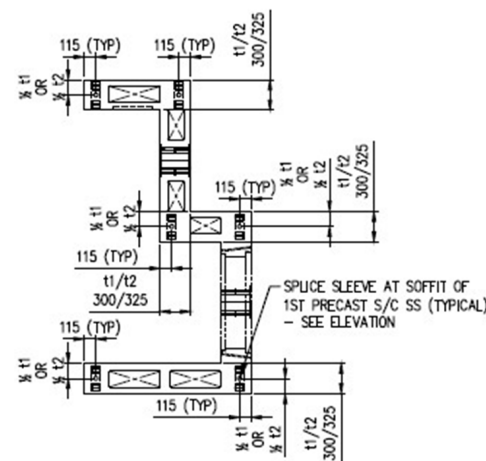


REFERENCE PLAN FOR 1ST STOREY COMPONENT 'C' PRECAST S/C SS

(SIZE AND ARRANGEMENT OF CORES SHOWN IS INDICATIVE ONLY)

NOTES:

1. THE 1ST OR LOWEST PRECAST STOREY SHELTER MUST BE CONNECTED BY SPLICE SLEEVE (DETAIL 'N', FIGURE 18) AT 4 CORNERS OR OTHER LOCATIONS OF SHELTER WALL. MINIMUM H28 DOWEL BAR FOR SPLICE SLEEVE SHALL BE CAST IN THE CAST IN-SITU SUPPORTING ELEMENTS (WALL, COLUMN, BEAM OR FOUNDATION).
2. THE UPPER PRECAST STOREY SHELTERS SHALL BE JOINED BY BOLT AND STEEL PLATE CONNECTION (SEE FIGURE 16 FOR DETAIL 'P' AND FIGURE 18 FOR SECTION 9-9, SECTION 10-10 AND DETAIL 'P') AT THEIR 4 CORNERS OR OTHER LOCATION OF SHELTER WALL.
3. ALTERNATIVE TO THE ABOVE NOTE 2, SPLICE SLEEVE CONNECTION CAN BE USED FOR PRECAST S/C SS TOWER (SEE FIGURE 17 FOR DETAIL 'Q' AND FIGURE 18 FOR SECTION 11-11 AND DETAIL 'Q').
4. HOT ROLLED STEEL SECTION OR PLATE SHALL BE GRADE S275.
5. H28 BARS REQUIRED FOR THESE TWO TYPES OF CONNECTION SHALL BE PROPERLY SECURED IN POSITION AT 4 TOP CORNERS OR OTHER LOCATIONS OF LOWER PRECAST S/C SS WALL WITH TEMPLATE SUCH THAT THEY ARE ALIGNED WITH THE BOLT HOLES OR SPLICE SLEEVE PROVIDED AT THE BASE OF THE UPPER PRECAST STAIRCASE STOREY SHELTER.
6. THE BOLT AND STEEL PLATE CONNECTION SHALL BE CHECKED AND DESIGNED BY PROFESSIONAL ENGINEER IF THE PRECAST S/C SS COMPONENT IS LARGER OR HEAVIER THAN THAT SHOWN IN FIGURE 1.

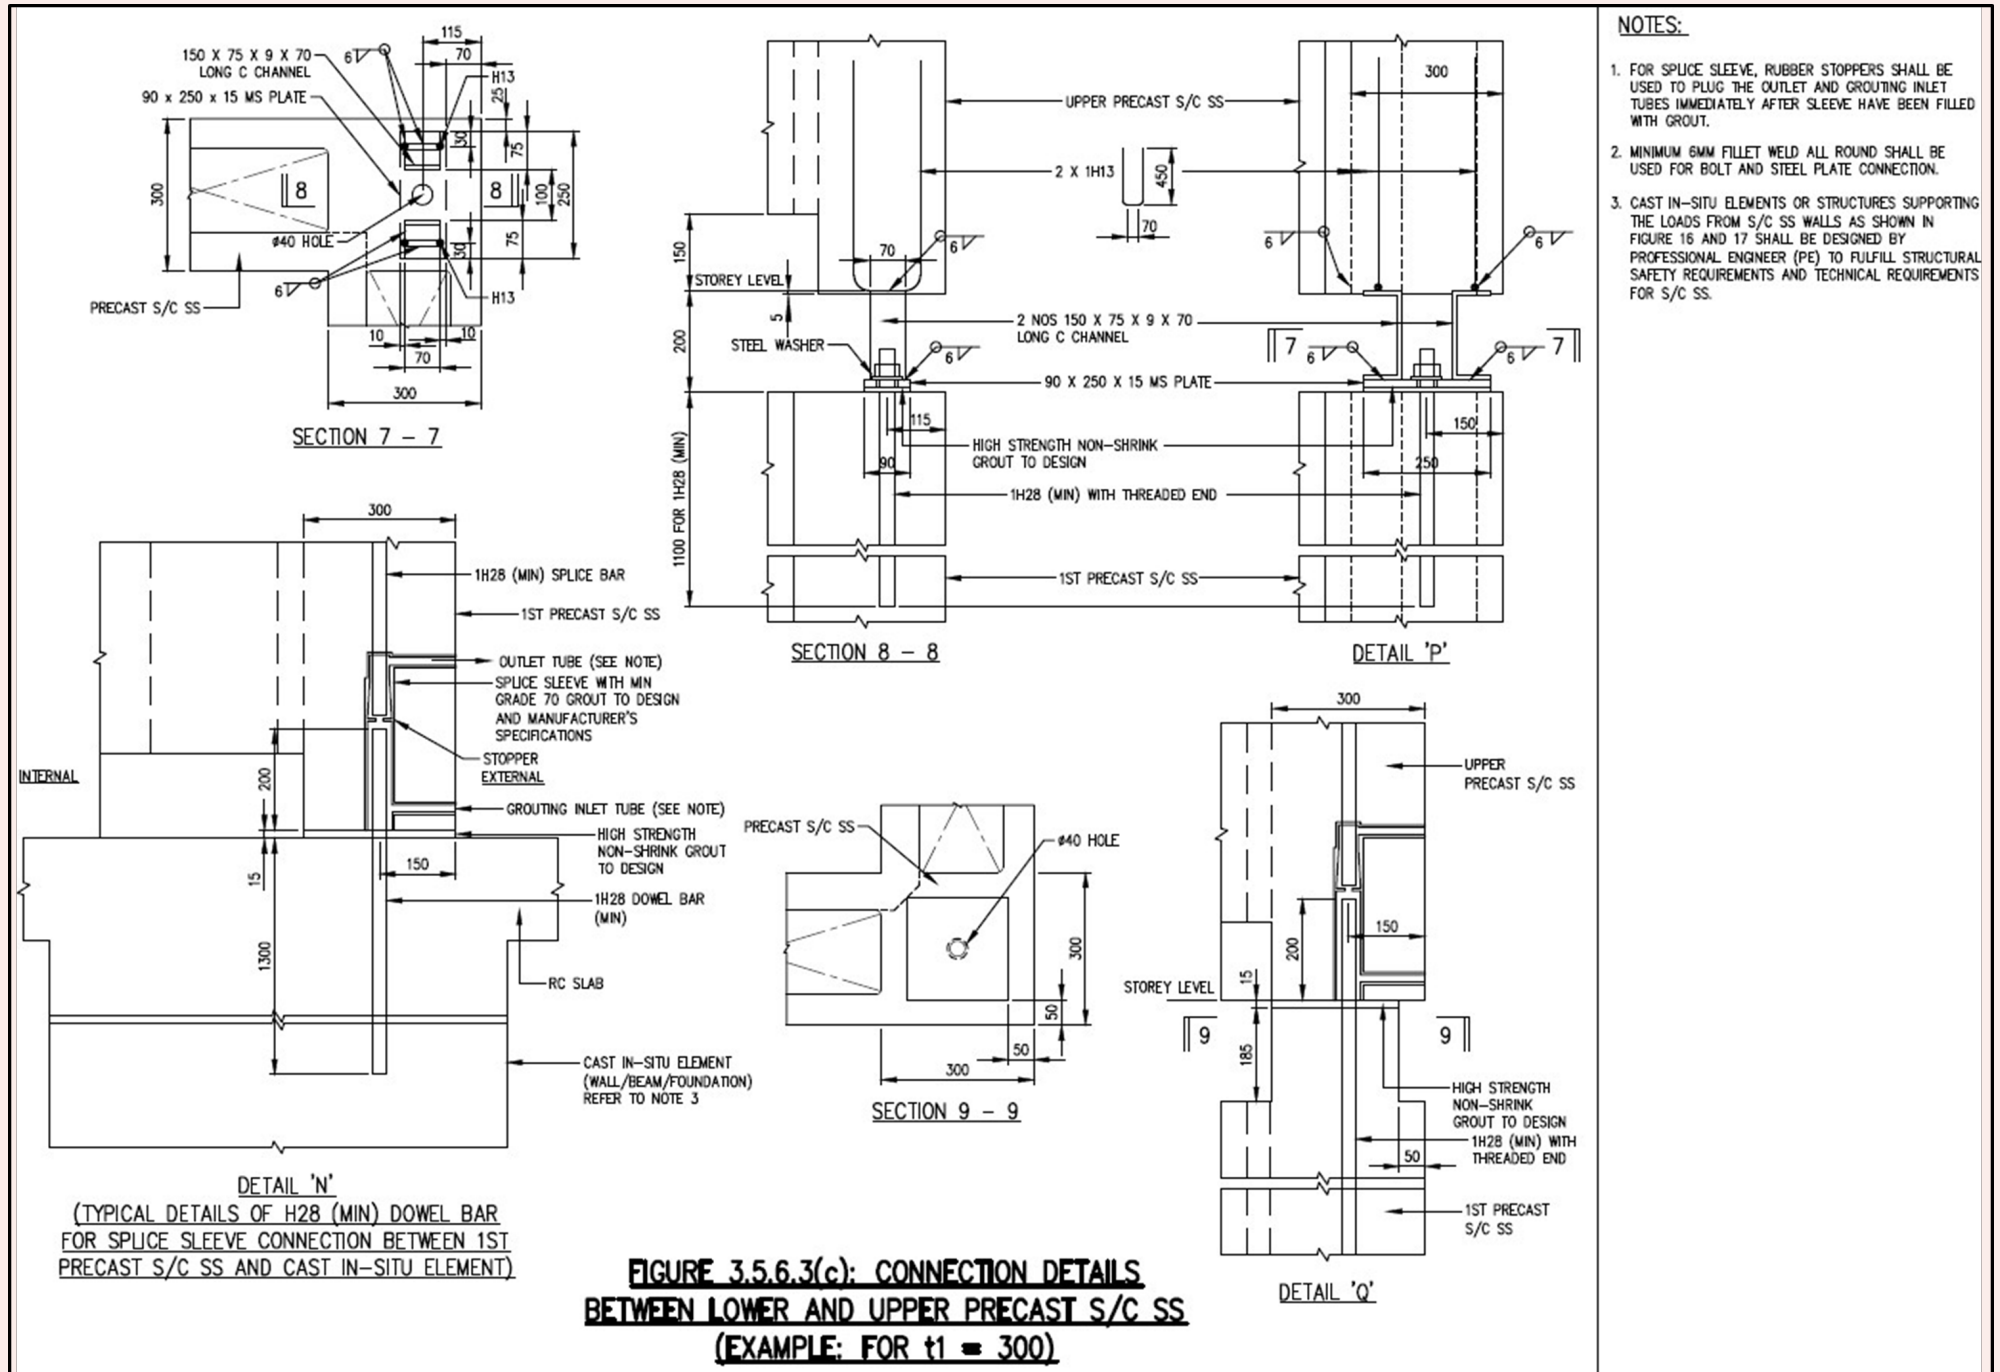

i. FIGURE 3.5.6.3(a): Splice Sleeve Connection Details between Precast S/C SS and Cast in-situ Element and Bolt Connection Details between Two Precast S/C SS.

Figures & Tables

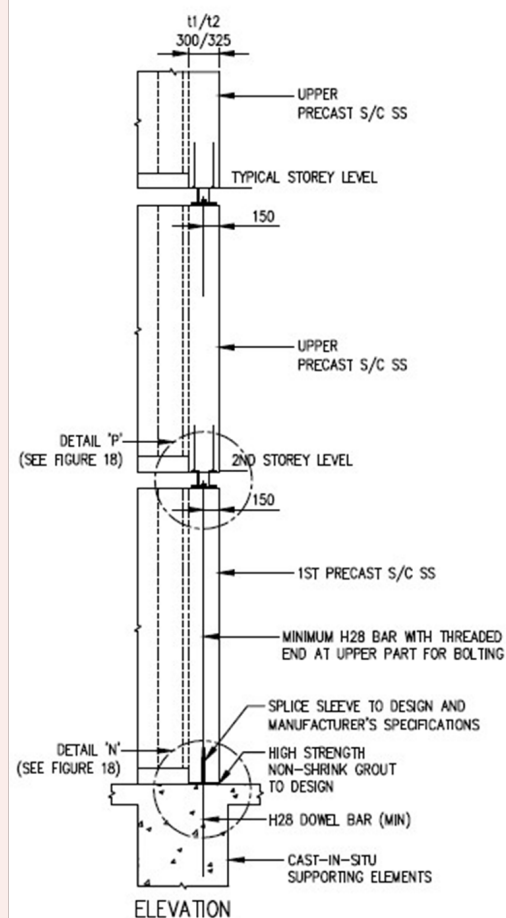


FIGURE 3.5.6.3(a): SPlice SLEEVE CONNECTION DETAILS BETWEEN PRECAST S/C SS AND CAST IN-SITU ELEMENT AND BOLT CONNECTION DETAILS BETWEEN TWO PRECAST S/C SS



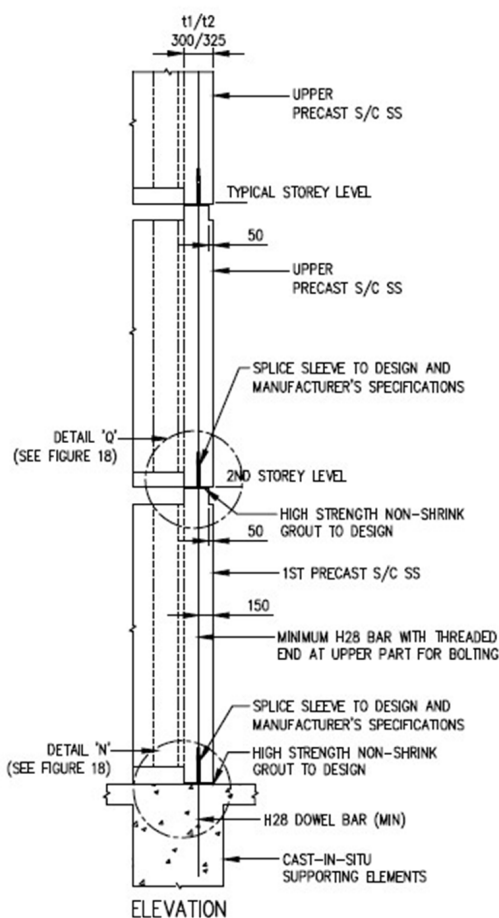


FIGURE 3.5.6.3(b): SPlice SLEEVE CONNECTION DETAILS FOR PRECAST S/C SS TOWER

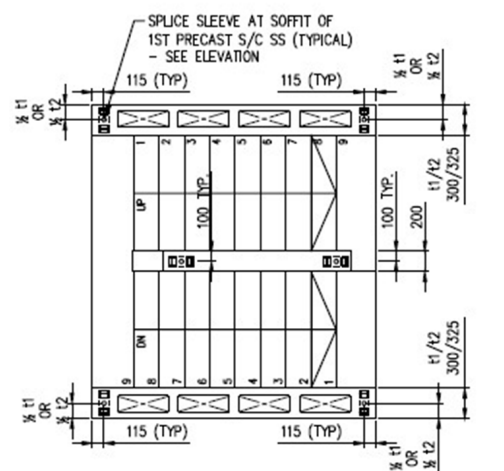

REFERENCE PLAN FOR 1ST STOREY COMPONENT 'B' PRECAST S/C SS
(SIZE AND ARRANGEMENT OF CORES SHOWN IS INDICATIVE ONLY.)

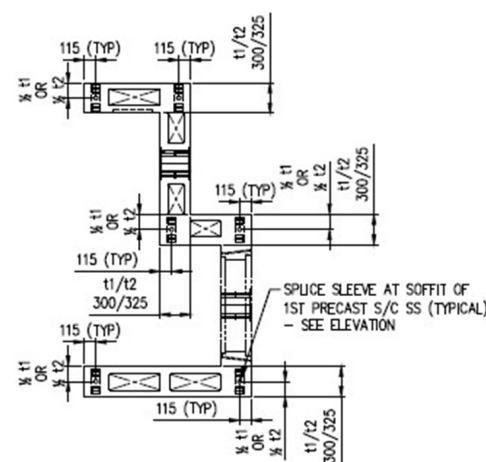

REFERENCE PLAN FOR 1ST STOREY COMPONENT 'C' PRECAST S/C SS
(SIZE AND ARRANGEMENT OF CORES SHOWN IS INDICATIVE ONLY.)

- NOTES:**
1. THE 1ST OR LOWEST PRECAST STOREY SHELTER MUST BE CONNECTED BY SPlice SLEEVE (DETAIL 'N', FIGURE 18) AT 4 CORNERS OR OTHER LOCATIONS OF SHELTER WALL. MINIMUM H28 DOWEL BAR FOR SPlice SLEEVE SHALL BE CAST IN THE CAST IN-SITU SUPPORTING ELEMENTS (WALL, COLUMN, BEAM OR FOUNDATION).
 2. THE UPPER PRECAST STOREY SHELTERS SHALL BE JOINED BY BOLT AND STEEL PLATE CONNECTION (SEE FIGURE 16 FOR DETAIL 'P' AND FIGURE 18 FOR SECTION 9-9, SECTION 10-10 AND DETAIL 'P') AT THEIR 4 CORNERS OR OTHER LOCATION OF SHELTER WALL.
 3. ALTERNATIVE TO THE ABOVE NOTE 2, SPlice SLEEVE CONNECTION CAN BE USED FOR PRECAST S/C SS TOWER (SEE FIGURE 17 FOR DETAIL 'Q' AND FIGURE 18 FOR SECTION 11-11 AND DETAIL 'Q').
 4. HOT ROLLED STEEL SECTION OR PLATE SHALL BE GRADE S275.
 5. H28 BARS REQUIRED FOR THESE TWO TYPES OF CONNECTION SHALL BE PROPERLY SECURED IN POSITION AT 4 TOP CORNERS OR OTHER LOCATIONS OF LOWER PRECAST S/C SS WALL WITH TEMPLATE SUCH THAT THEY ARE ALIGNED WITH THE BOLT HOLES OR SPlice SLEEVE PROVIDED AT THE BASE OF THE UPPER PRECAST STAIRCASE STOREY SHELTER.
 6. THE BOLT AND STEEL PLATE CONNECTION SHALL BE CHECKED AND DESIGNED BY PROFESSIONAL ENGINEER IF THE PRECAST S/C SS COMPONENT IS LARGER OR HEAVIER THAN THAT SHOWN IN FIGURE 1.

ii. FIGURE 3.5.6.3(b): Splice Sleeve Connection Details for Precast S/C SS Tower.

Figures & Tables

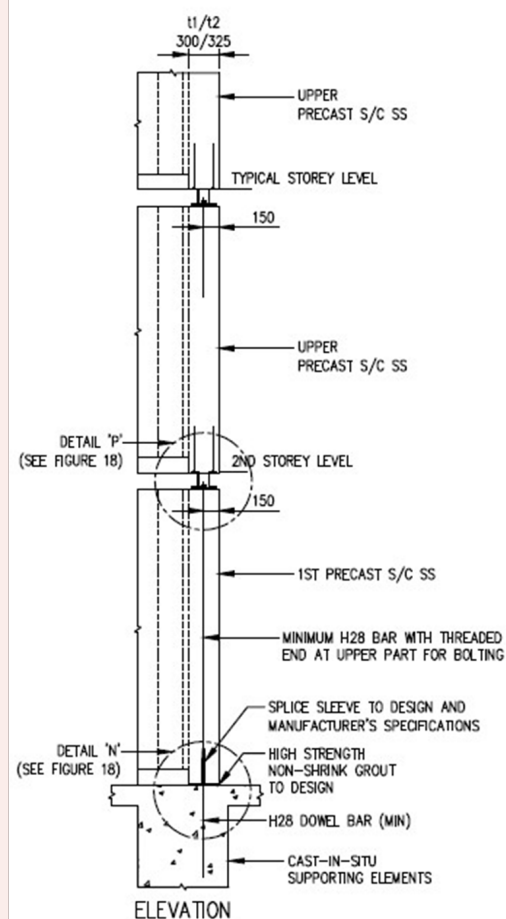


FIGURE 3.5.6.3(a): SPlice SLEEVE CONNECTION DETAILS BETWEEN PRECAST S/C SS AND CAST IN-SITU ELEMENT AND BOLT CONNECTION DETAILS BETWEEN TWO PRECAST S/C SS



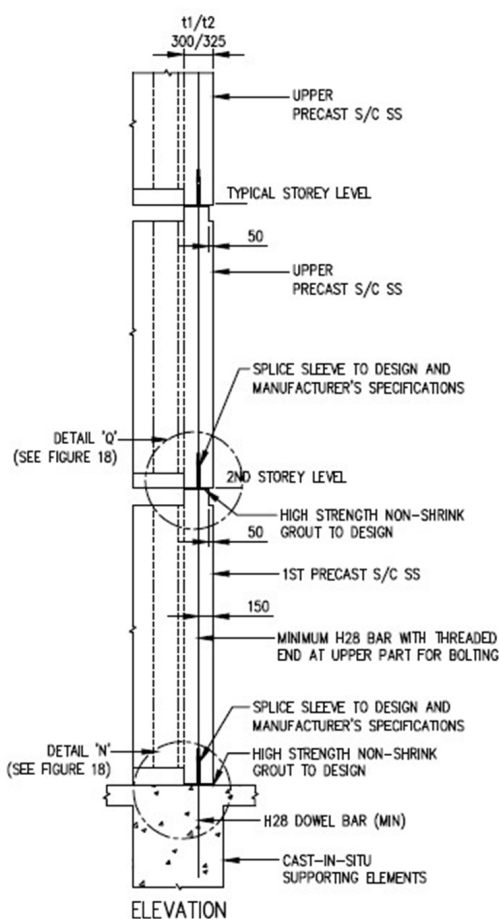


FIGURE 3.5.6.3(b): SPlice SLEEVE CONNECTION DETAILS FOR PRECAST S/C SS TOWER

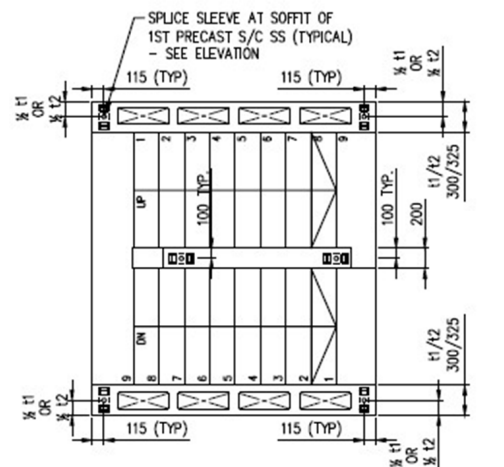


REFERENCE PLAN FOR 1ST STOREY COMPONENT 'B' PRECAST S/C SS
(SIZE AND ARRANGEMENT OF CORES SHOWN IS INDICATIVE ONLY.)

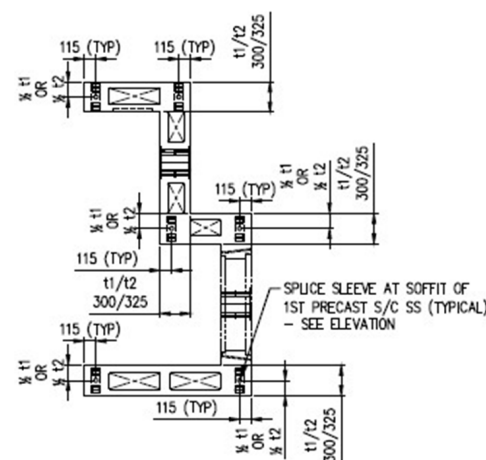

REFERENCE PLAN FOR 1ST STOREY COMPONENT 'C' PRECAST S/C SS
(SIZE AND ARRANGEMENT OF CORES SHOWN IS INDICATIVE ONLY.)

- NOTES:**
1. THE 1ST OR LOWEST PRECAST STOREY SHELTER MUST BE CONNECTED BY SPlice SLEEVE (DETAIL 'N', FIGURE 18) AT 4 CORNERS OR OTHER LOCATIONS OF SHELTER WALL. MINIMUM H28 DOWEL BAR FOR SPlice SLEEVE SHALL BE CAST IN THE CAST IN-SITU SUPPORTING ELEMENTS (WALL, COLUMN, BEAM OR FOUNDATION).
 2. THE UPPER PRECAST STOREY SHELTERS SHALL BE JOINED BY BOLT AND STEEL PLATE CONNECTION (SEE FIGURE 16 FOR DETAIL 'P' AND FIGURE 18 FOR SECTION 9-9, SECTION 10-10 AND DETAIL 'P') AT THEIR 4 CORNERS OR OTHER LOCATION OF SHELTER WALL.
 3. ALTERNATIVE TO THE ABOVE NOTE 2, SPlice SLEEVE CONNECTION CAN BE USED FOR PRECAST S/C SS TOWER (SEE FIGURE 17 FOR DETAIL 'Q' AND FIGURE 18 FOR SECTION 11-11 AND DETAIL 'Q').
 4. HOT ROLLED STEEL SECTION OR PLATE SHALL BE GRADE S275.
 5. H28 BARS REQUIRED FOR THESE TWO TYPES OF CONNECTION SHALL BE PROPERLY SECURED IN POSITION AT 4 TOP CORNERS OR OTHER LOCATIONS OF LOWER PRECAST S/C SS WALL WITH TEMPLATE SUCH THAT THEY ARE ALIGNED WITH THE BOLT HOLES OR SPlice SLEEVE PROVIDED AT THE BASE OF THE UPPER PRECAST STAIRCASE STOREY SHELTER.
 6. THE BOLT AND STEEL PLATE CONNECTION SHALL BE CHECKED AND DESIGNED BY PROFESSIONAL ENGINEER IF THE PRECAST S/C SS COMPONENT IS LARGER OR HEAVIER THAN THAT SHOWN IN FIGURE 1.

Figures & Tables

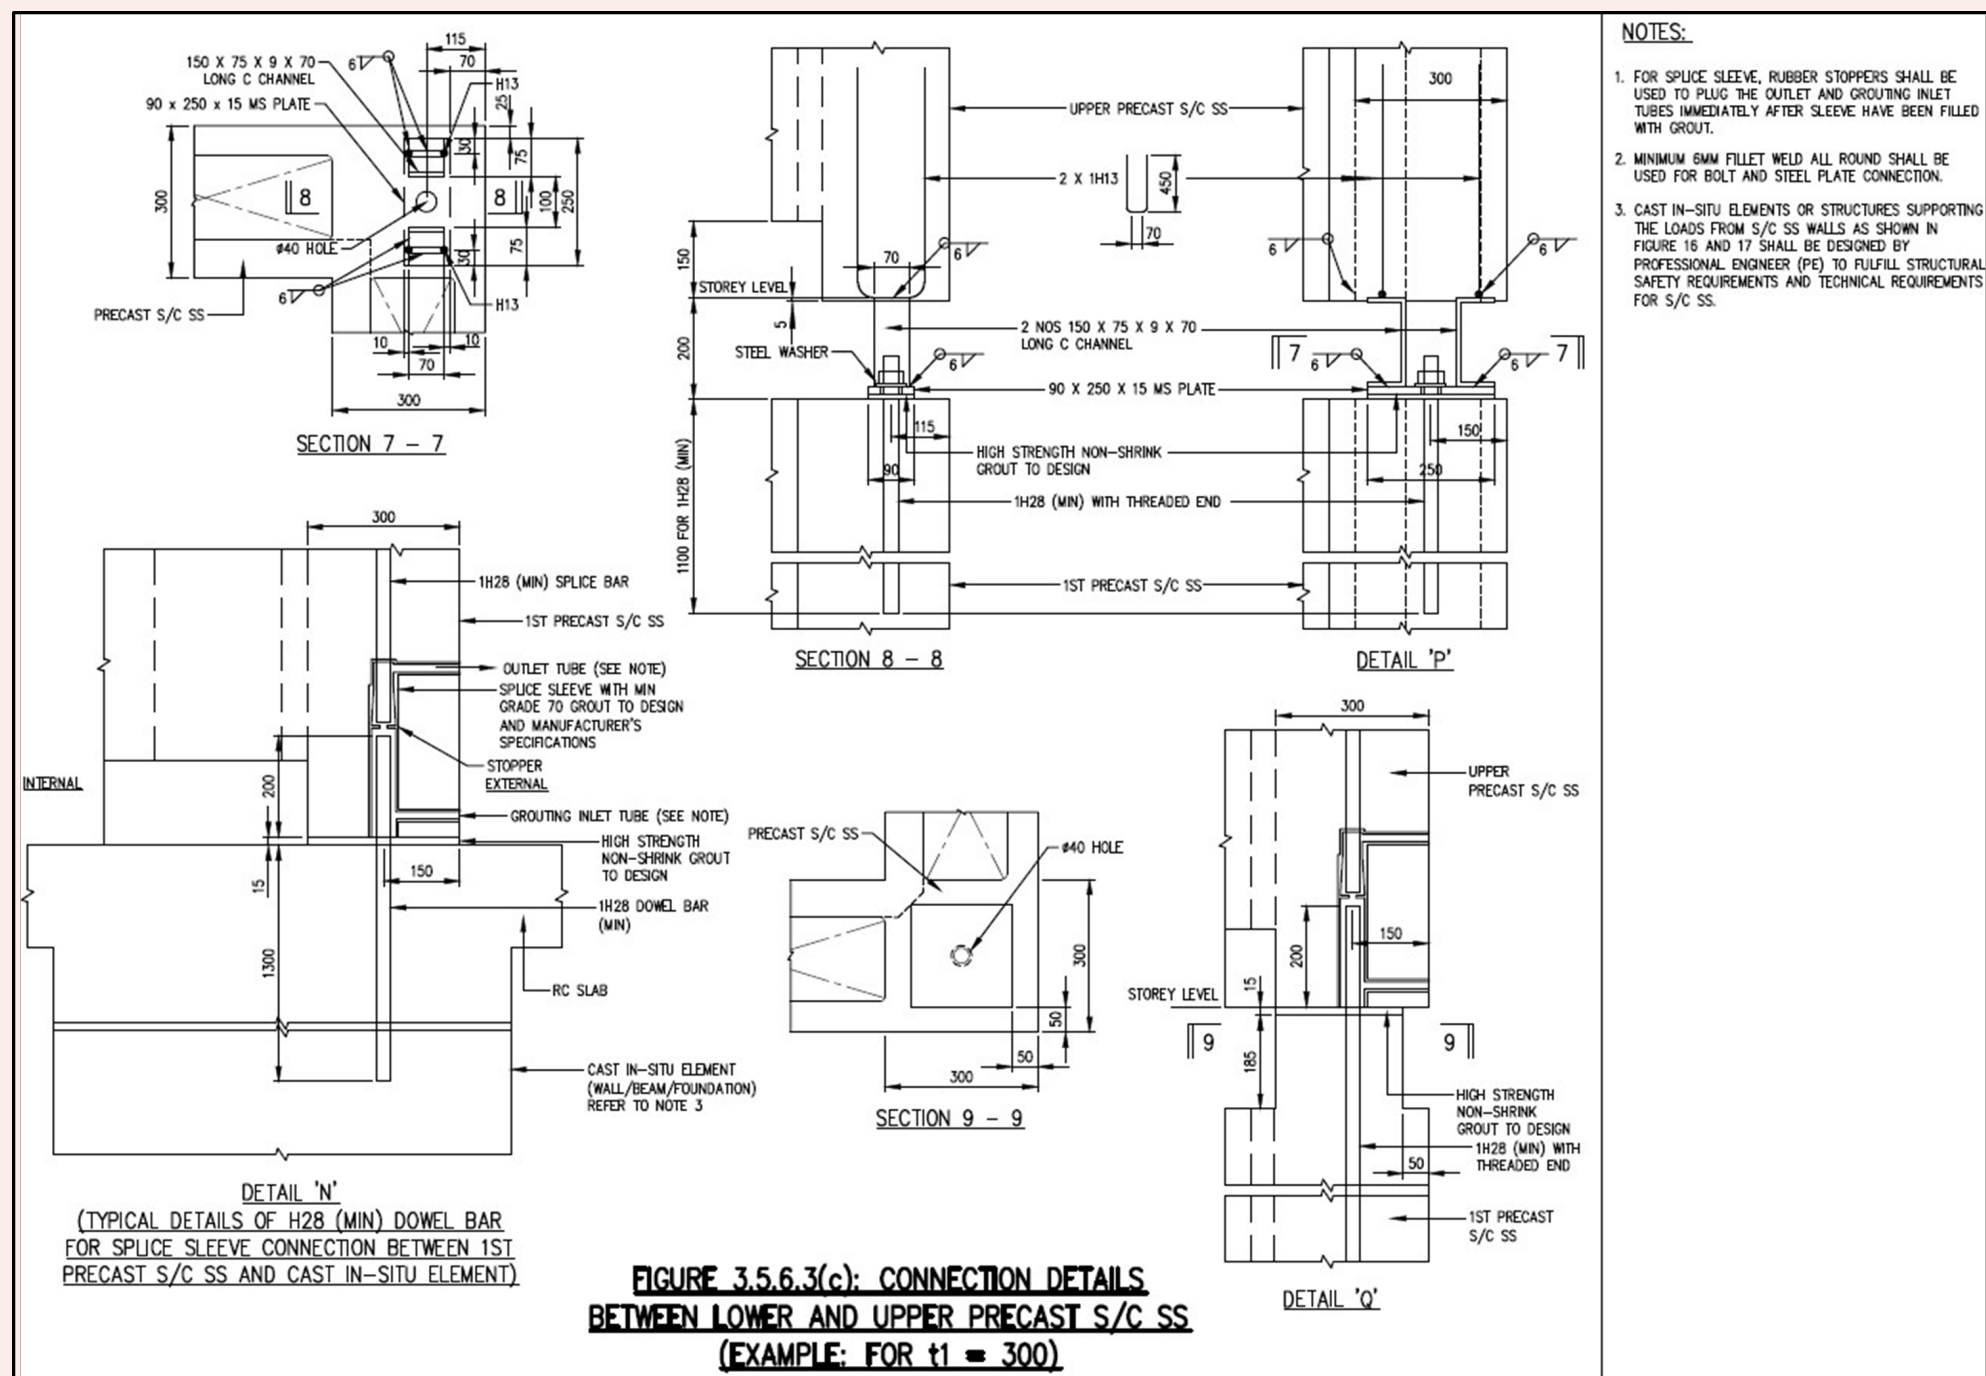

b. Where precast S/C SS is supported on cast in-situ elements (beam or wall), H28 dowel bars shall be cast in the in-situ elements for bolt and steel plate connection or splice sleeve connection between the precast S/C SS and the cast in-situ elements. These dowel bars must be properly secured in position with temporary template such that they are in line with bolt hole or splice sleeve of the upper precast S/C SS hollow core as shown in FIGURE 3.5.6.3(a) to 3.5.6.3(c). In case of the splice sleeve, it shall be pressure-grouted with minimum Grade 70 N/mm² grout to design and manufacturer's specification.

Figures & Tables

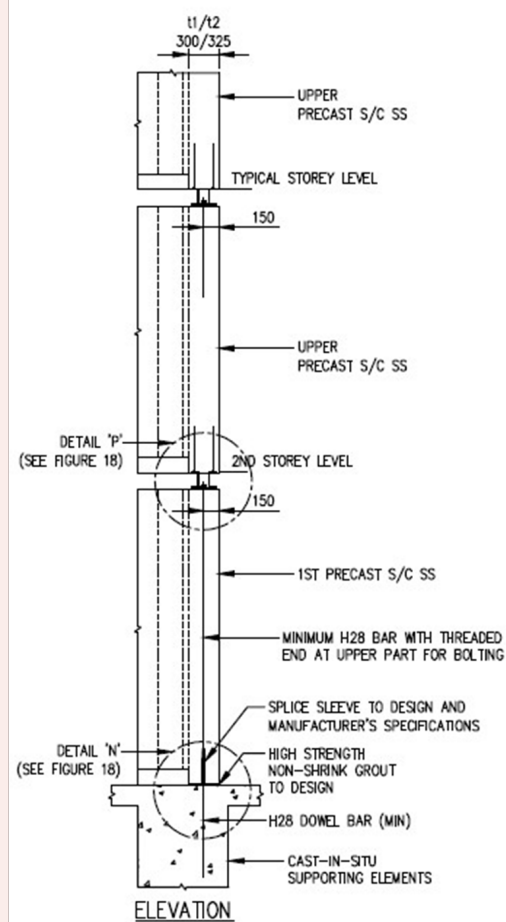


FIGURE 3.5.6.3(a): SPICE SLEEVE CONNECTION DETAILS BETWEEN PRECAST S/C SS AND CAST IN-SITU ELEMENT AND BOLT CONNECTION DETAILS BETWEEN TWO PRECAST S/C SS



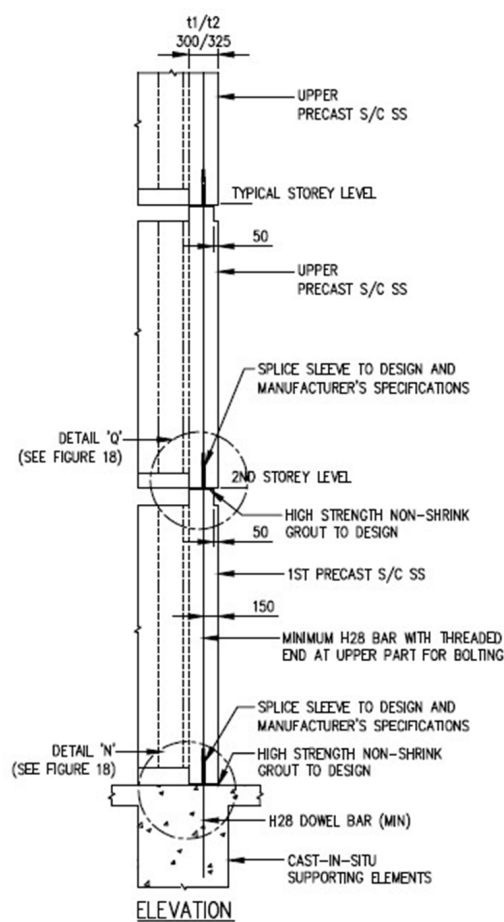


FIGURE 3.5.6.3(b): SPICE SLEEVE CONNECTION DETAILS FOR PRECAST S/C SS TOWER

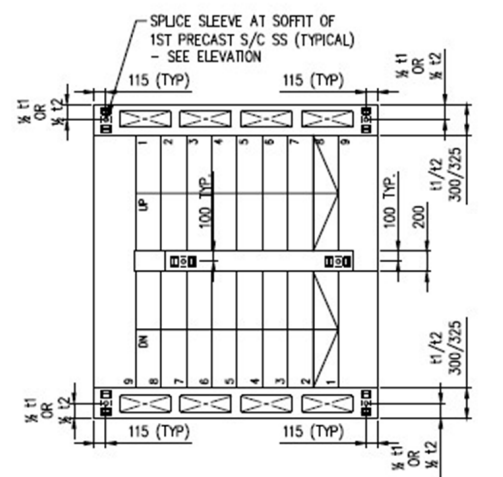


REFERENCE PLAN FOR 1ST STOREY COMPONENT 'B' PRECAST S/C SS
(SIZE AND ARRANGEMENT OF CORES SHOWN IS INDICATIVE ONLY)

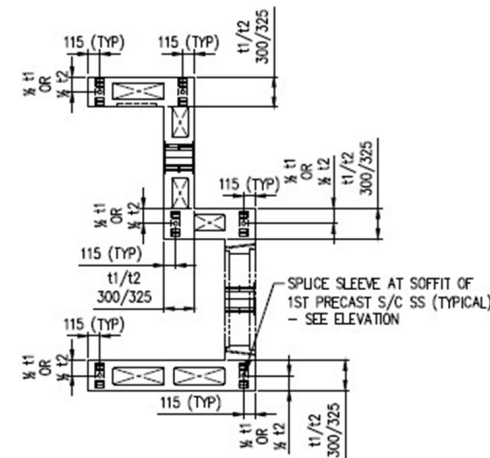


REFERENCE PLAN FOR 1ST STOREY COMPONENT 'C' PRECAST S/C SS
(SIZE AND ARRANGEMENT OF CORES SHOWN IS INDICATIVE ONLY)

NOTES:

1. THE 1ST OR LOWEST PRECAST STOREY SHELTER MUST BE CONNECTED BY SPICE SLEEVE (DETAIL 'N', FIGURE 18) AT 4 CORNERS OR OTHER LOCATIONS OF SHELTER WALL. MINIMUM H28 DOWEL BAR FOR SPICE SLEEVE SHALL BE CAST IN THE CAST IN-SITU SUPPORTING ELEMENTS (WALL, COLUMN, BEAM OR FOUNDATION).
2. THE UPPER PRECAST STOREY SHELTERS SHALL BE JOINED BY BOLT AND STEEL PLATE CONNECTION (SEE FIGURE 16 FOR DETAIL 'P' AND FIGURE 18 FOR SECTION 9-9, SECTION 10-10 AND DETAIL 'Q') AT THEIR 4 CORNERS OR OTHER LOCATION OF SHELTER WALL.
3. ALTERNATIVE TO THE ABOVE NOTE 2, SPICE SLEEVE CONNECTION CAN BE USED FOR PRECAST S/C SS TOWER (SEE FIGURE 17 FOR DETAIL 'Q' AND FIGURE 18 FOR SECTION 11-11 AND DETAIL 'Q').
4. HOT ROLLED STEEL SECTION OR PLATE SHALL BE GRADE S275.
5. H28 BARS REQUIRED FOR THESE TWO TYPES OF CONNECTION SHALL BE PROPERLY SECURED IN POSITION AT 4 TOP CORNERS OR OTHER LOCATIONS OF LOWER PRECAST S/C SS WALL WITH TEMPLATE SUCH THAT THEY ARE ALIGNED WITH THE BOLT HOLES OR SPICE SLEEVE PROVIDED AT THE BASE OF THE UPPER PRECAST STAIRCASE STOREY SHELTER.
6. THE BOLT AND STEEL PLATE CONNECTION SHALL BE CHECKED AND DESIGNED BY PROFESSIONAL ENGINEER IF THE PRECAST S/C SS COMPONENT IS LARGER OR HEAVIER THAN THAT SHOWN IN FIGURE 1.

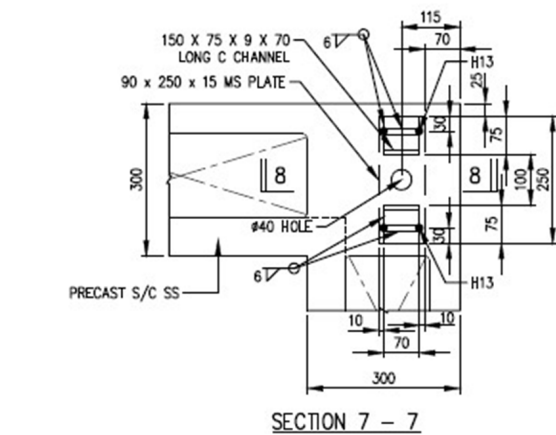


SECTION 7 - 7

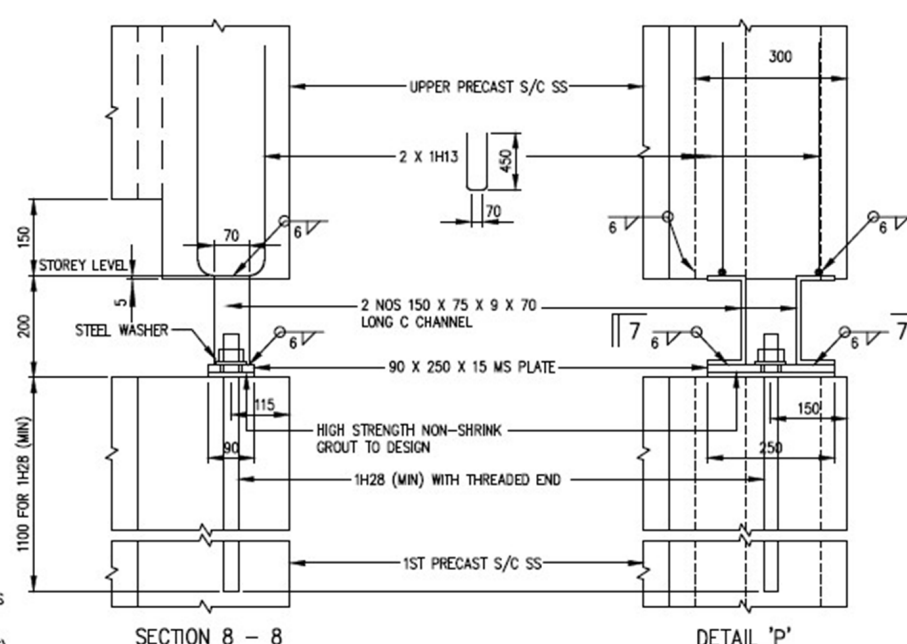


SECTION 8 - 8

DETAIL 'P'

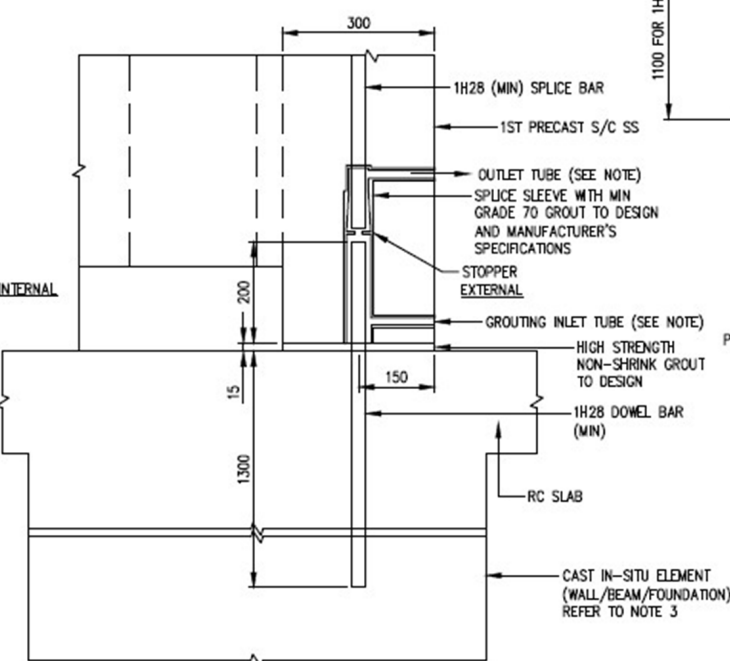

SECTION 9 - 9

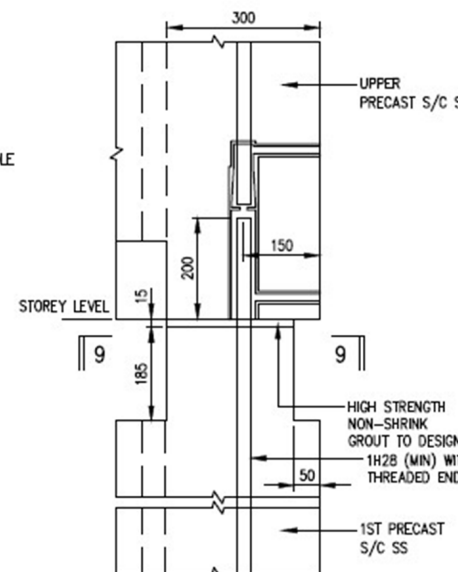

DETAIL 'Q'


NOTES:

1. FOR SPICE SLEEVE, RUBBER STOPPERS SHALL BE USED TO PLUG THE OUTLET AND GROUTING INLET TUBES IMMEDIATELY AFTER SLEEVE HAVE BEEN FILLED WITH GROUT.
2. MINIMUM 6MM FILLET WELD ALL ROUND SHALL BE USED FOR BOLT AND STEEL PLATE CONNECTION.
3. CAST IN-SITU ELEMENTS OR STRUCTURES SUPPORTING THE LOADS FROM S/C SS WALLS AS SHOWN IN FIGURE 16 AND 17 SHALL BE DESIGNED BY PROFESSIONAL ENGINEER (PE) TO FULFILL STRUCTURAL SAFETY REQUIREMENTS AND TECHNICAL REQUIREMENTS FOR S/C SS.

FIGURE 3.5.6.3(c): CONNECTION DETAILS BETWEEN LOWER AND UPPER PRECAST S/C SS (EXAMPLE: FOR t1 = 300)

c. The lower and upper precast S/C SS can be connected by bolt and steel plate connection or splice sleeve connection as shown in FIGURE 3.5.6.3(c). To facilitate installation, H28 bars required for these two types of connection shall be properly secured in position at 4 top corners or other locations (if any) of lower precast S/C SS wall with a temporary template such that they are aligned with the bolt holes or splice sleeve provided at the base or lower part of the upper precast S/C SS respectively.


Figures & Tables

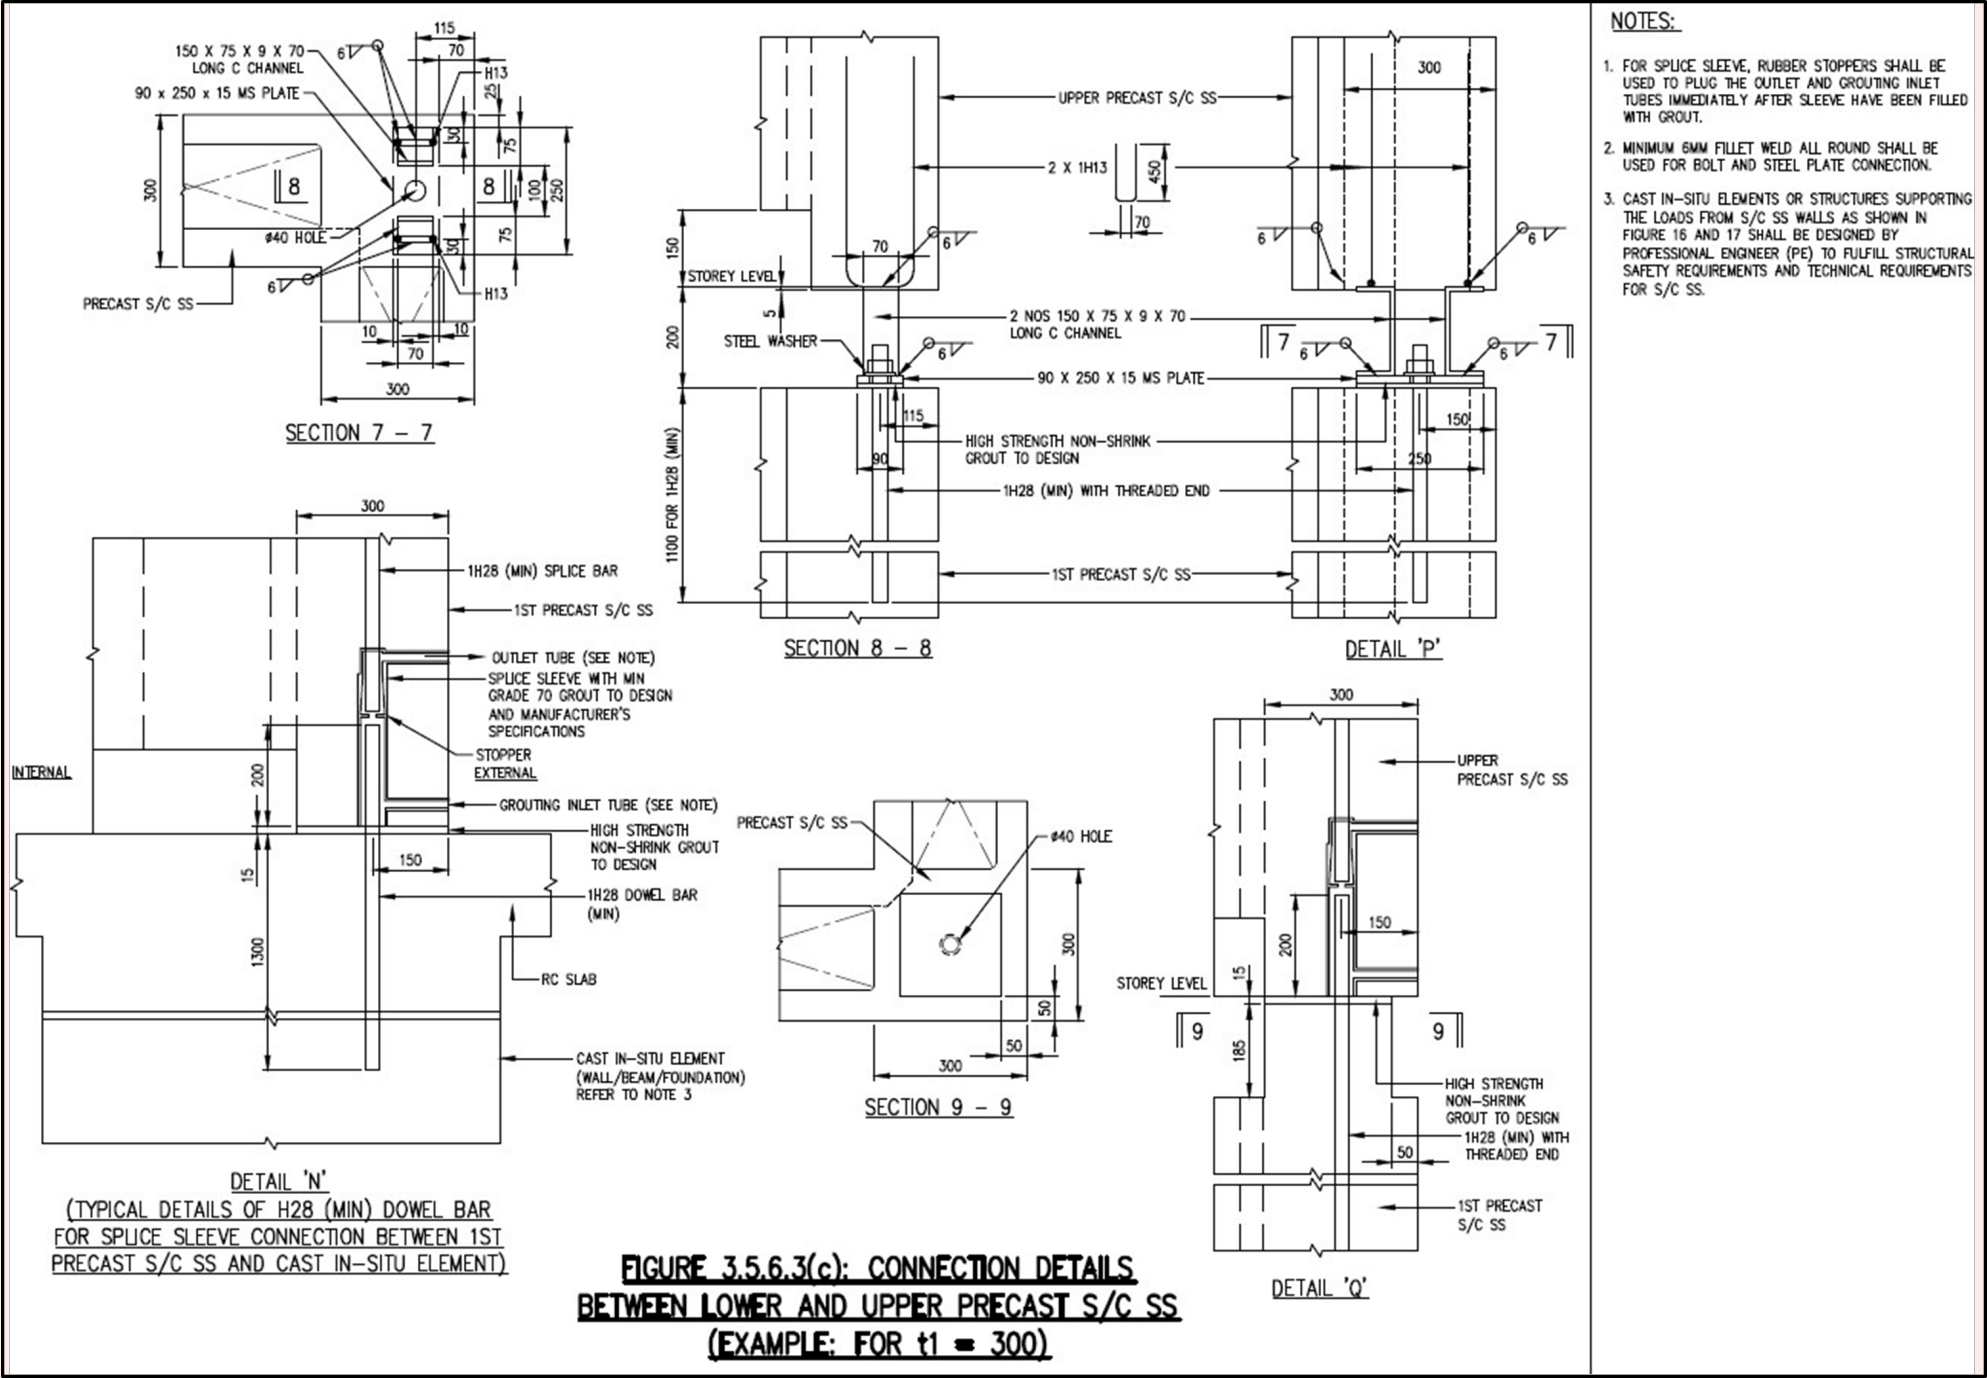

3.5.6.4 Precast Slab


- a. 90mm thick precast slab is cast as integrated part of the precast S/C SS component.
- b. The minimum reinforcements to be provided for precast slab and structural concrete topping for the slab shall be as shown in FIGURE 3.5.6.4(a). The details show the thickness of precast slab and in-situ concrete topping.

Figures & Tables

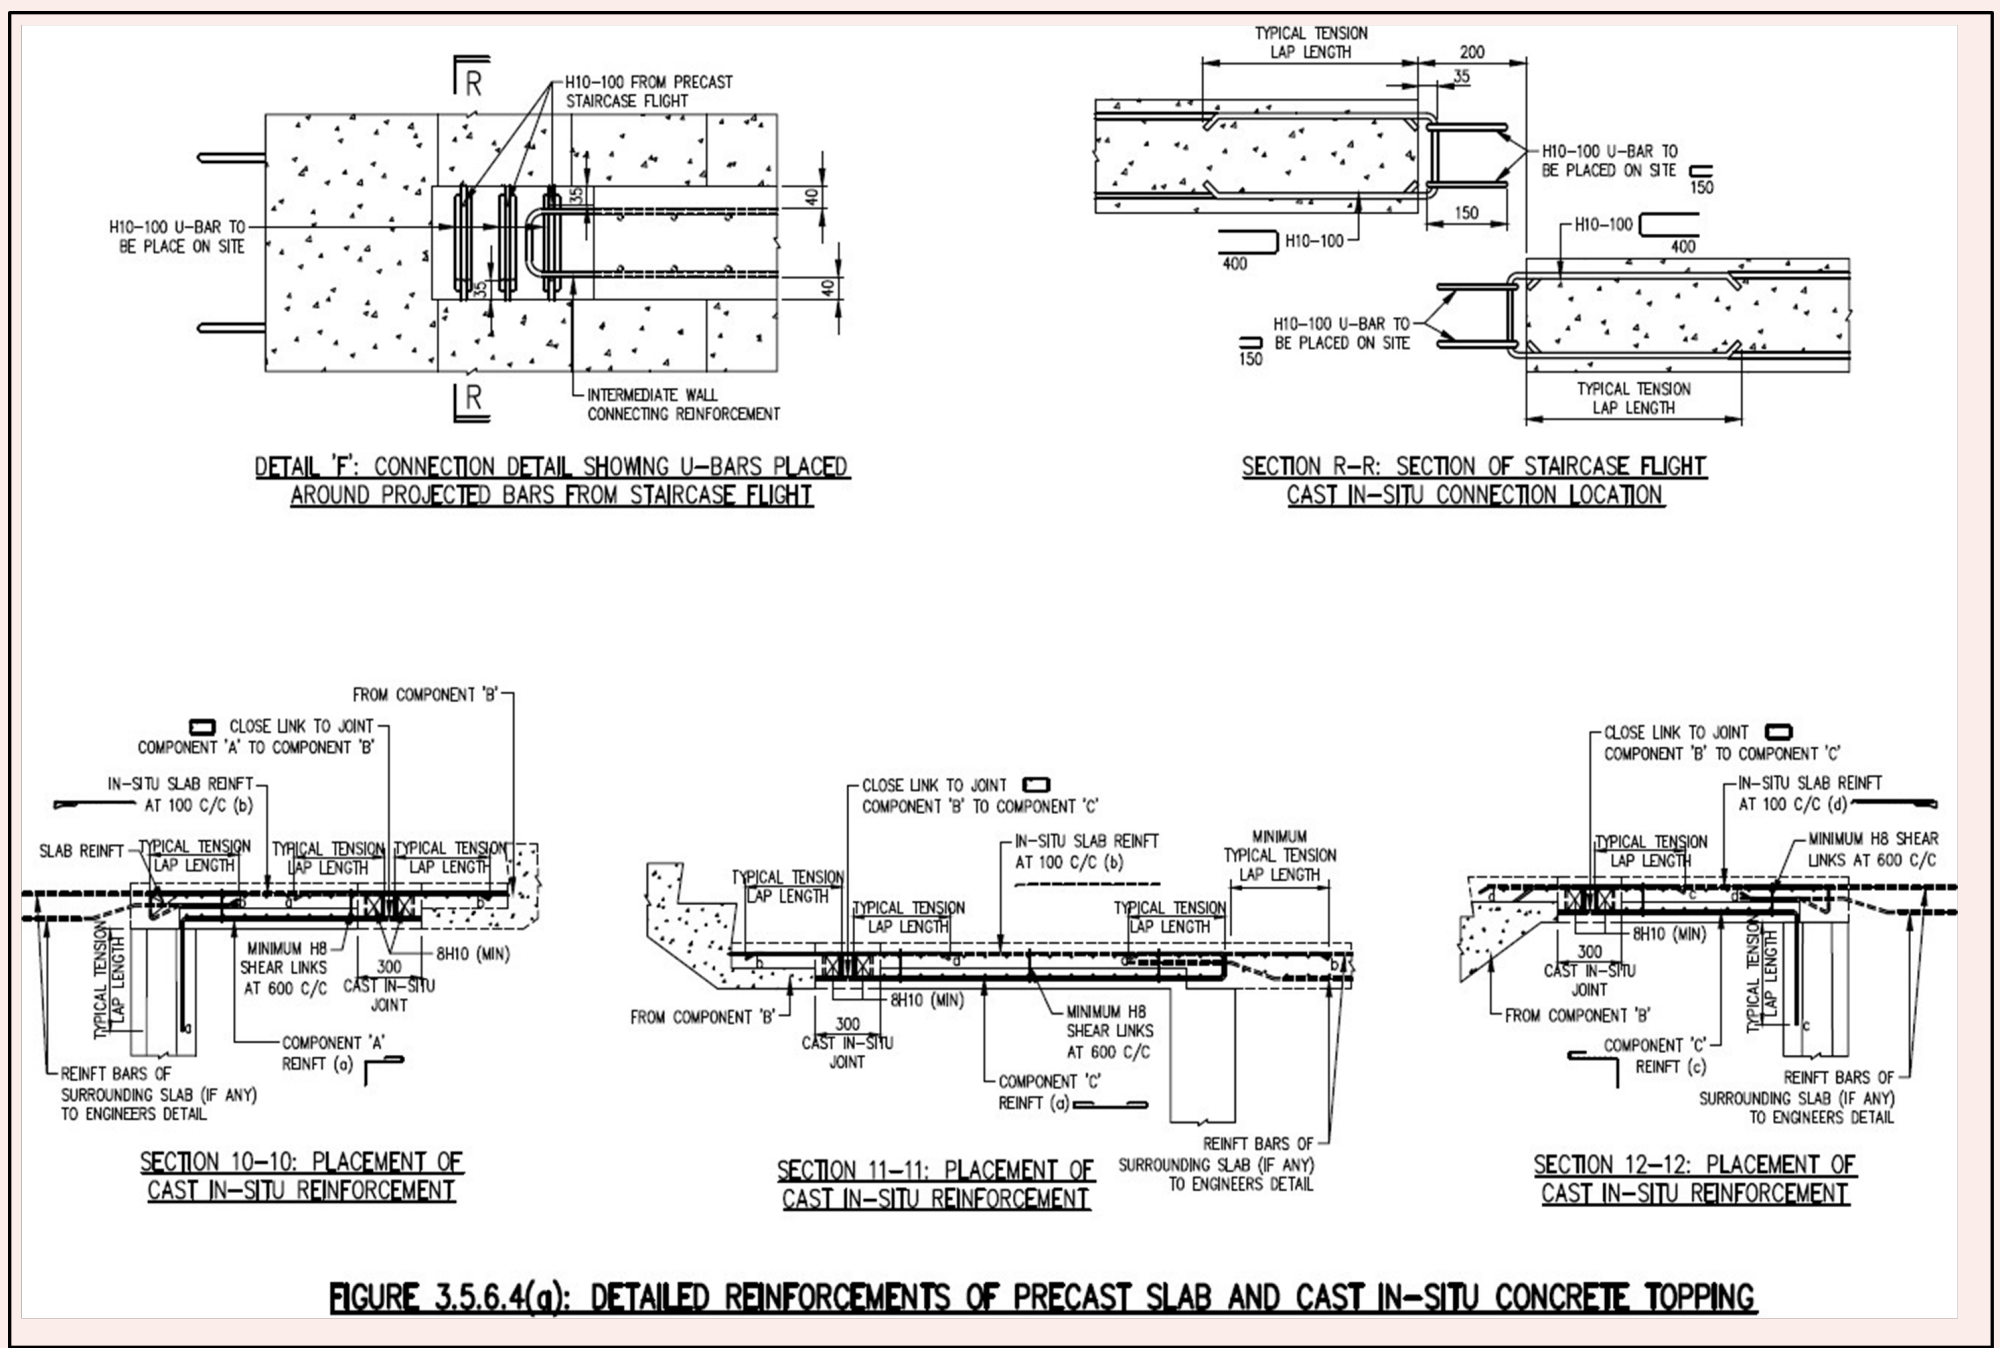

i. FIGURE 3.5.6.4(a): Detailed Reinforcements of Precast Slab and Cast In-Situ Concrete Topping.

Figures & Tables

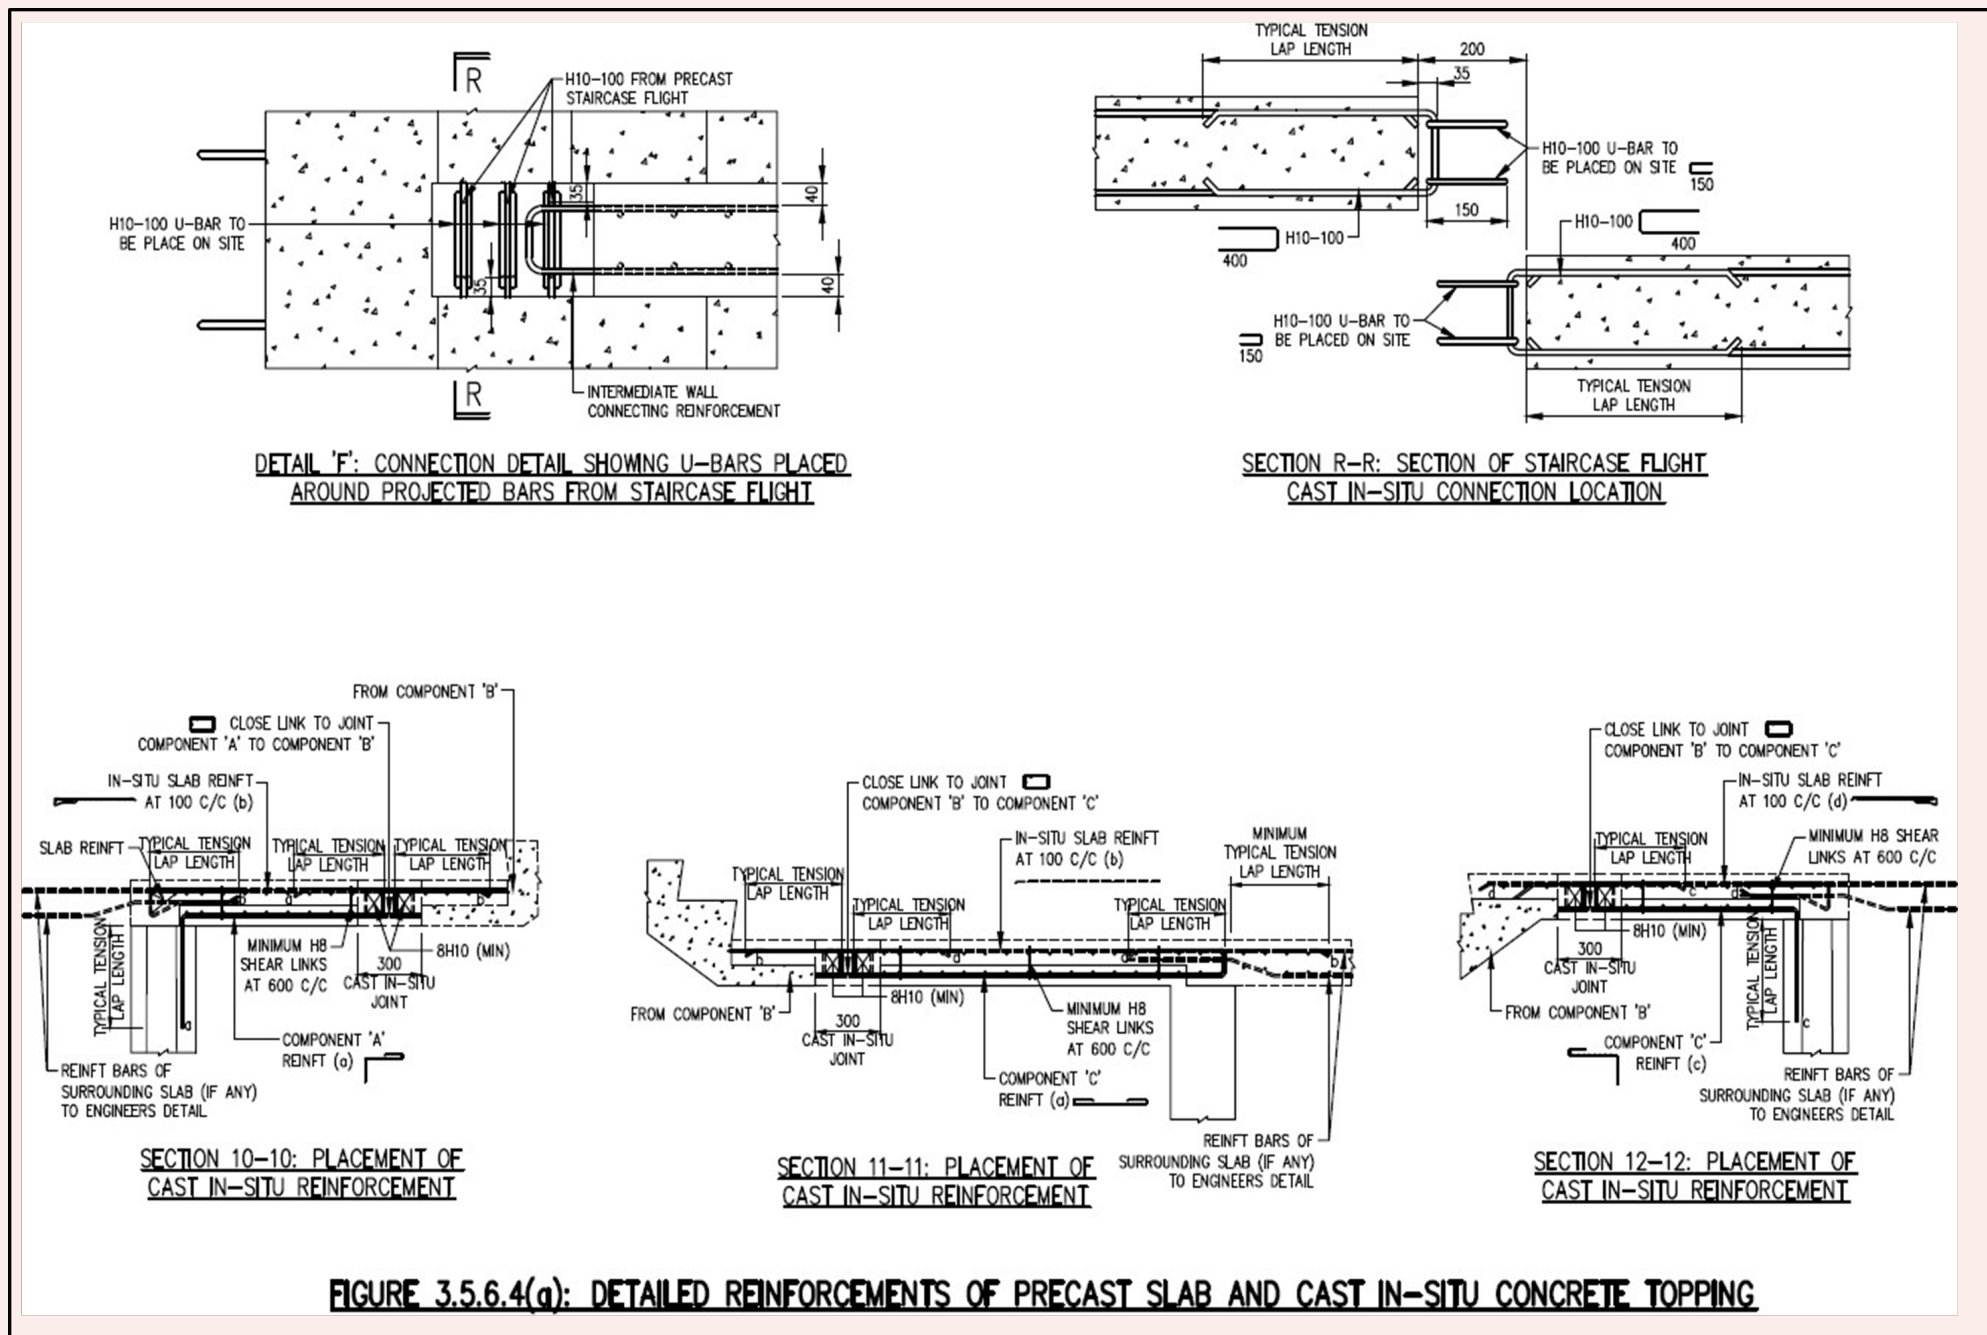

ii. FIGURE 3.5.6.4(b): Connection Details between Precast S/C SS and Cast In- Situ Wall.

Figures & Tables

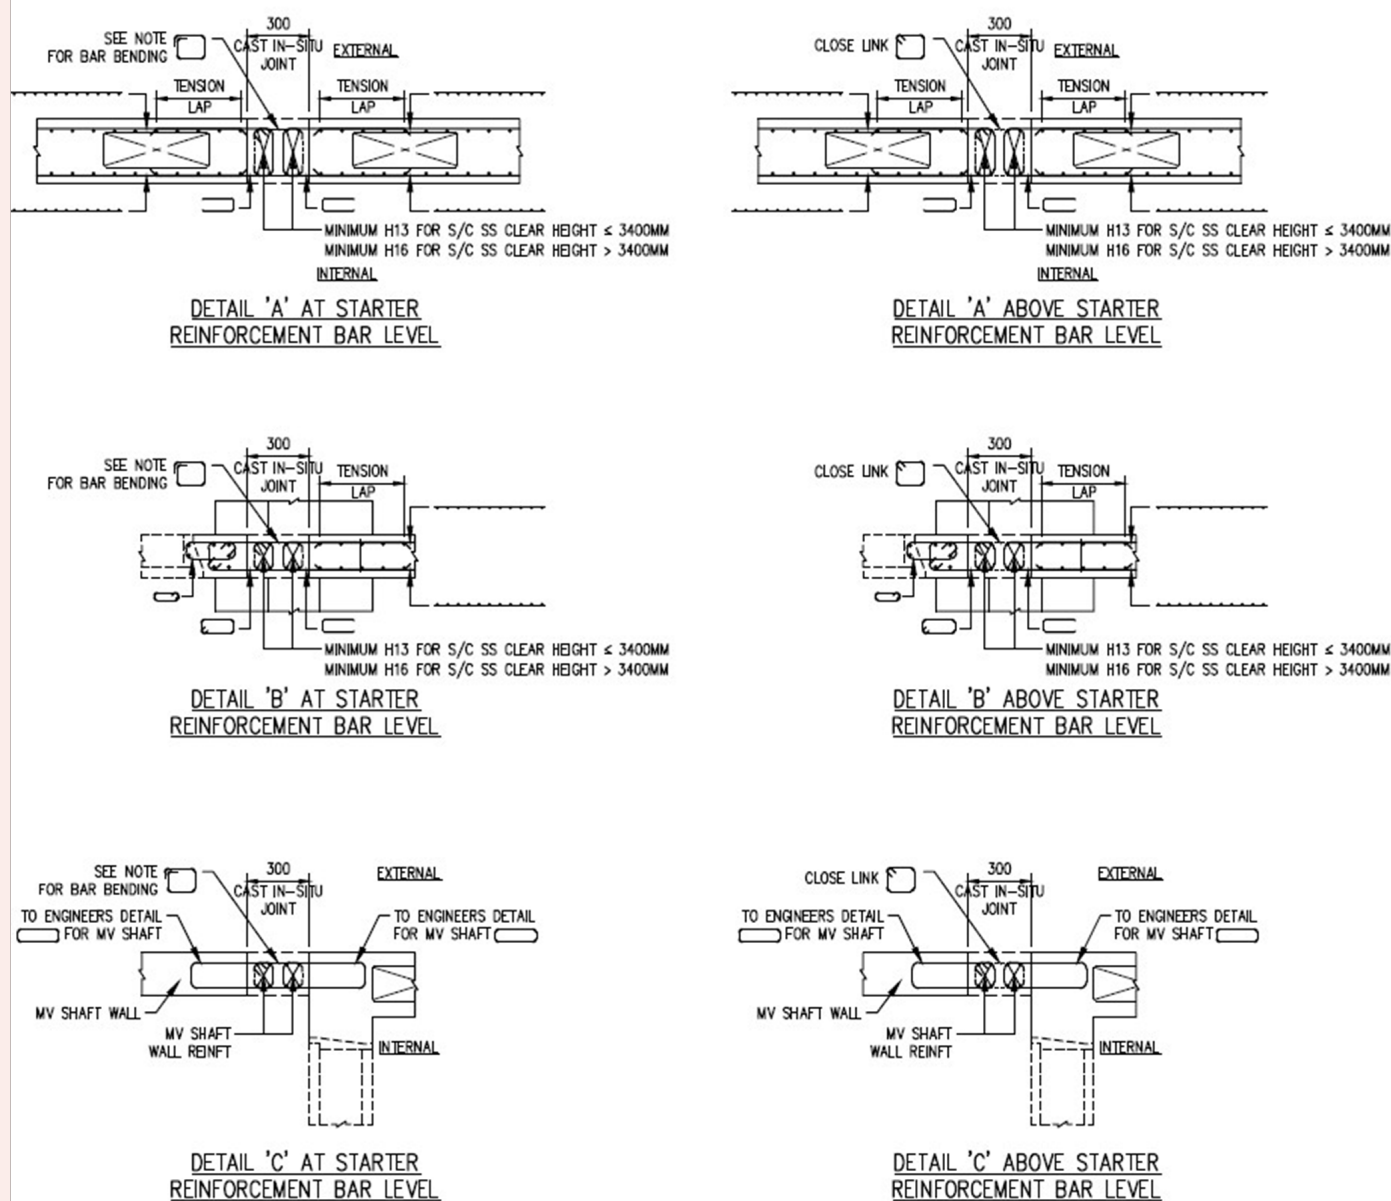


FIGURE 3.5.6.4(b): CONNECTION DETAILS BETWEEN PRECAST S/C SS AND CAST IN-SITU WALL

c. The shear links shall be cast in the precast slab. The hook of the shear links must be anchored around the outermost layer of reinforcement bars of the precast slab. The bend of the shear link shall be anchored around the outermost layer of reinforcement bars in the concrete topping.

3.5.6.5 External Electrical Fixtures

Where there are electrical fixtures on external face of S/C SS precast wall, a recess shall be formed on the rib of the precast S/C SS wall as shown in FIGURE 3.5.6.2(h).

Figures & Tables

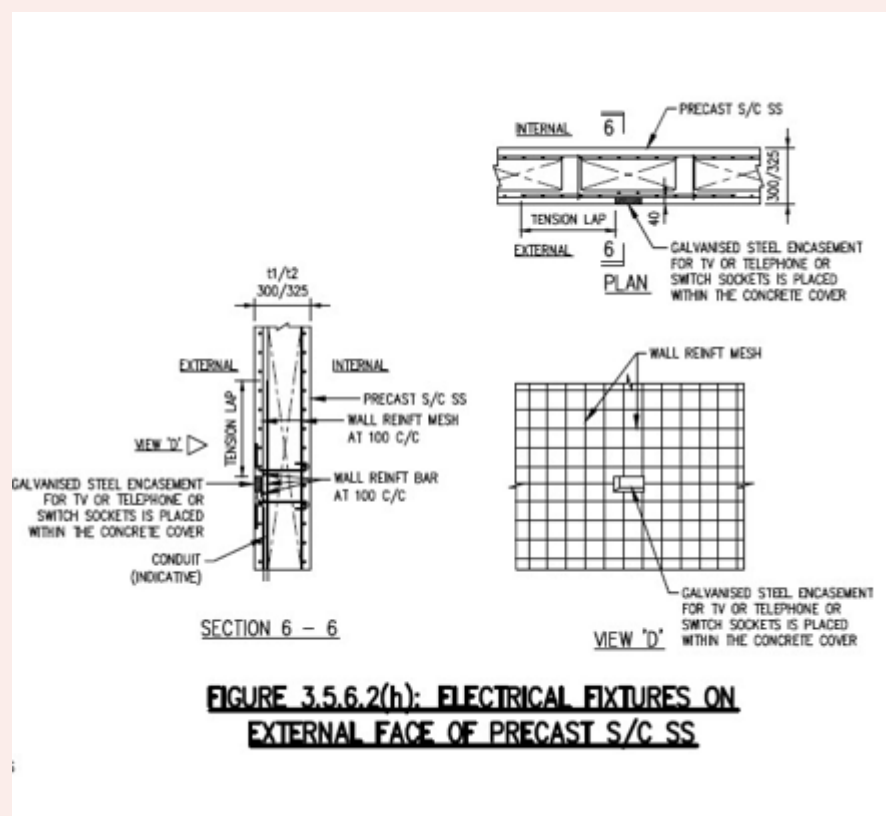



FIGURE 3.5.6.2(h): ELECTRICAL FIXTURES ON EXTERNAL FACE OF PRECAST S/C SS

3.5.6.6 Ventilation Sleeves

One of the two ventilation sleeves shall be located above the precast S/C SS door at the entrance.

3.5.6.7 Door Recess on Precast S/C SS Wall

A recess shall be formed on the external face of the precast S/C SS wall to accommodate the S/C SS door handle when the S/C SS door is opened in 180°. The recess shall not be larger than 160mm (length) x 80mm (height) x 40mm (depth). The reinforcement bars for the recess are shown in FIGURE 3.5.6.2(g).

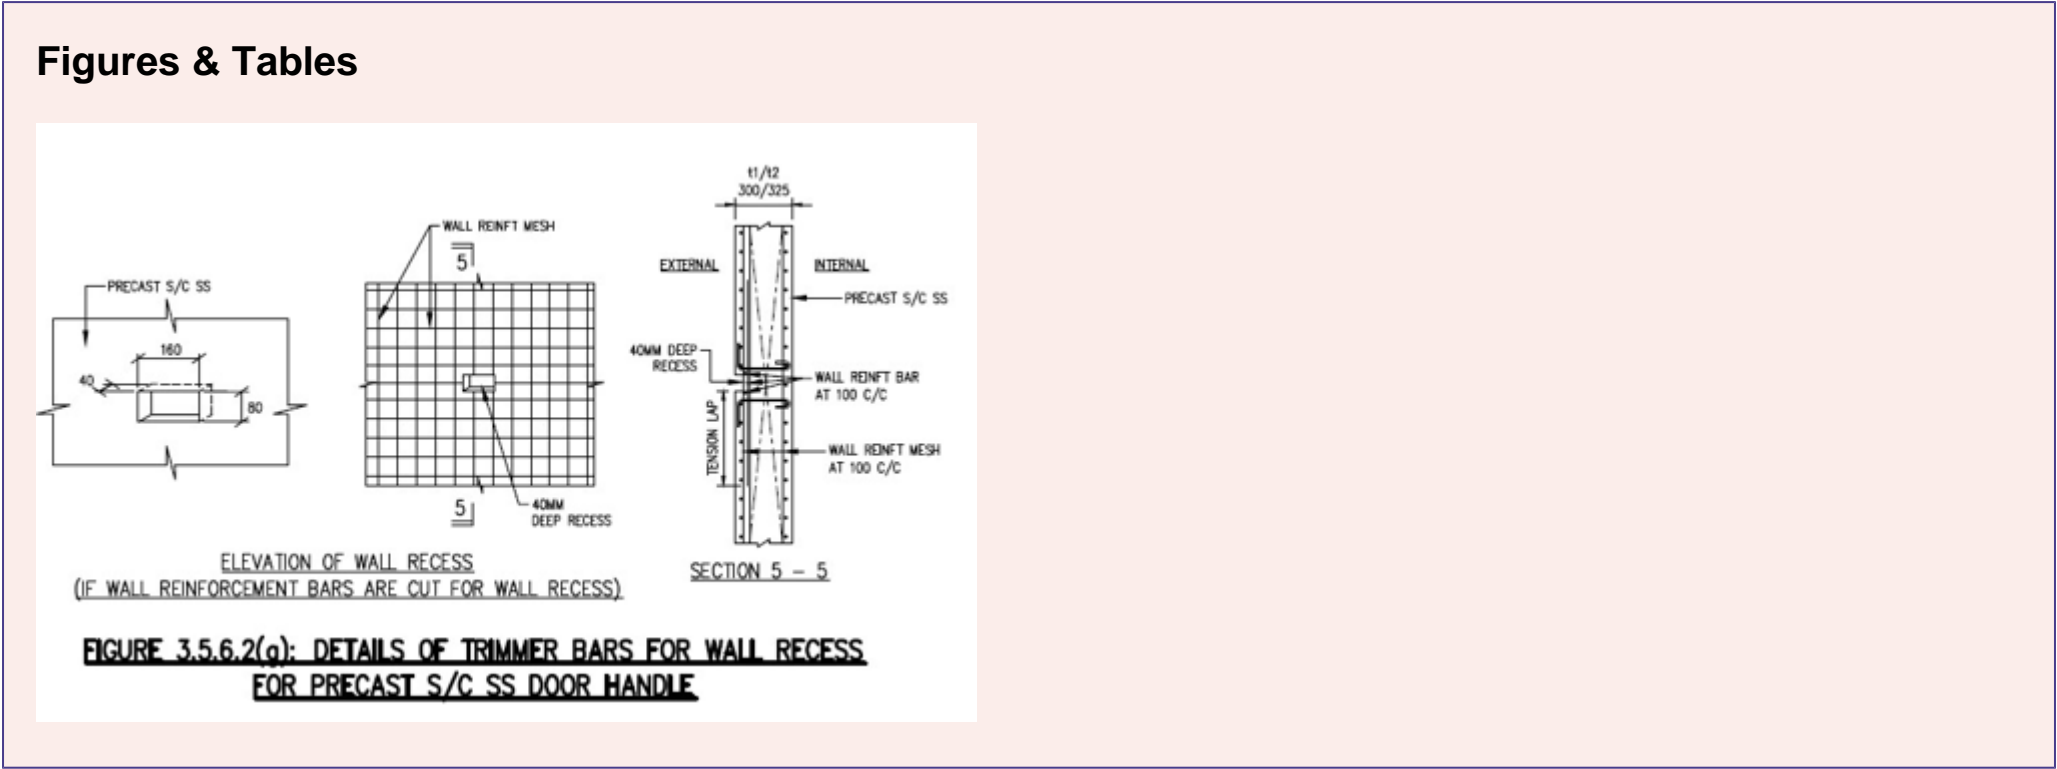


3.5.7 Joints

- a. Construction joints in an SS tower shall be properly executed to ensure that the strength and the integrity of the SS are not impaired. The type and location of joints shall be specified in the design after taking into account the following:
 - i. A concrete kicker, if provided, shall not be more than 100mm high.
 - ii. All SS walls located within each storey shall be cast in one operation.
- b. Expansion joints or contraction joints in the SS tower are not permitted.
- c. Ventilation sleeve and electrical services shall not be located within connection joint between precast SS door frame and cast in-situ SS/NS wall, and within connection joint between two precast SS walls.

CLAUSE 3.6 PENETRATION OF SERVICES

3.6.1 Electrical Services

- a. All service conduits shall not penetrate directly through the walls and slabs of the SS.
- b. Only service conduits serving the SS shall embed within the SS walls and slabs. Service conduit for electrical and communication fixtures which are located on external face of SS wall may also be embedded in the SS wall. Other than these, all service conduits which do not serve the SS shall not embed within the SS wall and slab.
- c. A maximum of ten numbers of 25mm diameter service conduits for electrical and communication cables serving the SS, and for electrical and communication services which are located on external face of SS wall, are allowed to be embedded in the SS walls. Both ends of these concealed conduits shall be fully sealed with sealing material in accordance with the manufacturer’s specification and up to a depth of not less than 100mm into the conduits to ensure air-tightness of the SS.
- d. Two cast-in service outlets located directly back-to-back on the internal and external faces of the SS wall are not permitted (refer to FIGURE 3.6.1(a)). Service outlets shall be fixed with at least a clear distance of 300mm between each other. Refer to FIGURE 2.10.

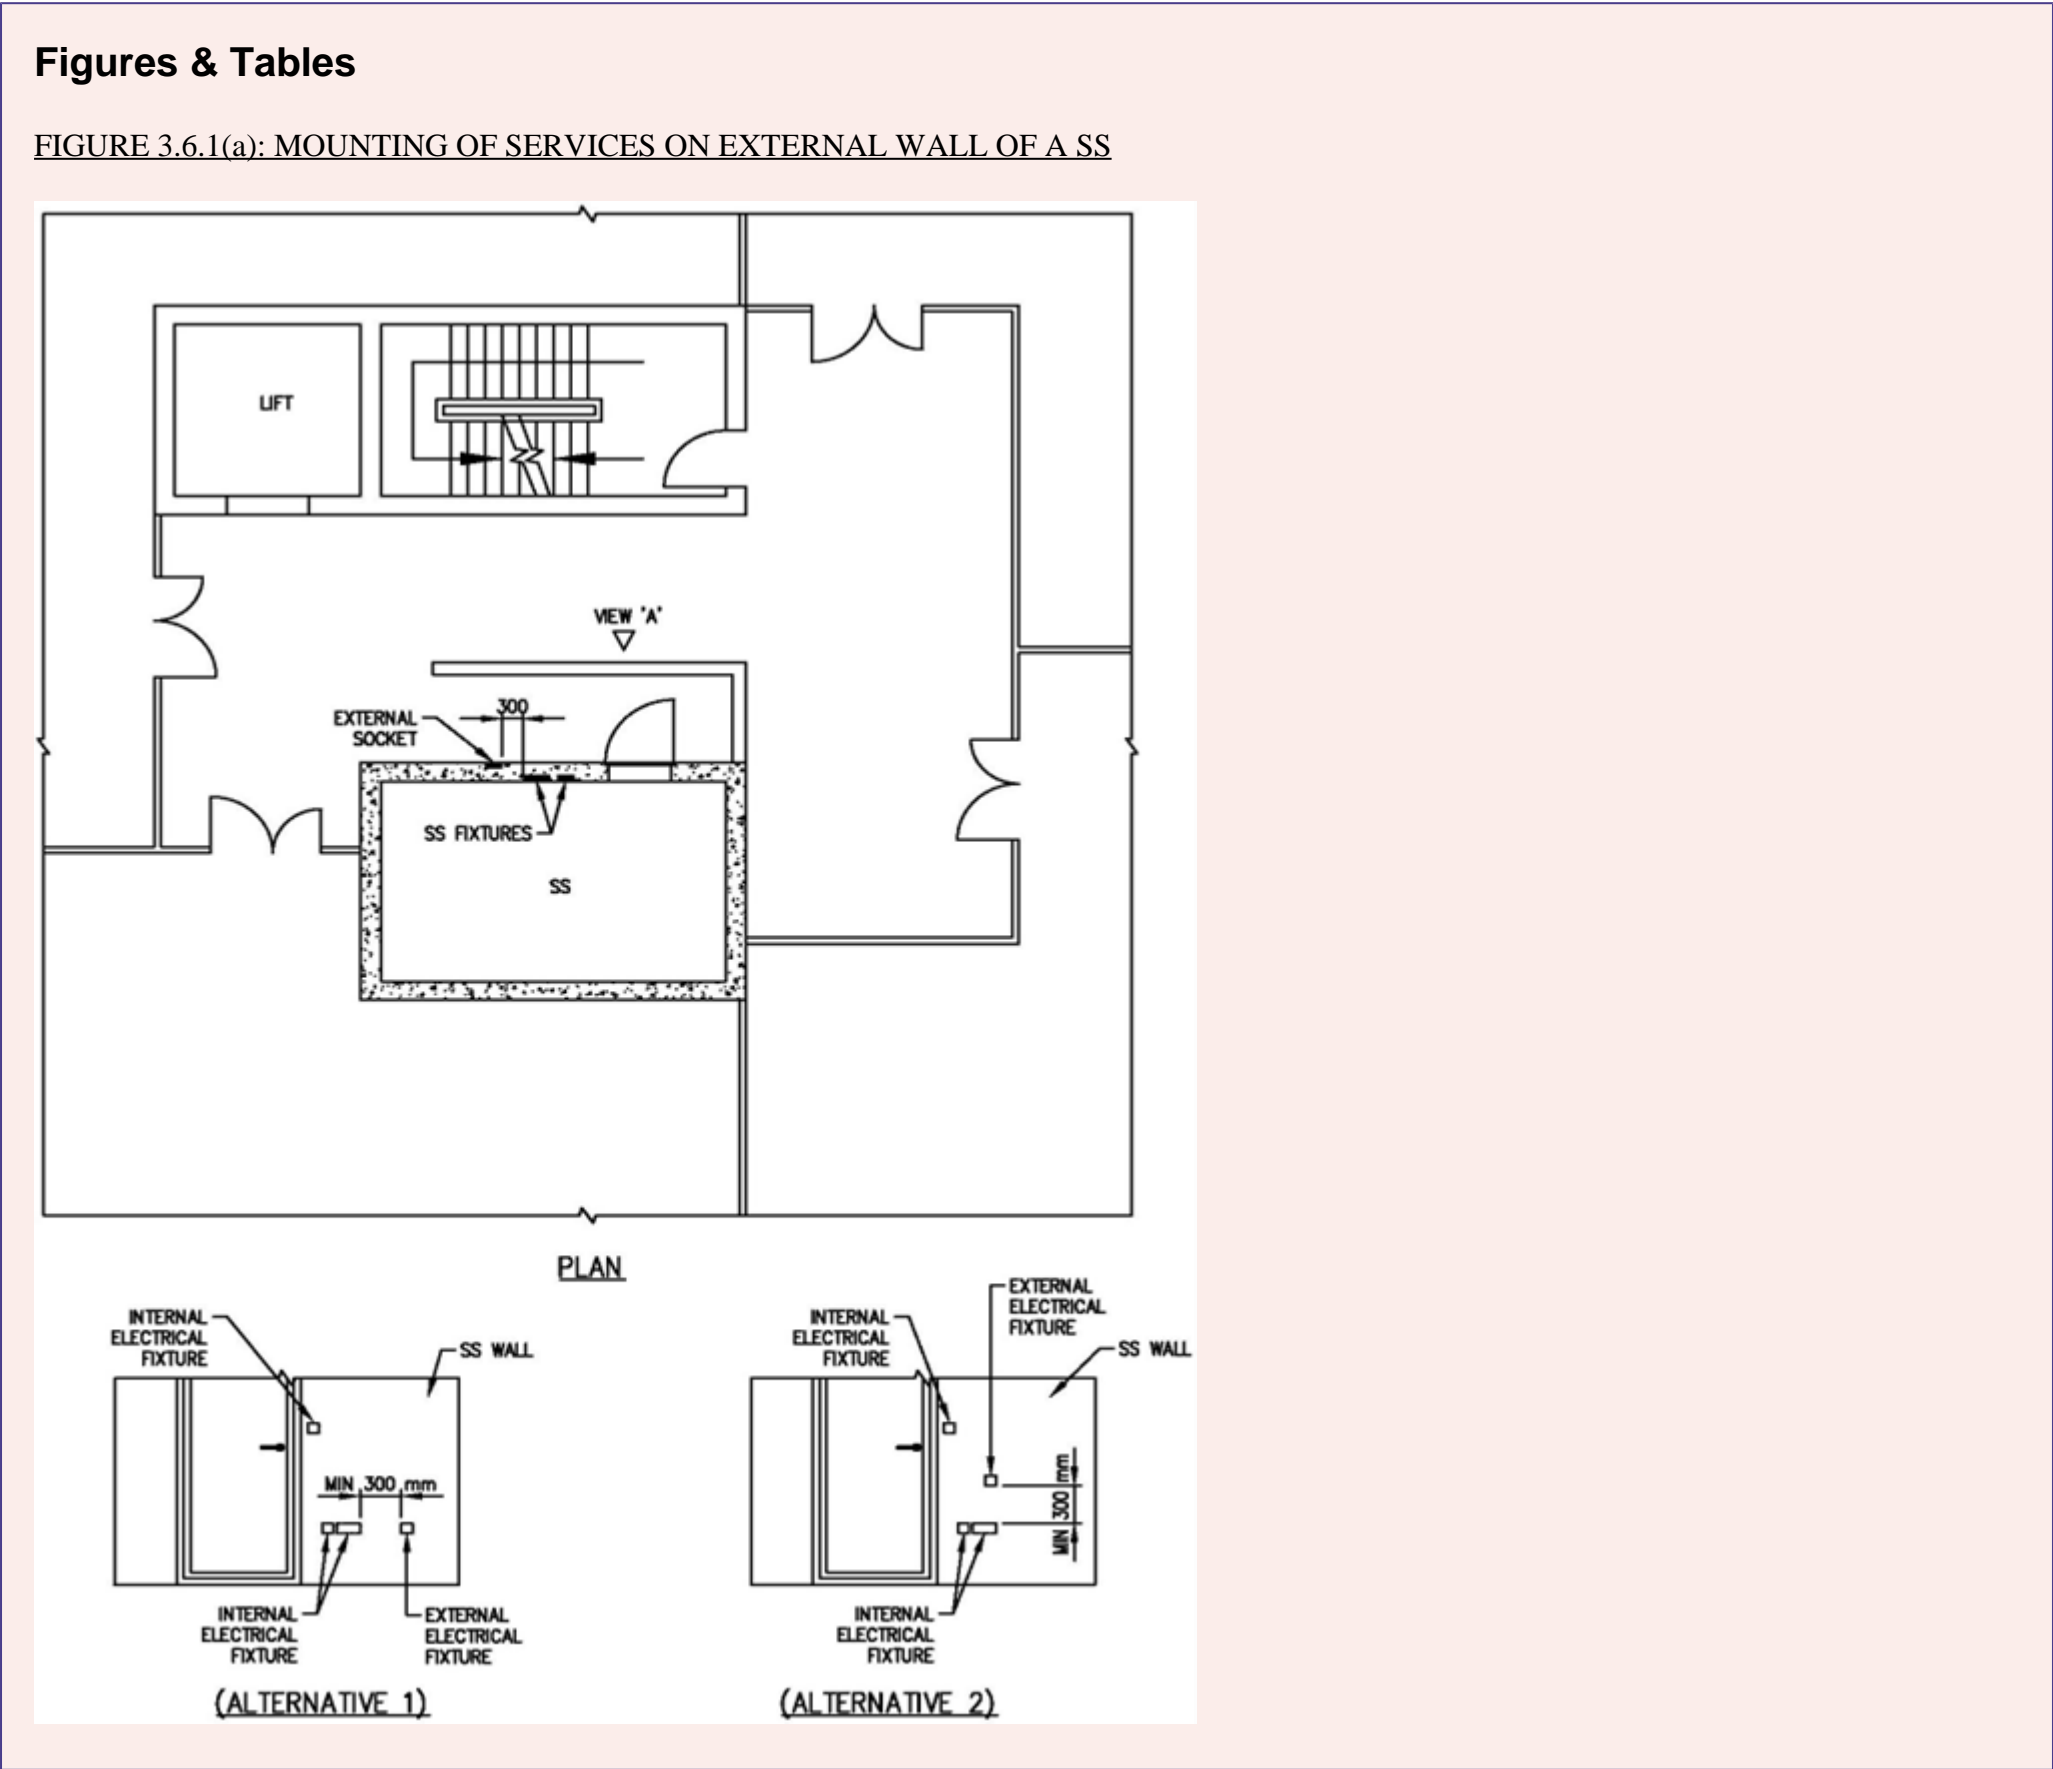

- e. Where service cables and fixtures in the SS are exposed on internal walls and slab, non-metallic inserts are to be used for their mounting. For embedded service cables and fixtures serving the SS, the details shall be as shown in FIGURE 3.5.4(e). The encasement of switch socket outlets, communication line for telephony outlet and switches of [Clause 2.6](#) shall be galvanised steel. Refer to FIGURE 3.6.1(b).

Figures & Tables

FIGURE 3.5.4(e): TYPICAL DETAILS OF EMBEDDED CONDUIT IN SS WALL


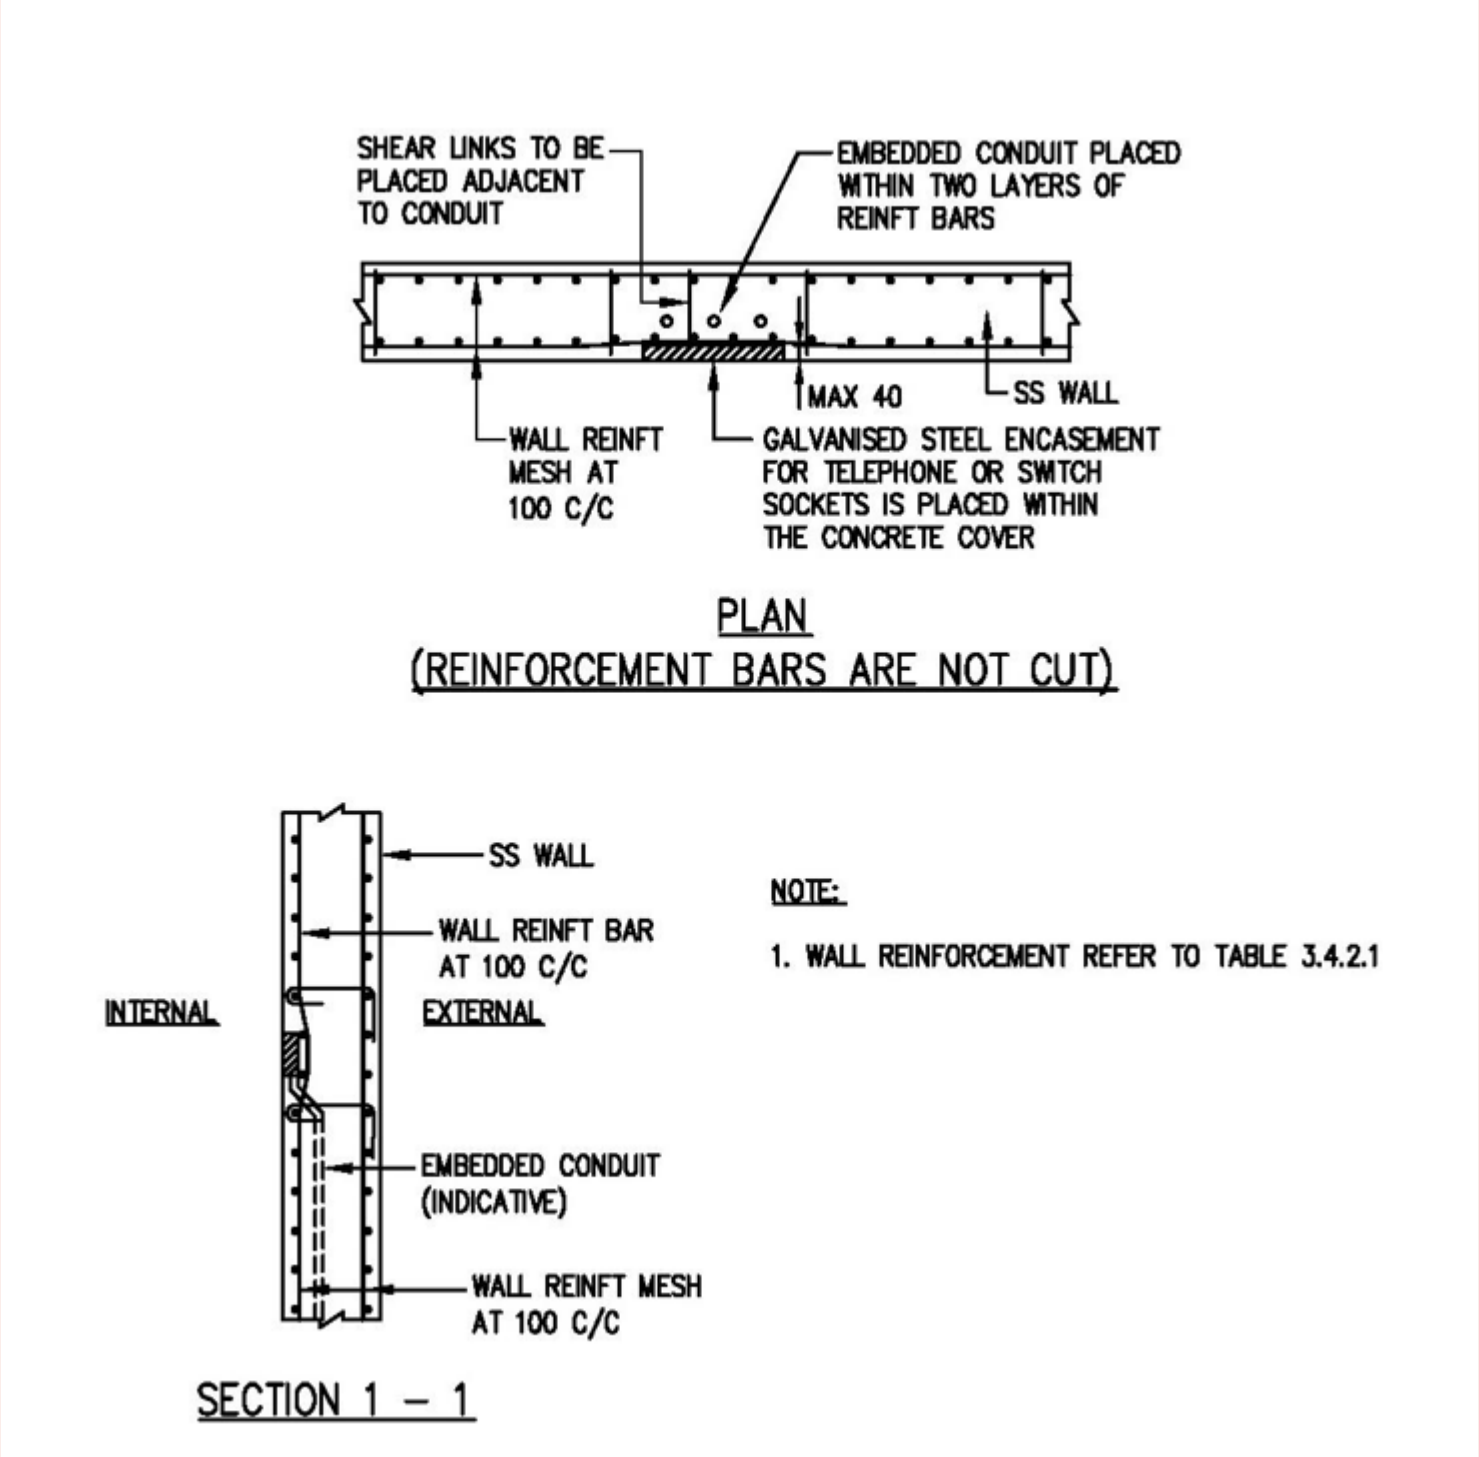


FIGURE 3.6.1(b): TYPICAL DETAILS OF EMBEDDED SOCKET/SWITCH

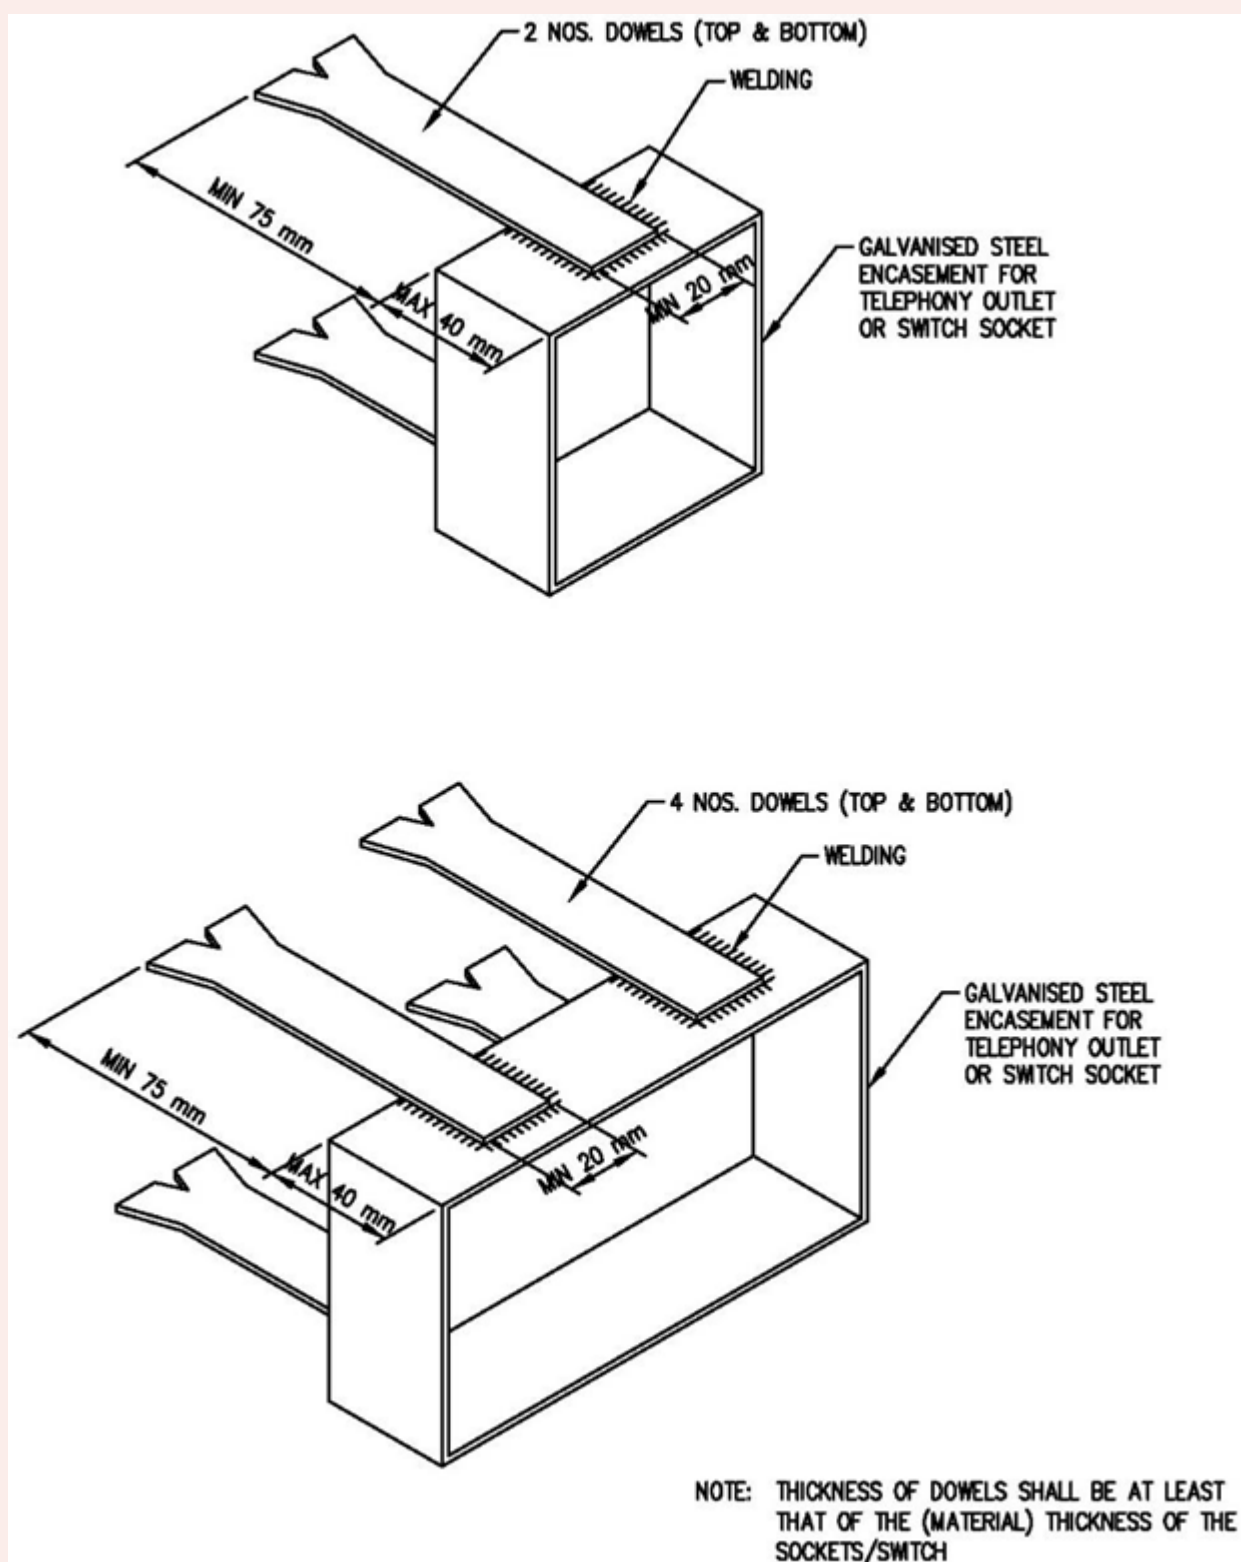


3.6.2 Water and Gas Services

Water and gas services are allowed to pass through the SS walls provided that they are laid within a stainless steel conduit encased by 150mm reinforced concrete all round. Refer to FIGURE 3.6.2. Joints in the pipes or in the stainless steel conduit shall be located outside the SS. Risers for services can be mounted on the external face of SS tower walls.

Figures & Tables

FIGURE 3.6.2: ENCASEMENT DETAILS OF WATER/ GAS SERVICE PIPES PENETRATING THROUGH SS WALLS

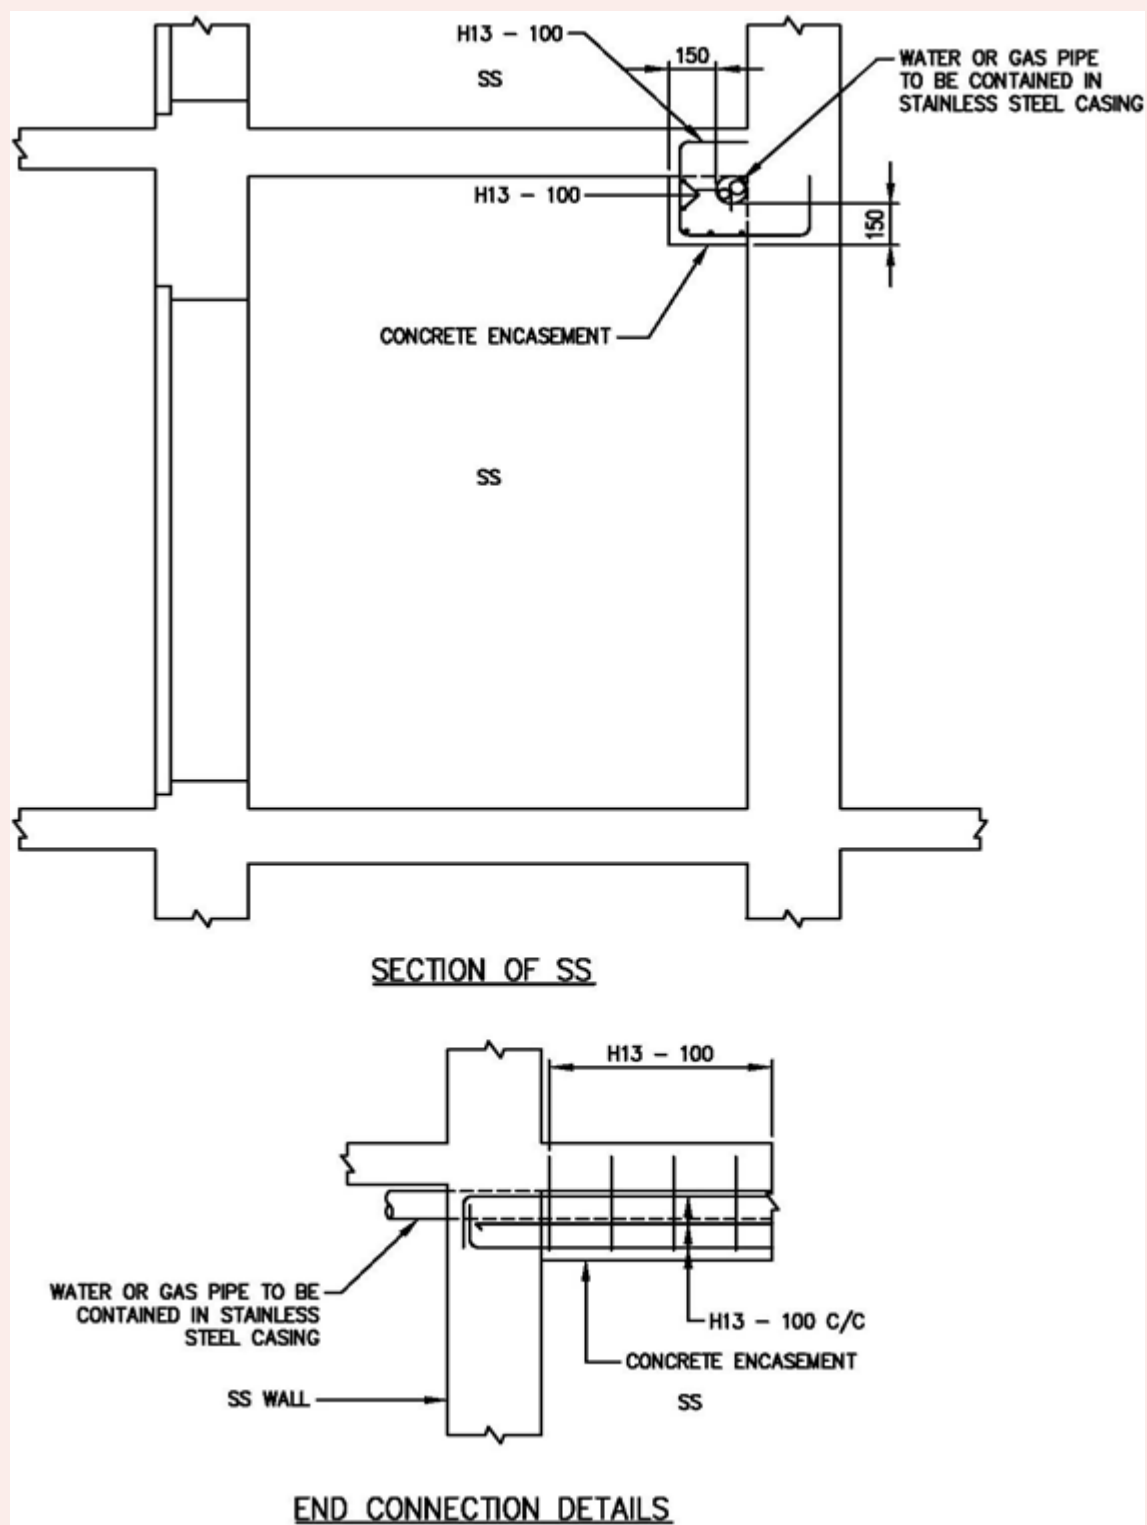


3.6.3 Refuse Chute and Gas Risers and any other service risers within setback distance of SS and S/C SS



Refuse chute and gas risers and service risers can be mounted on the external face of SS walls. Where this structure protrudes above the roof, it shall be designed with a minimum 300mm reinforced concrete all round and reinforcement details are as shown in FIGURE 3.6.3(a) to 3.6.3(c).

Figures & Tables


FIGURE 3.6.3(a): REINFORCEMENT DETAILS OF REFUSE CHUTE ABOVE ROOF LEVEL WITHIN SS SETBACK DISTANCE

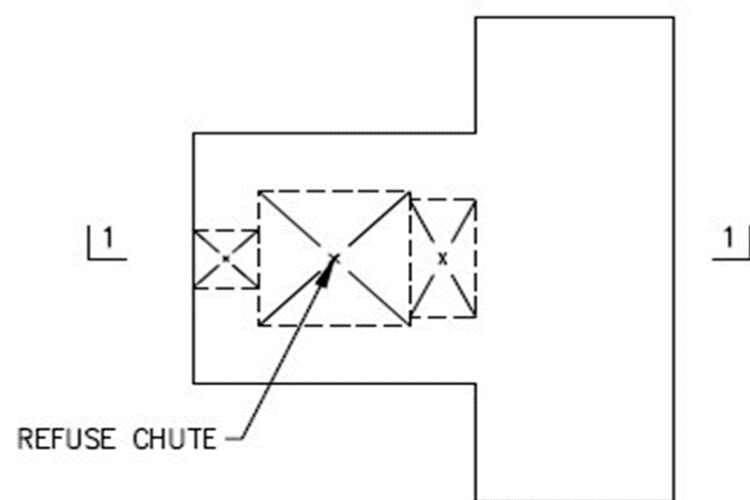


REFUSE CHUTE PLAN

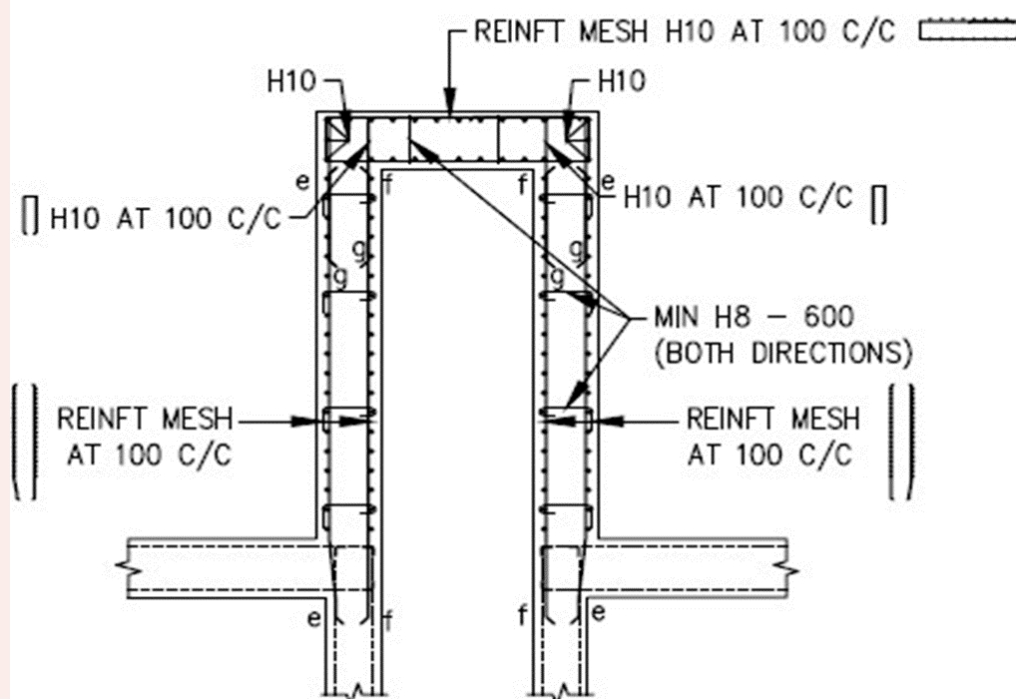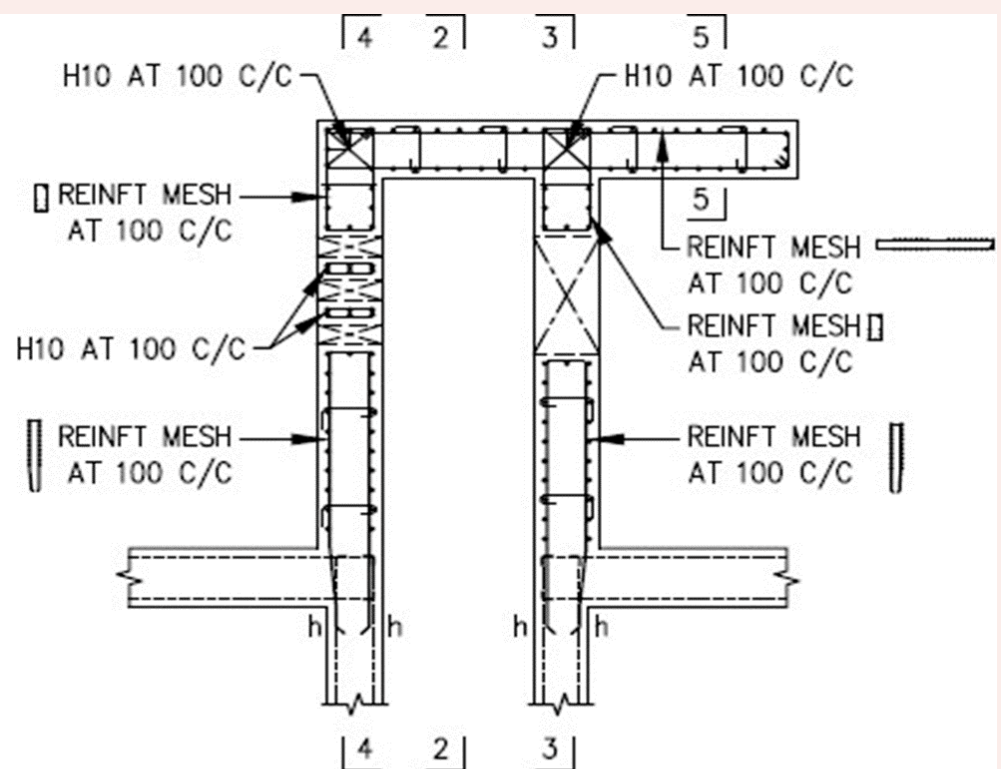


SECTION 2-2

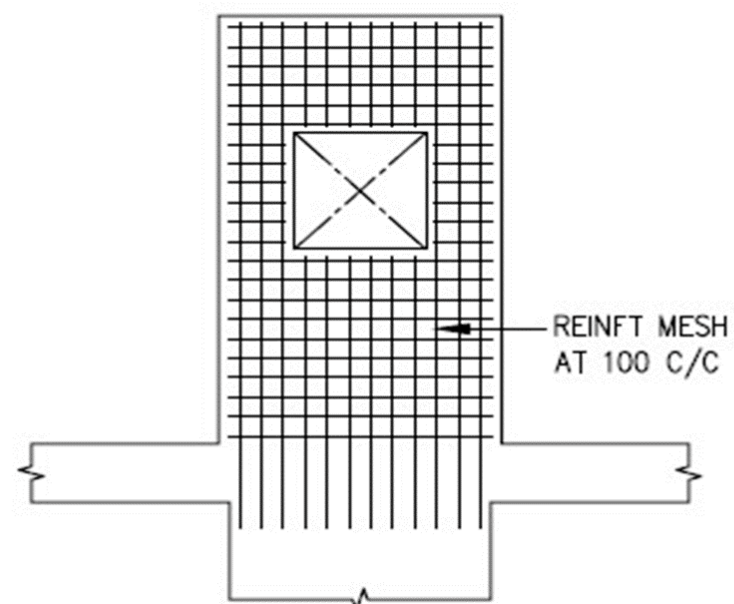

SECTION 3-3

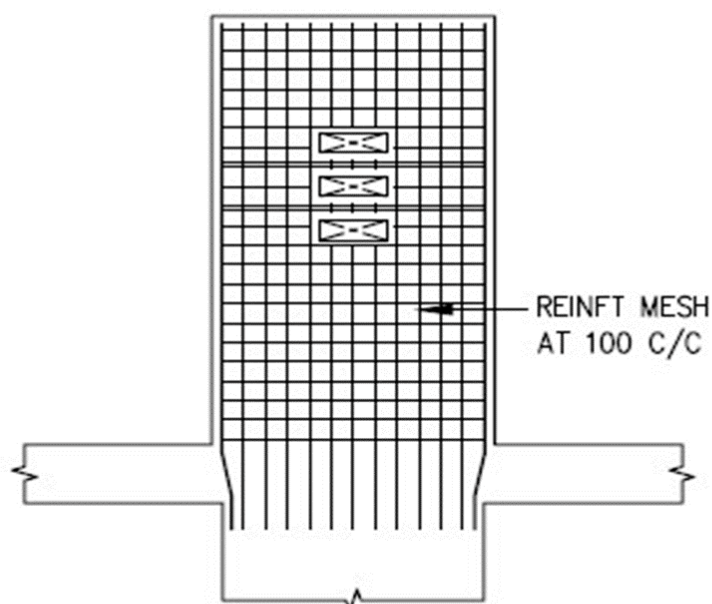

SECTION 4-4

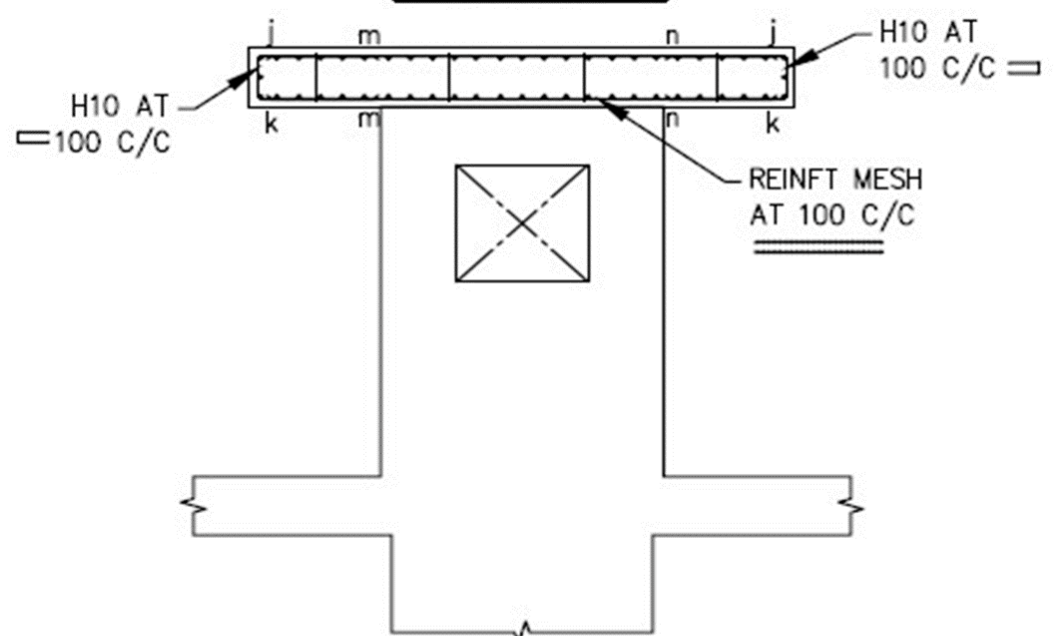

SECTION 5-5

NOTES:

1. WALL REINFORCEMENT REFER TO TABLE 3.4.2.1

FIGURE 3.6.3(b): REINFORCEMENT DETAILS OF RC STRUCTURES ABOVE ROOF LEVEL FOR GAS RISER WITHIN SS SETBACK DISTANCE (OPENING WIDTH $\leq 100\text{MM}$)



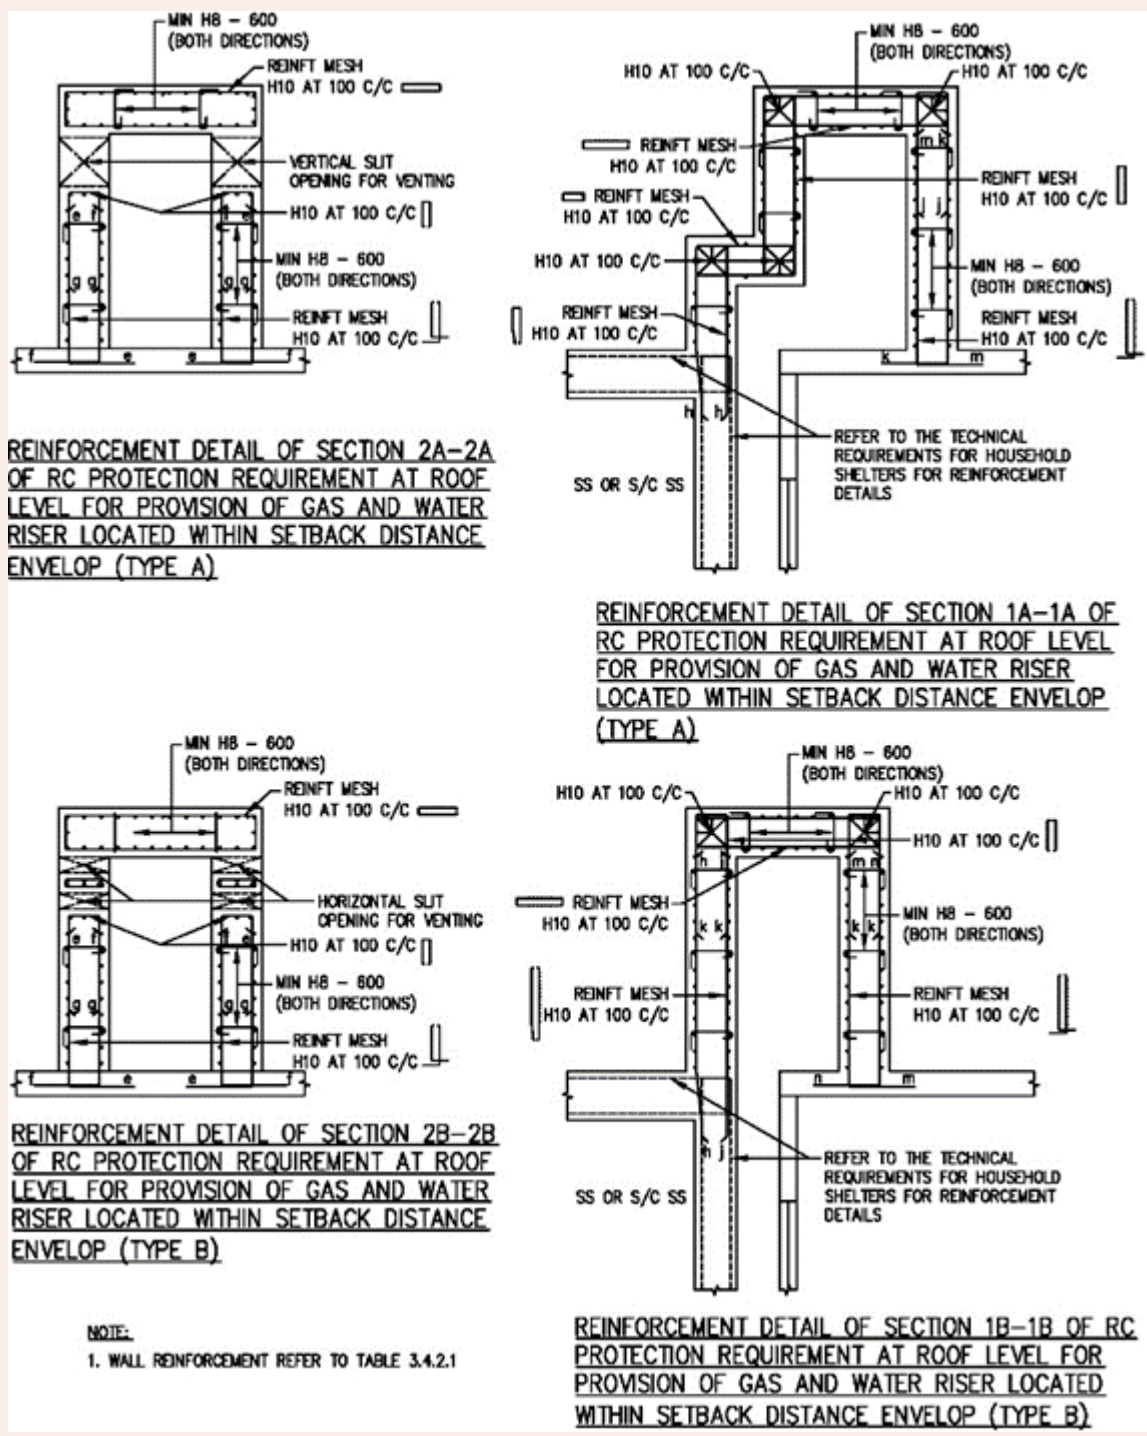



FIGURE 3.6.3(c): REINFORCEMENT DETAILS OF RC STRUCTURES ABOVE ROOF LEVEL FOR ANY OTHER SERVICE RISER WITHIN SS SETBACK DISTANCE (OPENING WIDTH $\leq 100\text{MM}$)

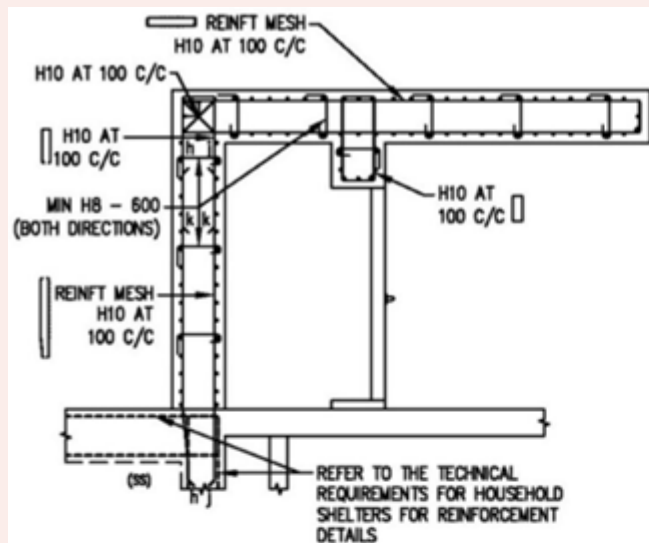

REINFORCEMENT DETAIL OF SECTION 1C-1C
OF RC PROTECTION REQUIREMENT AT ROOF
LEVEL FOR PROVISION OF ANY OTHER
SERVICE RISER LOCATED WITHIN SETBACK
DISTANCE ENVELOP

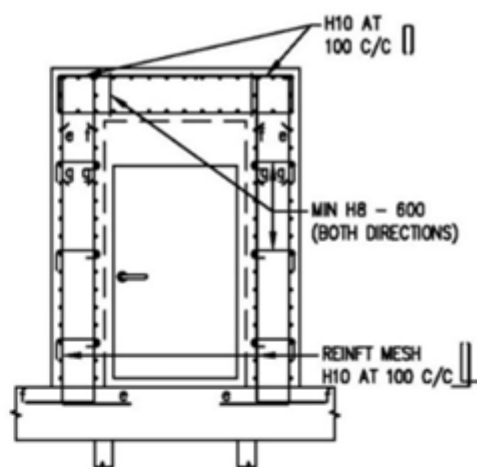

REINFORCEMENT DETAIL OF SECTION 3C-3C
OF RC PROTECTION REQUIREMENT AT ROOF
LEVEL FOR PROVISION OF ANY OTHER
SERVICE RISER LOCATED WITHIN SETBACK
DISTANCE ENVELOP

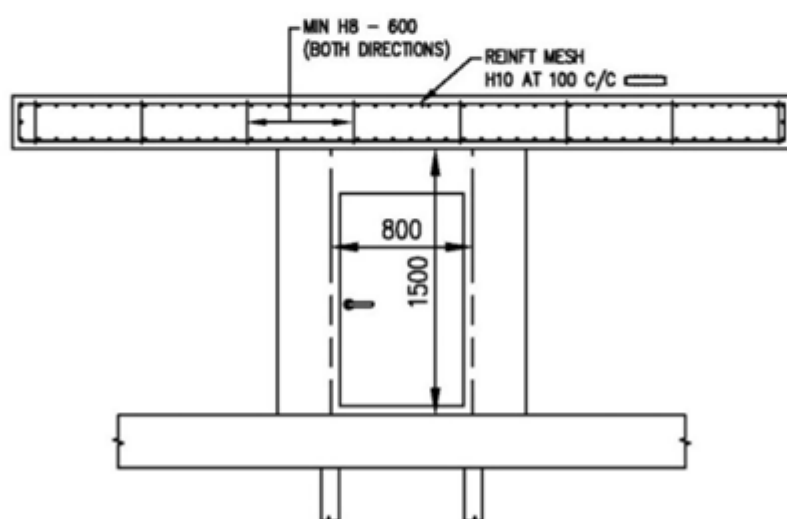

REINFORCEMENT DETAIL OF SECTION 2C-2C OF RC PROTECTION
REQUIREMENT AT ROOF LEVEL FOR PROVISION OF ANY OTHER
SERVICE RISER LOCATED WITHIN SETBACK DISTANCE ENVELOP

NOTE:

1. WALL REINFORCEMENT REFER TO TABLE 3.4.2.1

Amendment History - Chapter 3 - Structural Requirements


Clause No.	Amendment Date	Effective Date	Clause Status	Clause Before Amendment	Circular Date
------------	----------------	----------------	---------------	-------------------------	---------------


CLAUSE 4.1 GENERAL

Two 150mm diameter ventilation sleeves shall be cast into the wall/s of each SS. In the case of S/C SS or scissor S/C SS, no fire rating is required for these fragmentation plates. The two ventilation sleeves shall be provided in the S/C SS or scissor S/C SS wall at the staircase entrance landing or intermediate landing at each storey or one each at the entrance landing and intermediate landing. Only ventilation sleeves of an approved design from approved suppliers shall be used.

CLAUSE 4.2 POSITION

The position of each ventilation sleeve opening shall comply with the below clauses. Refer to FIGURE 4.2(a) and 4.2(b).

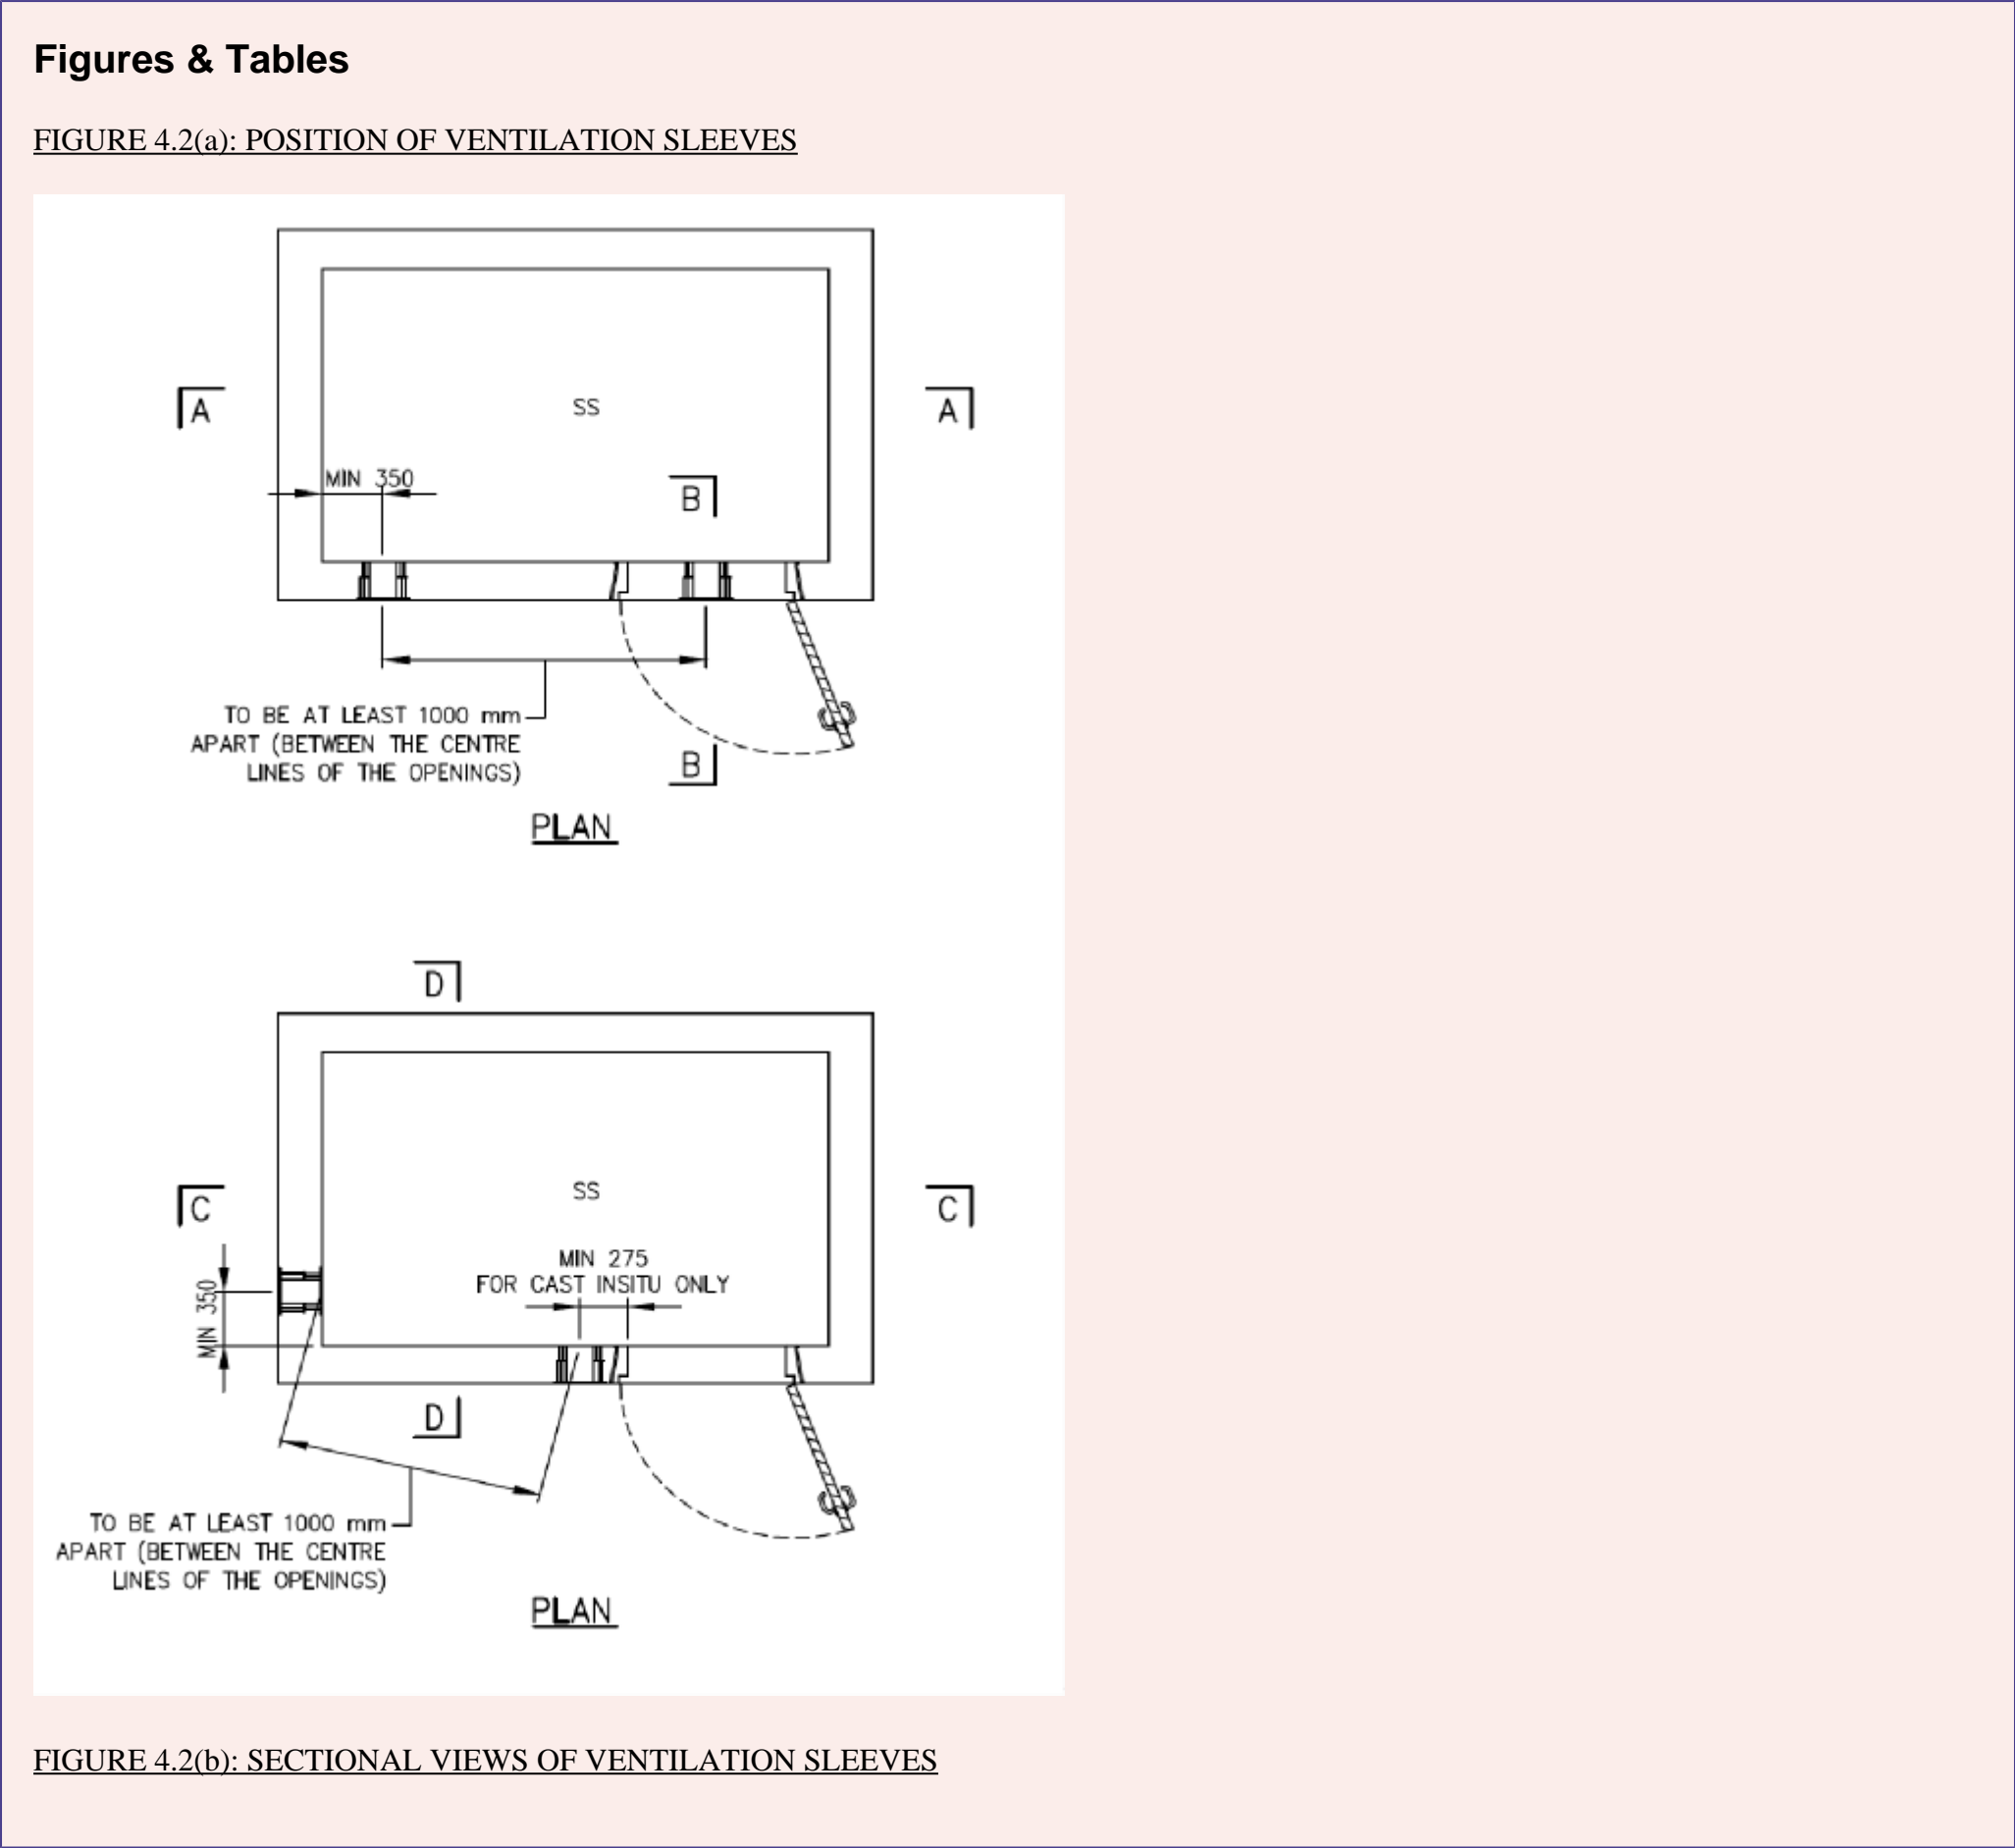


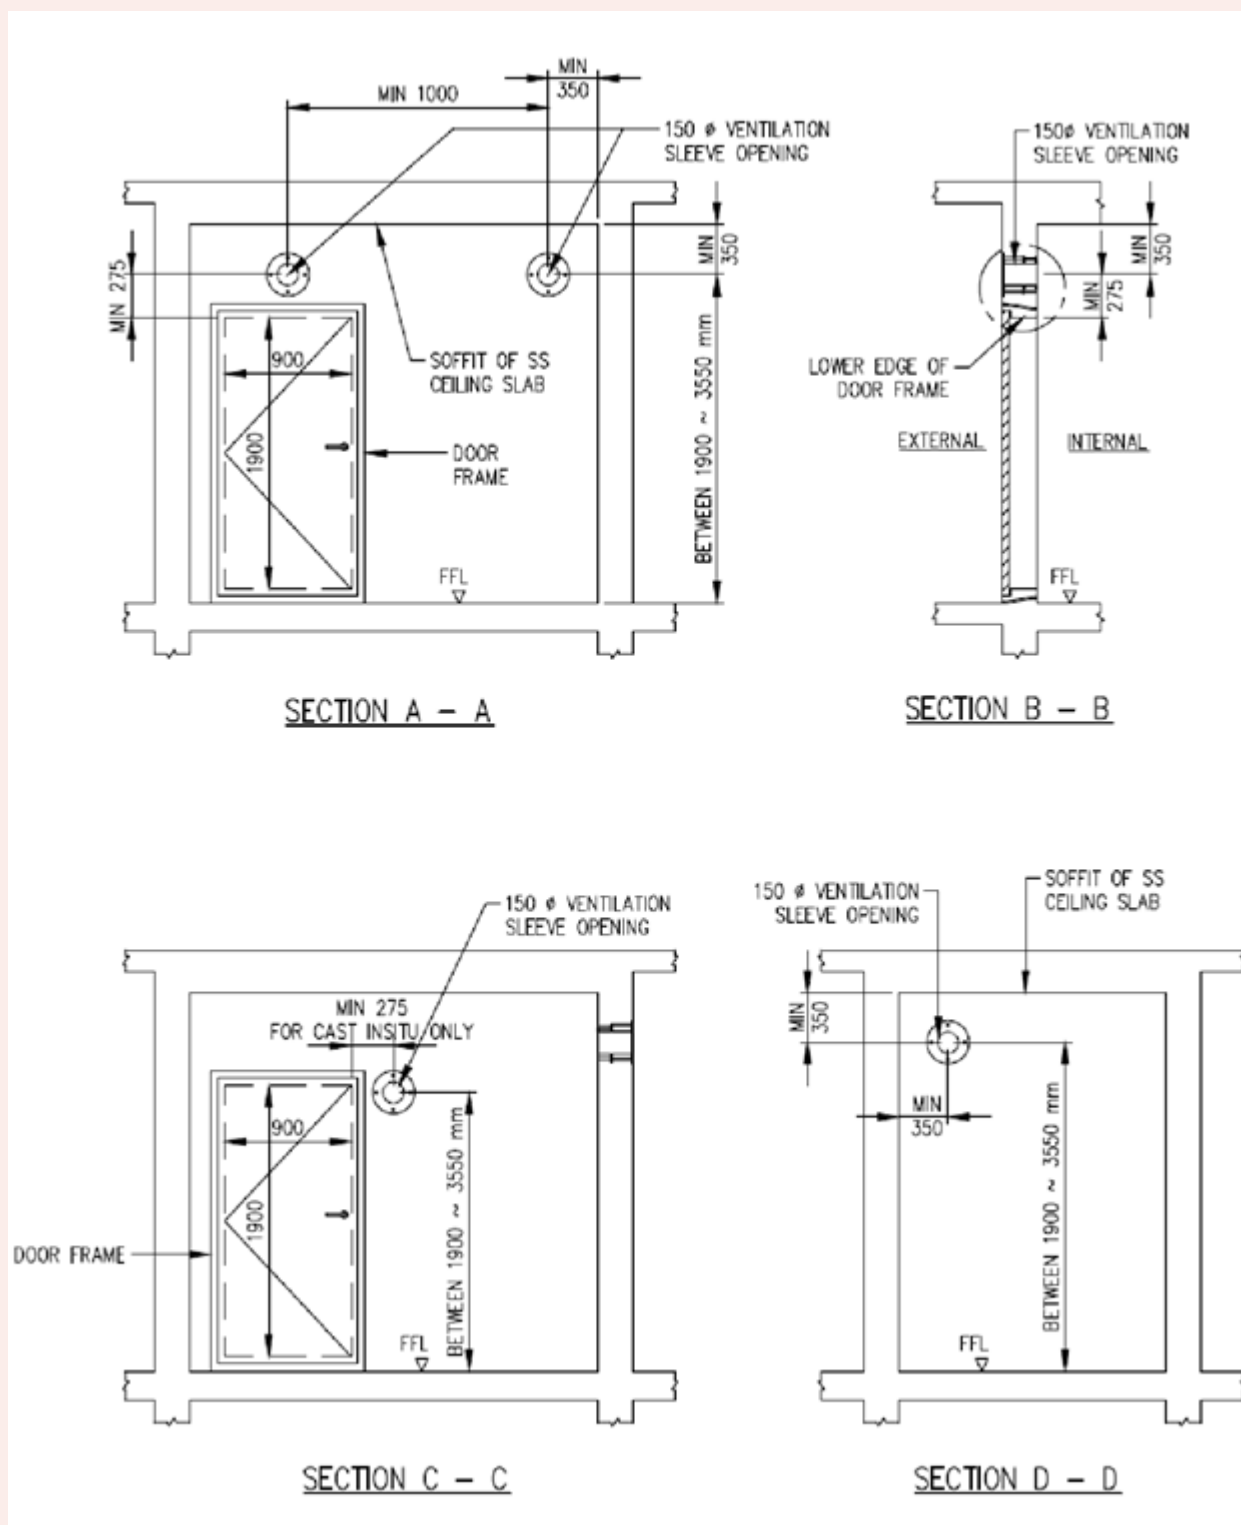

- The height of each ventilation sleeve opening, measured from the centre of the opening to internal FFL of the SS shall be between 1900mm and 3550mm.
- The ventilation sleeve opening shall be positioned such that there is sufficient clearance from any structural elements and services. The centre of the ventilation sleeve opening to the soffit of ceiling slab and the nearest face of the internal SS walls shall be at least 350mm.
- Where the ventilation sleeve is placed above or adjacent to the SS door frame, the centre of the ventilation sleeve opening shall be at least 275mm from the nearest edge of the SS door frame.
- The minimum distance between the centres of the two ventilation sleeves openings shall be at least 1000mm.
- Where the ventilation sleeve is located along the staircase flight of the S/C SS or scissor S/C SS, the maximum distance measuring between the edge of either end of staircase flight and the centre of the ventilation sleeve opening shall be 500mm.
- The ventilation sleeve openings shall not be opened into enclosed area outside the SS or S/C SS or scissor S/C SS. The ventilation sleeves shall not be located in the SS wall sharing with the dwelling unit. Refer to FIGURE 4.2(c). Enclosed area shall be defined as an area fully surrounded walls with an access door.

Figures & Tables


FIGURE 4.2(c): LOCATION OF VENTILATION SLEEVES

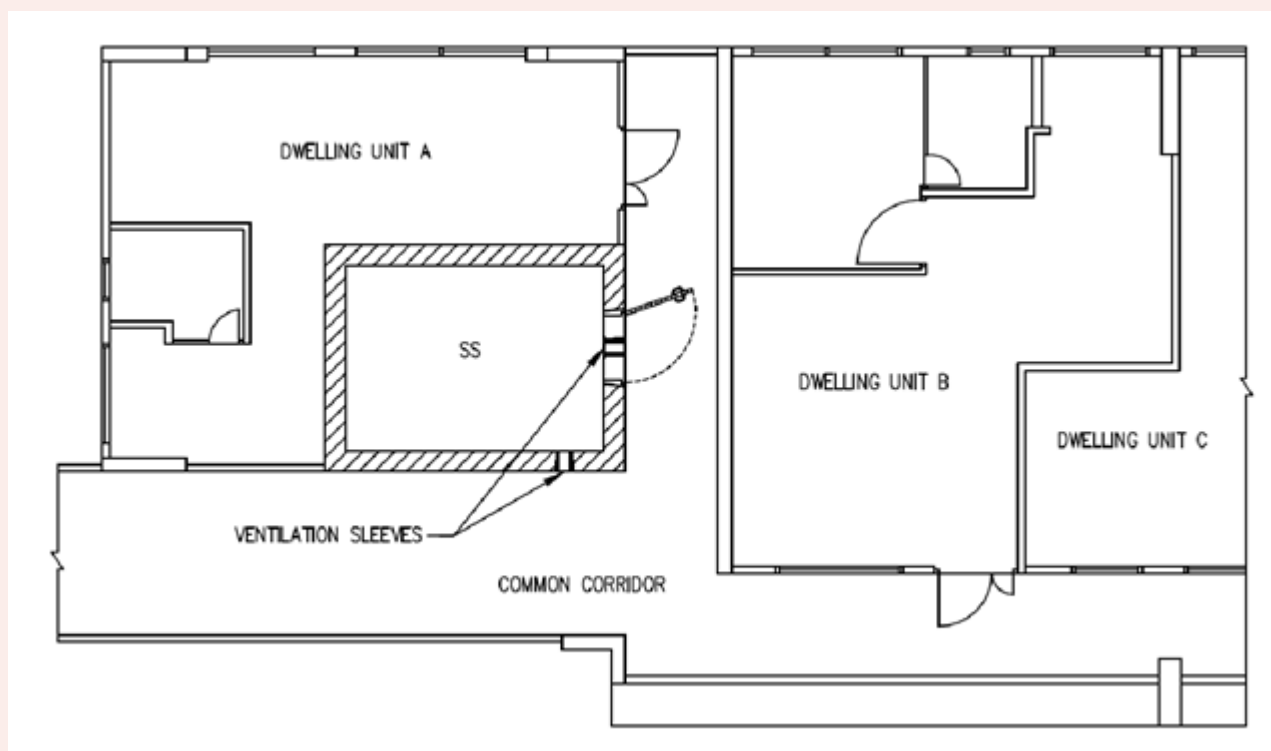

g. In the case of SS, the ventilation sleeve shall be located away from the rescue hatch openings. Refer to FIGURE 2.6.1(a).

Figures & Tables


FIGURE 2.6.1(a): SPECIFIC SS FIXTURE AND OPENINGS

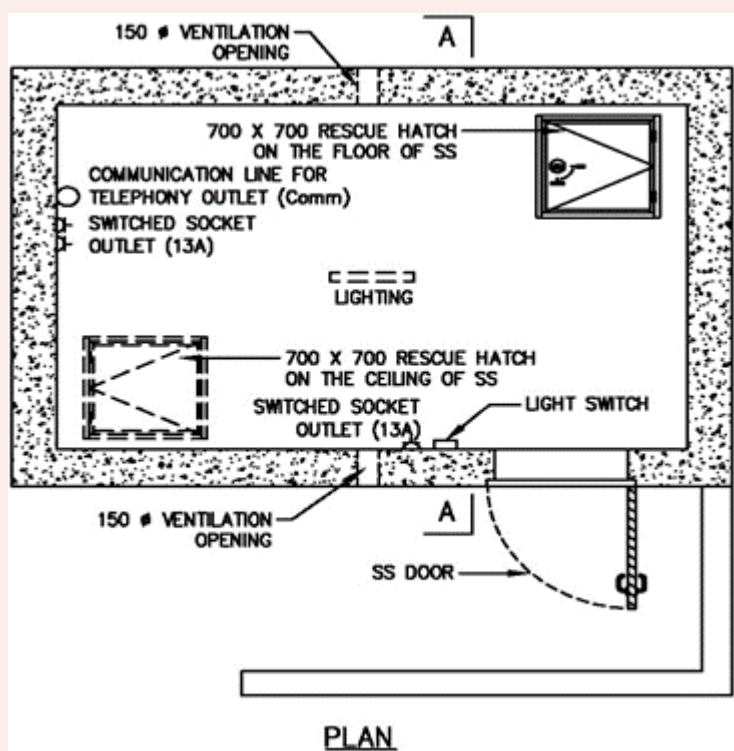


CLAUSE 4.3 ACCESSIBILITY OF VENTILATION SLEEVES

4.3.1 Clearance in front of and around Fragmentation Plates

- a. The minimum clearance from the fragmentation plate to RC beam or structure or service shall be 50mm. Where the RC beam or structure or service is fronting the fragmentation plate of ventilation sleeve, the clear distance between them shall be at least 500mm. Refer to FIGURE 4.3.1(a).

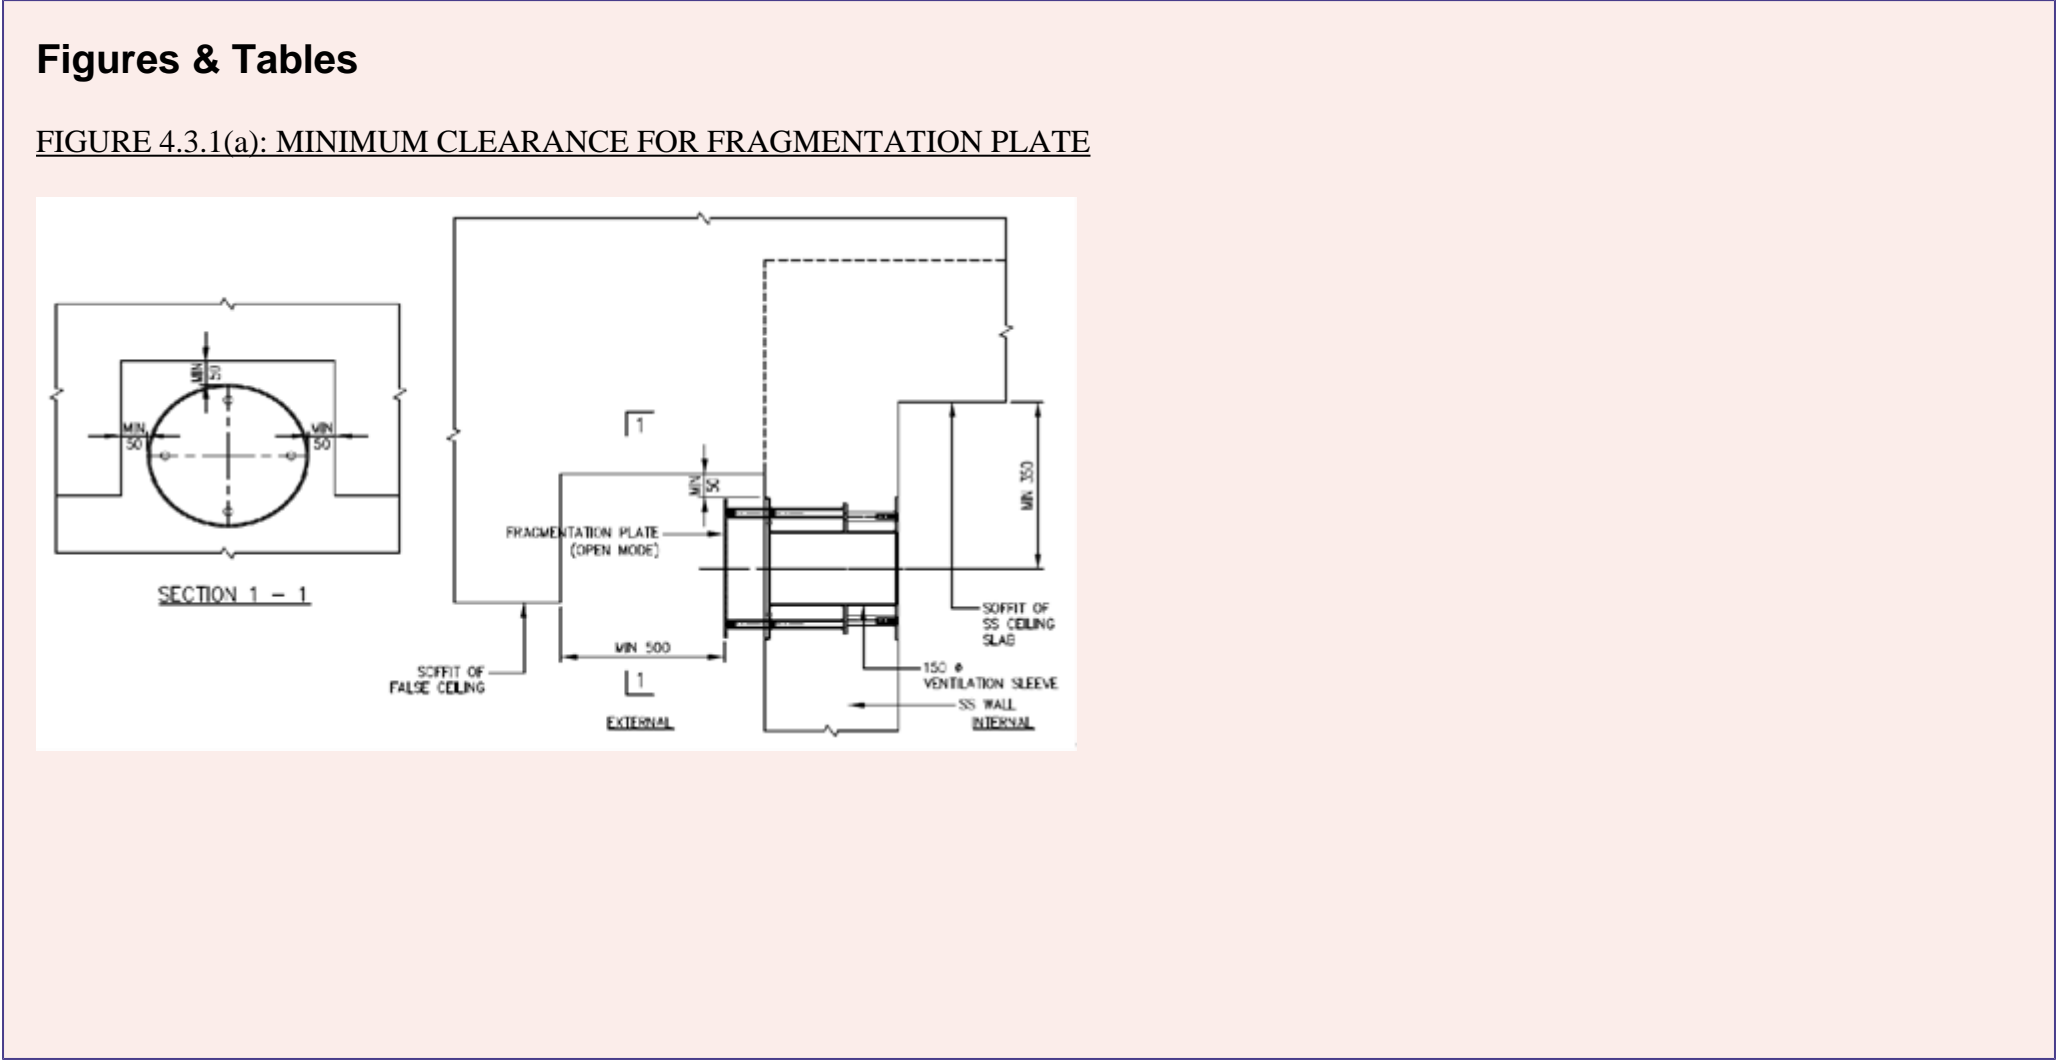


- b. In additional, there shall be a minimum unobstructed distance of at least 700mm from the face of the VS openings to the nearest face of any other internal structural elements within the SS, e.g. any protruding parts of a staircase. Refer to FIGURE 4.3.1(b).

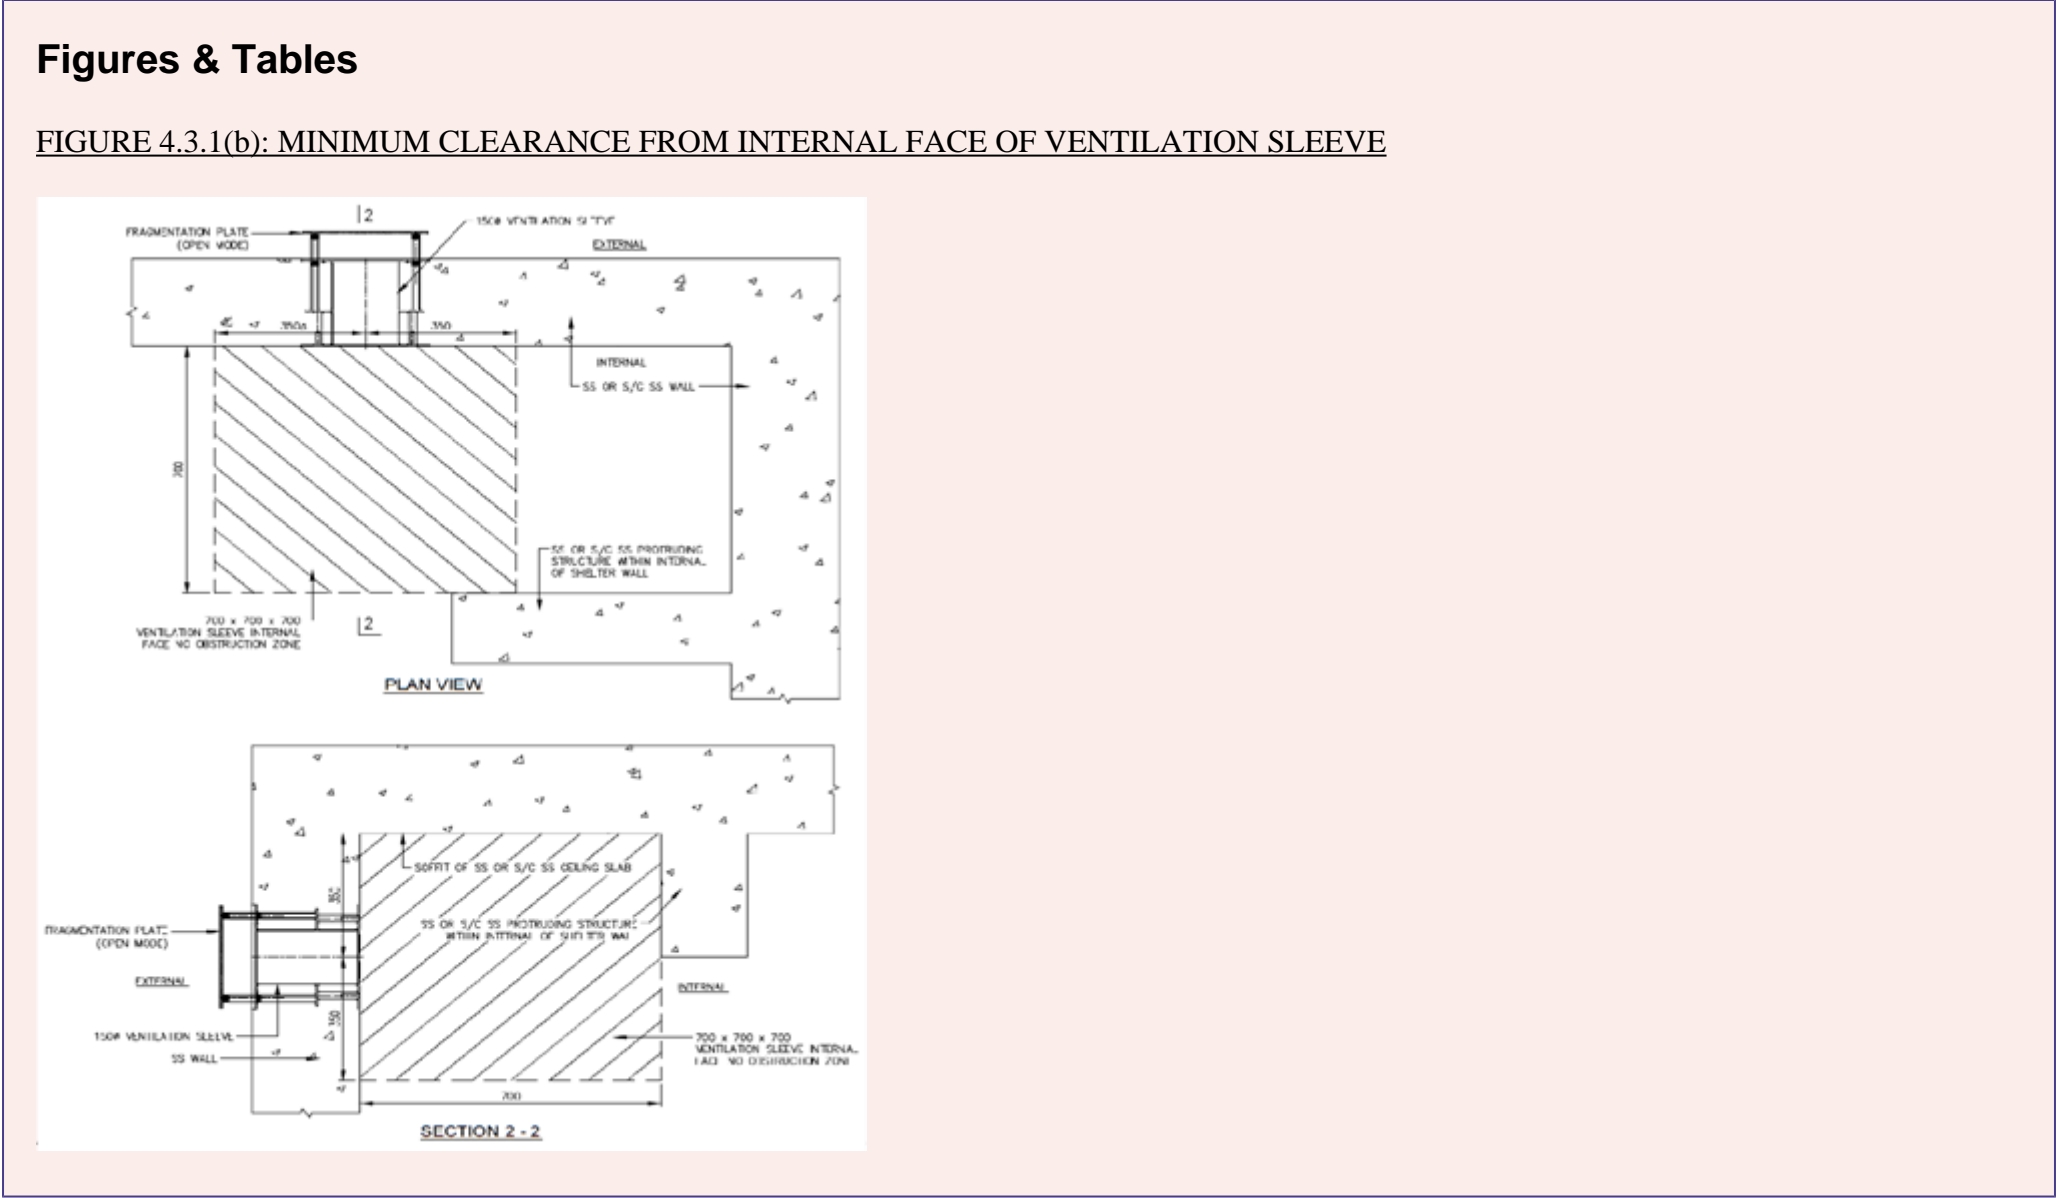


4.3.2 False Ceiling below Ventilation Sleeves

Where false ceilings are provided outside the SS, S/C SS or scissor S/C SS and below the ventilation sleeves, there shall be one access panel of a minimum size of 600mm x 600mm positioned directly below each ventilation sleeve. In the case of SS, one of the access panels shall be perforated and the ventilation sleeve above it shall be left open during peacetime. Refer to FIGURE 4.3.2.

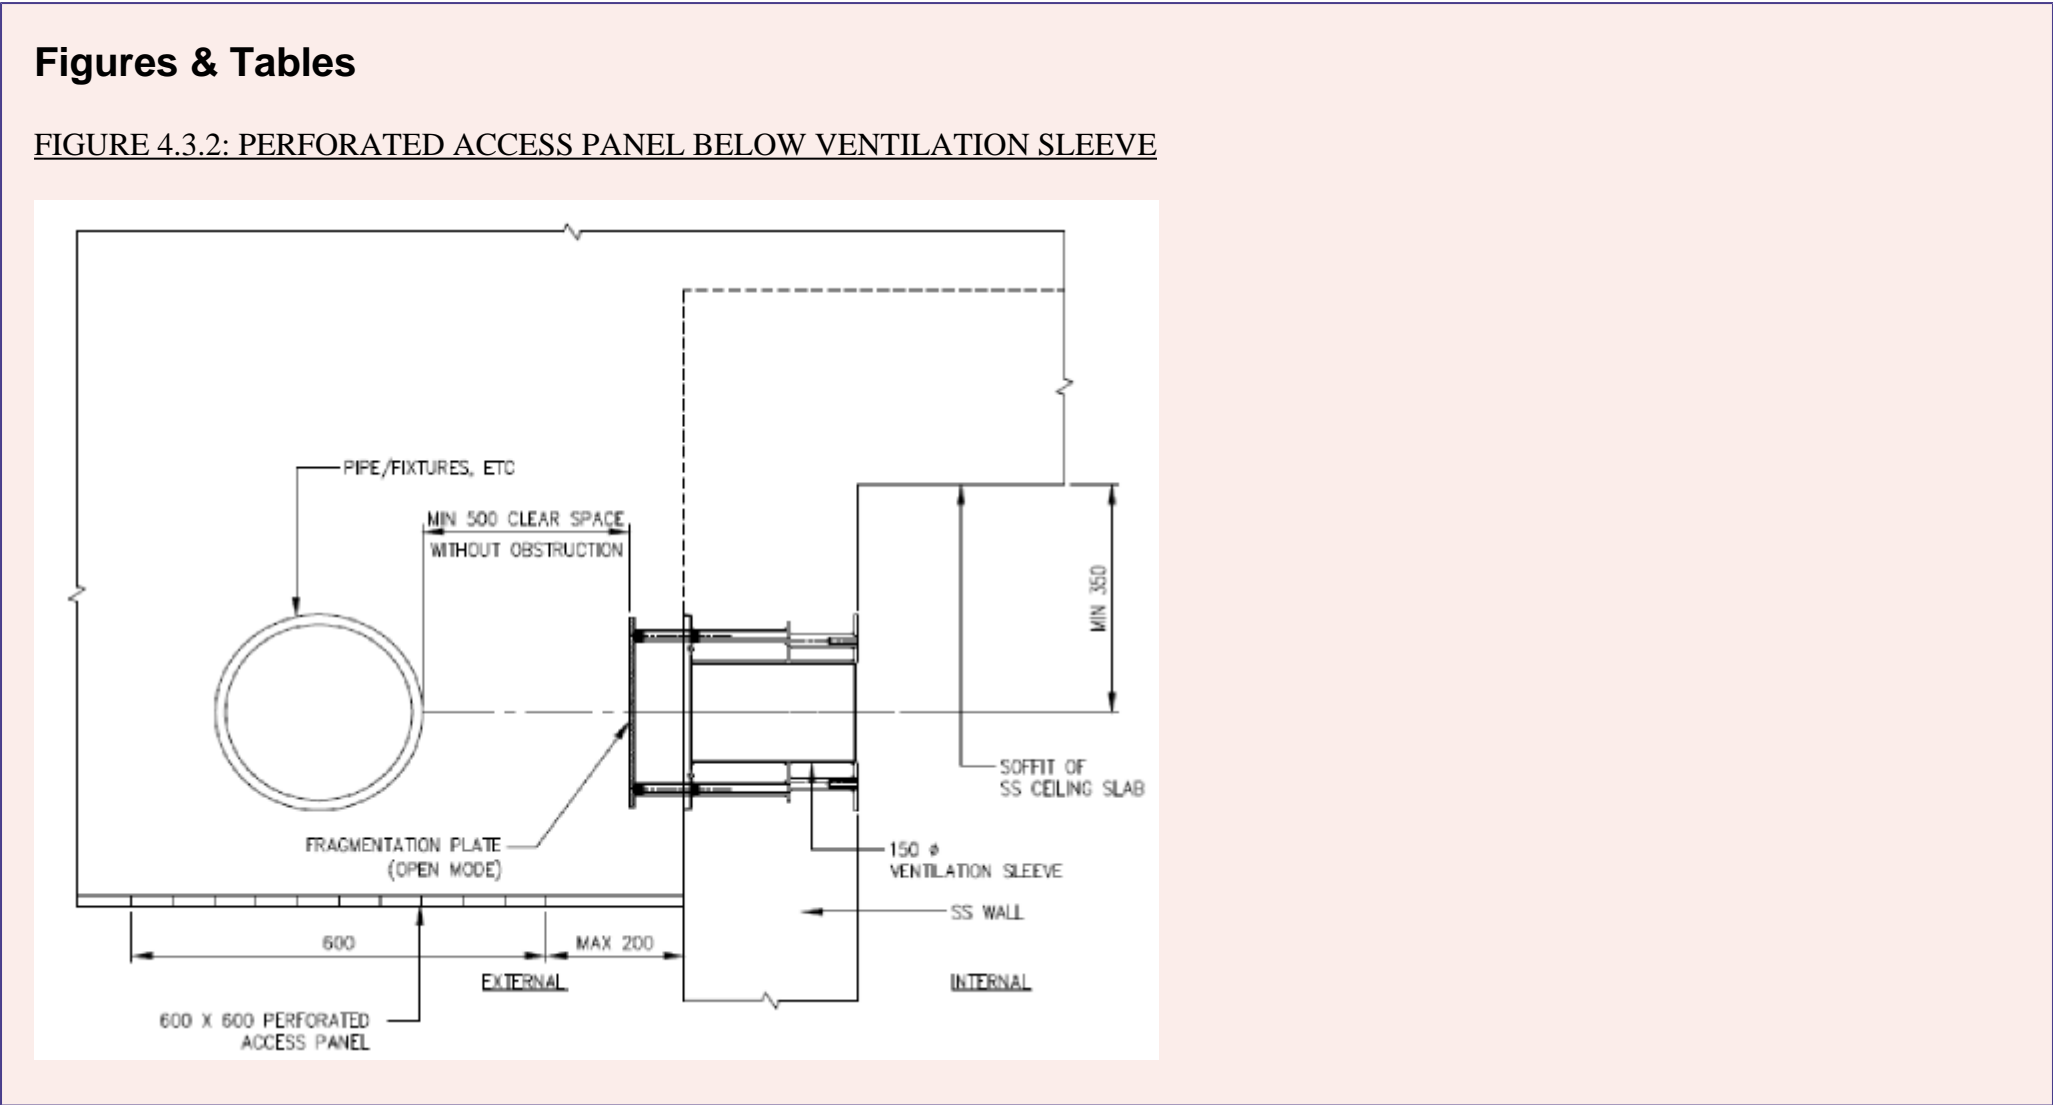

CLAUSE 4.4 FRAGMENTATION PLATE

Each ventilation sleeve shall have a 10mm thick stainless steel fragmentation plate mounted on the external face using 12mm stainless steel bolts. There shall be no drilling of additional holes on the fragmentation plates. Refer to FIGURE 4.4.

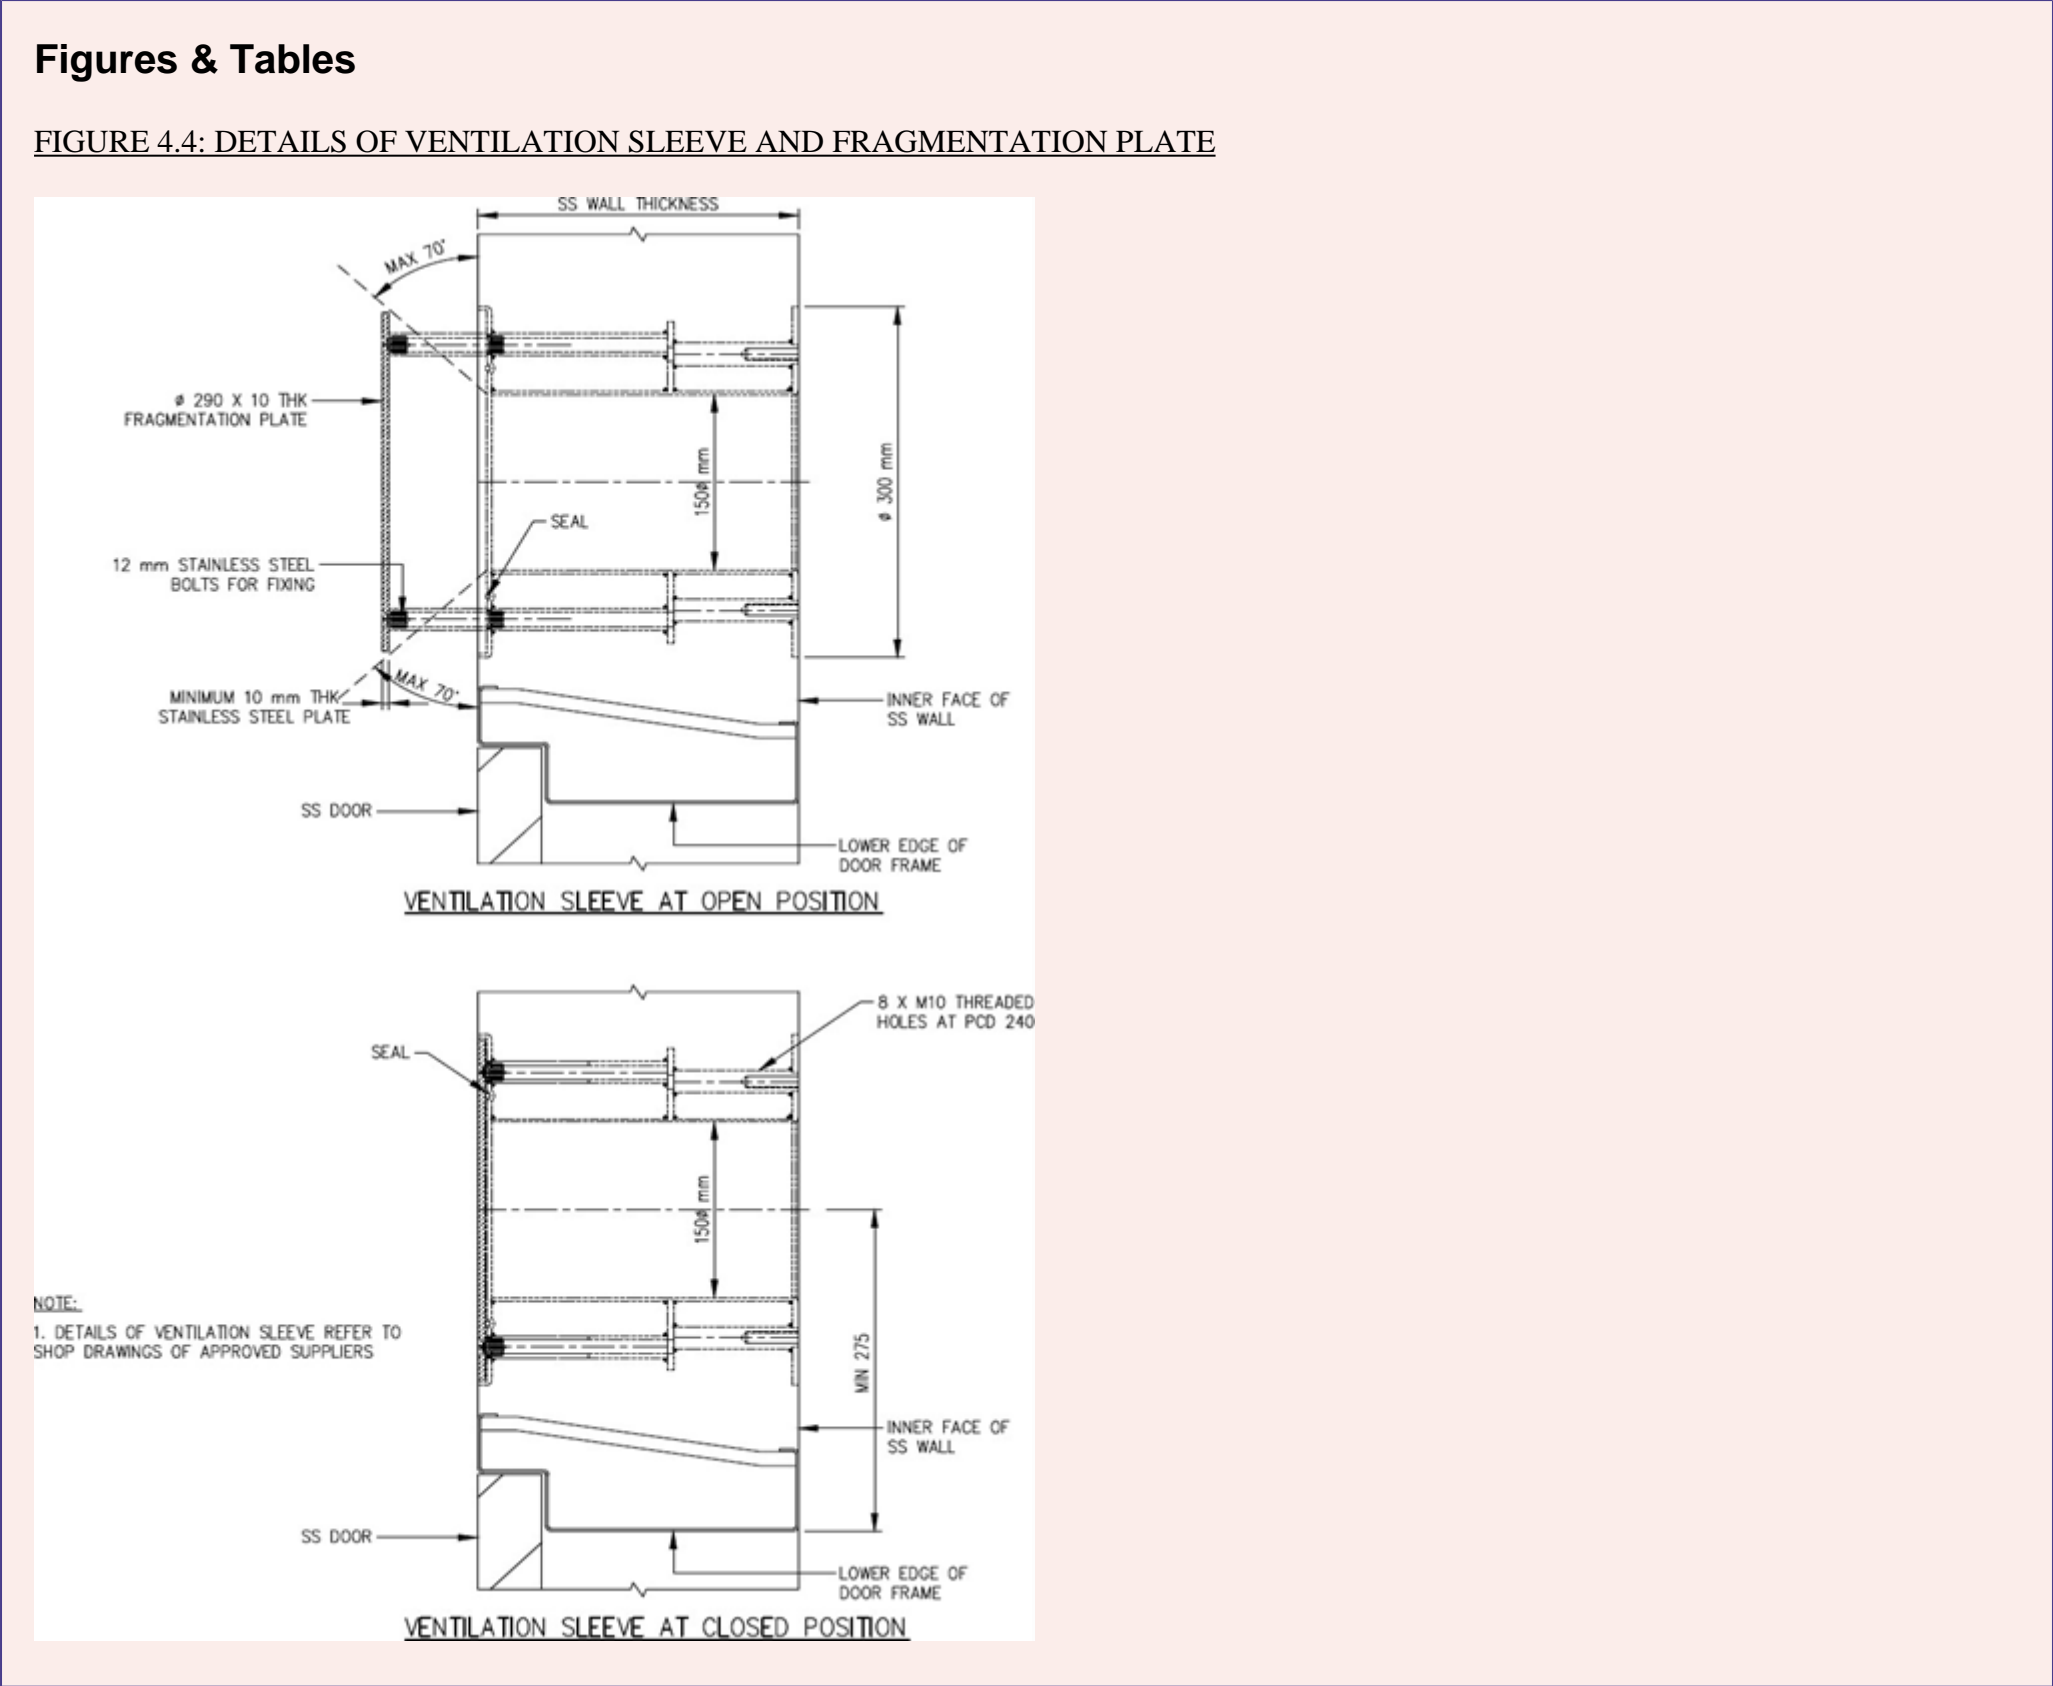


Amendment History - Chapter 4 - Ventilation Sleeves

Clause No.	Amendment Date	Effective Date	Clause Status	Clause Before Amendment	Circular Date
------------	----------------	----------------	---------------	-------------------------	---------------

CLAUSE 5.1 GENERAL

The SS door shall provide an airtight closure to the SS. The SS door providing entry into the SS from the outside shall be designed to open outwards from the SS.

SS Door frame that is cast together with the SS wall shall have single or double door rebate. Refer to Figure 2.5.1(a) and 2.5.1(b).

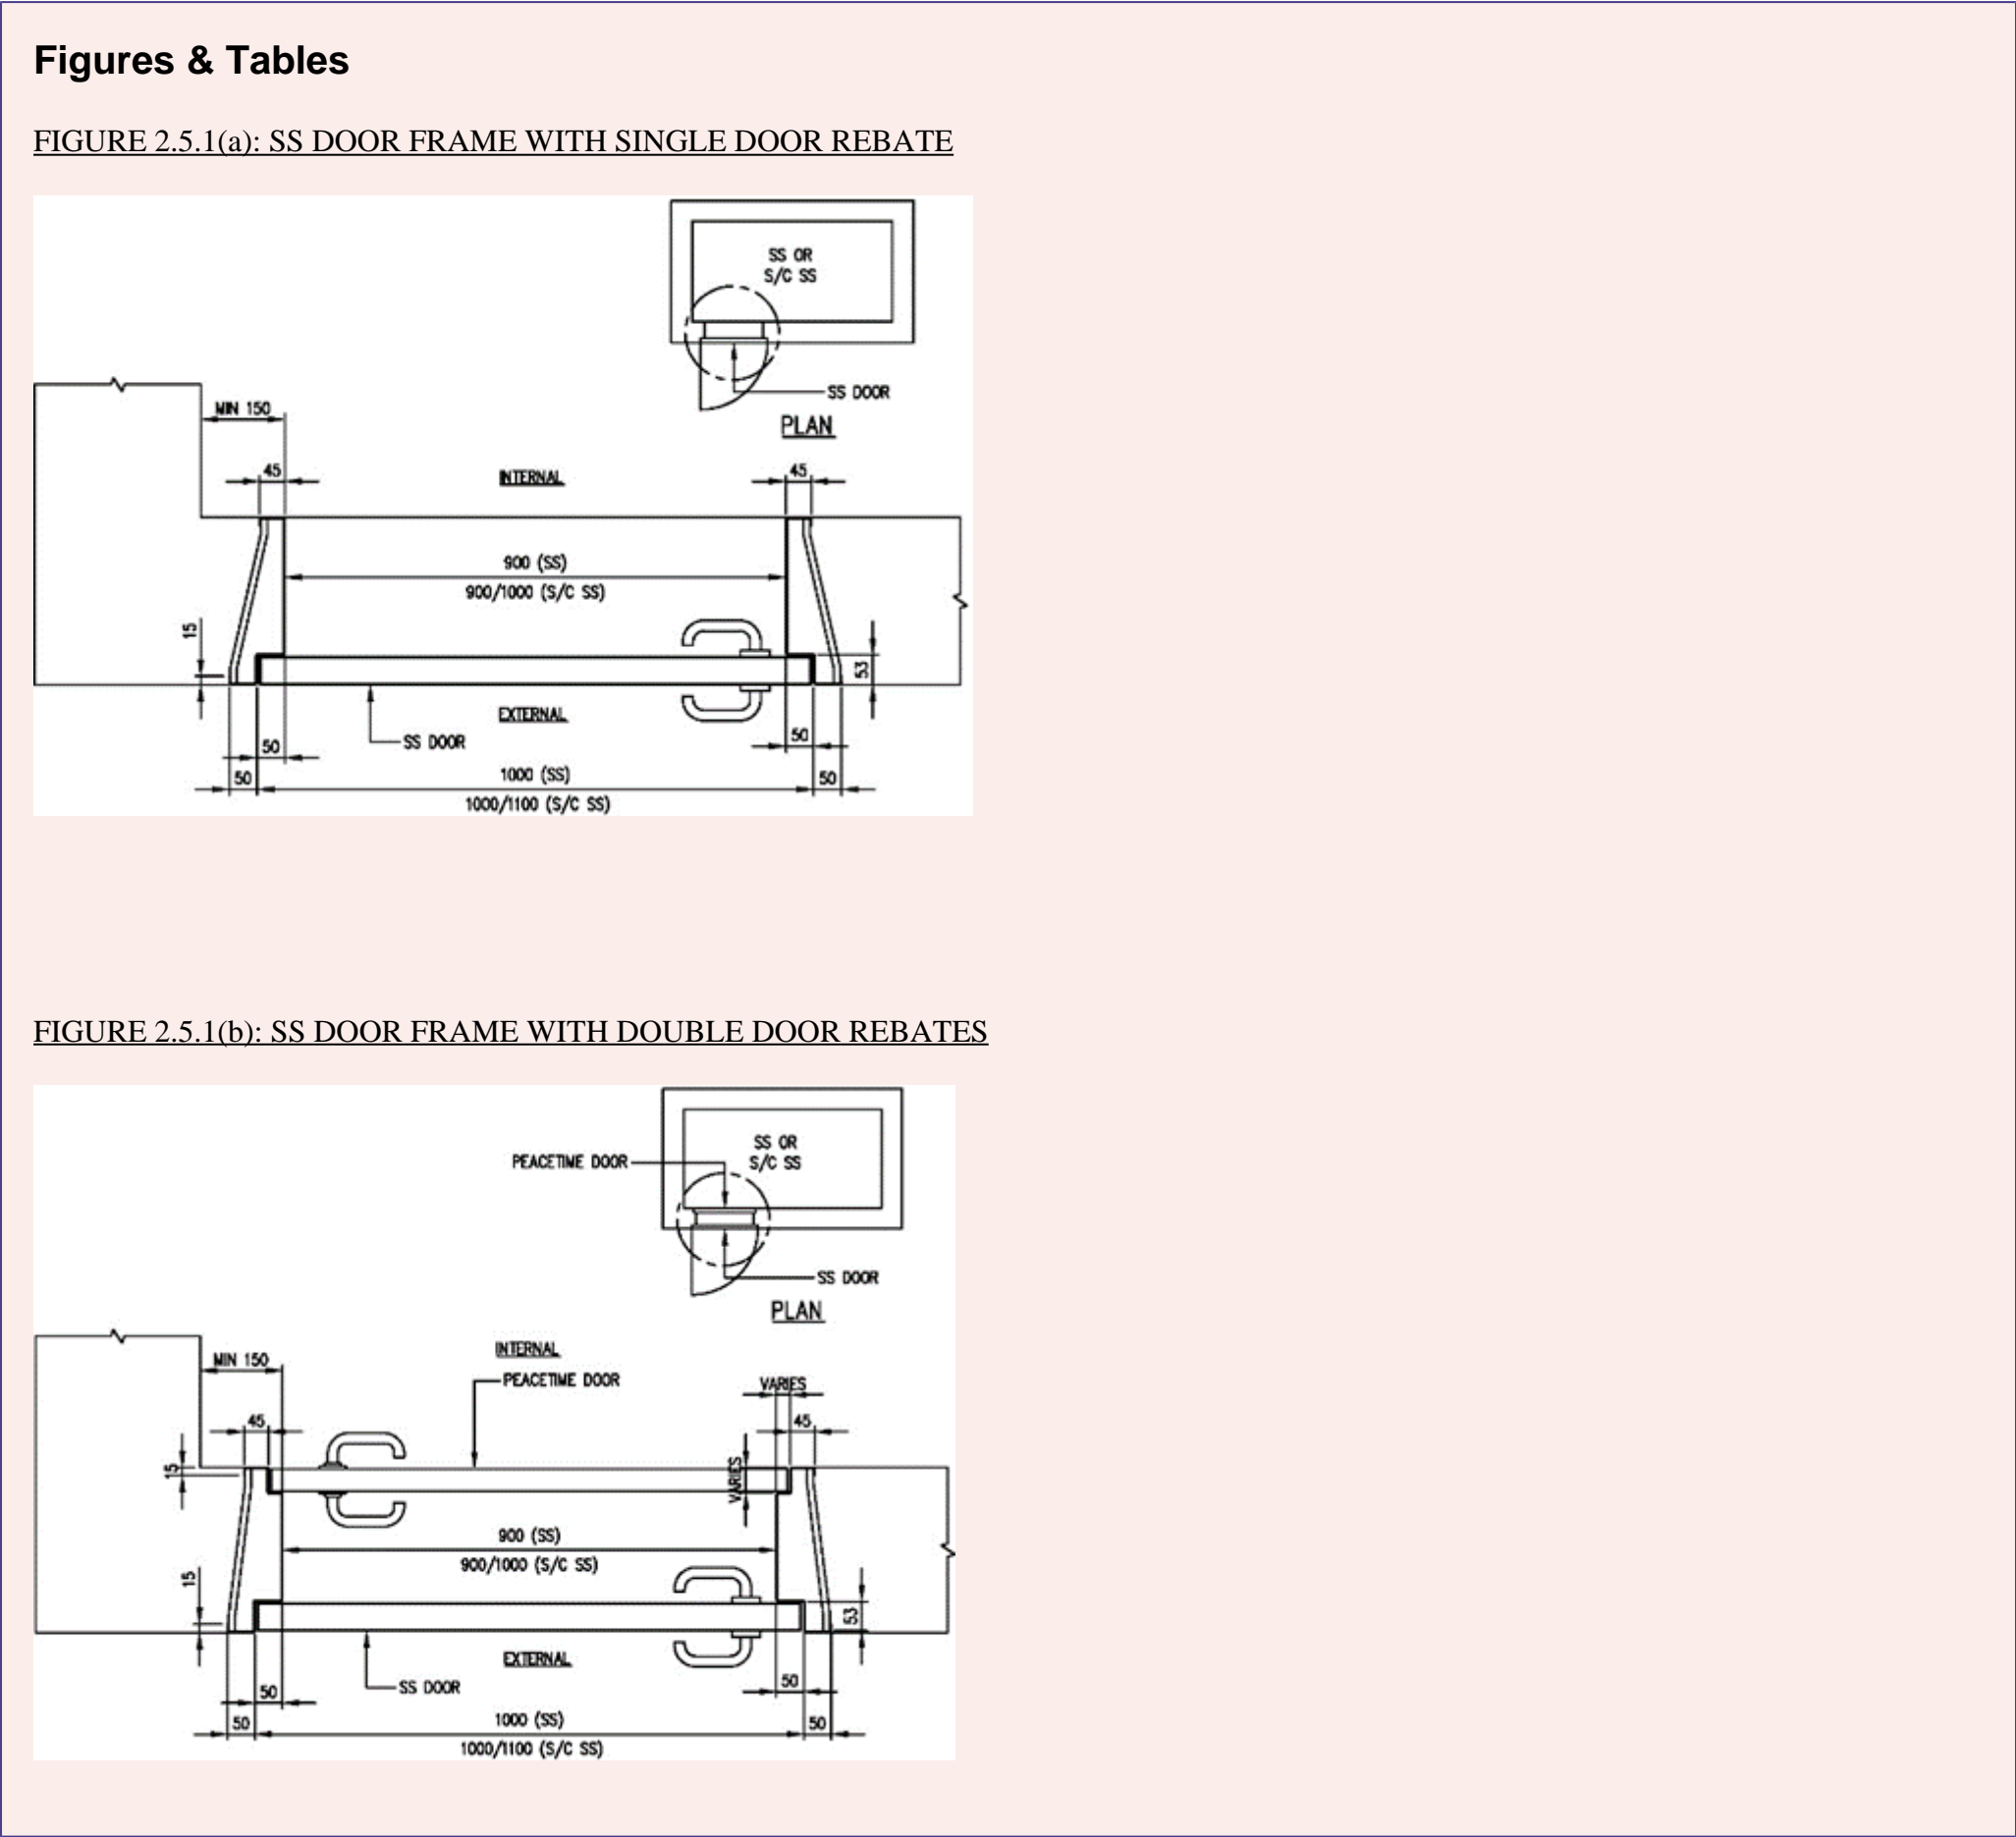


CLAUSE 5.2 APPROVED SS DOOR

Only SS doors of an approved design from an approved supplier, and which have been certified and listed under the Product Listing Scheme with a valid Certificate of Conformity (CoC) (as stipulated in **Chapter 8** of this TR), shall be used.

CLAUSE 5.3 REMOVEABLE DOOR KERB - APPLICABLE FOR S/C SS AND SCISSOR S/C SS ONLY

The removable SS door kerb shall be mounted on the top part of SS door frame during peacetime. Refer to FIGURE 5.3.

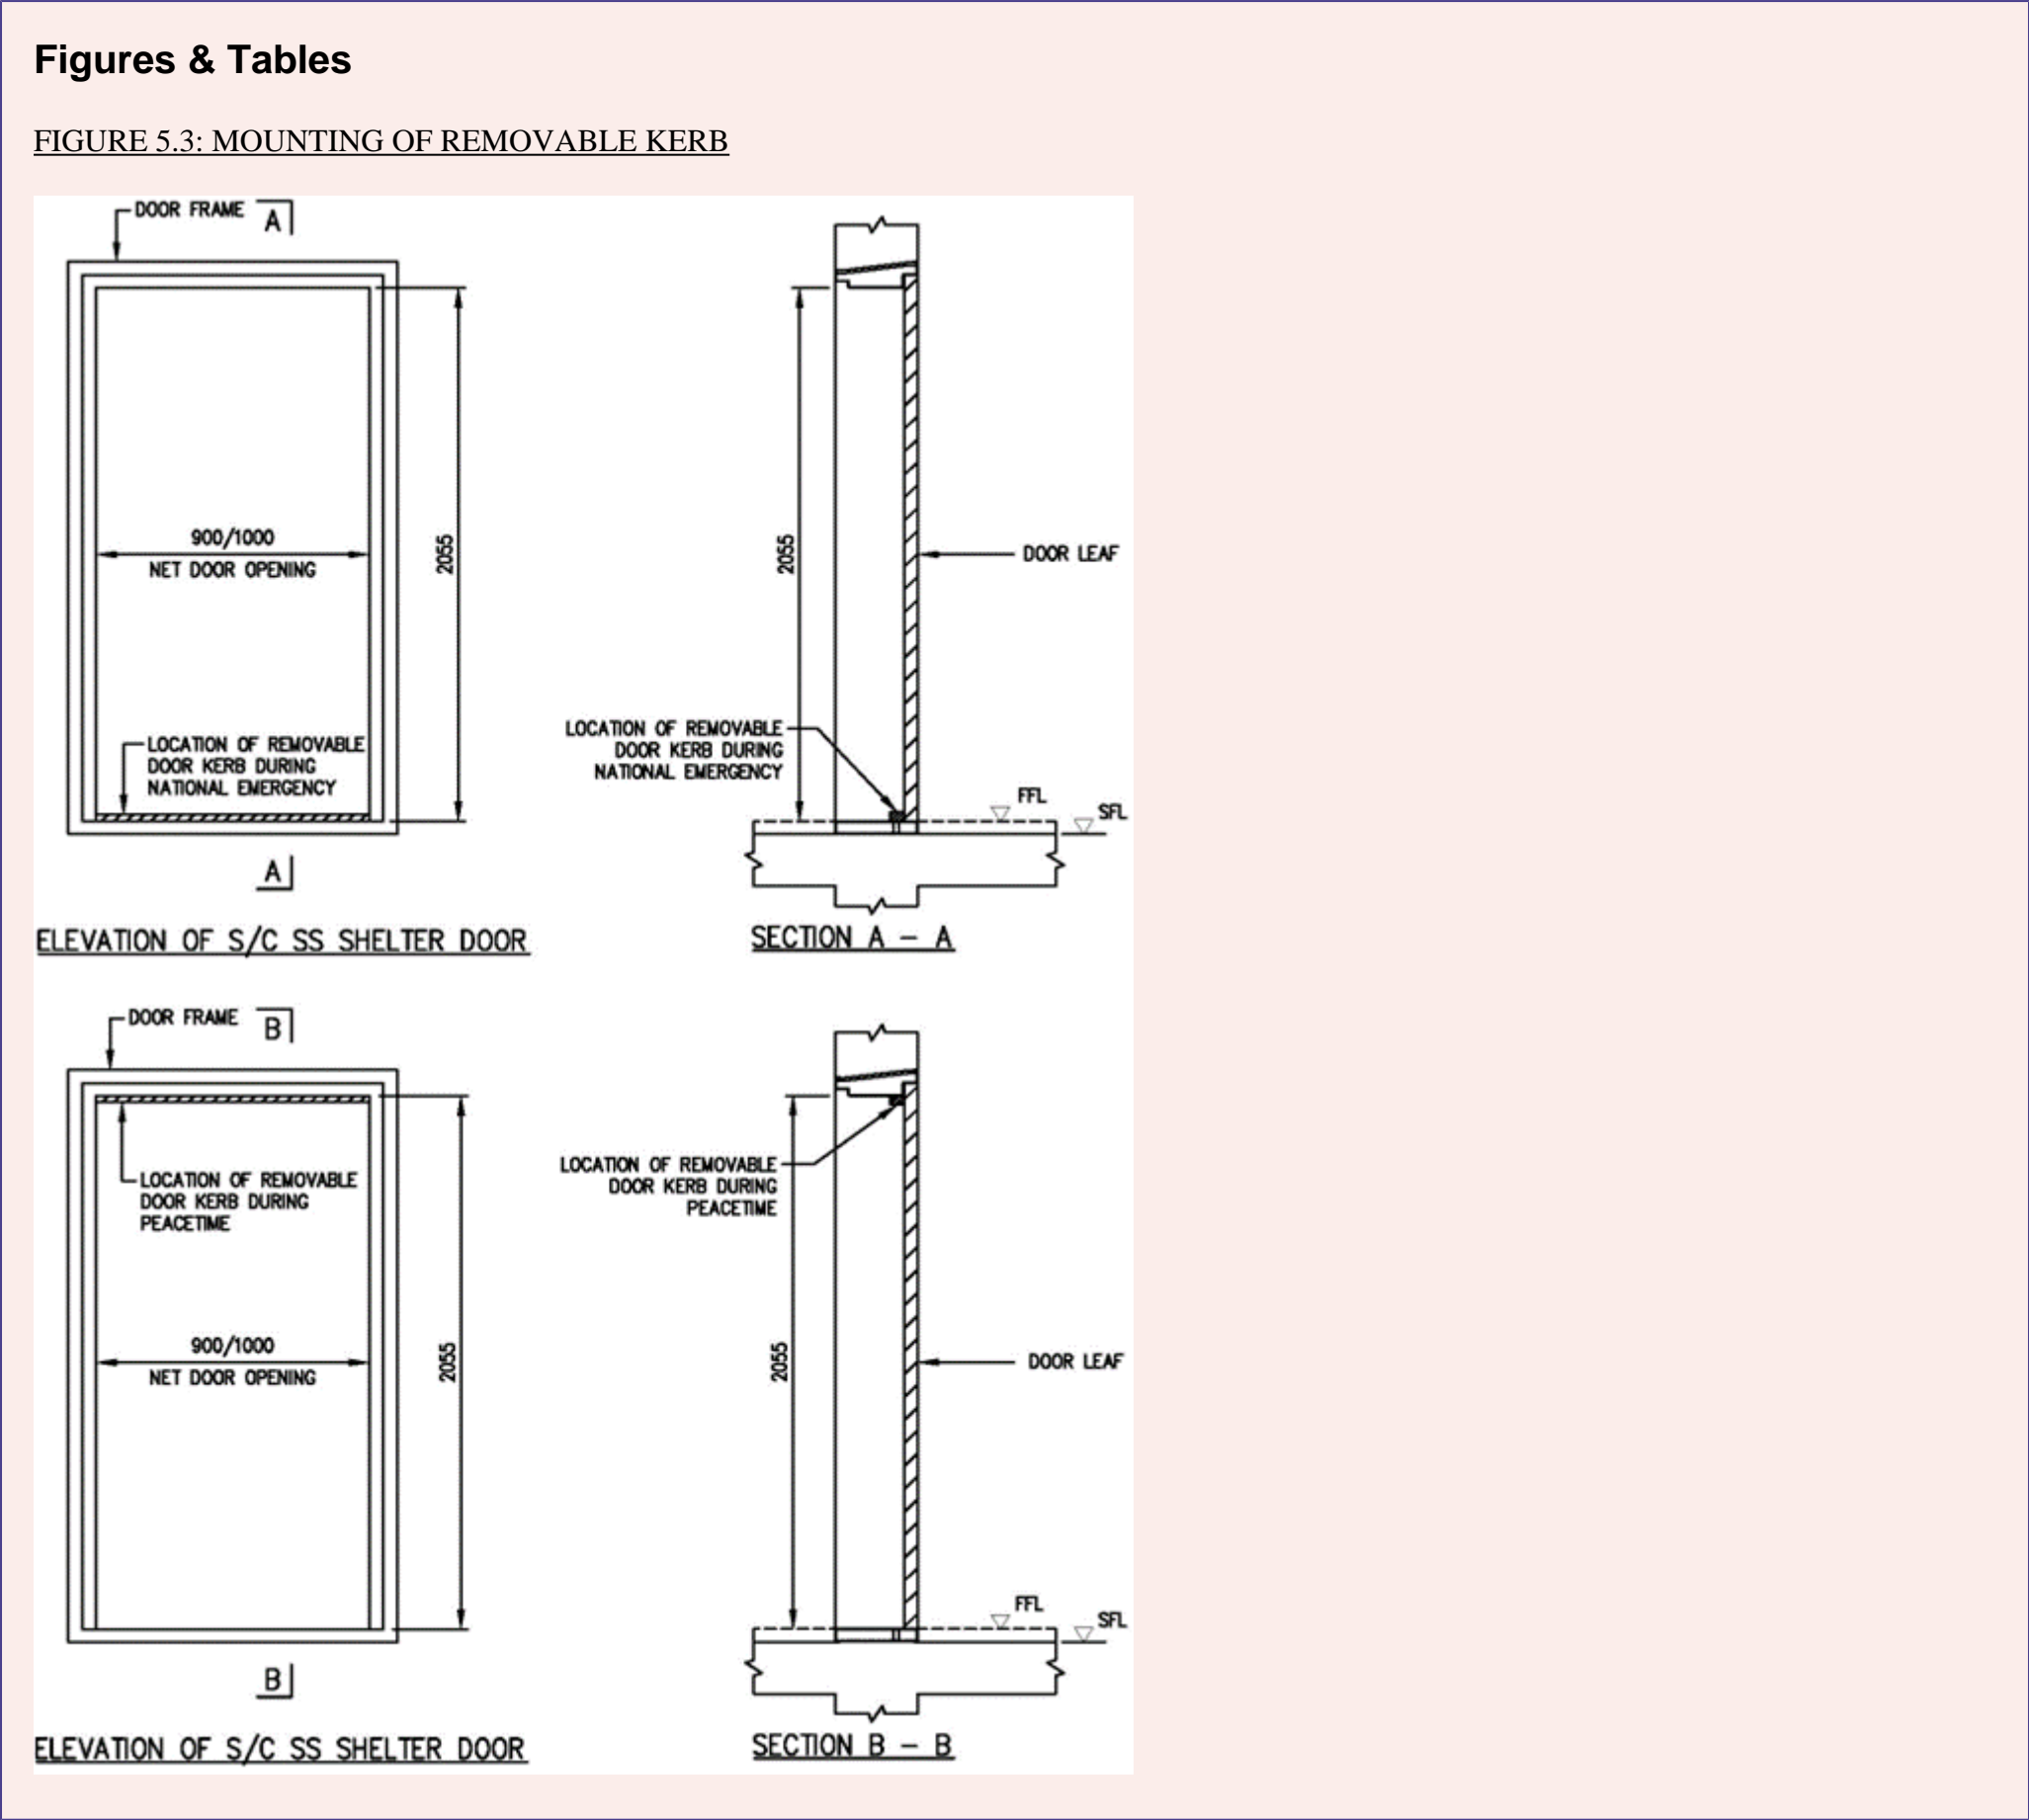

CLAUSE 5.4 SS DOOR NOTICE

Every SS door shall have a SS door notice affixed on its internal face. Refer to FIGURE 5.4(a). A sample notices for SS and S/C SS or scissor S/C SS are as shown in FIGURE 5.4(b) and 5.4(c).

Figures & Tables

FIGURE 5.4(a): LOCATION OF NOTICE ON SS DOOR

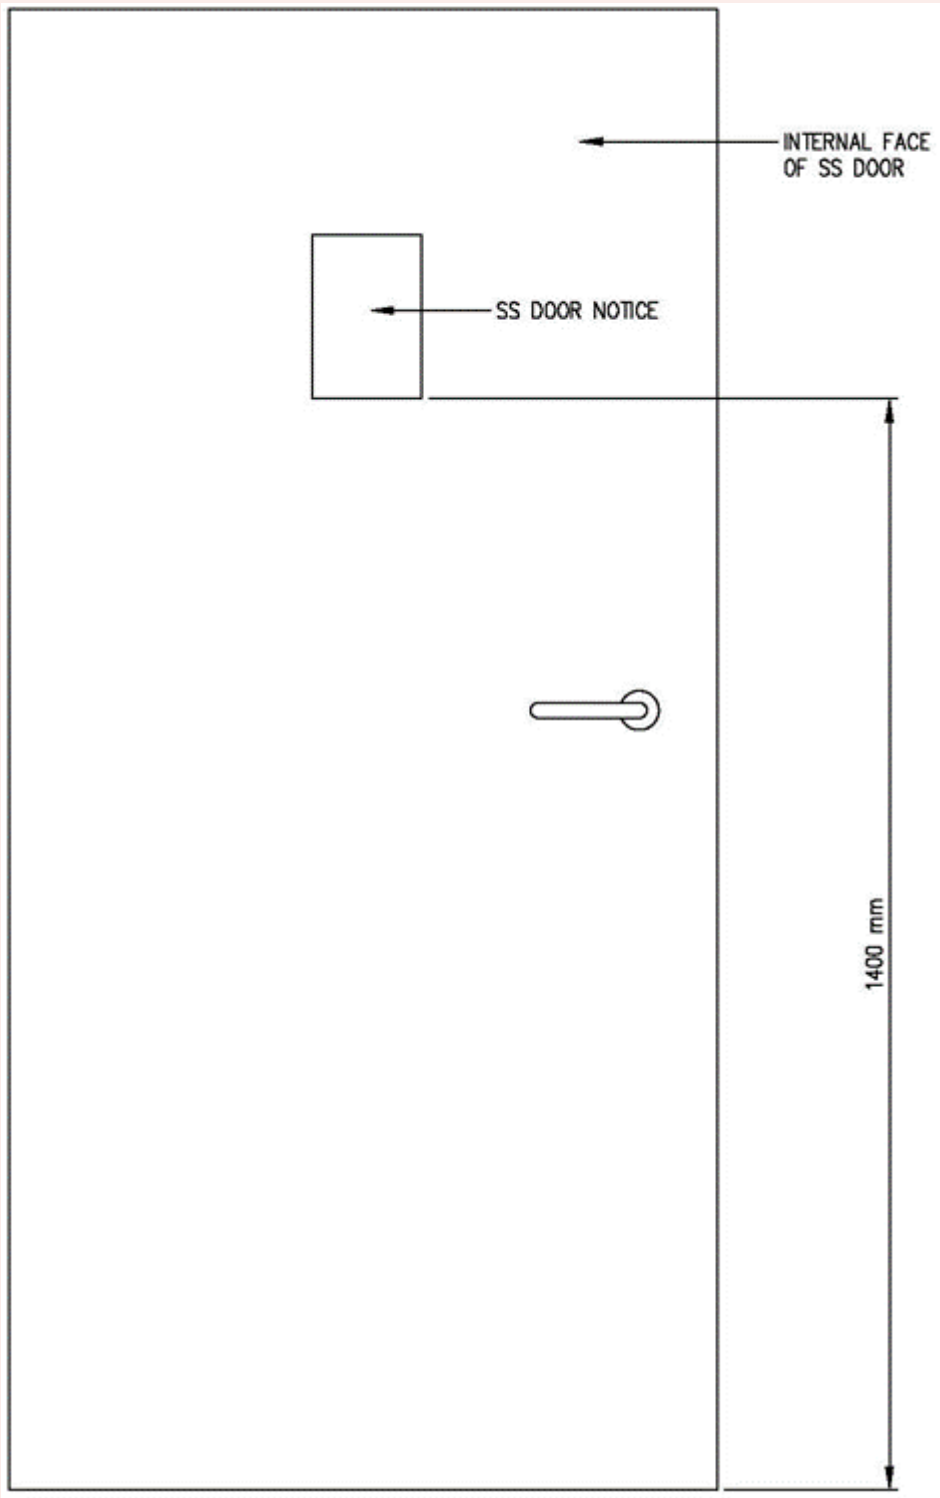


FIGURE 5.4(b): SAMPLE SS DOOR NOTICE

NOTICE

This staircase is designed to serve as civil defence storey shelters (SS) during a war emergency for residents who do not have civil defence household shelters in their units. Staircase SS are provided under the Civil Defence Shelter Act 1997.

Conversion of Staircase into Civil Defence Storey Shelters:

In the event of an impending war emergency, the Singapore Civil Defence Force (SCDF) will announce appropriate instructions to the population. Within the time period specified in the announcement, the building Management Corporation (MC) will manage the conversion of the staircase into a series of adjoining SS compartments from one another by SS doors at staircase entrances and landings. The conversion tasks may be found in the Staircase Storey Shelter Operation and Maintenance Manual held by the MC.

During a War Emergency:

The MC is expected to manage the staircase SS according to guidelines given in the aforesaid manual. Generally, for their own protection when the "Alarm" signal has been sounded or given, residents are to:

- ▶ Move into their allocated SS without delay, close the entrance SS door and all adjoining landing SS doors by pulling the door handles to **"Position B"** as shown in the diagram below.
- ▶ Remain in their allocated SS and not move into adjoining SS. For protection reasons, it is important to ensure all SS doors are fully closed and the door handles kept in **"Position B"**, to maintain every SS as a separate compartment.
- ▶ Switch on the radio or TV set to receive information on the war emergency and any instructions from the SCOF. Use the telephone set as necessary.
- ▶ Open the entrance SS door and leave the SS only after the **"All Clear"** signal has been sounded or given.

NOTIS

Tangga ini direka untuk bertindak sebagai kubu bertingkat (SS) pertahanan awam semasa kecemasan peperangan bagi penduduk yang tidak mempunyai kubu pertahanan awam di dalam rumah mereka


Penukaran Tangga Menjadi Kubu Bertingkat Pertahanan Awam:

Dalam masa akan berlakunya kecemasan peperangan, Pasukan Pertahanan Awam Singapura (SCDF) akan membuat pengumuman mengenai arahan-arahan yang sesuai kepada semua para penduduk keseluruhannya. Dalam tempoh masa yang telah ditetapkan melalui pengumuman SCDF ini, Perbadanan Pengurusan (MC) bangunan akan mengurusi penukaran tangga menjadi satu siru kubu bertingkat (SS) yang bercantum, dipisahkan antara satu sama lain oleh pintu SS di setiap laluan masuk dan pelantar tangga. Tugas bagi penukaran ini boleh didapati dalam buku Skema Panduan Operasi dan Penyelenggaraan kubu Tangga Bertingkat yang disediakan oleh MC.

Semasa Kecemasan Peperang

MC ditugaskan mengurus tangga SS mengikut garis panduan yang terdapat di dalam Buku Panduan Operasi dan Penyelenggaraan Kubu Tangga Berlingkat. Umumnya, bagi perlindungan mereka sendiri, apabila isyarat "Geraan" ("Alarm") dibunyikan atau diberikan, penduduk harus perlu:

- Bergerak ke SS yang telah disediakan tanpa berenang, menutup pintu SS dan semua pintu pelantar SS yang berancaman, dengan menggerakkan pemegang pintu tersebut ke "Posisi B" ("Position B") seperti yang terlihat di dalam gambarajah di bawah.
- Kekal berada di SS yang disediakan dan jangan bergerak ke SS yang berbeza. Anda adalah sebagai perindukan, adalah penting untuk memastikan semua pintu SS ditutup dengan rapat dan pemegang pintu diletakkan pada "Posisi B" ("Position B"), bagi mengukuhkan setiap SS sebagai petak yang berenang.
- Bunyikan radio atau TV untuk menerima maklumat mengenai keselamatan peperangan dan sebarang arahan daripada SCDF. Gunakan telefon untuk membuat panggilan.
- Buka pintu masuk SS dan tinggalkannya hanya apabila isyarat "Semua Selamat" ("All Clear") telah dibunyikan atau diberikan.



(A) Normal Mode
普通操作法
Kaedah biasa
இயல்பான முறை


CIVIL DEFENCE
 READINESS IS YOUR ONLY PROTECTION

通告

根据1997年民防防空壕法令的规定,在战争期间,住家没有防空壕的居民,可以利用特别设计的楼梯空间作为民防楼层防空壕(SS)。

將樓梯改裝成民防樓層防空壕 (SS)：

在面临战争危机时，新加坡民防部队(SCDF)将对民众发布相应的指令。在通告所规定的时间内，大厦管理机构(MC)会将负责把楼梯改装成一排并毗连的楼层防空壕(SS)，并在楼梯入口和平台之间用SS大门隔成不同的区域。MC都持有楼层防空壕的操作和维修手册，手册中对改装步骤也有说明。

战争期间：

根据维修手册的指导, MC 将负责楼层防空壕 (SS) 的管理工作。为了保障自己的生命, 当“警惕”信号响起时, 居民应该:

- ▶ 立刻进入指定的SS、关闭SS及其相邻平台之间的大门，将把转至如下图所示的“位置 (B)”。
- ▶ 停留在指定的SS中，不要闯入隔壁。出于安全考虑，应确保每个SS都隔成单独空间，所有门完全关闭及其门把手处于“位置 (B)”，这是至关重要的。
- ▶ 断开收音机或电视机，接收紧急信息和来自新加坡民防部队 (SCDF) 的指令。如有所需，请使用电话。
- ▶ 只有当听到“警报解除”信号，才可以大开SS门，并离开SS。

அறிவிப்பு

குடிசைத் தற்காப்பு கார்ப்பரேட்கள் இப்போது கட்டிடங்களில் வசிக்கும் குடியிருப்போர்கள், போர்டுகள் அமைந்துள்ள சாலைகளில் புகைகூட்டு கார்ப்பரேட்களை குடிசைத் தற்காப்பு கார்ப்பரேட்களாக (ரெஸிட்) பயன்படுத்திக் கொள்ளும் வகையில் வடிவமைக்கப்படுகிறது. இதற்கான புகைகூட்டு கார்ப்பரேட்கள், குடிசைத் தற்காப்பு கார்ப்பரேட் சட்டம் 1997-ல் அமைக்கப்படுகிறது.

(மே 11.11) இவ்வாறு சூது வளரத் தடுக்கவும், மரபுக் கட்டுப்பாடுகளையும் மாற்றியும்:

[illegible]

செயற்கை உணர்வுகளைக் கவனித்தல்

என்கி வேற்கூறு கைப்பிடிக்க கொடுக்கப்பட்டிருக்கிற கட்டுக்காட்டு முறைகளை பின்பற்றி படிக்கப் படிக்கக்கூடப்படுவது மராமத்துக்கும் ஒருவர எதிர்பார்க்கப்படுகிறது. பொதுவாக, "ஊராட்சி ஒன்றியம்" ஒன்றிக்கும் பொது கட்டிடப்பணி அவர்களின் பாதகப்படுத்தலாக பின்புறம் செயல்முறைகளை கடைப்பிடிக்க வேண்டும்.

- [illegible]

NOTICE

This staircase is designed to serve as civil defence storey shelters (SS) during a war emergency for residents who do not have civil defence household shelters in their units. Staircase SS are provided under the Civil Defence Shelter Act 1997.

Conversion of Staircase into Civil Defence Storey Shelters:

In the event of an impending war emergency, the Singapore Civil Defence Force (SCDF) will announce appropriate instructions to the population. Within the time period specified in the announcement, the building Management Corporation (MC) will manage the conversion of the staircase into a series of adjoining SS, compartmented from one another by SS doors at staircase entrances and landings. The conversion tasks may be found in the Staircase Storey Shelter Operation and Maintenance Manual held by the MC.

During a War Emergency:

The MC is expected to manage the staircase SS according to guidelines given in the aforesaid manual. Generally, for their own protection when the "Alarm" signal has been sounded or given, residents are to:

- ▶ Move into the allocated SS without delay, close the entrance SS door and all adjoining landing SS doors by putting the door handles to **"Position B"** as shown in the diagram below.
- ▶ Remain in their allocated SS and not move into adjoining SS. For protection reasons, it is important to ensure all SS doors are fully closed and the door handles kept in **"Position B"**, to maintain every SS as a separate compartment.
- ▶ Switch on the radio or TV set to receive information on the war emergency and any instructions from the SCDF. Use the telephone set as necessary.
- ▶ Open the entrance SS door and leave the SS only after the **"All Clear"** signal has been sounded or given.

NOTIS

Tangga ini direka untuk bertindak sebagai kubu bertingkat (SS) pertahanan awam semasa kecemasan peperangan bagi penduduk yang tidak mempunyai kubu pertahanan awam di dalam rumah mereka.


Penemuan Tenggol Menjadi Kubu Bertingkal Pertahanan Awam:

Dalam masa akan berlakunya kecamasan peperangan, Pasukan Pertahanan Awam Singapura (SCDF) akan membuat pengumuman mengenai arahan-arahan yang sesuai kepada semua para penduduk keseluruhannya. Dalam tempoh masa yang telah ditetapkan melalui pengumuman SCDF ini, Perbadanan Pengurusan (MC) bangunan akan menggarap penarikan tenaga menjadi satu ke kubu bertinggal (SS) yang bertembok, dipisahkan antara satu sama lain oleh pintu SS di setiap laluan masuk dan keluar tangga. Tugas bagi penarikan ini boleh didapati di dalam Buku Panduan Operasi dan Penyelenggaraan Kubu Tangga Bertinggal yang dikeluarkan oleh MC.

Semasa Kecemasan Peperang:

MC digunakan dengan tangga SS mengikat garis panduan yang terdapat di dalam Buku Panduan Operasi dan Penyelenggaraan Kabinet Beringkat. Umumnya, bagi perlindungan mereka sendiri, apabila isyarat "Geraan" ("Alarm") dibunyikan atau diberikan, pendakik harus perlu:

- ▶ Bergerak ke SS yang telah disediakan tanpa berhenti, menutup pintu SS dan semua pintu pelatar SS yang berbatasan, dengan menggunakan pemegang pintu tersebut ke "Posisi B" ("Position B") seperti yang tertera di dalam gambar yang di bawah ini.
- ▶ Jika berada di dalam SS yang disediakan dan jangan bergerak ke SS yang bersebelahan. Atas sebab-sebab perlindungan, adalah penting untuk memastikan semua pintu SS ditutup dengan rapat dan pemegang pintu diletakkan pada "Posisi B" ("Position B"), bagi mengkalakan setiap SS sebagai pintu yang berbatasan.
- ▶ Ruyikan radio atau TV untuk menerima maklumat mengenai kecamaran peperangan dan sebarang arahan daripada SCDF. Gunakan telefon untuk membuat panggilan.
- ▶ Jika pintu masuk SS dan tingkangannya hanya apabila isyarat "Semua Selamat" ("All Clear") telah dibunyikan atau dibenarkan.



(A) Normal Mode
普通操作法
Kaedah biasa
இயல்பான முறை

通告

根据1997年民防防空壕法令的规定,在战争期间,住家内没有防空壕的居民,可以利用特别设计的楼梯空间作为民防楼层防空壕(SS)。

將樓梯改裝成民防樓層防空壕 (SS)。

在面临战争危机时，新加坡民防部队(SCDF)将对民众发布相应的指令。在通告所规定的时间内，大厦管理机构(MC)会将负责把楼梯改装成一排排毗邻的楼层防空壕(SS)，并在楼梯入口和平台之间用SS大门隔成不同的空间。MC都持有楼层防空壕的操作和维修手册，手册中对改装步骤也有说明。

战争期间，

根据维修手册的指导, MC将负责楼层防空壕 (SS) 的管理工作。为了保障自己的生命, 当“警惕”信号响起时, 居民应该:

- ▶ 立刻进入指定的SS、关闭SS及其相邻平台之间的大门，将把手转至如下图所示的“位置(B)”。
- ▶ 停留在指定的SS中，不要闯入隔壁。出于安全考虑，应确保每个SS都隔成单独空间。所有门完全关闭及其门把手位于“位置(B)”。这是至关重要的。
- ▶ 扭开收音机或电视机，接收紧急信息和来自新加坡民防部队(SCDF)的指令。如有所需，请使用电话。
- ▶ 只有当听到“警报解除”信号，才可以打开SS门，并离开SS。

அறிவிப்பு

குமாஸ்த் தரகர்ப்பு ஸாப்ட்வேர் இல்லாத கட்டிடங்களில் வசீகரம் குறைவிடுபாளர்கள், பொதுக்கூலி அலுவலர்கள் சமூகத்தில் படிக்கட்டு ஸாப்ட்வேரை குமாஸ்த் தரகர்ப்பு வர ஸாப்ட்வேரை நன்றால் பயன்படுத்திக் கொள்ளும் வகையில் வடிவமைக்கப்பட்டுள்ளது. இந்தக்கூலி படிக்கட்டு ஸாப்ட்வேர், குமாஸ்த் தரகர்ப்பு ஸாப்ட்வேர் சட்டம் 1997 படி அமைக்கப்பட்டுள்ளது.

புகார் குறைவு ஏதுமில்லாத புகார் அளிப்பதற்கான வழிமுறை :

உயிரின சமூகத்தை அங்கீகரி :

என்பி, வேதாந்திய கணிப்பீதம் கெட்டுக்கிடப்பதால் வந்திருக்கிற குறைபாடுகள் பின்பற்றி படிக்கிற மாண்புமிகு அமைச்சர் பதார்த்தம் என்று எதிர்பார்க்கப்படுகிறது. பொதுவாக, 'பலம் அறிவிப்பு' என்கிற பொது குறியீடுகளாகக் கூறினால் பதார்த்தப்பக்கம் பின்பற்றும் பெரும்பகுதியான கணிப்பீதம் வேறானது.

- [illegible]

CLAUSE 5.5 SPECIFICATIONS OF SS DOOR NOTICE

a. Manner of Application:

To be affixed on the internal SS door by pressure sensitive and strong adhesive.

b. Special Features:

Non-brittle, rub and mar resistant, storage stability and colour fastness under light

c. Text, Lettering, Layout:

Conform to sample notice

d. Colours:

Background is light yellow, lettering is black, sub- headings, border and triangular logo area are red

Amendment History - Chapter 5 - SS Door

Clause No.	Amendment Date	Effective Date	Clause Status	Clause Before Amendment	Circular Date
------------	----------------	----------------	---------------	-------------------------	---------------

CLAUSE 6.1 GENERAL

As the SS is designed to resist weapon effects, good workmanship is essential to achieve the designed protection level.

CLAUSE 6.2 STRUCTURAL WORKS

The following shall be observed:

- a. Only the non-removable type of form-tie (form-tie without through opening) to secure formwork before casting of SS wall is permitted. Upon the removal of every recessible type of plastic cones from the form-tie, the recess shall be sealed with non-shrink grout. The use of reinforcement bar as form-tie is not permitted.
- b. To avoid bending, warping or displacement of HS door frame and honeycombing due to inadequate compaction or leakage of cementitious grout, additional precaution to ensure adequate compaction shall be taken while casting the concrete near the SS door frame.
- c. All embedded items shall be placed and tightly secured in their intended location to ensure their stability during casting. All hacking and drilling of SS tower walls, ceiling slabs or floor slabs are not permitted without prior approval from the Commissioner of Building Control.
- d. The exposed surfaces of SS walls and soffit of SS ceiling slabs shall be cast with smooth concrete finish. A maximum of 2mm thick skim coat on the internal face of the SS walls and ceiling slabs of SS is allowed.
- e. The concrete structural elements shall be adequately compacted to ensure air- tightness. Concrete areas with segregation or honeycombing shall not be hacked and plastered back without prior approval from the Commissioner of Building Control.
- f. Irregularities of exposed surfaces shall not be hacked and plastered back without prior approval from the Commissioner of Building Control.
- g. Method statement of the remedial work on structural elements, including SS door frame, shall be approved by the Commissioner of Building Control.

CLAUSE 6.3 SS DOOR

The following shall be observed:

- a. Allowing an opening in the SS wall and later erecting the SS door frame and door leaf in this opening, followed by casting concrete around it, is not permitted.
- b. When casting the SS wall with SS door frame, a dummy door leaf of adequate design shall be placed to ensure the stability and prevent the bending, warping or displacement of the SS door frame during concreting.
- c. The FFL of the floor slab outside the SS shall be done such that the SS door can be opened adequately for the peacetime use of the SS.

CLAUSE 6.4 PEACETIME REQUIREMENT OF VENTILATION SLEEVES

For ventilation purposes during peacetime, at least 25% of total area of the two ventilation sleeve openings in the SS walls shall be kept uncovered.

In the case of S/C SS and scissor S/C SS, all ventilation sleeve openings shall be fully closed.

CLAUSE 6.5 COMMISSIONING REQUIREMENTS

All electrical and communication fixtures such as switch and lighting point, electrical socket outlets, communication line for telephony outlet, including SS door notice, rescue hatch and cat-ladder (both applicable to SS), blast hatch (applicable to S/C SS or scissor S/C SS) shall be provided inside the completed SS. The service conduits with electrical cables serving the SS shall be provided prior to commissioning.

A SS is considered commissioned only if the SS passes all the following tests in one inspection:

- a. Light penetration test of SS door - an acceptable test method to check on light penetration into the SS is to use torchlight from the exterior of SS door. The test is considered to have passed if no light could be seen from the inside of SS.
- b. Chalk mark test on the SS door - an acceptable test method is to apply chalk to the part of the door frame where the door seal will come into contact with when the door is closed. The test is considered to have passed if there is an unbroken and uniform transfer of the chalk markings onto the door seal when the door is closed and re-opened.
- c. Air-tightness test of the SS - an acceptable test method is to pressurise the SS and measure the rate of pressure drop or the pressure difference between the interior and exterior of the SS. The *pressure gauge can be used for the test. The SS is pressurised by pumping air into the SS such that there is a pressure difference of 250 Pa* between inside and outside of SS. The SS is considered to have passed the test if the pressure gauge shows more than or equal to 50 Pa after 45 seconds.

Except in the case of S/C SS or scissor S/C SS, the ventilation sleeves of the SS, which have been closed for the commissioning tests, shall be opened after the tests to comply with [Clause 6.4](#) for ventilation during peacetime.

* The pressure gauge used should have a dial size with a scale of 0 to 50mm or 0 to 500 Pa. (Note: 1 mm = 10 Pa).

Amendment History - Chapter 6 - Construction and Commissioning

Clause No.	Amendment Date	Effective Date	Clause Status	Clause Before Amendment	Circular Date
------------	----------------	----------------	---------------	-------------------------	---------------


CLAUSE 7.1 GENERAL

Any repair or alteration or renovation works, which are likely to weaken or damage any structural elements of the SS or NS, is not permitted.

CLAUSE 7.2 PERMITTED AND NOT PERMITTED WORKS

7.2.1 Permitted Works in SS


- a. Laying of floor tiles bonded to wet cement mortar. The total thickness of floor finishes and screed is not to exceed 50mm.
- b. Laying of floor skirting tiles (up to a maximum of 100mm high) by bonding them with wet cement mortar to SS walls.
- c. Laying of vinyl or linoleum flooring is permitted in SS but not permitted in S/C SS or scissor S/C SS.
- d. Applying splatter dash or equivalent to the external face of SS walls only to provide rough surface for feature wall panels or wall tiles installation.
- e. Painting of walls, ceiling or door. In the case of SS door, owners shall not cover up or paint over the SS door notice (See [Clause 5.3](#)), locking bolts or door seal. The old paint coat on door and door frame is to be removed prior to repainting to avoid increase in paint thickness resulting in difficulty in closing and opening of the door. The new paint coat must be dried up completely before closing the door as wet or damp paint will cause the door/rubber gasket to stick onto the door frame when opening the closed door.
- f. Painting on only the exterior face of the 10mm fragmentation stainless steel plate of the ventilation sleeves.
- g. Drilling into internal face of SS walls and ceiling slabs to a depth of not more than 50mm to affix inserts and removable screws is permitted in SS but not permitted in S/C SS or scissor S/C SS. Fixtures such as pictures, posters, cabinets or shelves mounted on the internal face of SS walls will have to be removed by the owners within 48 hours upon notification. There is no restriction to the diameter of the non- metallic insert as long as it does not exceed 50mm in length. It is the owner’s responsibility to ensure that the strength of the insert is adequately provided for the intended purpose.
- h. Power driven nails are allowed only on external face of the SS walls to facilitate flexibility in mounting of features/fixtures by owners.
- i. Removal of the fragmentation plates (Clause 4.4) covering the ventilation openings is permitted for SS but not permitted in S/C SS or scissor S/C SS. The removal of fragmentation for SS shall comply with the following conditions:
 - i. The plates (after removal) shall be securely mounted with removable screws on non-metallic inserts not exceeding 50mm deep on one of the internal face of SS walls.
 - ii. After the removal of plates, the bolts and nuts shall be installed back to their original positions on the ventilation sleeves.
 - iii. Closing or covering up of ventilation openings by removable aesthetic or architectural finishes is allowed, provided that at least 25% of the total area of the two openings shall be left uncovered for ventilation purposes during peacetime.
- j. The minimum clearance from the fragmentation plate to RC beam or structure or service shall be 50mm. Where RC beam or structure or service is fronting the fragmentation plate of ventilation sleeve, the clear distance between them shall be at least 500mm. Refer to FIGURE 4.3.1(a).

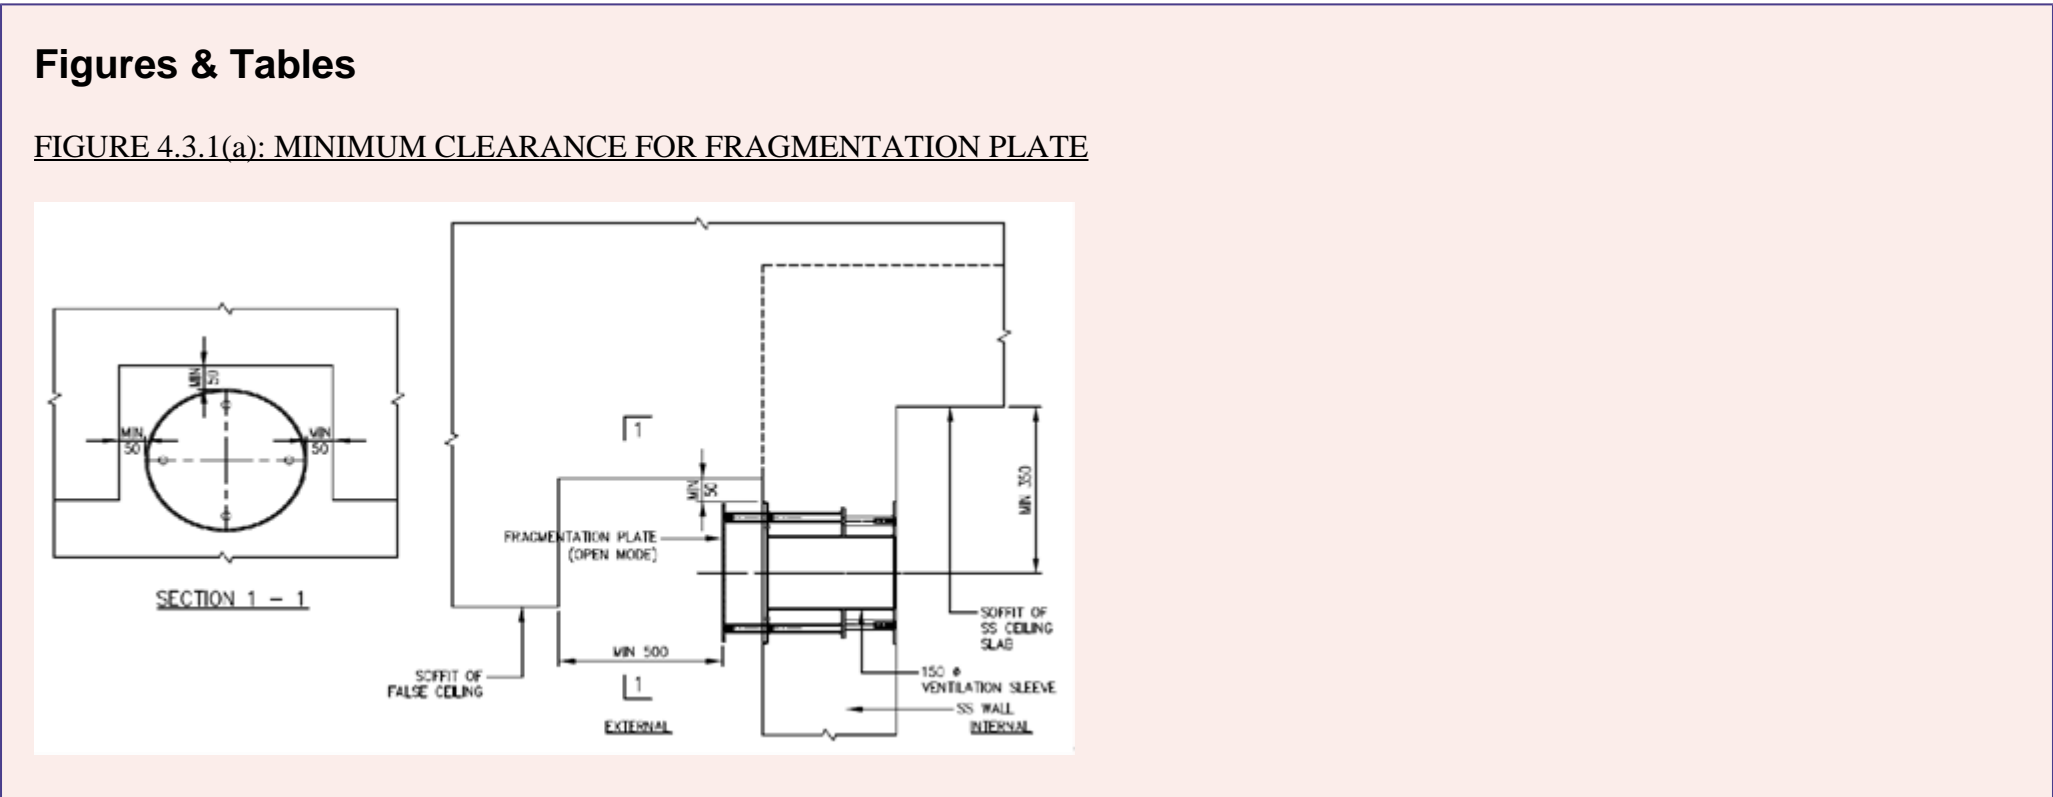

- k. Where false ceilings, which are provided on the exterior of the SS, are to be installed at a level below the ventilation sleeves, there shall be one perforated access panel of a minimum size of 600mm x 600mm to be provided directly below each ventilation sleeve. Refer to FIGURE 4.3.2.



FIGURE 4.3.2: PERFORATED ACCESS PANEL BELOW VENTILATION SLEEVE

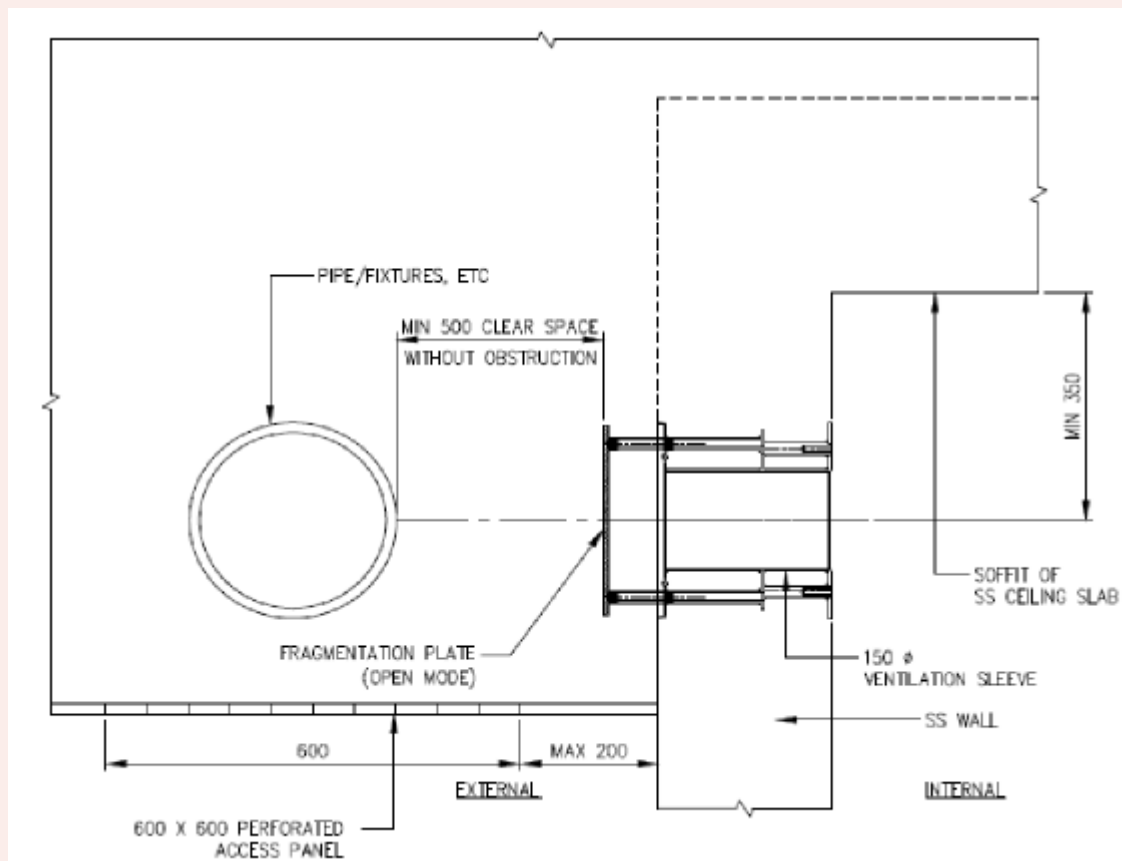

7.2.2 Not Permitted Works in SS

- a. Laying of wall tiles or spray of rock tone finish, cement sand finish and gypsum plastering on the internal faces of SS walls.
- b. Laying of floor tiles using adhesive materials.
- c. Laying of 2nd layer of tiles on floor or skirting tiles.
- d. Installation of cornices within the SS.
- e. Installation works with fixings using power driving nails into the internal SS walls
- f. Tampering with, removing or covering up of the SS door notice. The SS door notice provides important information to the occupants on the use of the SS.
- g. Hacking and drilling of SS walls, floor slabs, and ceiling slabs without prior approval from the Commissioner of Building Control, other than drilling permitted in Clause 7.2.1(g) and 7.2.1(h) and shall not exceed 50mm.
- h. Hacking to both internal and external face of the SS walls to form key for tiling.
- i. Hacking on external face of SS wall for mounting of feature wall panels or wall tiles installation.
- j. Modifying, changing, removing or tampering of SS door without prior approval from the Commissioner of Building Control.
- k. Modifying, altering or tampering with any part of the ventilation openings, plates and the mounting devices such as bolts and nuts without prior approval from the Commissioner of Building Control.
- l. Painting to the interior face of the 10mm fragmentation stainless steel plate of the ventilation sleeves, the ventilation sleeves, “O” ring rubber gaskets and the four or eight numbers of stainless steel bolts which hold the steel plate to the sleeves.

7.2.3 Not Permitted Works in NS

- a. Hacking and drilling of NS walls, floor slabs, and ceiling slabs without prior approval from the Commissioner of Building Control, other than drilling into NS walls and ceiling slab to affix removable screws on inserts, provided the depth of the insert shall not exceed 50mm.
- b. Modifying, changing, removing or tampering of SS door without prior approval from the Commissioner of Building Control.

Amendment History - Chapter 7 - Permitted And Not Permitted Works in SS Tower

Clause No.	Amendment Date	Effective Date	Clause Status	Clause Before Amendment	Circular Date
------------	----------------	----------------	---------------	-------------------------	---------------

CLAUSE 8.1 GENERAL

This Chapter stipulates requirements relating to the certification of shelter products regulated by SCDF under the Product Listing Scheme. These requirements include the acceptable test standards, certification scheme and surveillance regime for the regulated shelter product (refer to Table 8.1).

For the full list of requirements, this Chapter shall be read in conjunction with the Civil Defence Shelter Act (CDSA) and CT 23 of SAC’s “Criteria for Product Certification Bodies (Regulated Shelter Products)”.

Figures & Tables

TABLE 8.1 : LIST OF REGULATED SHELTER PRODUCT

TABLE 8.1 : LIST OF REGULATED SHELTER PRODUCT

PRODUCTS

ACCEPTABLE STANDARDS

CERTIFICATION SCHEME

TESTING

SURVEILLANCE REGIME

FACTORY AND SITE INSPECTION

Storey Shelter Door

Refer to Table 8.2

Scheme 5

(Label issued)

Once every 3 years for cyclic test.

Annually for water tightness test, dimension check, CED coating test & rubber gasket test.

At least once annually or by trigger (every 200 labels).

TABLE 8.2: TEST STANDARDS AND SPECIFICATIONS FOR STOREY SHELTER DOOR

TABLE 8.2: TEST STANDARDS AND SPECIFICATIONS FOR STOREY SHELTER DOOR

TYPE TESTS – SCHEME TYPE 5

S/N

TEST

STANDARD/SPECIFICATION

1

Door locking mechanism cyclic test (Once in 3 years)

Test Cycles

The entire test shall consist of 60,000 cycles, which in turn comprise two cyclic types:

• Type A : 10,000 in Civil Defence (CD) mode when the lock bolts are activated.

• Type B : 50,000 for normal opening and closing of door (based on 900 angle of opening function).

(Note: Type A cycles are to be performed interspersed between the Type B cycles in the ratio 1:5, i.e. 1 Type A cycle to be done after every 5 Type B cycles.)

Test Method and Requirements

• The test is conducted using the test rig designed to be able to support the doorset and holding it rigidly in place, preventing any movement that may occur during the tests.

• 5 Type B cycles to be carried out. Each cycle shall consist of the latch of lockset unlatching (with its level handle completing at 900 angle movement), followed by the door leaf opening to 900 angle and then by the closing of the door leaf and finally latching in place. During each cycle, the lockset shall be able to latch fully.

• After the 5 Type B cycles, 1 Type A cycle to be performed. The type A cycle is a 900 angle movement of the lever handle of the lockset in locking and unlocking the doorset. During each cycle, the lockset shall fully engage the bolts onto the door frame, with the lever handle completing the full cycle of operation without straining.

• This pattern of 5 Type B cycles followed by 1 Type A cycle is to be repeated 10,000 times.

After completion of 60,000 cycles

• After the test, the doorset shall be checked manually that it is still able to lock in place without causing any strains and all functions of the lockset shall still operate.

- Check that there shall be no damages or evidence of undue wear or loosening of any parts of the doorset including the hardwares installed or other defects that may impair its reliability of functioning and the test leaf shall remain connected to the frame.
- Check that the lockset’s spring bolt through the striking plate shall continue to function correctly and be able to return to its normally extended position under its own spring pressure and all functions of the lockset shall still operate.
- Check for visible cracking or breakage of any components on the hinges and check that the doorset is capable of closing properly, maintaining all clearances between leaf to frame and floor as measured before the test.

2

Water-tightness test

Water tightness test shall be carried out on the door leaf and frame assembly in their closed position. The enclosure formed by the door leaf and frame assembly in their closed position shall be filled with water to a uniform depth of 25mm of water for a period of 2 hours. There shall be no seepage of water within this period.

3

CED/Galvanised Coating Test

CED

- ASTM D3359
 - Rating 5B (no removal of coating).
- SS5 : Part F2
 - The coating shall withstand test load of 2000g.
- ASTM 3363
 - 2H shall be the hardest pencil that does not scratch the film.
- SS5 : Part B1
 - Dry film thickness shall be 20 ± 5µm
- SS5 : Part G1. Test duration = 500 hours
 - The coating may have any quantity of Size 2 blisters but shall have no more than Density 2 Size 3 blisters as illustrated in ISO 4628-2.
 - Degree of rusting shall not be more than scale Ri 2 according to ISO 4628-3.
- SS5 : Part G6. Test duration = 500 hours
 - The coating shall have no more than Density 2 Size 2 blisters as illustrated in ISO 4628-2.
 - Degree of rusting shall not be more than scale Ri 1 accordingly to ISO 4628-3.

Electro-galvanised

- ASTM A90
 - Coating thickness = 3.5 microns minimum.

4

Rubber gasket test

ASTM D1056 (Grade 2A3, 2A4, 2A5, 2B3, 2B4 or 2B5).

SURVEILLANCE TESTS – SCHEME TYPE 5

1

Door locking mechanism cyclic test

Test Cycles

The entire test shall consist of 60,000 cycles, which in turn comprise two cyclic types:

- **Type A** : 10,000 in Civil Defence (CD) mode when the lock bolts are activated.
- **Type B** :: 50,000 for normal opening and closing of door (based on 900 angle of opening function).

(Note: Type A cycles are to be performed interspersed between the Type B cycles in the ratio 1:5, i.e. 1 Type A cycle to be done after every 5 Type B cycles.)

Test Method and Requirements

- The test is conducted using the test rig designed to be able to support the doorset and holding it rigidly in place, preventing any movement that may occur during the tests.
- 5 Type B cycles to be carried out. Each cycle shall consist of the latch of lockset unlatching (with its level handle completing at 900 angle movement), followed by the door leaf opening to 900 angle and

then by the closing of the door leaf and finally latching in place. During each cycle, the lockset shall be able to latch fully.

- After the 5 Type B cycles, 1 Type A cycle to be performed. The type A cycle is a 900 angle movement of the lever handle of the lockset in locking and unlocking the doorset. During each cycle, the lockset shall fully engage the bolts onto the door frame, with the lever handle completing the full cycle of operation without straining.
- This pattern of 5 Type B cycles followed by 1 Type A cycle is to be repeated 10,000 times.

After completion of 60,000 cycles

- After the test, the doorset shall be checked manually that it is still able to lock in place without causing any strains and all functions of the lockset shall still operate.
- Check that there shall be no damages or evidence of undue wear or loosening of any parts of the doorset including the hardware installed or other defects that may impair its reliability of functioning and the test leaf shall remain connected to the frame.
- Check that the lockset's spring bolt through the striking plate shall continue to function correctly and be able to return to its normally extended position under its own spring pressure and all functions of the lockset shall still operate.
- Check for visible cracking or breakage of any components on the hinges and check that the doorset is capable of closing properly, maintaining all clearances between leaf to frame and floor as measured before the test.

2	Water-tightness test	Water tightness test shall be carried out on the door leaf and frame assembly in their closed position. The enclosure formed by the door leaf and frame assembly in their closed position shall be filled with water to a uniform depth of 25mm of water for a period of 2 hours. There shall be no seepage of water within this period.
---	----------------------	--

3	Production test	Dimensional checks in accordance to approved drawings. The door frame can be double rebated to facilitate the installation of a fire door.
---	-----------------	--

4	CED/Galvanised Coating Test	<p><u>CED</u></p> <ul style="list-style-type: none"> • ASTM D3359 <ul style="list-style-type: none"> - Rating 5B (no removal of coating). • SS5 : Part F2 <ul style="list-style-type: none"> - The coating shall withstand test load of 2000g. • ASTM 3363 <ul style="list-style-type: none"> - 2H shall be the hardest pencil that does not scratch the film. • SS5 : Part B1 <ul style="list-style-type: none"> - Dry film thickness shall be $20 \pm 5\mu$. • SS5 : Part G1. Test duration = 500 hours <ul style="list-style-type: none"> - The coating may have any quantity of Size 2 blisters but shall have no more than Density 2 Size 3 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 2 according to ISO 4628-3. • SS5 : Part G6. Test duration = 500 hours <ul style="list-style-type: none"> - The coating shall have no more than Density 2 Size 2 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 1 accordingly to ISO 4628-3.
---	-----------------------------	--

Electro-galvanised

- ASTM A90
 - Coating thickness = 3.5 microns minimum.

5	Rubber gasket test	ASTM D1056 (Grade 2A3, 2A4, 2A5, 2B3, 2B4 or 2B5)
---	--------------------	---

CLAUSE 8.2 DEFINITIONS

8.2.1 Accredited Certification Body

“Accredited certification body” (CB) refers to a body corporate or corporation incorporated or constituted under the law of Singapore, accredited under the Singapore Accreditation Council (SAC)’s certification body accreditation scheme administered by the Enterprise Singapore Board.

8.2.2 Accredited Laboratory

“Accredited laboratory” refers to a body corporate or corporation providing laboratory testing services, which is accredited under SAC’s laboratory accreditation scheme administered by the Enterprise Singapore Board, or recognised under the International Laboratory Accreditation Cooperation (ILAC) Mutual Recognition Agreement/Arrangement between Singapore and other countries.

8.2.3 Certificate of Conformity (CoC)

“Certificate of Conformity” refers to a certificate issued by CBs for a regulated shelter product that meets product testing standards and certification requirements. These certified products shall be recorded in a product directory on the CB’s website for reference and verification of the CoCs’ validity.

8.2.4 Local Representative

“Local representative” refers to the Singapore-registered agent/partner appointed by a foreign CoC holder, in order for its certified regulated shelter products to be supplied in Singapore.

8.2.5 Mutual Recognition Arrangement/Agreement (MRA)

“Mutual Recognition Arrangement” or “Mutual Recognition Agreement” refers to the arrangements signed between SAC and other international assessment bodies, which mutually recognise reports and certificates issued by an accredited Conformity Assessment Body (CAB) as equivalent to their own accreditation requirements.

8.2.6 Product Listing Scheme (PLS)

“Product listing scheme” refers to the third-party certification scheme administered by SCDF for regulated shelter products.

8.2.7 Scheme Type 5 (Scheme 5)

“Scheme Type 5” consists of type testing and factory inspection during initial certification, and ongoing assessment of the entire quality management system, including auditing the production process and management system. Surveillance testing of the product is done either from the market or at the point of production, or both, to check that items produced fulfil the specified requirements.

8.2.8 Serial Label

“Serial label” refers to a certification label issued by CBs, with unique serial numbers. These are affixed to certified regulated shelter products, such as SS doors (refer to Table 8.1). Such labels allow tracing of these products to their corresponding CoC and the specific installation location of each product.

Figures & Tables

TABLE 8.1 : LIST OF REGULATED SHELTER PRODUCT				
PRODUCTS	ACCEPTABLE STANDARDS	CERTIFICATION SCHEME	SURVEILLANCE REGIME	
			TESTING	FACTORY AND SITE INSPECTION
Storey Shelter Door	Refer to Table 8.2	Scheme 5	Once every 3 years for cyclic test.	At least once annually or by trigger (every 200 labels).
		(Label issued)	Annually for water tightness test, dimension check, CED coating test & rubber gasket test.	

TABLE 8.2: TEST STANDARDS AND SPECIFICATIONS FOR STOREY SHELTER DOOR				
--	--	--	--	--

TABLE 8.2: TEST STANDARDS AND SPECIFICATIONS FOR STOREY SHELTER DOOR				
--	--	--	--	--

TYPE TESTS – SCHEME TYPE 5

S/N	TEST	STANDARD/SPECIFICATION
1	Door locking mechanism cyclic test (Once in 3 years)	<p><u>Test Cycles</u></p> <p>The entire test shall consist of 60,000 cycles, which in turn comprise two cyclic types:</p> <ul style="list-style-type: none"> • Type A : 10,000 in Civil Defence (CD) mode when the lock bolts are activated. • Type B : 50,000 for normal opening and closing of door (based on 900 angle of opening function). <p>(Note: Type A cycles are to be performed interspersed between the Type B cycles in the ratio 1:5, i.e. 1 Type A cycle to be done after every 5 Type B cycles.)</p> <p><u>Test Method and Requirements</u></p> <ul style="list-style-type: none"> • The test is conducted using the test rig designed to be able to support the doorset and holding it rigidly in place, preventing any movement that may occur during the tests. • 5 Type B cycles to be carried out. Each cycle shall consist of the latch of lockset unlatching (with its level handle completing at 900 angle movement), followed by the door leaf opening to 900 angle and then by the closing of the door leaf and finally latching in place. During each cycle, the lockset shall be able to latch fully. • After the 5 Type B cycles, 1 Type A cycle to be performed. The type A cycle is a 900 angle movement of the lever handle of the lockset in locking and unlocking the doorset. During each cycle, the lockset shall fully engage the bolts onto the door frame, with the lever handle completing the full cycle of operation without straining. • This pattern of 5 Type B cycles followed by 1 Type A cycle is to be repeated 10,000 times. <p><u>After completion of 60,000 cycles</u></p> <ul style="list-style-type: none"> • After the test, the doorset shall be checked manually that it is still able to lock in place without causing any strains and all functions of the lockset shall still operate. • Check that there shall be no damages or evidence of undue wear or loosening of any parts of the doorset including the hardwares installed or other defects that may impair its reliability of functioning and the test leaf shall remain connected to the frame. • Check that the lockset's spring bolt through the striking plate shall continue to function correctly and be able to return to its normally extended position under its own spring pressure and all functions of the lockset shall still operate. • Check for visible cracking or breakage of any components on the hinges and check that the doorset is capable of closing properly, maintaining all clearances between leaf to frame and floor as measured before the test.
2	Water-tightness test	<p>Water tightness test shall be carried out on the door leaf and frame assembly in their closed position. The enclosure formed by the door leaf and frame assembly in their closed position shall be filled with water to a uniform depth of 25mm of water for a period of 2 hours. There shall be no seepage of water within this period.</p>
3	CED/Galvanised Coating Test	<p><u>CED</u></p> <ul style="list-style-type: none"> • ASTM D3359 <ul style="list-style-type: none"> - Rating 5B (no removal of coating). • SS5 : Part F2 <ul style="list-style-type: none"> - The coating shall withstand test load of 2000g. • ASTM 3363 <ul style="list-style-type: none"> - 2H shall be the hardest pencil that does not scratch the film. • SS5 : Part B1 <ul style="list-style-type: none"> - Dry film thickness shall be $20 \pm 5\mu$

- SS5 : Part G1. Test duration = 500 hours
 - The coating may have any quantity of Size 2 blisters but shall have no more than Density 2 Size 3 blisters as illustrated in ISO 4628-2.
 - Degree of rusting shall not be more than scale Ri 2 according to ISO 4628-3.
- SS5 : Part G6. Test duration = 500 hours
 - The coating shall have no more than Density 2 Size 2 blisters as illustrated in ISO 4628-2.
 - Degree of rusting shall not be more than scale Ri 1 accordingly to ISO 4628-3.

Electro-galvanised

- ASTM A90
 - Coating thickness = 3.5 microns minimum.

4 Rubber gasket test ASTM D1056 (Grade 2A3, 2A4, 2A5, 2B3, 2B4 or 2B5).

SURVEILLANCE TESTS – SCHEME TYPE 5

1 Door locking mechanism cyclic test

Test Cycles

The entire test shall consist of 60,000 cycles, which in turn comprise two cyclic types:

- **Type A** : 10,000 in Civil Defence (CD) mode when the lock bolts are activated.
- **Type B** :: 50,000 for normal opening and closing of door (based on 900 angle of opening function).

(Note: Type A cycles are to be performed interspersed between the Type B cycles in the ratio 1:5, i.e. 1 Type A cycle to be done after every 5 Type B cycles.)

Test Method and Requirements

- The test is conducted using the test rig designed to be able to support the doorset and holding it rigidly in place, preventing any movement that may occur during the tests.
- 5 Type B cycles to be carried out. Each cycle shall consist of the latch of lockset unlatching (with its level handle completing at 900 angle movement), followed by the door leaf opening to 900 angle and then by the closing of the door leaf and finally latching in place. During each cycle, the lockset shall be able to latch fully.
- After the 5 Type B cycles, 1 Type A cycle to be performed. The type A cycle is a 900 angle movement of the lever handle of the lockset in locking and unlocking the doorset. During each cycle, the lockset shall fully engage the bolts onto the door frame, with the lever handle completing the full cycle of operation without straining.
- This pattern of 5 Type B cycles followed by 1 Type A cycle is to be repeated 10,000 times.

After completion of 60,000 cycles

- After the test, the doorset shall be checked manually that it is still able to lock in place without causing any strains and all functions of the lockset shall still operate.
- Check that there shall be no damages or evidence of undue wear or loosening of any parts of the doorset including the hardwares installed or other defects that may impair its reliability of functioning and the test leaf shall remain connected to the frame.
- Check that the lockset's spring bolt through the striking plate shall continue to function correctly and be able to return to its normally extended position under its own spring pressure and all functions of the lockset shall still operate.
- Check for visible cracking or breakage of any components on the hinges and check that the doorset is capable of closing properly, maintaining all clearances between leaf to frame and floor as measured before the test.

2 Water-tightness test Water tightness test shall be carried out on the door leaf and frame assembly in their closed position. The enclosure formed by the door leaf and frame assembly in their closed position shall be filled with water to a uniform depth of 25mm of water for a period of 2 hours. There shall be no seepage of water within this period.

3 Production test Dimensional checks in accordance to approved drawings. The door frame can be double rebated to facilitate

		the installation of a fire door.
4	CED/Galvanised Coating Test	<p><u>CED</u></p> <ul style="list-style-type: none"> • ASTM D3359 <ul style="list-style-type: none"> - Rating 5B (no removal of coating). • SS5 : Part F2 <ul style="list-style-type: none"> - The coating shall withstand test load of 2000g. • ASTM 3363 <ul style="list-style-type: none"> - 2H shall be the hardest pencil that does not scratch the film. • SS5 : Part B1 <ul style="list-style-type: none"> - Dry film thickness shall be $20 \pm 5\mu$. • SS5 : Part G1. Test duration = 500 hours <ul style="list-style-type: none"> - The coating may have any quantity of Size 2 blisters but shall have no more than Density 2 Size 3 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 2 according to ISO 4628-3. • SS5 : Part G6. Test duration = 500 hours <ul style="list-style-type: none"> - The coating shall have no more than Density 2 Size 2 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 1 accordingly to ISO 4628-3. <p><u>Electro-galvanised</u></p> <ul style="list-style-type: none"> • ASTM A90 <ul style="list-style-type: none"> - Coating thickness = 3.5 microns minimum.
5	Rubber gasket test	ASTM D1056 (Grade 2A3, 2A4, 2A5, 2B3, 2B4 or 2B5)

8.2.9 Surveillance Window

'Surveillance window", also known as “surveillance cycle”, refers to the period of 12 or 36 months (as stipulated in Table 8.1), starting from the date that a CoC is issued in relation to a regulated shelter product, and every subsequent period of 12 or 36 months or shorter, if the CoC expires, or is terminated or withdrawn. Products may be subjected to post -certification testing and/or inspection, based on the surveillance window.

Figures & Tables

TABLE 8.1 : LIST OF REGULATED SHELTER PRODUCT

PRODUCTS	ACCEPTABLE STANDARDS	CERTIFICATION SCHEME	SURVEILLANCE REGIME	
			TESTING	FACTORY AND SITE INSPECTION
Storey Shelter Door	Refer to Table 8.2	Scheme 5	Once every 3 years for cyclic test.	At least once annually or by trigger (every 200 labels).
		(Label issued)	Annually for water tightness test, dimension check, CED coating test & rubber gasket test.	

TABLE 8.2: TEST STANDARDS AND SPECIFICATIONS FOR STOREY SHELTER DOOR

TABLE 8.2: TEST STANDARDS AND SPECIFICATIONS FOR STOREY SHELTER DOOR		
TYPE TESTS – SCHEME TYPE 5		
S/N	TEST	STANDARD/SPECIFICATION

1	Door locking mechanism cyclic test (Once in 3 years)	<p><u>Test Cycles</u></p> <p>The entire test shall consist of 60,000 cycles, which in turn comprise two cyclic types:</p> <ul style="list-style-type: none"> • Type A : 10,000 in Civil Defence (CD) mode when the lock bolts are activated. • Type B : 50,000 for normal opening and closing of door (based on 90° angle of opening function). <p>(Note: Type A cycles are to be performed interspersed between the Type B cycles in the ratio 1:5, i.e. 1 Type A cycle to be done after every 5 Type B cycles.)</p> <p><u>Test Method and Requirements</u></p> <ul style="list-style-type: none"> • The test is conducted using the test rig designed to be able to support the doorset and holding it rigidly in place, preventing any movement that may occur during the tests. • 5 Type B cycles to be carried out. Each cycle shall consist of the latch of lockset unlatching (with its level handle completing at 90° angle movement), followed by the door leaf opening to 90° angle and then by the closing of the door leaf and finally latching in place. During each cycle, the lockset shall be able to latch fully. • After the 5 Type B cycles, 1 Type A cycle to be performed. The type A cycle is a 90° angle movement of the lever handle of the lockset in locking and unlocking the doorset. During each cycle, the lockset shall fully engage the bolts onto the door frame, with the lever handle completing the full cycle of operation without straining. • This pattern of 5 Type B cycles followed by 1 Type A cycle is to be repeated 10,000 times. <p><u>After completion of 60,000 cycles</u></p> <ul style="list-style-type: none"> • After the test, the doorset shall be checked manually that it is still able to lock in place without causing any strains and all functions of the lockset shall still operate. • Check that there shall be no damages or evidence of undue wear or loosening of any parts of the doorset including the hardwares installed or other defects that may impair its reliability of functioning and the test leaf shall remain connected to the frame. • Check that the lockset's spring bolt through the striking plate shall continue to function correctly and be able to return to its normally extended position under its own spring pressure and all functions of the lockset shall still operate. • Check for visible cracking or breakage of any components on the hinges and check that the doorset is capable of closing properly, maintaining all clearances between leaf to frame and floor as measured before the test.
2	Water-tightness test	<p>Water tightness test shall be carried out on the door leaf and frame assembly in their closed position. The enclosure formed by the door leaf and frame assembly in their closed position shall be filled with water to a uniform depth of 25mm of water for a period of 2 hours. There shall be no seepage of water within this period.</p>
3	CED/Galvanised Coating Test	<p><u>CED</u></p> <ul style="list-style-type: none"> • ASTM D3359 <ul style="list-style-type: none"> - Rating 5B (no removal of coating). • SS5 : Part F2 <ul style="list-style-type: none"> - The coating shall withstand test load of 2000g. • ASTM 3363 <ul style="list-style-type: none"> - 2H shall be the hardest pencil that does not scratch the film. • SS5 : Part B1 <ul style="list-style-type: none"> - Dry film thickness shall be $20 \pm 5\mu$ • SS5 : Part G1. Test duration = 500 hours <ul style="list-style-type: none"> - The coating may have any quantity of Size 2 blisters but shall have no more than Density 2 Size 3 blisters as illustrated in ISO 4628-2.

- Degree of rusting shall not be more than scale Ri 2 according to ISO 4628-3.
- SS5 : Part G6. Test duration = 500 hours
- The coating shall have no more than Density 2 Size 2 blisters as illustrated in ISO 4628-2.
- Degree of rusting shall not be more than scale Ri 1 accordingly to ISO 4628-3.

Electro-galvanised

- ASTM A90
- Coating thickness = 3.5 microns minimum.

4 Rubber gasket test ASTM D1056 (Grade 2A3, 2A4, 2A5, 2B3, 2B4 or 2B5).

SURVEILLANCE TESTS – SCHEME TYPE 5

1 Door locking mechanism cyclic test

Test Cycles

The entire test shall consist of 60,000 cycles, which in turn comprise two cyclic types:

- **Type A** : 10,000 in Civil Defence (CD) mode when the lock bolts are activated.
- **Type B** :: 50,000 for normal opening and closing of door (based on 900 angle of opening function).

(Note: Type A cycles are to be performed interspersed between the Type B cycles in the ratio 1:5, i.e. 1 Type A cycle to be done after every 5 Type B cycles.)

Test Method and Requirements

- The test is conducted using the test rig designed to be able to support the doorset and holding it rigidly in place, preventing any movement that may occur during the tests.
- 5 Type B cycles to be carried out. Each cycle shall consist of the latch of lockset unlatching (with its level handle completing at 900 angle movement), followed by the door leaf opening to 900 angle and then by the closing of the door leaf and finally latching in place. During each cycle, the lockset shall be able to latch fully.
- After the 5 Type B cycles, 1 Type A cycle to be performed. The type A cycle is a 900 angle movement of the lever handle of the lockset in locking and unlocking the doorset. During each cycle, the lockset shall fully engage the bolts onto the door frame, with the lever handle completing the full cycle of operation without straining.
- This pattern of 5 Type B cycles followed by 1 Type A cycle is to be repeated 10,000 times.

After completion of 60,000 cycles

- After the test, the doorset shall be checked manually that it is still able to lock in place without causing any strains and all functions of the lockset shall still operate.
- Check that there shall be no damages or evidence of undue wear or loosening of any parts of the doorset including the hardwares installed or other defects that may impair its reliability of functioning and the test leaf shall remain connected to the frame.
- Check that the lockset's spring bolt through the striking plate shall continue to function correctly and be able to return to its normally extended position under its own spring pressure and all functions of the lockset shall still operate.
- Check for visible cracking or breakage of any components on the hinges and check that the doorset is capable of closing properly, maintaining all clearances between leaf to frame and floor as measured before the test.

2 Water-tightness test Water tightness test shall be carried out on the door leaf and frame assembly in their closed position. The enclosure formed by the door leaf and frame assembly in their closed position shall be filled with water to a uniform depth of 25mm of water for a period of 2 hours. There shall be no seepage of water within this period.

3 Production test Dimensional checks in accordance to approved drawings. The door frame can be double rebated to facilitate the installation of a fire door.

4	CED/Galvanised Coating Test	<p><u>CED</u></p> <ul style="list-style-type: none"> • ASTM D3359 <ul style="list-style-type: none"> - Rating 5B (no removal of coating). • SS5 : Part F2 <ul style="list-style-type: none"> - The coating shall withstand test load of 2000g. • ASTM 3363 <ul style="list-style-type: none"> - 2H shall be the hardest pencil that does not scratch the film. • SS5 : Part B1 <ul style="list-style-type: none"> - Dry film thickness shall be $20 \pm 5\mu$. • SS5 : Part G1. Test duration = 500 hours <ul style="list-style-type: none"> - The coating may have any quantity of Size 2 blisters but shall have no more than Density 2 Size 3 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 2 according to ISO 4628-3. • SS5 : Part G6. Test duration = 500 hours <ul style="list-style-type: none"> - The coating shall have no more than Density 2 Size 2 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 1 accordingly to ISO 4628-3. <p><u>Electro-galvanised</u></p> <ul style="list-style-type: none"> • ASTM A90 <ul style="list-style-type: none"> - Coating thickness = 3.5 microns minimum.
5	Rubber gasket test	ASTM D1056 (Grade 2A3, 2A4, 2A5, 2B3, 2B4 or 2B5)

8.2.10 Suspension of CoC

“Suspension of CoC” refers to the temporary invalidation of a CoC by a CB under circumstances not limited to the following:

- a. Non-compliance to any component of the surveillance regime.
- b. Products are suspected to not meet shelter requirements but are still in the process of being tested/investigated.
- c. CoC holder breaching the CB’s terms and conditions (including non - payment of fees).

8.2.11 Termination of CoC

“Termination of CoC” refers to the cancellation of a CoC, either on the request of the CoC holder before its expiry, or due to reasons not related to shelter requirements. Examples of such circumstances include:

- a. CoC holder ceases to supply the product due to business considerations (e.g. shutting down of business, liquidation).
- b. CoC holder fails to take adequate rectification measures within the given timeframe, despite being suspended for a breach in the CB’s terms and conditions (including non-payment of fees).

8.2.12 Type Testing

“Type testing”, also known as prototype testing, refers to testing of a product according to the test standard(s) and specification(s) for that product for the application of CoC, as specified in Table 8.2.

<p>Figures & Tables</p> <p><u>TABLE 8.2: TEST STANDARDS AND SPECIFICATIONS FOR STOREY SHELTER DOOR</u></p> <p>TABLE 8.2: TEST STANDARDS AND SPECIFICATIONS FOR STOREY SHELTER DOOR</p> <p>TYPE TESTS – SCHEME TYPE 5</p>

S/N	TEST	STANDARD/SPECIFICATION
1	Door locking mechanism cyclic test (Once in 3 years)	<p><u>Test Cycles</u></p> <p>The entire test shall consist of 60,000 cycles, which in turn comprise two cyclic types:</p> <ul style="list-style-type: none"> • Type A : 10,000 in Civil Defence (CD) mode when the lock bolts are activated. • Type B : 50,000 for normal opening and closing of door (based on 900 angle of opening function). <p>(Note: Type A cycles are to be performed interspersed between the Type B cycles in the ratio 1:5, i.e. 1 Type A cycle to be done after every 5 Type B cycles.)</p> <p><u>Test Method and Requirements</u></p> <ul style="list-style-type: none"> • The test is conducted using the test rig designed to be able to support the doorset and holding it rigidly in place, preventing any movement that may occur during the tests. • 5 Type B cycles to be carried out. Each cycle shall consist of the latch of lockset unlatching (with its level handle completing at 900 angle movement), followed by the door leaf opening to 900 angle and then by the closing of the door leaf and finally latching in place. During each cycle, the lockset shall be able to latch fully. • After the 5 Type B cycles, 1 Type A cycle to be performed. The type A cycle is a 900 angle movement of the lever handle of the lockset in locking and unlocking the doorset. During each cycle, the lockset shall fully engage the bolts onto the door frame, with the lever handle completing the full cycle of operation without straining. • This pattern of 5 Type B cycles followed by 1 Type A cycle is to be repeated 10,000 times. <p><u>After completion of 60,000 cycles</u></p> <ul style="list-style-type: none"> • After the test, the doorset shall be checked manually that it is still able to lock in place without causing any strains and all functions of the lockset shall still operate. • Check that there shall be no damages or evidence of undue wear or loosening of any parts of the doorset including the hardwares installed or other defects that may impair its reliability of functioning and the test leaf shall remain connected to the frame. • Check that the lockset's spring bolt through the striking plate shall continue to function correctly and be able to return to its normally extended position under its own spring pressure and all functions of the lockset shall still operate. • Check for visible cracking or breakage of any components on the hinges and check that the doorset is capable of closing properly, maintaining all clearances between leaf to frame and floor as measured before the test.
2	Water-tightness test	<p>Water tightness test shall be carried out on the door leaf and frame assembly in their closed position. The enclosure formed by the door leaf and frame assembly in their closed position shall be filled with water to a uniform depth of 25mm of water for a period of 2 hours. There shall be no seepage of water within this period.</p>
3	CED/Galvanised Coating Test	<p><u>CED</u></p> <ul style="list-style-type: none"> • ASTM D3359 <ul style="list-style-type: none"> - Rating 5B (no removal of coating). • SS5 : Part F2 <ul style="list-style-type: none"> - The coating shall withstand test load of 2000g. • ASTM 3363 <ul style="list-style-type: none"> - 2H shall be the hardest pencil that does not scratch the film. • SS5 : Part B1 <ul style="list-style-type: none"> - Dry film thickness shall be $20 \pm 5\mu$ • SS5 : Part G1. Test duration = 500 hours <ul style="list-style-type: none"> - The coating may have any quantity of Size 2 blisters but shall have no more than Density 2

Size 3 blisters as illustrated in ISO 4628-2.

- Degree of rusting shall not be more than scale Ri 2 according to ISO 4628-3.

- SS5 : Part G6. Test duration = 500 hours

- The coating shall have no more than Density 2 Size 2 blisters as illustrated in ISO 4628-2.

- Degree of rusting shall not be more than scale Ri 1 accordingly to ISO 4628-3.

Electro-galvanised

- ASTM A90

- Coating thickness = 3.5 microns minimum.

4 Rubber gasket test ASTM D1056 (Grade 2A3, 2A4, 2A5, 2B3, 2B4 or 2B5).

SURVEILLANCE TESTS – SCHEME TYPE 5

1 Door locking mechanism
cyclic test **Test Cycles**

The entire test shall consist of 60,000 cycles, which in turn comprise two cyclic types:

- **Type A** : 10,000 in Civil Defence (CD) mode when the lock bolts are activated.
- **Type B** :: 50,000 for normal opening and closing of door (based on 900 angle of opening function).

(Note: Type A cycles are to be performed interspersed between the Type B cycles in the ratio 1:5, i.e. 1 Type A cycle to be done after every 5 Type B cycles.)

Test Method and Requirements

- The test is conducted using the test rig designed to be able to support the doorset and holding it rigidly in place, preventing any movement that may occur during the tests.
- 5 Type B cycles to be carried out. Each cycle shall consist of the latch of lockset unlatching (with its level handle completing at 900 angle movement), followed by the door leaf opening to 900 angle and then by the closing of the door leaf and finally latching in place. During each cycle, the lockset shall be able to latch fully.
- After the 5 Type B cycles, 1 Type A cycle to be performed. The type A cycle is a 900 angle movement of the lever handle of the lockset in locking and unlocking the doorset. During each cycle, the lockset shall fully engage the bolts onto the door frame, with the lever handle completing the full cycle of operation without straining.
- This pattern of 5 Type B cycles followed by 1 Type A cycle is to be repeated 10,000 times.

After completion of 60,000 cycles

- After the test, the doorset shall be checked manually that it is still able to lock in place without causing any strains and all functions of the lockset shall still operate.
- Check that there shall be no damages or evidence of undue wear or loosening of any parts of the doorset including the hardwares installed or other defects that may impair its reliability of functioning and the test leaf shall remain connected to the frame.
- Check that the lockset's spring bolt through the striking plate shall continue to function correctly and be able to return to its normally extended position under its own spring pressure and all functions of the lockset shall still operate.
- Check for visible cracking or breakage of any components on the hinges and check that the doorset is capable of closing properly, maintaining all clearances between leaf to frame and floor as measured before the test.

2 Water-tightness test Water tightness test shall be carried out on the door leaf and frame assembly in their closed position. The enclosure formed by the door leaf and frame assembly in their closed position shall be filled with water to a uniform depth of 25mm of water for a period of 2 hours. There shall be no seepage of water within this period.

3 Production test Dimensional checks in accordance to approved drawings. The door frame can be double rebated to facilitate the installation of a fire door.

4	CED/Galvanised Coating Test	<p><u>CED</u></p> <ul style="list-style-type: none"> • ASTM D3359 <ul style="list-style-type: none"> - Rating 5B (no removal of coating). • SS5 : Part F2 <ul style="list-style-type: none"> - The coating shall withstand test load of 2000g. • ASTM 3363 <ul style="list-style-type: none"> - 2H shall be the hardest pencil that does not scratch the film. • SS5 : Part B1 <ul style="list-style-type: none"> - Dry film thickness shall be $20 \pm 5\mu$. • SS5 : Part G1. Test duration = 500 hours <ul style="list-style-type: none"> - The coating may have any quantity of Size 2 blisters but shall have no more than Density 2 Size 3 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 2 according to ISO 4628-3. • SS5 : Part G6. Test duration = 500 hours <ul style="list-style-type: none"> - The coating shall have no more than Density 2 Size 2 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 1 accordingly to ISO 4628-3. <p><u>Electro-galvanised</u></p> <ul style="list-style-type: none"> • ASTM A90 <ul style="list-style-type: none"> - Coating thickness = 3.5 microns minimum.
5	Rubber gasket test	ASTM D1056 (Grade 2A3, 2A4, 2A5, 2B3, 2B4 or 2B5)

8.2.13 Withdrawal of CoC

“Withdrawal of CoC” refers to the cancellation of a CoC by the CB under circumstances not limited to the following:

- a. Non-compliance with the requirements of the Product Listing Scheme, including:
 - i. Regulated shelter product that is supplied to the industry differs from the prototype described in the CoC and laboratory test report.
 - ii. Misuse of certification mark, logo and certificates.
 - iii. Supply of products from a factory which differs from the factory declared during the CoC application.
- b. Failure to take adequate rectification measures within the given timeframe, despite being suspended for a shelter-related non- compliance./p>
- c. Non-compliance that failure production process to consistently produce products of acceptable quality, including:
 - i. Failure or refusal of test/analysis of the product.
 - ii. The surveillance regime is not completed within the surveillance window.
- d. Other reasons related to shelter requirements.

CLAUSE 8.3 ACCREDITATION AND CERTIFICATION

8.3.1 General

All regulated shelter products shall be certified and have valid CoCs before they can be used on/in buildings as part of shelter works in Singapore (henceforth, for the purpose of this Chapter, “use in Singapore” shall be taken to mean “on/in buildings as part of shelter works in Singapore”).

8.3.2 Age of Test Reports for Regulated Shelter Products

Certification of regulated shelter products under the Product Listing Scheme shall be based on test report(s) that were issued within the specified timeframes, as listed below.

Certification Scheme (with reference to Table 8.1)	Age of Test Reports that can be Considered for Issuance of CoC
Scheme 5	Less than 5 years

8.3.3 Validity of CoC for Regulated Shelter Products

- a. A CoC for regulated shelter products is valid for 5 years from the date of issuance.
- b. A CoC which is terminated, expired or withdrawn shall be considered permanently invalid, whereas a CoC which is suspended shall be considered temporarily invalid until the suspension is lifted.
- c. The status of the CoC will determine whether the regulated shelter products are permitted to be supplied and used in Singapore. Information relating to the CoCs, including the status, can be verified against CBs’ online directories.
 - i. For products with valid CoCs at the date of delivery to the project site, i.e. not suspended, terminated, expired or withdrawn, these are permitted to be used in Singapore.
 - ii. For products with CoCs that are not valid on the date of delivery to the project site, i.e. suspended, terminated, expired or withdrawn, usage of these products in Singapore is prohibited.
 - iii. Notwithstanding (1), for products with CoCs that were valid on the date of delivery, but are subsequently withdrawn, usage of the affected batches of such products in Singapore is subject to further assessment and investigation by SCDF and/or the CBs.
 - iv. Notwithstanding (1), for products with CoCs that were valid on the date of delivery, but are subsequently suspended for shelter - related reasons, e.g. pending investigation, it is not recommended that such products be used, as the investigation may show that the products are non-compliant and cannot be used (e.g. products that have been installed will need to be replaced/removed).
 - v. CBs shall not allow the termination of a CoC which is suspended for shelter-related reasons, or which is under investigation by SCDF.

8.3.4 Accreditation Requirements

- a. Regulated shelter products used in shelter works shall be certified by a local certification body accredited by SAC.
- b. Regulated shelter products shall be accompanied by test reports from testing laboratories accredited by SAC or recognised by SAC via the International Laboratory Accreditation Cooperation (ILAC) MRA.
- c. Any new CB participating in the PLS shall notify SCDF, in writing, of its accreditation by SAC, and submit its Certificate of Accreditation and Schedule issued by SAC for SCDF’s record. SCDF may request for additional information from the CB.

8.3.5 Certification Requirements

a. General Requirements

CoCs issued for products intended for use in Singapore shall bear SAC’s accreditation mark.

b. Information Submitted for New CoC Applications

The following information, at minimum, shall be submitted to a CB for application of a CoC. Where the information/documents are not provided in English, an official English translation, endorsed by a Notary Public, shall also be provided:

- i. CoC applicant details, including:
 - a. Unique Entity Number (UEN) issued by the Accounting and Corporate Regulatory Authority (ACRA), or foreign equivalent, where applicable.

- b. Full names of the company directors, or equivalent .
 - c. Name, address, contact number and email address of the company.
 - d. Where the applicant is a foreign company, the details of the appointed local representative, for parts (1)(a) through (1)(c) shall also be included./p>
 - e. Proof of partnership between the local representative and foreign CoC holder.
- ii. Manufacturer’s details, for all the manufacturing plants of components of the regulated shelter product affecting shelter - related requirements, including:
- a. Country, name, address, contact number and email address of the manufacturer.
- iii. Certification scheme details, including:
- a. Product category as classified under Table 8.1.

Figures & Tables

TABLE 8.1 : LIST OF REGULATED SHELTER PRODUCT

TABLE 8.1 : LIST OF REGULATED SHELTER PRODUCT				
PRODUCTS	ACCEPTABLE STANDARDS	CERTIFICATION SCHEME	SURVEILLANCE REGIME	
			TESTING	FACTORY AND SITE INSPECTION
Storey Shelter Door	Refer to Table 8.2	Scheme 5	Once every 3 years for cyclic test.	At least once annually or by trigger (every 200 labels).
		(Label issued)	Annually for water tightness test, dimension check, CED coating test & rubber gasket test.	

TABLE 8.2: TEST STANDARDS AND SPECIFICATIONS FOR STOREY SHELTER DOOR

TABLE 8.2: TEST STANDARDS AND SPECIFICATIONS FOR STOREY SHELTER DOOR		
TYPE TESTS – SCHEME TYPE 5		
S/N	TEST	STANDARD/SPECIFICATION
1	Door locking mechanism cyclic test (Once in 3 years)	<p><u>Test Cycles</u></p> <p>The entire test shall consist of 60,000 cycles, which in turn comprise two cyclic types:</p> <ul style="list-style-type: none"> • Type A : 10,000 in Civil Defence (CD) mode when the lock bolts are activated. • Type B : 50,000 for normal opening and closing of door (based on 900 angle of opening function). <p>(Note: Type A cycles are to be performed interspersed between the Type B cycles in the ratio 1:5, i.e. 1 Type A cycle to be done after every 5 Type B cycles.)</p> <p><u>Test Method and Requirements</u></p> <ul style="list-style-type: none"> • The test is conducted using the test rig designed to be able to support the doorset and holding it rigidly in place, preventing any movement that may occur during the tests. • 5 Type B cycles to be carried out. Each cycle shall consist of the latch of lockset unlatching (with its level handle completing at 900 angle movement), followed by the door leaf opening to 900 angle and then by the closing of the door leaf and finally latching in place. During each cycle, the lockset shall be able to latch fully. • After the 5 Type B cycles, 1 Type A cycle to be performed. The type A cycle is a 900 angle movement of the lever handle of the lockset in locking and unlocking the doorset. During each cycle, the lockset shall fully engage the bolts onto the door frame, with the lever handle completing the full cycle of operation without straining.

- This pattern of 5 Type B cycles followed by 1 Type A cycle is to be repeated 10,000 times.

After completion of 60,000 cycles

- After the test, the doorset shall be checked manually that it is still able to lock in place without causing any strains and all functions of the lockset shall still operate.
- Check that there shall be no damages or evidence of undue wear or loosening of any parts of the doorset including the hardware installed or other defects that may impair its reliability of functioning and the test leaf shall remain connected to the frame.
- Check that the lockset's spring bolt through the striking plate shall continue to function correctly and be able to return to its normally extended position under its own spring pressure and all functions of the lockset shall still operate.
- Check for visible cracking or breakage of any components on the hinges and check that the doorset is capable of closing properly, maintaining all clearances between leaf to frame and floor as measured before the test.

2	Water-tightness test	Water tightness test shall be carried out on the door leaf and frame assembly in their closed position. The enclosure formed by the door leaf and frame assembly in their closed position shall be filled with water to a uniform depth of 25mm of water for a period of 2 hours. There shall be no seepage of water within this period.
---	----------------------	--

3	CED/Galvanised Coating Test	<p><u>CED</u></p> <ul style="list-style-type: none"> • ASTM D3359 <ul style="list-style-type: none"> - Rating 5B (no removal of coating). • SS5 : Part F2 <ul style="list-style-type: none"> - The coating shall withstand test load of 2000g. • ASTM 3363 <ul style="list-style-type: none"> - 2H shall be the hardest pencil that does not scratch the film. • SS5 : Part B1 <ul style="list-style-type: none"> - Dry film thickness shall be $20 \pm 5\mu$ • SS5 : Part G1. Test duration = 500 hours <ul style="list-style-type: none"> - The coating may have any quantity of Size 2 blisters but shall have no more than Density 2 Size 3 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 2 according to ISO 4628-3. • SS5 : Part G6. Test duration = 500 hours <ul style="list-style-type: none"> - The coating shall have no more than Density 2 Size 2 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 1 accordingly to ISO 4628-3.
---	-----------------------------	---

Electro-galvanised

- ASTM A90
 - Coating thickness = 3.5 microns minimum.

4	Rubber gasket test	ASTM D1056 (Grade 2A3, 2A4, 2A5, 2B3, 2B4 or 2B5).
---	--------------------	--

SURVEILLANCE TESTS – SCHEME TYPE 5

1	Door locking mechanism cyclic test	<u>Test Cycles</u>
---	------------------------------------	--------------------

The entire test shall consist of 60,000 cycles, which in turn comprise two cyclic types:

- **Type A** : 10,000 in Civil Defence (CD) mode when the lock bolts are activated.
- **Type B** :: 50,000 for normal opening and closing of door (based on 90° angle of opening function).

(Note: Type A cycles are to be performed interspersed between the Type B cycles in the ratio 1:5, i.e. 1 Type A cycle to be done after every 5 Type B cycles.)

Test Method and Requirements

- The test is conducted using the test rig designed to be able to support the doorset and holding it rigidly in place, preventing any movement that may occur during the tests.
- 5 Type B cycles to be carried out. Each cycle shall consist of the latch of lockset unlatching (with its level handle completing at 90° angle movement), followed by the door leaf opening to 90° angle and then by the closing of the door leaf and finally latching in place. During each cycle, the lockset shall be able to latch fully.
- After the 5 Type B cycles, 1 Type A cycle to be performed. The type A cycle is a 90° angle movement of the lever handle of the lockset in locking and unlocking the doorset. During each cycle, the lockset shall fully engage the bolts onto the door frame, with the lever handle completing the full cycle of operation without straining.
- This pattern of 5 Type B cycles followed by 1 Type A cycle is to be repeated 10,000 times.

After completion of 60,000 cycles

- After the test, the doorset shall be checked manually that it is still able to lock in place without causing any strains and all functions of the lockset shall still operate.
- Check that there shall be no damages or evidence of undue wear or loosening of any parts of the doorset including the hardware installed or other defects that may impair its reliability of functioning and the test leaf shall remain connected to the frame.
- Check that the lockset's spring bolt through the striking plate shall continue to function correctly and be able to return to its normally extended position under its own spring pressure and all functions of the lockset shall still operate.
- Check for visible cracking or breakage of any components on the hinges and check that the doorset is capable of closing properly, maintaining all clearances between leaf to frame and floor as measured before the test.

2	Water-tightness test	Water tightness test shall be carried out on the door leaf and frame assembly in their closed position. The enclosure formed by the door leaf and frame assembly in their closed position shall be filled with water to a uniform depth of 25mm of water for a period of 2 hours. There shall be no seepage of water within this period.
3	Production test	Dimensional checks in accordance to approved drawings. The door frame can be double rebated to facilitate the installation of a fire door.
4	CED/Galvanised Coating Test	<p><u>CED</u></p> <ul style="list-style-type: none">• ASTM D3359<ul style="list-style-type: none">- Rating 5B (no removal of coating).• SS5 : Part F2<ul style="list-style-type: none">- The coating shall withstand test load of 2000g.• ASTM 3363<ul style="list-style-type: none">- 2H shall be the hardest pencil that does not scratch the film.• SS5 : Part B1<ul style="list-style-type: none">- Dry film thickness shall be $20 \pm 5\mu$.• SS5 : Part G1. Test duration = 500 hours<ul style="list-style-type: none">- The coating may have any quantity of Size 2 blisters but shall have no more than Density 2 Size 3 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 2 according to ISO 4628-3.• SS5 : Part G6. Test duration = 500 hours<ul style="list-style-type: none">- The coating shall have no more than Density 2 Size 2 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 1 accordingly to ISO 4628-3.

Electro-galvanised

		<ul style="list-style-type: none"> • ASTM A90 - Coating thickness = 3.5 microns minimum.
5	Rubber gasket test	ASTM D1056 (Grade 2A3, 2A4, 2A5, 2B3, 2B4 or 2B5)

b. Certification scheme, according to [Clause 8.2.7](#).

iv. Product details, including:

- a. Brand and model, as determined by the manufacturer.
- b. Density and weight, where applicable, measured in kg/m 3 and kg, respectively.
- c. Dimensions, where applicable, measured in mm.
- d. Latest product catalogue stipulating the specifications and user instructions.

v. Details of type tests, including:

- a. The reference number of the test report.
- b. Test standards (including version of the test standard, i.e. year) which the product is tested to.

c. Documents Submitted for New CoC Applications

The following documents shall also be submitted for CoC applications:

- i. Test reports, including the full type test reports and other test(s) required by the CB (e.g. material tests), which shall be:
 - a. In full colour.
 - b. Bear the brand and model of the regulated shelter product.
- ii. For each test report, the credentials of the accredited laboratory which issued the test report, including:
 - a. Documentation that the test laboratory is accredited by SAC or recognised by SAC via ILAC MRA./p>
 - b. The accreditation scope indicating the test laboratory is accredited to perform such a test.

d. Information and Documents Submitted for Renewal of CoC

CoC holders shall submit the information stipulated in [Clause 8.3.5b](#).(1) and (2) and provide the date of issue of the very first CoC that had been issued for the product (i.e. “Original date of issue”). The CB shall make an assessment on whether there is a need to submit information stipulated in [Clause 8.3.5b](#).(3) – (5), as well as documents stipulated in [Clause 8.3.5c](#).(1) and (2). CB may require submission of any further information/documents as it deems fit.

CLAUSE 8.4 SERIAL LABELS

8.4.1 Traceability of Certified Shelter Products

- a. Serial labels affixed to certified shelter products shall be water -proof and tamper-proof, and shall include a Quick Response (QR) code that stores the following information on an online database, which can be read by scanning the QR code:
 - i. CoC holder company name.
 - ii. CoC holder ACRA UEN.
 - iii. CoC reference number
 - iv. Brief product description.
 - v. Exact location, including unit number, where applicable, where the regulated shelter product is installed.
 - vi. The status of the label (“valid” or “void”).

Note: The status of the label will be ‘void’ if SCDF detects discrepancies relating to the use of serial labels and digitally voided the serial label.

- b. The following information shall be printed on the label itself:
 - i. Product category.
 - ii. Unique serial number.
 - iii. CB's logo or CB's certification mark.

8.4.2 Replacement of Serial Labels

- a. The following information shall be printed on the label itself:
- b. An investigation by the CB shall also be conducted on the nature of the damage and/or loss, with the findings reported to SCDF for accountability.

Exemption: If labels are returned to the CB with the serial numbers still legible, a police report is not required.

CLAUSE 8.5 REQUIREMENTS AND RESPONSIBILITIES FOR QUALIFIED PERSONS

Where shelter works involve the use of regulated shelter products, Qualified Persons shall carry out inspections of the shelter products, including but not limited to, the following:

- a. Verify that the regulated shelter product(s) have valid CoC(s) and that the CoC(s) match exactly with the products used.
- b. Verify that the regulated shelter product(s) are affixed with serial labels, if said products are stipulated to have labels in Table 8.1.

Figures & Tables

TABLE 8.1 : LIST OF REGULATED SHELTER PRODUCT

TABLE 8.1 : LIST OF REGULATED SHELTER PRODUCT				
PRODUCTS	ACCEPTABLE STANDARDS	CERTIFICATION SCHEME	SURVEILLANCE REGIME	
			TESTING	FACTORY AND SITE INSPECTION
Storey Shelter Door	Refer to Table 8.2	Scheme 5	Once every 3 years for cyclic test.	At least once annually or by trigger (every 200 labels).
		(Label issued)	Annually for water tightness test, dimension check, CED coating test & rubber gasket test.	

TABLE 8.2: TEST STANDARDS AND SPECIFICATIONS FOR STOREY SHELTER DOOR

TABLE 8.2: TEST STANDARDS AND SPECIFICATIONS FOR STOREY SHELTER DOOR		
TYPE TESTS – SCHEME TYPE 5		
S/N	TEST	STANDARD/SPECIFICATION
1	Door locking mechanism cyclic test (Once in 3 years)	<p><u>Test Cycles</u></p> <p>The entire test shall consist of 60,000 cycles, which in turn comprise two cyclic types:</p> <ul style="list-style-type: none"> • Type A : 10,000 in Civil Defence (CD) mode when the lock bolts are activated. • Type B : 50,000 for normal opening and closing of door (based on 900 angle of opening function). <p>(Note: Type A cycles are to be performed interspersed between the Type B cycles in the ratio 1:5, i.e. 1 Type A cycle to be done after every 5 Type B cycles.)</p> <p><u>Test Method and Requirements</u></p> <ul style="list-style-type: none"> • The test is conducted using the test rig designed to be able to support the doorset and holding it rigidly in place, preventing any movement that may occur during the tests. • 5 Type B cycles to be carried out. Each cycle shall consist of the latch of lockset unlatching (with its level handle completing at 900 angle movement), followed by the door leaf opening to 900 angle and then by the closing of the door leaf and finally latching in place. During each cycle, the lockset shall be able to latch fully. • After the 5 Type B cycles, 1 Type A cycle to be performed. The type A cycle is a 900 angle movement of the lever handle of the lockset in locking and unlocking the doorset. During each cycle, the lockset shall fully engage the bolts onto the door frame, with the lever handle completing the full cycle of operation without straining. • This pattern of 5 Type B cycles followed by 1 Type A cycle is to be repeated 10,000 times. <p><u>After completion of 60,000 cycles</u></p> <ul style="list-style-type: none"> • After the test, the doorset shall be checked manually that it is still able to lock in place without causing any strains and all functions of the lockset shall still operate.

		<ul style="list-style-type: none"> • Check that there shall be no damages or evidence of undue wear or loosening of any parts of the doorset including the hardwares installed or other defects that may impair its reliability of functioning and the test leaf shall remain connected to the frame. • Check that the lockset's spring bolt through the striking plate shall continue to function correctly and be able to return to its normally extended position under its own spring pressure and all functions of the lockset shall still operate. • Check for visible cracking or breakage of any components on the hinges and check that the doorset is capable of closing properly, maintaining all clearances between leaf to frame and floor as measured before the test.
2	Water-tightness test	Water tightness test shall be carried out on the door leaf and frame assembly in their closed position. The enclosure formed by the door leaf and frame assembly in their closed position shall be filled with water to a uniform depth of 25mm of water for a period of 2 hours. There shall be no seepage of water within this period.
3	CED/Galvanised Coating Test	<p><u>CED</u></p> <ul style="list-style-type: none"> • ASTM D3359 <ul style="list-style-type: none"> - Rating 5B (no removal of coating). • SS5 : Part F2 <ul style="list-style-type: none"> - The coating shall withstand test load of 2000g. • ASTM 3363 <ul style="list-style-type: none"> - 2H shall be the hardest pencil that does not scratch the film. • SS5 : Part B1 <ul style="list-style-type: none"> - Dry film thickness shall be $20 \pm 5\mu$ • SS5 : Part G1. Test duration = 500 hours <ul style="list-style-type: none"> - The coating may have any quantity of Size 2 blisters but shall have no more than Density 2 Size 3 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 2 according to ISO 4628-3. • SS5 : Part G6. Test duration = 500 hours <ul style="list-style-type: none"> - The coating shall have no more than Density 2 Size 2 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 1 accordingly to ISO 4628-3. <p><u>Electro-galvanised</u></p> <ul style="list-style-type: none"> • ASTM A90 <ul style="list-style-type: none"> - Coating thickness = 3.5 microns minimum.
4	Rubber gasket test	ASTM D1056 (Grade 2A3, 2A4, 2A5, 2B3, 2B4 or 2B5).

SURVEILLANCE TESTS – SCHEME TYPE 5

1	Door locking mechanism cyclic test	<p><u>Test Cycles</u></p> <p>The entire test shall consist of 60,000 cycles, which in turn comprise two cyclic types:</p> <ul style="list-style-type: none"> • Type A : 10,000 in Civil Defence (CD) mode when the lock bolts are activated. • Type B :: 50,000 for normal opening and closing of door (based on 90° angle of opening function). <p>(Note: Type A cycles are to be performed interspersed between the Type B cycles in the ratio 1:5, i.e. 1 Type A cycle to be done after every 5 Type B cycles.)</p> <p><u>Test Method and Requirements</u></p> <ul style="list-style-type: none"> • The test is conducted using the test rig designed to be able to support the doorset and holding it rigidly in place, preventing any movement that may occur during the tests. • 5 Type B cycles to be carried out. Each cycle shall consist of the latch of lockset unlatching (with its
---	------------------------------------	---

level handle completing at 90° angle movement), followed by the door leaf opening to 90° angle and then by the closing of the door leaf and finally latching in place. During each cycle, the lockset shall be able to latch fully.

- After the 5 Type B cycles, 1 Type A cycle to be performed. The type A cycle is a 90° angle movement of the lever handle of the lockset in locking and unlocking the doorset. During each cycle, the lockset shall fully engage the bolts onto the door frame, with the lever handle completing the full cycle of operation without straining.
- This pattern of 5 Type B cycles followed by 1 Type A cycle is to be repeated 10,000 times.

After completion of 60,000 cycles

- After the test, the doorset shall be checked manually that it is still able to lock in place without causing any strains and all functions of the lockset shall still operate.
- Check that there shall be no damages or evidence of undue wear or loosening of any parts of the doorset including the hardware installed or other defects that may impair its reliability of functioning and the test leaf shall remain connected to the frame.
- Check that the lockset's spring bolt through the striking plate shall continue to function correctly and be able to return to its normally extended position under its own spring pressure and all functions of the lockset shall still operate.
- Check for visible cracking or breakage of any components on the hinges and check that the doorset is capable of closing properly, maintaining all clearances between leaf to frame and floor as measured before the test.

2	Water-tightness test	Water tightness test shall be carried out on the door leaf and frame assembly in their closed position. The enclosure formed by the door leaf and frame assembly in their closed position shall be filled with water to a uniform depth of 25mm of water for a period of 2 hours. There shall be no seepage of water within this period.
3	Production test	Dimensional checks in accordance to approved drawings. The door frame can be double rebated to facilitate the installation of a fire door.
4	CED/Galvanised Coating Test	<p><u>CED</u></p> <ul style="list-style-type: none"> • ASTM D3359 <ul style="list-style-type: none"> - Rating 5B (no removal of coating). • SS5 : Part F2 <ul style="list-style-type: none"> - The coating shall withstand test load of 2000g. • ASTM 3363 <ul style="list-style-type: none"> - 2H shall be the hardest pencil that does not scratch the film. • SS5 : Part B1 <ul style="list-style-type: none"> - Dry film thickness shall be $20 \pm 5\mu$. • SS5 : Part G1. Test duration = 500 hours <ul style="list-style-type: none"> - The coating may have any quantity of Size 2 blisters but shall have no more than Density 2 Size 3 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 2 according to ISO 4628-3. • SS5 : Part G6. Test duration = 500 hours <ul style="list-style-type: none"> - The coating shall have no more than Density 2 Size 2 blisters as illustrated in ISO 4628-2. - Degree of rusting shall not be more than scale Ri 1 accordingly to ISO 4628-3.

Electro-galvanised

- ASTM A90
 - Coating thickness = 3.5 microns minimum.

5	Rubber gasket test	ASTM D1056 (Grade 2A3, 2A4, 2A5, 2B3, 2B4 or 2B5)
---	--------------------	---

c. Where there are serial labels, verify that the serial label affixed on the product, are accurate and match exactly with the product.

Amendment History - Chapter 8 - Regulated Shelter Products

Clause No.	Amendment Date	Effective Date	Clause Status	Clause Before Amendment	Circular Date
------------	----------------	----------------	---------------	-------------------------	---------------